

© 2025 NC SOLAR NOW EXPRESSLY RESERVES ITS COMMON LAW COPYRIGHT AND OTHER PROPERTY RIGHTS IN THESE PLANS. THESE PLANS ARE NOT TO BE REPRODUCED, CHANGED OR COPIED IN ANY FORM OR MANNER WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESSED WRITTEN PERMISSION AND CONSENT OF NC SOLAR NOW.



PV MATERIAL SUMMARY: DISTRIBUTOR	
REC460AA PURE-RX	27
MCI-2	14
Tesla PW3 1707000-xx-y	1
Tesla GW3 1841000-01-y	1
XR-10-184B	20
XR10-BOSS-01-M1	16
UFO-CL-01-B1	42
UFO-END-01-B1	24
XR-LUG-03-A1	6
4 IN QB2	58
GC66803 Geocel Sealant	4
SOLADECK 0799-5B	2

NOTICE TO CONTRACTOR

All construction must comply with current NC Building Codes and is subject to field inspection and verification.

APPROVED

Limited building only review
Permit holder responsible for full compliance with the code

05/12/2025







CLIENT INFO

THOMAS W NICTER
36 APPLECROSS COURT
SANFORD, NC 27332

PROJECT INFO

DC INPUT: 12.420 kW
AC OUTPUT: 11.500 kW
DOI INSPT. METHOD: OPTION 2

Model Energy

300 Fayetteville St.
#1430
Raleigh, NC 27602
919-274-9905
ModelEnergy.com

P-1194



CODE REFERENCES

NATIONAL ELECTRICAL CODE v. 2017
NC FIRE PROTECTION CODE v. 2018
NC BUILDING CODE v. 2018
NC RESIDENTIAL CODE v. 2018
ACSE v. 7-10

SITE CONDITIONS

WIND SPEED: 120 MPH
RISK CATEGORY: II
EXPOSURE: B
SNOW: 10 PSF

SHEET INDEX

PV-1: COVER SHEET
PV-2: PV STRUCTURAL
PV-3: PV ELECTRICAL
PV-4: PV EQUIPMENT LABELS
PV-5: PV INSTALL GUIDE







VERSIONS

FOR:	DESIGNER	DATE
CONSTRUCTION	CRM	4/29/2025


PV SYSTEM COVER PAGE

PV-1.1

© 2025 NC SOLAR NOW EXPRESSLY RESERVES ITS COMMON LAW COPYRIGHT AND OTHER PROPERTY RIGHTS IN THESE PLANS. THESE PLANS ARE NOT TO BE REPRODUCED, CHANGED OR COPIED IN ANY FORM OR MANNER WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESSED WRITTEN PERMISSION AND CONSENT OF NC SOLAR NOW.

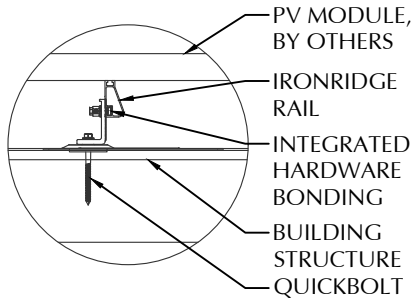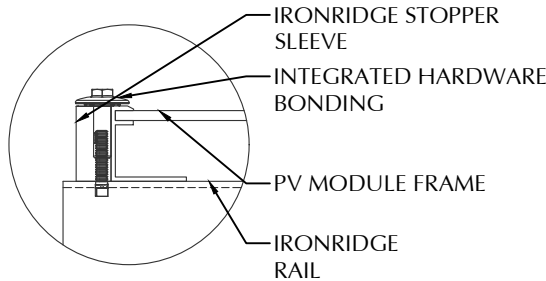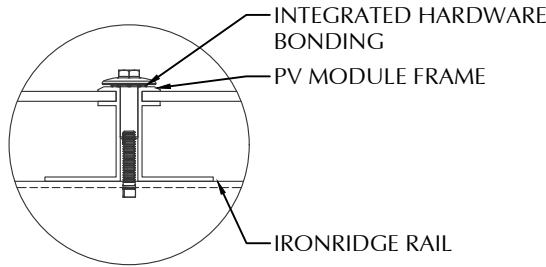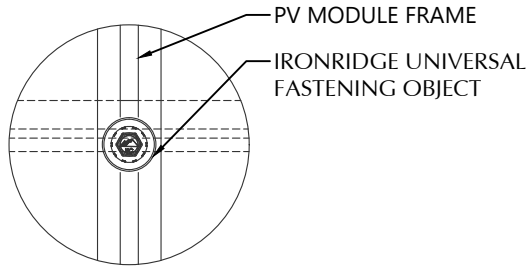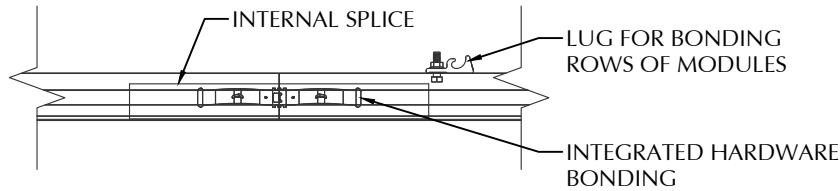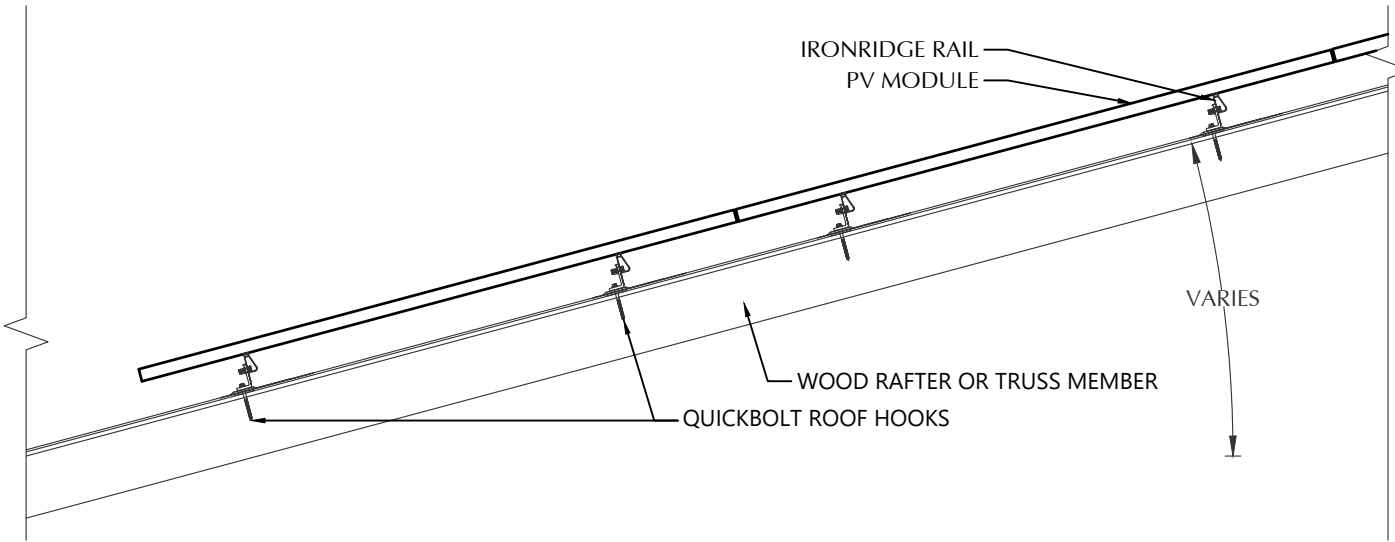

1 ROOF FASTENER DETAIL
NOT TO SCALE

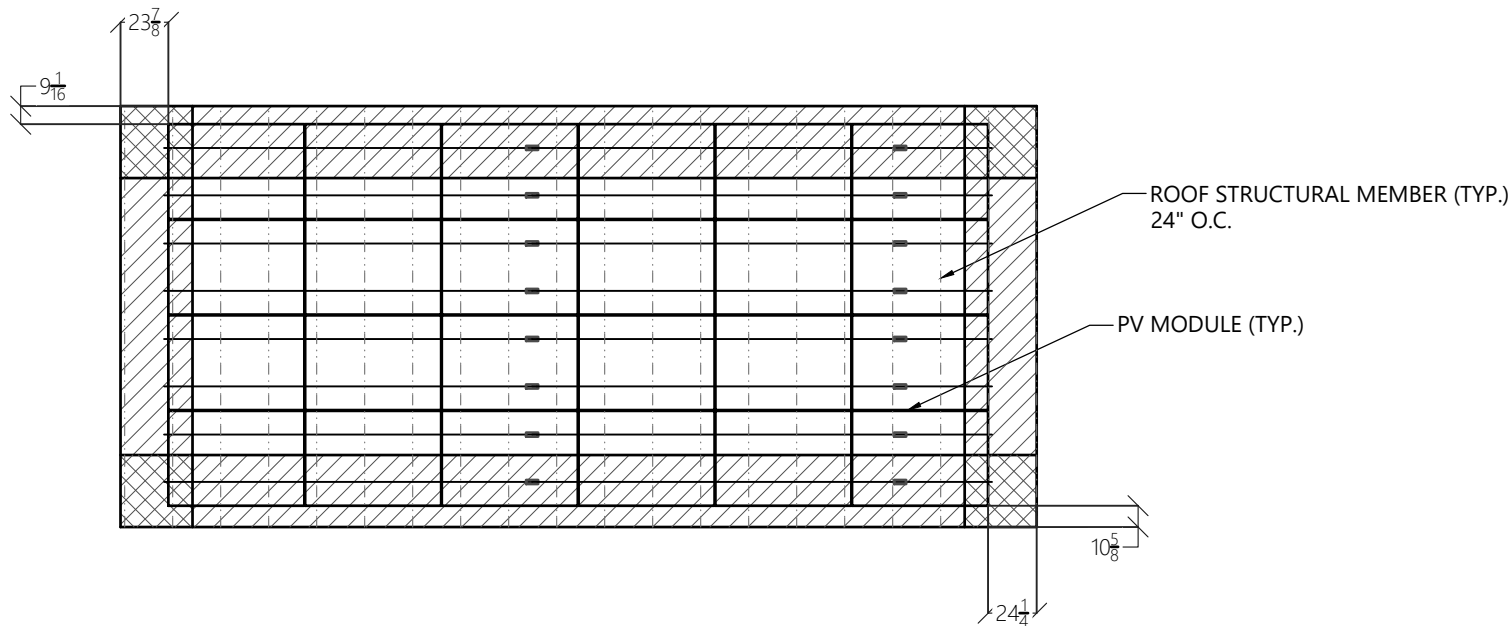

2 ROOF A ARRAY LAYOUT
1/8" = 1'-0"

STATEMENT OF STRUCTURAL COMPLIANCE

THE EXISTING ROOF STRUCTURE HAS BEEN DESIGNED TO SUPPORT THE ADDITIONAL LOADS OF THE PROPOSED PV SYSTEM. IN ADDITION, THE RACKING AND FASTENING SYSTEM SHALL BE CAPABLE OF SECURING THE SYSTEM TO THE STRUCTURE UNDER DESIGN CONDITIONS WHEN INSTALLED PROPERLY AND IN ACCORDANCE WITH THE RACKING AND FASTENING ARRANGEMENT DETAILED WITHIN THESE DRAWINGS.

NAME: ANDREW W. KING, PE

SIGNED:

PV MODULES

MAKE	REC
MODEL	REC460AA PURE-RX
WIDTH	47.40 IN
LENGTH	68.00 IN
THICKNESS	30 MM
WEIGHT	50.00 LBS.
ARRAY AREA	537 SQFT.
ARRAY WEIGHT	1343 LBS.

ROOF SUMMARY

STRUCTURE:	
TYPE	TRUSSES
MATERIAL	SOUTHERN PINE #2
SIZE	2 X 4
SPACING	24 IN O.C.
ALLOWABLE SPAN	88 IN
PITCH	8/12
DENSITY	30 LBS./CU.FT.
DECKING:	
TYPE	OSB
MATERIAL	COMPOSITE
THICKNESS	7/16 IN
WEIGHT	1.60 LBS/SQFT
ROOFING:	
TYPE	ASPHALT SHINGLE
MATERIAL	ASPHALT
WEIGHT	2.30 LBS/SQFT.

ROOF MOUNT SUMMARY

MAXIMUM (IN)	MOUNT SPACING	RAIL OVERHANG
WIND ZONE 1	72 IN	24 IN
WIND ZONE 2	48 IN	24 IN
WIND ZONE 3	48 IN	24 IN

ROOF LOADING

GROUND SNOW LOAD:	15 LBS./SQFT.
LIVE LOAD	20 LBS./SQFT.
DEAD LOAD	
ROOFING	3.9 LBS/SQFT.
PV ARRAY	2.5 LBS./SQFT.
TOTAL	6.4 LBS./SQFT.
WIND LOAD:	
UPLIFT ZONE 1	-24.6 LBS./SQFT.
UPLIFT ZONE 2	-29.0 LBS./SQFT.
UPLIFT ZONE 3	-29.0 LBS./SQFT.
DOWNWARD	23.0 LBS./SQFT.
FASTENER LOAD:	
UPLIFT ZONE 1	-290 LBS.
UPLIFT ZONE 2	-228 LBS.
UPLIFT ZONE 3	-228 LBS.
DOWNWARD	271 LBS.

ROOF MOUNT & FASTENER

ROOF MOUNT:	
MAKE	QUICKBOLT
MODEL	4 IN QB2
MATERIAL	STAINLESS / EPDM
FASTENER:	
MAKE	QUICK SCREWS
MODEL	HEX LAG BOLT
MATERIAL	304 SS
SIZE	5/16" X 4" (1/2" HEX)
GENERAL:	
WEIGHT	0.65 LBS.
FASTENERS PER MOUNT	1
MAX. PULL-OUT FORCE	960.0 LBS.
SAFETY FACTOR	2
DESIGN PULL-OUT FORCE	480.0 LBS.

MOUNTING RAILS

MAKE	IRONRIDGE
MODEL	XR10
MATERIAL	ALUMINUM
WEIGHT	0.425 LBS/IN
SPACING	24 IN



CLIENT INFO

THOMAS W NICHTER
36 APPLECROSS COURT
SANFORD, NC 27332

PROJECT INFO

DC INPUT: 12.420 kW
AC OUTPUT: 11.500 kW
DOI INSPT. METHOD: OPTION 2

Model Energy

300 Fayetteville St.
#1430
Raleigh, NC 27602
919-274-9905
ModelEnergy.com

P-1194



CODE REFERENCES

NATIONAL ELECTRICAL CODE v. 2017
NC FIRE PROTECTION CODE v. 2018
NC BUILDING CODE v. 2018
NC RESIDENTIAL CODE v. 2018
ACSE v. 7-10

SITE CONDITIONS

WIND SPEED: 120 MPH
RISK CATEGORY: II
EXPOSURE: B
SNOW: 10 PSF

SHEET INDEX

PV-1: COVER SHEET
PV-2: PV STRUCTURAL
PV-3: PV ELECTRICAL
PV-4: PV EQUIPMENT LABELS
PV-5: PV INSTALL GUIDE







VERSIONS

FOR:	DESIGNER	DATE
CONSTRUCTION	CRM	4/29/2025


PV SYSTEM STRUCTURAL

PV-2.1

© 2025 NC SOLAR NOW EXPRESSLY RESERVES ITS COMMON LAW COPYRIGHT AND OTHER PROPERTY RIGHTS IN THESE PLANS. THESE PLANS ARE NOT TO BE REPRODUCED, CHANGED OR COPIED IN ANY FORM OR MANNER WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESSED WRITTEN PERMISSION AND CONSENT OF NC SOLAR NOW.

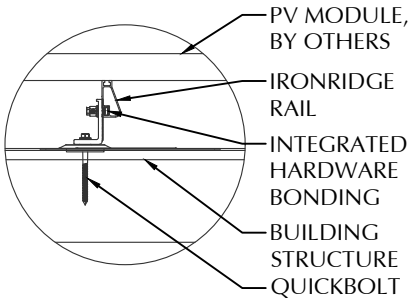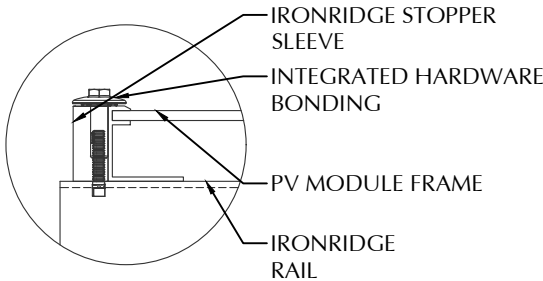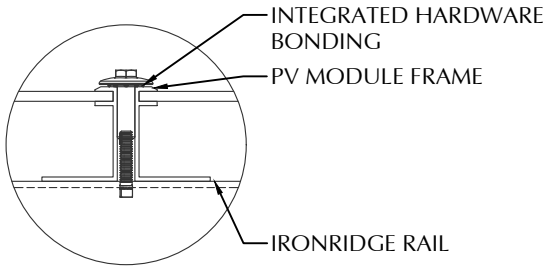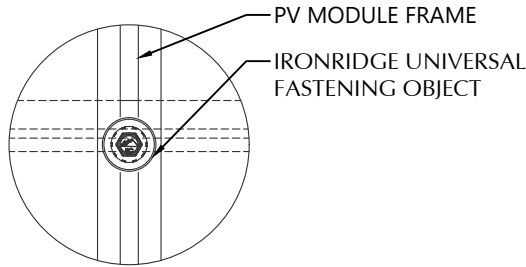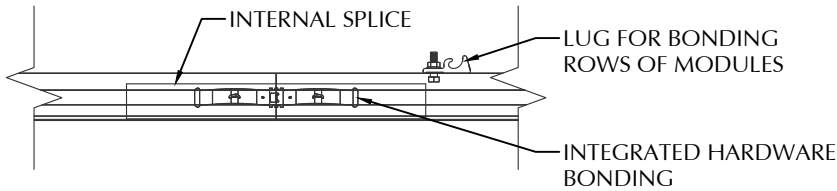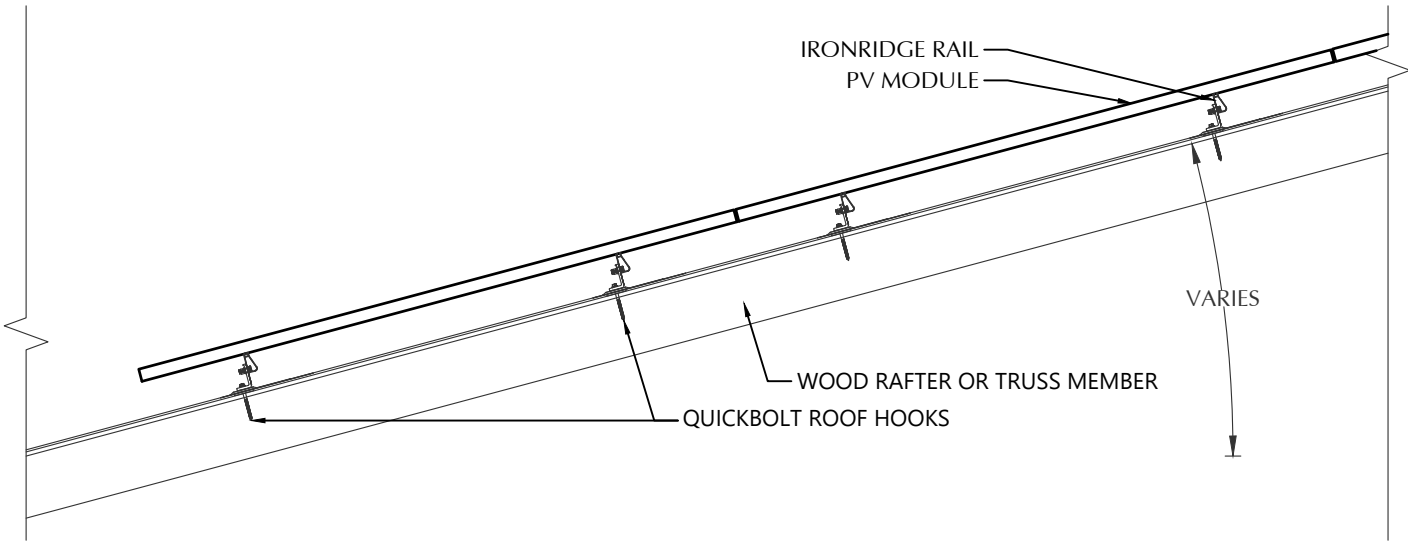

1 ROOF FASTENER DETAIL
NOT TO SCALE

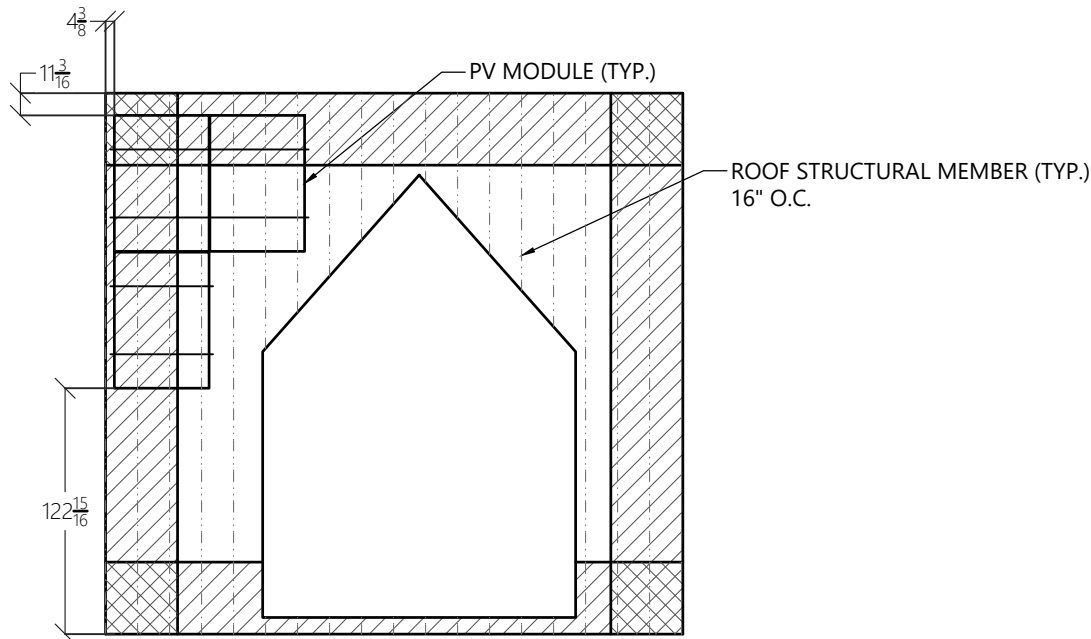

2 ROOF B ARRAY LAYOUT
1/8" = 1'-0"

STATEMENT OF STRUCTURAL COMPLIANCE

THE EXISTING ROOF STRUCTURE HAS BEEN DESIGNED TO SUPPORT THE ADDITIONAL LOADS OF THE PROPOSED PV SYSTEM. IN ADDITION, THE RACKING AND FASTENING SYSTEM SHALL BE CAPABLE OF SECURING THE SYSTEM TO THE STRUCTURE UNDER DESIGN CONDITIONS WHEN INSTALLED PROPERLY AND IN ACCORDANCE WITH THE RACKING AND FASTENING ARRANGEMENT DETAILED WITHIN THESE DRAWINGS.

NAME: ANDREW W. KING, PE

SIGNED:

PV MODULES

MAKE	REC
MODEL	REC460AA PURE-RX
WIDTH	47.40 IN
LENGTH	68.00 IN
THICKNESS	30 MM
WEIGHT	50.00 LBS.
ARRAY AREA	67 SQFT.
ARRAY WEIGHT	168 LBS.

ROOF SUMMARY

STRUCTURE:	
TYPE	RAFTERS
MATERIAL	SOUTHERN PINE #2
SIZE	2 X 8
SPACING	16 IN O.C.
EFFECTIVE SPAN	105 IN
PITCH	8/12
DENSITY	30 LBS./CU.FT.
DECKING:	
TYPE	OSB
MATERIAL	COMPOSITE
THICKNESS	7/16 IN
WEIGHT	1.60 LBS/SQFT
ROOFING:	
TYPE	ASPHALT SHINGLE
MATERIAL	ASPHALT
WEIGHT	2.30 LBS/SQFT.

ROOF MOUNT SUMMARY

MAXIMUM (IN)	MOUNT SPACING	RAIL OVERHANG
WIND ZONE 1	64 IN	16 IN
WIND ZONE 2	64 IN	16 IN
WIND ZONE 3	48 IN	16 IN

ROOF LOADING

GROUND SNOW LOAD:	15 LBS./SQFT.
LIVE LOAD	20 LBS./SQFT.
DEAD LOAD	
ROOFING	3.9 LBS/SQFT.
PV ARRAY	2.5 LBS./SQFT.
TOTAL	6.4 LBS./SQFT.
WIND LOAD:	
UPLIFT ZONE 1	-24.6 LBS./SQFT.
UPLIFT ZONE 2	-29.0 LBS./SQFT.
UPLIFT ZONE 3	-29.0 LBS./SQFT.
DOWNWARD	23.0 LBS./SQFT.
FASTENER LOAD:	
UPLIFT ZONE 1	-370 LBS.
UPLIFT ZONE 2	-436 LBS.
UPLIFT ZONE 3	-327 LBS.
DOWNWARD	346 LBS.

ROOF MOUNT & FASTENER

ROOF MOUNT:	
MAKE	QUICKBOLT
MODEL	4 IN QB2
MATERIAL	STAINLESS / EPDM
FASTENER:	
MAKE	QUICK SCREWS
MODEL	HEX LAG BOLT
MATERIAL	304 SS
SIZE	5/16" X 4" (1/2" HEX)
GENERAL:	
WEIGHT	0.65 LBS.
FASTENERS PER MOUNT	1
MAX. PULL-OUT FORCE	960.0 LBS.
SAFETY FACTOR	2
DESIGN PULL-OUT FORCE	480.0 LBS.

MOUNTING RAILS

MAKE	IRONRIDGE
MODEL	XR10
MATERIAL	ALUMINUM
WEIGHT	0.425 LBS/IN
SPACING	34 IN



CLIENT INFO

THOMAS W NICHTER
36 APPLECROSS COURT
SANFORD, NC 27332

PROJECT INFO

DC INPUT: 12.420 kW
AC OUTPUT: 11.500 kW
DOI INSPT. METHOD: OPTION 2

Model Energy

300 Fayetteville St.
#1430
Raleigh, NC 27602
919-274-9905
ModelEnergy.com

P-1194



CODE REFERENCES

NATIONAL ELECTRICAL CODE v. 2017
NC FIRE PROTECTION CODE v. 2018
NC BUILDING CODE v. 2018
NC RESIDENTIAL CODE v. 2018
ACSE v. 7-10

SITE CONDITIONS

WIND SPEED: 120 MPH
RISK CATEGORY: II
EXPOSURE: B
SNOW: 10 PSF

SHEET INDEX

PV-1: COVER SHEET
PV-2: PV STRUCTURAL
PV-3: PV ELECTRICAL
PV-4: PV EQUIPMENT LABELS
PV-5: PV INSTALL GUIDE

VERSIONS

FOR:	DESIGNER	DATE
CONSTRUCTION	CRM	4/29/2025

PV SYSTEM STRUCTURAL

PV-2.2

© 2025 NC SOLAR NOW EXPRESSLY RESERVES ITS COMMON LAW COPYRIGHT AND OTHER PROPERTY RIGHTS IN THESE PLANS. THESE PLANS ARE NOT TO BE REPRODUCED, CHANGED OR COPIED IN ANY FORM OR MANNER WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESSED WRITTEN PERMISSION AND CONSENT OF NC SOLAR NOW.

CONDUCTOR SCHEDULE

TAG	CURRENT CARRYING CONDUCTORS			GROUNDING CONDUCTORS			CONDUIT/RACEWAY			NOTES
	QTY.	SIZE	INSULATION	QTY.	SIZE	INSULATION	QTY.	SIZE	LOCATION	
C1	10	10 AWG	PV WIRE	1	6 AWG	BARE	-	-	FREE AIR	1
C2	10	10 AWG	THWN-2	1	10 AWG	THWN-2	2	3/4"	EXT/INT	2,4
C3	3	6 AWG	THWN-2	1	10 AWG	THWN-2	1	1"	EXTERIOR	2,4
C4	3	4/0 AWG ALUMINUM	XHHW	1	6 AWG	THWN-2	1	2"	EXTERIOR	2,4
C5	3	4/0 AWG ALUMINUM	XHHW	-	-	-	1	2"	EXTERIOR	2,4
XC	-	-	-	-	-	-	-	-	-	3

NOTES:

- MANUFACTURER PROVIDED, UL LISTED WIRING HARNESS FOR USE ON EXPOSED ROOFS
- CONDUIT SIZE SHOWN IS CODE MINIMUM. LARGER SIZES ARE ALLOWED.
- EXISTING CONDUCTORS, FIELD VERIFY
- EQUIPMENT TERMINAL RATING SHALL BE A MINIMUM OF 75°C AT BOTH END OF CONDUCTOR

ENERGY MANAGEMENT

MAKE	TESLA
MODEL	BACKUP GATEWAY 3
ENCL. RATING	NEMA 3R
VOLT. RATING	240 VOLTS
DISCONNECT CURR.	200 AMPS
UL LIST. (Y/N)	YES
MAIN BREAKER (Y/N)	YES
MAIN BREAKER RATING	200 AMPS

- TROUGH MAY BE USED IF NECESSARY
- INSTALL 200A MAIN BREAKER THAT WILL SERVE AS THE NEW SERVICE DISCONNECT SWITCH
- LAND POWERWALL 3 VIA 60A BREAKER ON INTERNAL PANELBOARD
- INSTALL BONDING JUMPER FROM NEUTRAL TO GROUND
- FEED BACKED-UP LOADS PANEL VIA BACKUP LUGS

PV MODULE

MAKE	REC
MODEL	REC460AA PURE-RX
NOM. POWER (PNOM)	460 WATTS
NOM. VOLT. (VMPP)	54.9 VOLTS
O.C. VOLT (VOC)	65.8 VOLTS
MAX. SYS. VOLT.	1000 VOLTS
NOM. CURR. (IMPP)	8.4 AMPS
S.C. CURR. (ISC)	8.9 AMPS
TEMP. COEF. (PMPP)	-0.24 %/C
TEMP. COEF. (Voc)	-0.24 %/C
MAX SERIES FUSE	25 AMPS
UL COMPLIANT (Y/N)	YES

MAX. DC VOLTAGE CALCULATION

$V_{oc}MAX = V_{oc} * (1 + (TMIN - TSTC) * (VTC / 100))$	
$V_{oc}MAX$	71.42
MAX STRING VOLTAGE	428.5

MAX. DC CURRENT CALCULATION

$I_{sc}MAX = I_{sc} * TCX$	
$I_{sc}MAX$ (AMPS)	11.10

UTILITY METER

MAKE	SIEMENS
MODEL	OUTD-LAN UAT417-XGF
ENCL. RATING	NEMA 3R
VOLT. RATING	240 VOLTS
BUS RATING	200 AMPS
UL LIST. (Y/N)	YES

- REMOVE EXISTING METER COMBO PANEL AND REPLACE WITH METER BASE THAT FEEDS ENERGY MANAGEMENT
- RELOCATE ALL BREAKERS FROM METER COMBO TO NEW BACKED-UP LOADS PANEL

MID-CIRCUIT INTERRUPTER

MAKE	TESLA
MODEL	MCI-2
ENCL. RATING	NEMA 4X / IP65
DC INPUT:	
CONNECTOR TYPE	MC4
MAX IN-LINE PV MODULES	3
MAX MCI PER STRING	5
MAX. SYSTEM VOLTAGE	1000 VOLTS
NOM. CURRENT (Imp)	13.00 AMPS
MAX. CURRENT (Isc)	17.00 AMPS
RSD COMPLIANT (Y/N)	YES
UL COMPLIANT (Y/N)	YES

JUNCTION BOX

MAKE	SOLADECK
PROTECT. RATING	NEMA TYPE 3R
UL LIST. (Y/N)	YES

BACKED-UP LOADS PANEL

MAKE	GENERIC
MODEL	NA
ENCL. RATING	NEMA TYPE 1
VOLT. RATING	240
BUS RATING	200 AMPS
UL LIST. (Y/N)	YES
MAIN BREAKER (Y/N)	YES
MAIN BREAKER RATING	200 AMPS


DC/AC INVERTER & BATTERY

MAKE	TESLA POWERWALL 3
MODEL	1707000-XX-Y
DC INPUT:	
MAX POWER	20000 WATTS
INPUT VOLT. RANGE	60-550 VOLTS
MPPT VOLT. RANGE	60-480 VOLTS
MAX. CURR. (Imp / Isc)	13 / 15 AMPS
STRING INPUTS	6 MPPTs
AC OUTPUT:	
MAX. CONT. POWER	11500 WATTS
NOM. VOLT.	120 / 240 VOLTS
MAX. CONT. CURRENT	48.00 AMPS
RAPID SHUTDOWN (Y/N)	YES
PROTECT. RATING	NEMA TYPE 3R
BATTERY INFO:	
USABLE ENERGY	13.5 kWh
NOM. VOLT.	240 VOLTS
MAX. CONT. CHARGE	5000 WATTS
MAX. CONT. DISCHARGE	11500 WATTS
UL LIST. (Y/N)	YES

AC DISCONNECT

MAKE	GENERIC
MODEL	NA
ENCL. RATING	NEMA 3R
VOLT. RATING	240 VOLTS
AMP RATING	60 AMPS
UL LIST. (Y/N)	YES
FUSED (Y/N)	NO
FUSE RATING	N/A

- LOAD-BREAK RATED
- VISIBLE OPEN
- LOCKABLE IN OPEN POSITION
- INSTALL ADJACENT TO METER
- DISCONNECT TO BE READILY ACCESSIBLE TO UTILITY COMPANY PERSONNEL AT ALL TIMES
- DISCONNECT MARKED AND RATED PER NEC SECTION 690.13 AND 705.10

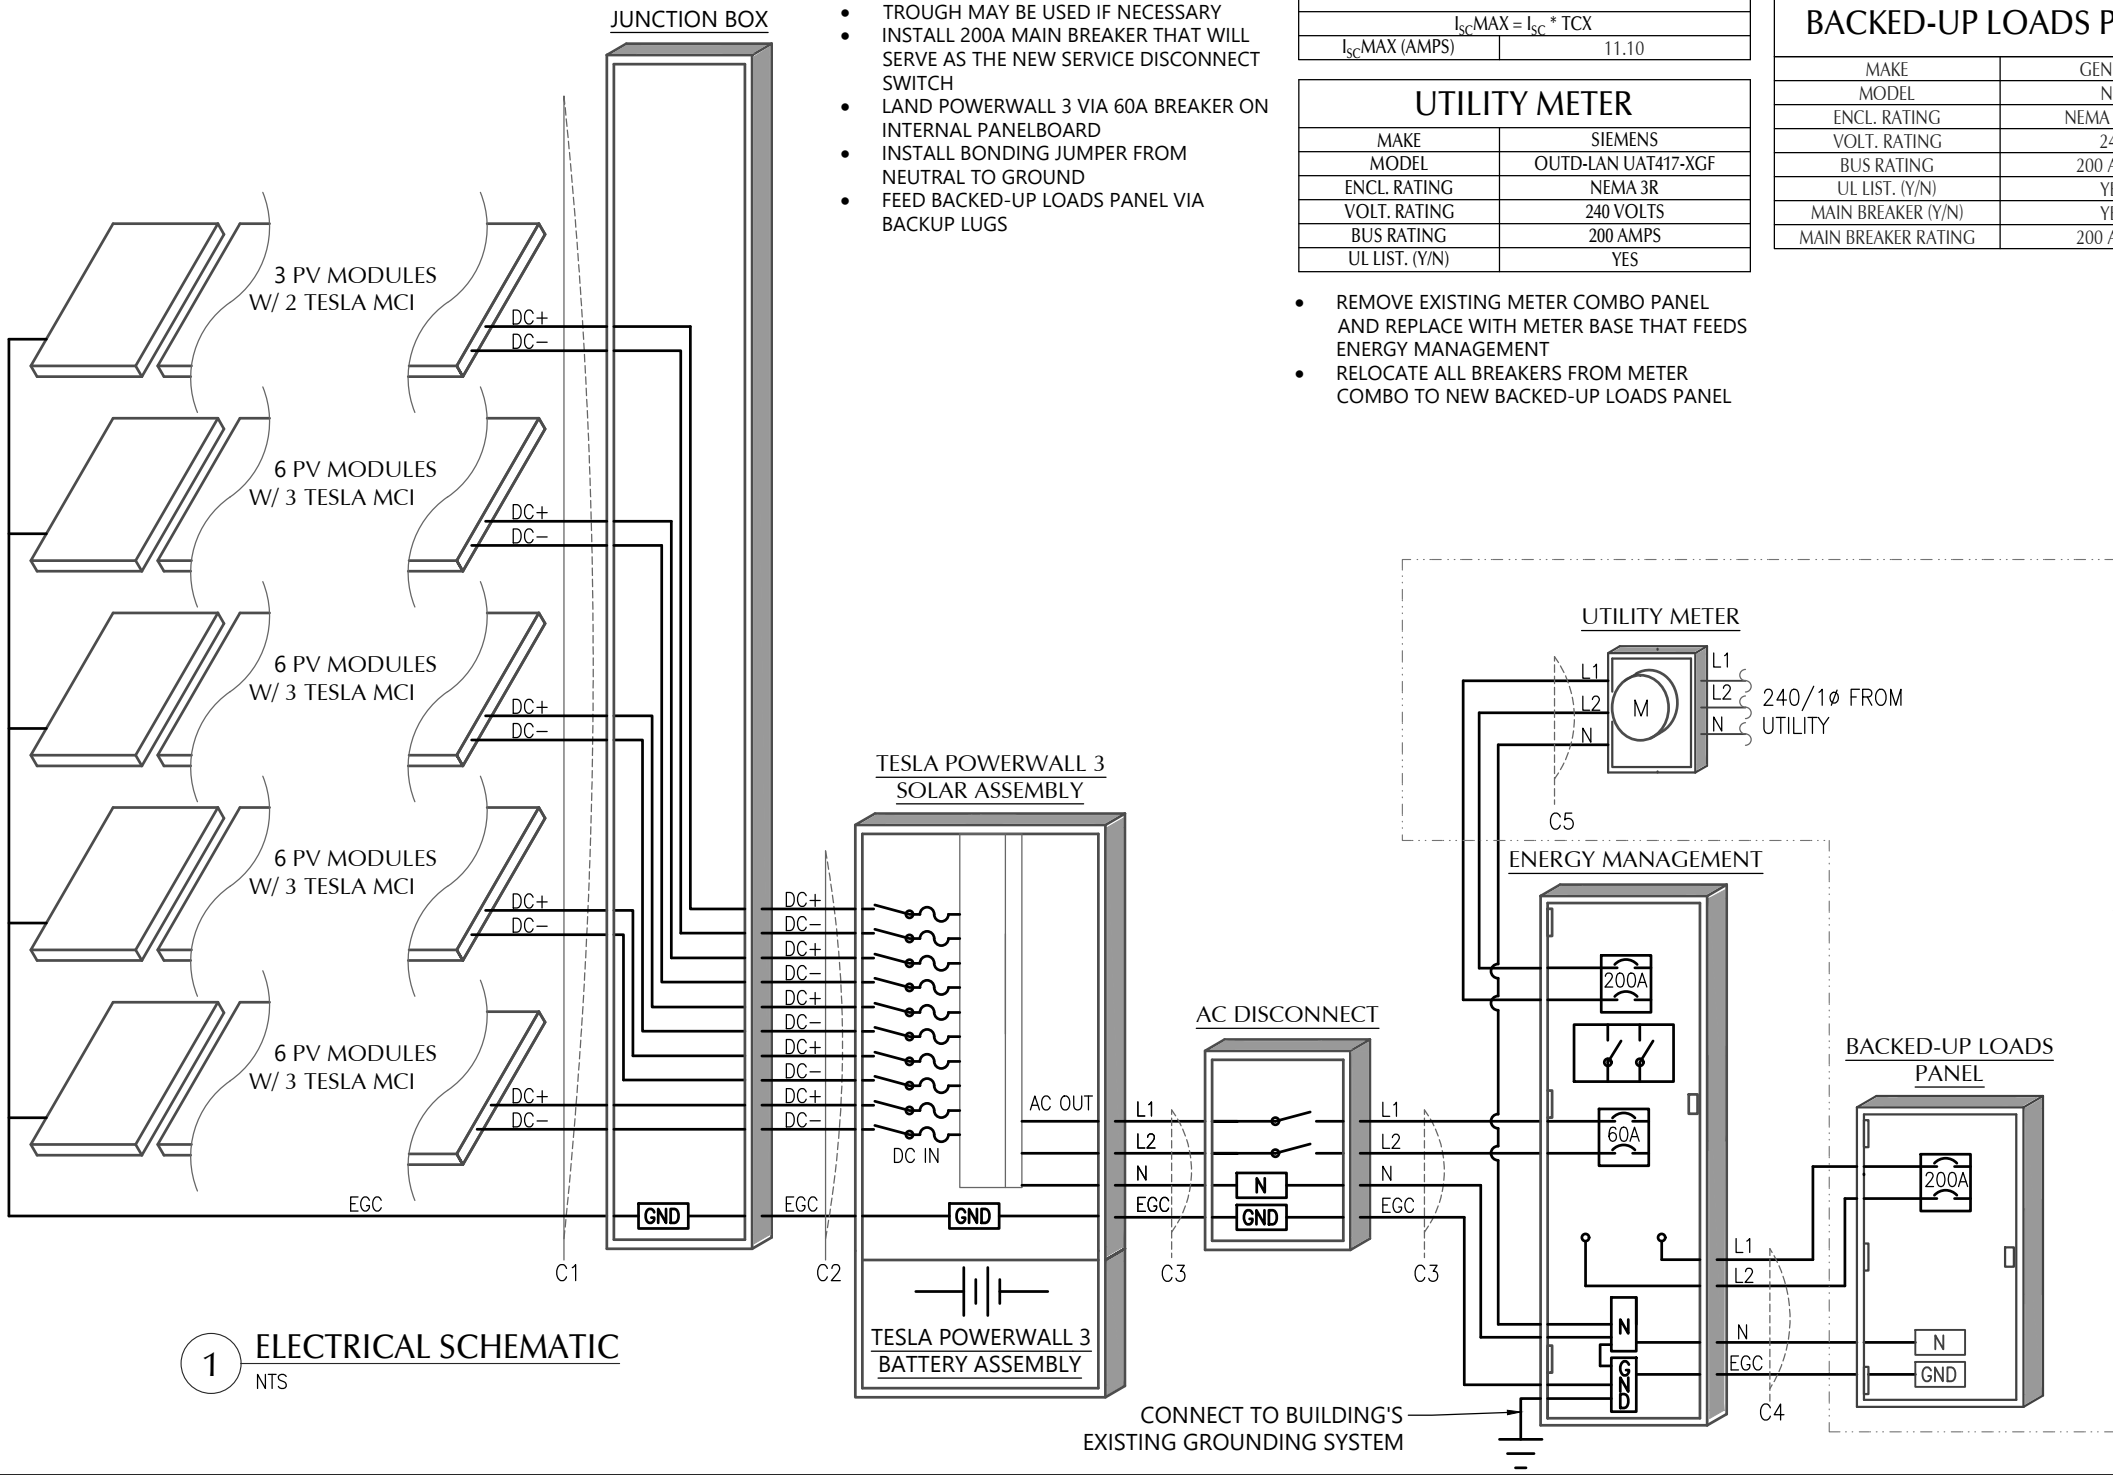

1 ELECTRICAL SCHEMATIC

NTS



CLIENT INFO

THOMAS W NICHTER
36 APPLECROSS COURT
SANFORD, NC 27332

PROJECT INFO

DC INPUT: 12.420 kW
AC OUTPUT: 11.500 kW
DOI INSPT. METHOD: OPTION 2

Model Energy

300 Fayetteville St.
#1430
Raleigh, NC 27602
919-274-9905
ModelEnergy.com

P-1194



CODE REFERENCES

NATIONAL ELECTRICAL CODE v. 2017
NC FIRE PROTECTION CODE v. 2018
NC BUILDING CODE v. 2018
NC RESIDENTIAL CODE v. 2018
ACSE v. 7-10

SITE CONDITIONS

WIND SPEED: 120 MPH
RISK CATEGORY: II
EXPOSURE: B
SNOW: 10 PSF

SHEET INDEX

PV-1: COVER SHEET
PV-2: PV STRUCTURAL
PV-3: PV ELECTRICAL
PV-4: PV EQUIPMENT LABELS
PV-5: PV INSTALL GUIDE

VERSIONS

FOR:	DESIGNER:	DATE:
CONSTRUCTION	CRM	4/29/2025

PV SYSTEM
ELECTRICAL

PV-3.1

WARNING: PHOTOVOLTAIC
POWER SOURCE

NEC 690.31 (G)(3)&(4)
PLACE ON ALL JUNCTION BOXES, EXPOSED RACEWAYS, AND OTHER
WIRING METHODS EVERY 10' AND ON EVERY SECTION SEPARATED BY
ENCLOSURES, WALLS, PARTITIONS, CEILINGS, OR FLOORS.

RAPID SHUTDOWN
SWITCH FOR
SOLAR PV SYSTEM

NEC 690.56 (C)(3)
PLACE ON RAPID SHUTDOWN SWITCH OR EQUIPMENT
WITH INTEGRATED RAPID SHUTDOWN *REFLECTIVE*

PV SYSTEM
DISCONNECT

NEC 690.13 (B)
PLACE ON PV SYSTEM DISCONNECTING MEANS.

DIRECT CURRENT
PHOTOVOLTAIC POWER SOURCE

MAXIMUM VOLTAGE 600 VDC
MAX CIRCUIT CURRENT 55.5 AMPS

NEC 690.53
PLACE ON ALL DC DISCONNECTING MEANS


PHOTOVOLTAIC POWER SOURCE

OPERATING AC VOLTAGE 240 V
MAXIMUM OPERATING
AC OUTPUT CURRENT 48.0 A

NEC 690.54
PLACE ON INTERCONNECTION
DISCONNECTING MEANS

SOLAR PV SYSTEM EQUIPPED
WITH RAPID SHUTDOWN

TURN RAPID SHUTDOWN
SWITCH TO THE
"OFF" POSITION TO
SHUT DOWN PV SYSTEM
AND REDUCE
SHOCK HAZARD
IN THE ARRAY



NEC 690.56 (C)(1)(a)
PLACE WITHIN 3FT OF SERVICE DISCONNECTING MEANS TO
WHICH THE PV SYSTEMS ARE CONNECTED AND SHALL
INDICATE THE LOCATIONS OF RAPID SHUTDOWN SWITCHES



WARNING

THIS EQUIPMENT FED BY MULTIPLE
SOURCES. TOTAL RATING OF ALL
OVERCURRENT DEVICES EXCLUDING
MAIN SUPPLY OVERCURRENT
DEVICE SHALL NOT EXCEED
AMPACITY OF BUSBAR.

NEC 705.12 (B)(2)(3)(c)



WARNING

THREE POWER SOURCES

SOURCES: UTILITY GRID, BATTERY
AND PV SOLAR ELECTRIC SYSTEM

NEC 705.12(B)(3)
PLACE ON ALL EQUIPMENT THAT IS SUPPLIED
BY THREE POWER SOURCES

SERVICE DISCONNECT LOCATED:

PV/BATTERY DISCONNECT LOCATED:

NEC 705.10
PLACE AT SERVICE EQUIPMENT AND
PV SYSTEM DISCONNECTING MEANS.

LABEL NOTES:

1. LABELS SHOWN ARE NOT TO SCALE.
2. LABEL MATERIAL SHALL BE SUITABLE FOR THE EQUIPMENT ENVIRONMENT.
3. DC CONDUIT SHALL BE MARKED WITH REQUIRED LABEL EVERY 10 FEET.
4. PHOTOVOLTAIC SYSTEMS SHALL BE PERMANENTLY MARKED AT VARIOUS EQUIPMENT LOCATIONS TO IDENTIFY THAT A PHOTOVOLTAIC SYSTEM IS INSTALLED AND THAT VARIOUS DANGERS ARE PRESENT.
5. EACH PHOTOVOLTAIC SYSTEM DISCONNECTING MEANS SHALL BE PERMANENTLY MARKED TO IDENTIFY IT AS A PHOTOVOLTAIC SYSTEM DISCONNECT.
6. WHERE ALL TERMINALS OF A DISCONNECTING MEANS MAY BE ENERGIZED IN THE OPEN POSITION, A WARNING SIGN SHALL BE MOUNTED ON OR ADJACENT TO THE DISCONNECT.
7. A PERMANENT LABEL FOR THE DIRECT-CURRENT PHOTOVOLTAIC POWER SOURCE SHALL BE PROVIDED AT THE DC DISCONNECT MEANS.
8. A PERMANENT PLAQUE OR DIRECTORY, DENOTING ALL ELECTRIC POWER SOURCES SERVING THE PREMISES, SHALL BE INSTALLED AT EACH SERVICE EQUIPMENT LOCATION AND AT LOCATIONS OF ALL POWER PRODUCTION SOURCES.
9. LABELS WILL BE APPLIED IN ACCORDANCE WITH THE NEC. SOME LABELS SHOWN MAY NOT BE NECESSARY.

WIRING NOTES:

1. CONDUCTORS SHALL BE COPPER OR ALUMINUM, RATED AT NOT LESS THAN 600 VOLTS
2. MINIMUM SIZE SHALL BE #10 #14 AWG UNLESS OTHERWISE NOTED ON THE DRAWINGS.
3. EXPOSED WIRING CONDUCTOR INSULATION SHALL BE TYPE PV WIRE, USE-2, OR RHW-2 WHERE THE OUTER LAYER OF THE INSULATION IS UV, SUNLIGHT, AND MOISTURE RESISTANT. CABLE ASSEMBLIES SHALL BE TYPE DG. BARE CONDUCTORS SHALL BE A MINIMUM OF #6 AWG.
4. EXTERIOR WIRING CONDUCTOR INSULATION SHALL BE TYPE THWN-2 AND INSTALLED IN ELECTRICAL METALLIC TUBING(EMT), RIGID POLYVINYL CHLORIDE CONDUIT(PVC), RIGID METALLIC CONDUIT (RMC), LIQUIDTIGHT FLEXIBLE METALLIC CONDUIT (LFMC), OR LIQUIDTIGHT FLEXIBLE NON METALLIX CONDUIT (LFNC). SE-TYPE CABLE CAN BE USED AS AN ALTERNATIVE. ADDITIONAL WIRING METHODS SHALL BE PERMITTED ONLY WHEN IN COMPLIANCE WITH ALL NEC REQUIREMENTS.
5. INTERIOR WIRING CONDUCTOR INSULATION SHALL BE TYPE THWN-2 OR XHHW AND INSTALLED IN ELECTRICAL METALLIC TUBING (EMT), FLEXIBLE METAL CONDUIT(FMC), LIQUIDTIGHT FLEXIBLE METAL CONDUIT (LFMC), LIQUIDTIGHT FLEXIBLE NONMETALLIC CONDUIT (LFNC). TYPE SE, NM, AND MC CABLE ASSEMBLIES SHALL ALSO BE PERMITTED. ADDITIONAL WIRING METHODS SHALL BE PERMITTED ONLY WHEN IN COMPLIANCE WITH ALL NEC REQUIREMENTS.
6. BURIED WIRING CONDUCTOR INSULATION SHALL BE RATED FOR DIRECT BURIAL WHEN INSTALLED OUTSIDE OF RACEWAY. CONDUCTOR INSULATION SHALL BE TYPE THWN-2 OR XHHW AND INSTALLED IN RIGID PVC, RIGID METALLIC CONDUIT, OR HDPE. ADDITIONAL WIRING METHODS SHALL BE PERMITTED ONLY WHEN IN COMPLIANCE WITH ALL NEC REQUIREMENTS.
7. USE SCHEDULE 40 PVC OUTDOORS WHERE NOT SUBJECT TO PHYSICAL DAMAGE OR BELOW FLOOR SLAB. USE SCHEDULE 80 PVC OUTDOORS WHERE SUBJECT TO PHYSICAL DAMAGE
8. MINIMUM CONDUIT SIZE TO BE 1/2".
9. WIRING METHODS TO CONFORM TO CHAPTER 3 OF THE NEC.

CONSTRUCTION NOTES:

1. ALL WORK IS TO BE PERFORMED IN ACCORDANCE WITH THE NEC, STATE, AND LOCAL APPLICABLE CODES.
2. FOLLOW MANUFACTURER'S INSTALLATION INSTRUCTIONS, BEST PRACTICES, AND SPECIFICATIONS.
3. ENSURE REQUIRED MAINTENANCE ACCESS AND CLEARANCES ARE
4. FUSES 0 - 600 AMPS SHALL BE UL CLASS "RK-1" LOW PEAK DUAL ELEMENT TIME DELAY WITH 200,000 AMPERE INTERRUPTING RATING A, UNLESS NOTED OTHERWISE.
5. ALL TERMINALS, SPlicing CONNECTORS, LUGS, ETC SHALL BE IDENTIFIED FOR USE WITH THE MATERIAL (CU/AL) OF THE CONDUCTOR AND SHALL BE PROPERLY INSTALLED.
6. ALL PENETRATIONS THROUGH EXTERIOR ROOFS SHALL BE FLASHED IN A WATERPROOF MANNER.
7. ALL PENETRATIONS THROUGH ATTIC FIRE BARRIERS SHALL BE SEALED WITH FIRE-BARRIER SEALANT CAULK.
8. SUPPORT ALL CONDUIT AND EQUIPMENT IN ACCORDANCE W/ NEC. ANY SUSPENDED MATERIALS SHALL BE DIRECTLY SUPPORTED BY THE BUILDING STRUCTURE.
9. A NORTH CAROLINA REGISTERED DESIGN PROFESSIONAL WILL BE REQUIRED TO SEAL THE STRUCTURAL DESIGN AT THE TIME OF PERMIT APPLICATION IF ANY OF THE FOLLOWING EXIST AND ARE ATTESTED TO BY THE APPLICANT:
 - THE WEIGHT OF THE PV SYSTEM EXCEEDS THREE (3) POUNDS PER SQUARE FOOT(PSF)
 - THE ROOF POSSESSES MORE THAN ONE (1) LAYER OF ASPHALT SHINGLES
 - THE ROOFING MATERIAL CONSISTS OF A TYPE OTHER THAN ASPHALT SHINGLES OR METAL
 - THE ROOF IS LOCATED IN A 140 MPH OR GREATER WIND ZONE



CLIENT INFO

THOMAS W'NICHTER
36 APPLECROSS COURT
SANFORD, NC 27332

PROJECT INFO

DC INPUT: 12.420 kW
AC OUTPUT: 11.500 kW
DOI INSPT. METHOD: OPTION 2

Model Energy

300 Fayetteville St.
#1430
Raleigh, NC 27602
919-274-9905
ModelEnergy.com

P-1194



CODE REFERENCES

NATIONAL ELECTRICAL CODE v. 2017
NC FIRE PROTECTION CODE v. 2018
NC BUILDING CODE v. 2018
NC RESIDENTIAL CODE v. 2018
ACSE v. 7-10

SITE CONDITIONS

WIND SPEED: 120 MPH
RISK CATEGORY: II
EXPOSURE: B
SNOW: 10 PSF

SHEET INDEX

PV-1: COVER SHEET
PV-2: PV STRUCTURAL
PV-3: PV ELECTRICAL
PV-4: PV EQUIPMENT LABELS
PV-5: PV INSTALL GUIDE


VERSIONS

FOR:	DESIGNER	DATE
CONSTRUCTION	CRM	4/29/2025



PV SYSTEM
EQUIPMENT LABELS

PV-4.1

© 2025 NC SOLAR NOW EXPRESSLY RESERVES ITS COMMON LAW COPYRIGHT AND OTHER PROPERTY RIGHTS IN THESE PLANS. THESE PLANS ARE NOT TO BE REPRODUCED, CHANGED OR COPIED IN ANY FORM OR MANNER WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESSED WRITTEN PERMISSION AND CONSENT OF NC SOLAR NOW.

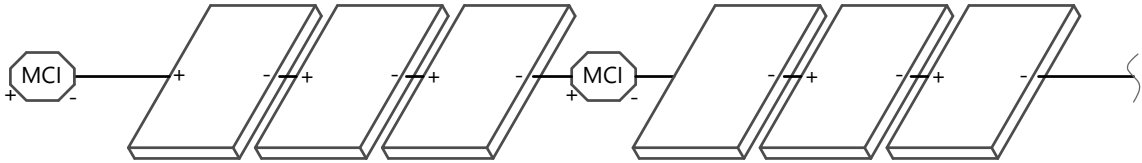

1 STRING WIRING + MCI DETAIL
NOT TO SCALE

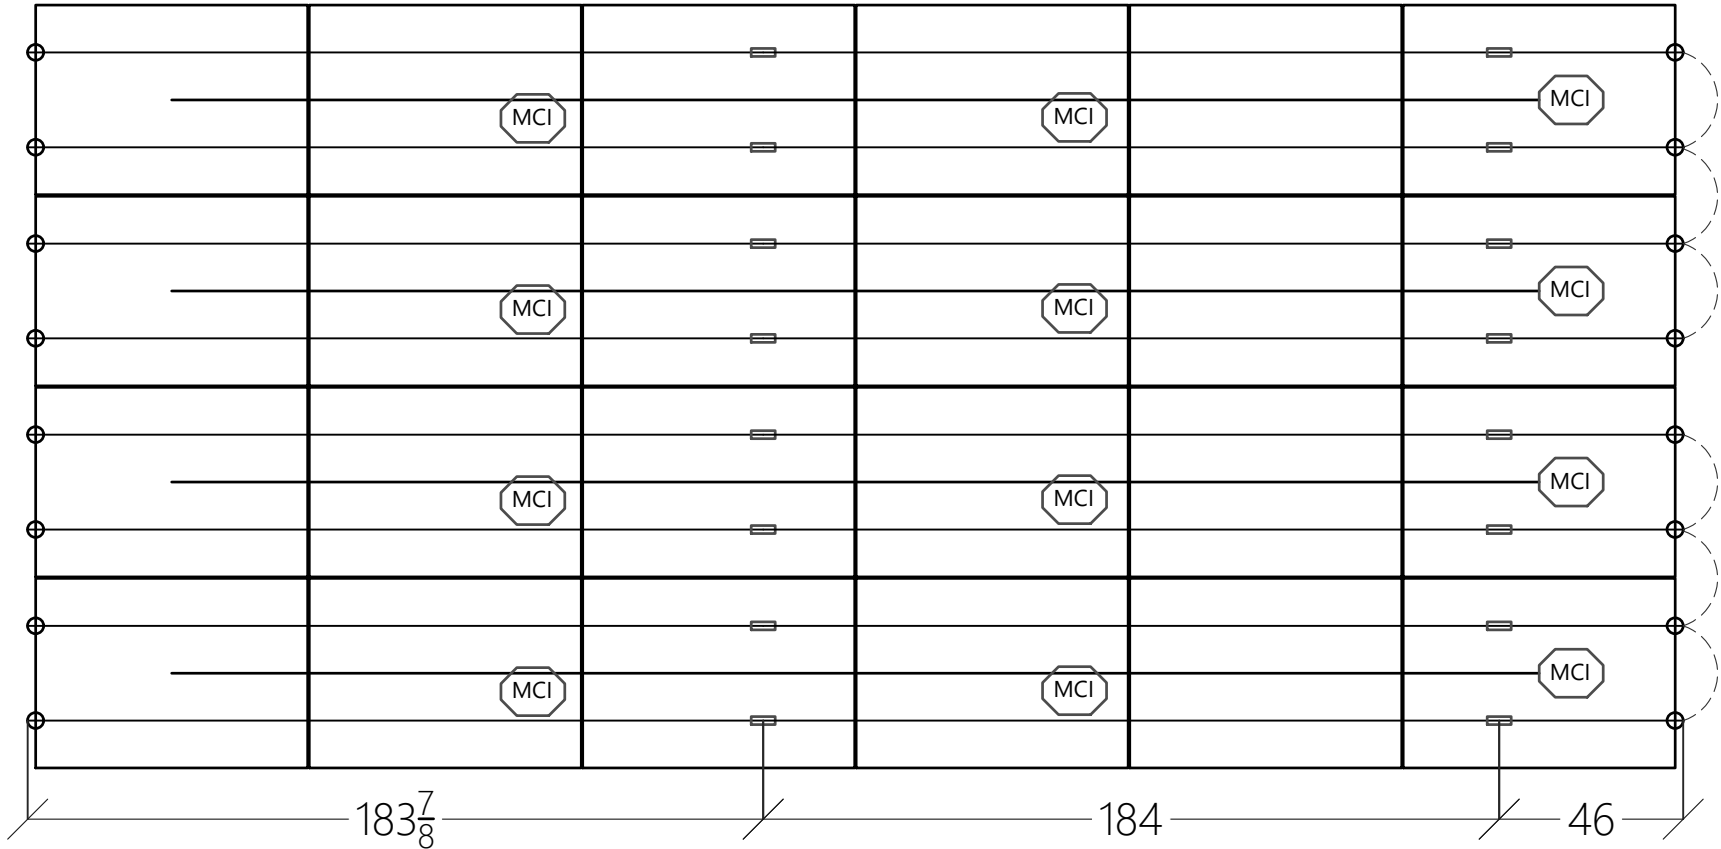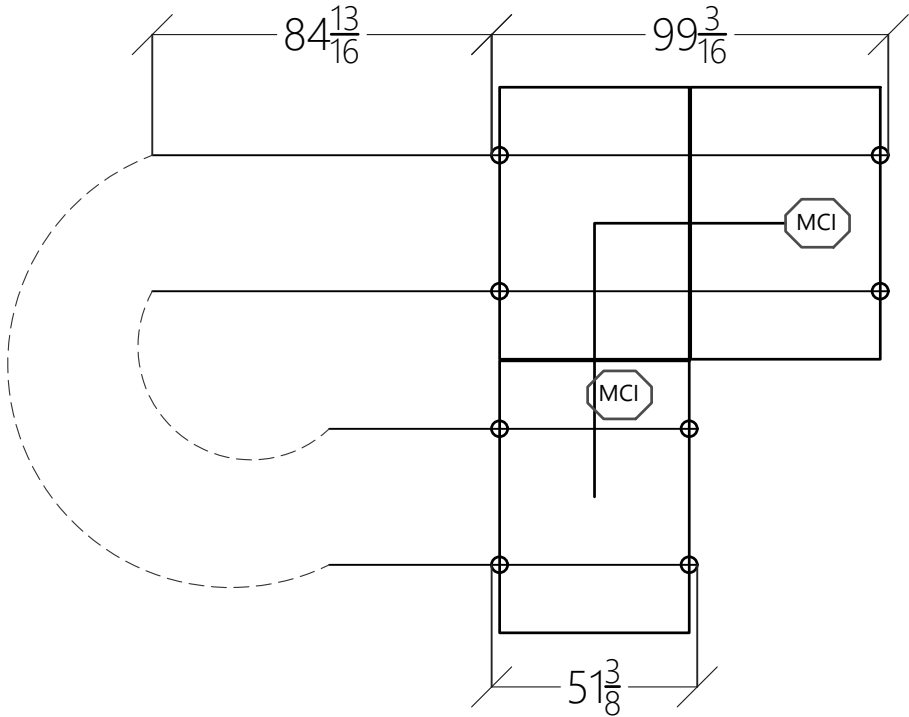

1 ARRAY LAYOUT DETAIL
NOT TO SCALE



CLIENT INFO

THOMAS W NICHTER
36 APPLECROSS COURT
SANFORD, NC 27332

PROJECT INFO

DC INPUT: 12.420 kW
AC OUTPUT: 11.500 kW
DOI INSPT. METHOD: OPTION 2

Model Energy

300 Fayetteville St.
#1430
Raleigh, NC 27602
919-274-9905
ModelEnergy.com

P-1194



CODE REFERENCES

NATIONAL ELECTRICAL CODE v. 2017
NC FIRE PROTECTION CODE v. 2018
NC BUILDING CODE v. 2018
NC RESIDENTIAL CODE v. 2018
ACSE v. 7-10

SITE CONDITIONS

WIND SPEED: 120 MPH
RISK CATEGORY: II
EXPOSURE: B
SNOW: 10 PSF

SHEET INDEX

PV-1: COVER SHEET
PV-2: PV STRUCTURAL
PV-3: PV ELECTRICAL
PV-4: PV EQUIPMENT LABELS
PV-5: PV INSTALL GUIDE

VERSIONS

FOR:	DESIGNER	DATE
CONSTRUCTION	CRM	4/29/2025

PV SYSTEM INSTALL
GUIDE


PV-5.1

SOLAR'S MOST TRUSTED



REC ALPHA[®] PURE-RX SERIES

DATASHEET

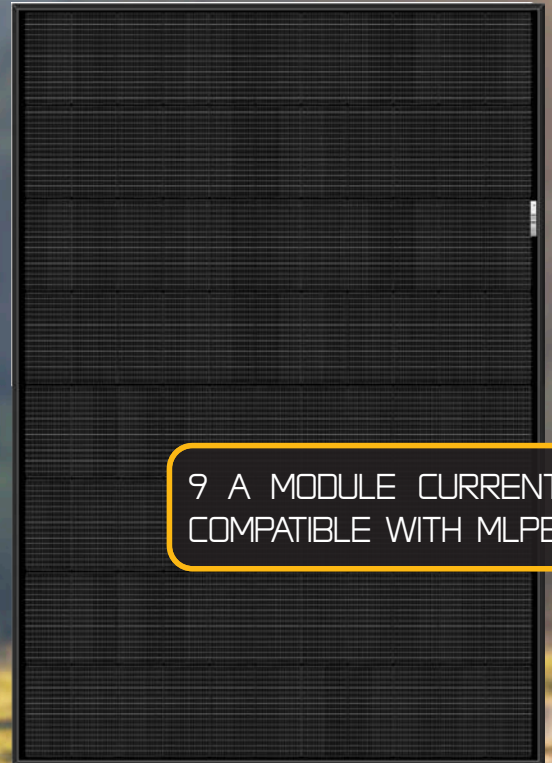

9 A MODULE CURRENT
COMPATIBLE WITH MLPE

450 - 470W
HETEROJUNCTION
TECHNOLOGY

22.6% EFFICIENCY
>92% POWER IN YEAR 25
-0.24%/K TEMPERATURE
COEFFICIENT OF P_{MAX}



ELIGIBLE


REC ALPHA® PURE-RX SERIES

DATASHEET

Measurements in [inches] and mm

GENERAL DATA

Cell Type	88 half-cut bifacial REC heterojunction cells, with gapless technology
Glass	0.13 in solar glass with anti-reflective surface treatment in accordance with EN12150
Backsheet	Highly resistant polymer (Black)
Frame	Anodized aluminum (Black)
Junction Box	4-part, 4 bypass diodes, IP68 rated, in accordance with IEC 62790:2020
Connectors	Stäubli MC4 PV-KBT4/KST4 (12 AWG) in accordance with IEC 62852:2014, IP68 only when connected
Cable	12 AWG solar cable, 66.9 in (1.70 m) + 66.9 in (1.70 m) in accordance with EN50618:2014
Dimensions	68.0 x 47.4 x 1.2 in (22.4 ft²) / 1728 x 1205 x 30 mm (2.08 m²)
Weight	50.0 lb / 22.7 kg
Origin	Made in Singapore

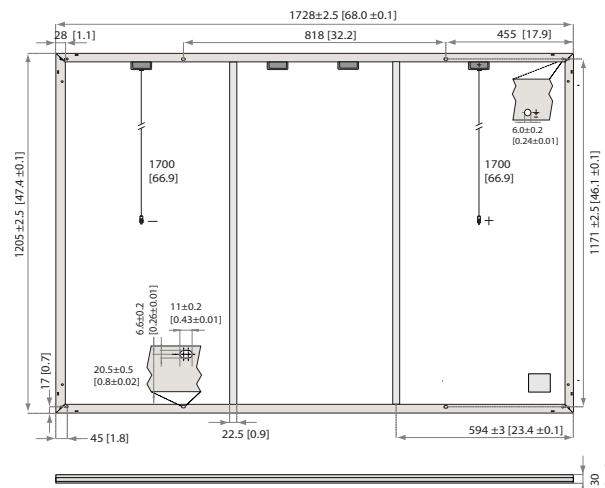

Specifications subject to change without notice.

ELECTRICAL DATA

PRODUCT CODE*: RECXXXAA PURE-RX

Power Output - P _{MAX} (WP)	450	460	470
Watt Class Sorting - (W)	0/+10	0/+10	0/+10
Nominal Power Voltage - V _{MPP} (V)	54.3	54.9	55.4
Nominal Power Current - I _{MPP} (A)	8.29	8.38	8.49
Open Circuit Voltage - V _{OC} (V)	65.6	65.8	65.9
Short Circuit Current - I _{SC} (A)	8.81	8.88	8.95
Power Density (W/ft²)	20.1	20.5	21.0
Panel Efficiency (%)	21.6	22.1	22.6

Power Output - P _{MAX} (W _P)	343	350	358
Nominal Power Voltage - V _{MPP} (V)	51.2	51.7	52.2
Nominal Power Current - I _{MPP} (A)	6.70	6.77	6.86
Open Circuit Voltage - V _{OC} (V)	61.8	62.0	62.1

Values at standard test conditions (STC: air mass AM 1.5, irradiance 1000 W/m², temperature 25°C), based on a production spread with a tolerance of P_{MAX}, V_{OC} & I_{SC} ±3% within one watt class. Nominal module operating temperature (NMOT: air mass AM 1.5, irradiance 800 W/m², temperature 20°C, windspeed 1 m/s). * Where xxx indicates the nominal power class (P_{MAX}) at STC above.

MODULE RATINGS

Module Operating Temperature [T ₉₈]	158°F (70°C)
Min. Environmental Temperature	-40°F (-40°C)
System Voltage	1000 V
Maximum Test Load (4 Point Mounting, Front)*	+7000 Pa (1.02 lbs/in²)
Maximum Test Load (4 Point Mounting, Rear)*	-4000 Pa (0.58 lbs/in²)
Maximum Test Load (6 Point Mounting, Front)**	+8000 Pa (1.16 lbs/in²)
Maximum Test Load (6 Point Mounting, Rear)**	-6000 Pa (0.87 lbs/in²)
Max Series Fuse Rating	25 A
Max Reverse Current	25 A

Design load = Test load / 1.5 (safety factor)
5 98th percentile operating temperature

* IEC 61730/UL 61730 certified. Refer to installation manual.

** Internal testing. Refer to installation manual.

TEMPERATURE RATINGS*

Nominal Module Operating Temperature	44 ± 2°C
Temperature coefficient of P _{MAX}	-0.24%/K
Temperature coefficient of V _{OC}	-0.24%/K
Temperature coefficient of I _{SC}	0.04%/K

*The temperature coefficients stated are linear values

DELIVERY INFORMATION

Panels per Pallet	33
Panels per 40 ft GP/high cube container	594 (18 Pallets)
Panels per 53 ft truck	792 (24 Pallets)

CERTIFICATIONS

ISO 14001; ISO 9001; IEC 45001; IEC 62941	
IEC 61215:2021; IEC 61730:2023; UL 61730	
ISO 11925-2	Ignitability (EN 13501-1 Class E)
IEC 62716	Ammonia Resistance
IEC 61701	Salt Mist (SM6)
IEC 61215:2016	Hailstone (35mm)
UL 61730	Fire Type 2




WARRANTY

	Standard	REC ProTrust	
Installed by an REC	No	Yes	Yes
Certified Professional			
System Size	All	<25 kW	25-500 kW
Product Warranty (yrs)	20	25	25
Power Warranty (yrs)	25	25	25
Labor Warranty (yrs)	0	25	10
Power in Year 1	98%	98%	98%
Annual Degradation	0.25%	0.25%	0.25%
Power in Year 25	92%	92%	92%

REC ProTrust Warranty applies only for i) REC panels installed by an REC Certified Solar Professional, and ii) panels have been registered by the installer with REC. Subject to System Size and further conditions. See www.recgroup.com for details.

LOW LIGHT BEHAVIOR

Typical low irradiance performance of module at STC:

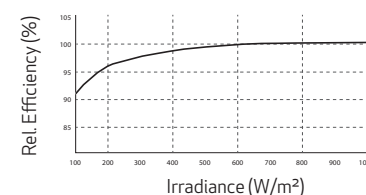

Available from:

Founded in 1996, REC Group is an international pioneering solar energy company dedicated to empowering consumers with clean, affordable solar power. As Solar's Most Trusted, REC is committed to high quality, innovation, and a low carbon footprint in the solar materials and solar panels it manufactures. Headquartered in Norway with operational headquarters in Singapore, REC also has regional hubs in North America, Europe, and Asia-Pacific.

REC Solar PTE. LTD.
20 Tuas South Ave. 14
Singapore 637312
post@recgroup.com
www.recgroup.com

Powerwall 3

Power Everything

Powerwall 3 is a fully integrated solar and battery system, designed to accelerate the transition to sustainable energy. Customers can receive whole home backup, cost savings, and energy independence by producing and consuming their own energy while participating in grid services. Once installed, customers can manage their system using the Tesla App to customize system behavior to meet their energy goals.

Powerwall 3 achieves this by supporting up to 20 kW DC of solar and providing up to 11.5 kW AC of continuous power per unit. It has the ability to start heavy loads rated up to 185 LRA, meaning a single unit can support the power needs of most homes. Powerwall 3 Expansions make it easier and more affordable to scale up customers' systems to meet their current or future needs. Powerwall 3 is designed for fast and efficient installations, modular system expansion, and simple connection to any electrical service.



Powerwall 3 Technical Specifications

System Technical Specifications

Model Number	1707000-xx-y			
Nominal Grid Voltage (Input & Output)	120/240 VAC			
Grid Type	Split phase			
Frequency	60 Hz			
Nominal Battery Energy	13.5 kWh AC ¹			
Nominal Output Power (AC)	5.8 kW	7.6 kW	10 kW	11.5 kW
Maximum Apparent Power	5,800 VA	7,600 VA	10,000 VA	11,500 VA
Maximum Continuous Current	24 A	31.7 A	41.7 A	48 A
Overcurrent Protection Device ²	30 A	40 A	60 A	60 A
Configurable Maximum Continuous Discharge Power Off-Grid (PV Only, -20°C to 25°C)	15.4 kW ³			
Maximum Continuous Charge Current / Power (Powerwall 3 only)	20.8 A AC / 5 kW			
Maximum Continuous Charge Current / Power (Powerwall 3 with up to (3) Expansion units)	33.3 A AC / 8 kW			
Output Power Factor Rating	0 – 1 (Grid Code configurable)			
Maximum Output Fault Current (1 s)	160 A			
Maximum Short-Circuit Current Rating	10 kA			
Load Start Capability	185 LRA			
Solar to Battery to Home/Grid Efficiency	89% ^{1,4}			
Solar to Home/Grid Efficiency	97.5% ⁵			
Power Scalability	Up to 4 Powerwall 3 units supported			
Energy Scalability	Up to 3 Expansion units (for a maximum total of 7 units)			
Supported Islanding Devices	Gateway 3, Backup Switch, Backup Gateway 2			
Connectivity	Wi-Fi (2.4 and 5 GHz), Ethernet, Cellular (LTE/4G ⁶)			
Hardware Interface	Dry contact relay, Rapid Shutdown (RSD) certified switch and 2-pin connector, RS-485 for meters			
AC Metering	Revenue Grade (+/- 0.5%, ANSI C12.20)			
Protections	Integrated arc fault circuit interrupter (AFCI), Isolation Monitor Interrupter (IMI), PV Rapid Shutdown (RSD) using Tesla Mid-Circuit Interrupters			
Customer Interface	Tesla Mobile App			
Warranty	10 years			

¹Values provided for 25°C (77°F), at beginning of life. 3.3 kW charge/discharge power.

²See [Powerwall 3 Installation Manual](#) for fuse requirements if using fuse for overcurrent protection.

³If enabling the 15.4 kW off-grid maximum continuous discharge power, Powerwall 3 must be installed with an 80 A breaker and appropriately sized conductors.

⁴Typical solar shifting use case.

⁵Tested using CEC weighted efficiency methodology.

⁶The customer is expected to provide internet connectivity for Powerwall 3; cellular should not be used as the primary mode of connectivity. Cellular connectivity subject to network operator service coverage and signal strength.

Powerwall 3 Technical Specifications

Solar Technical Specifications

Maximum Solar STC Input	20 kW
Withstand Voltage	600 V DC
PV DC Input Voltage Range	60 — 550 V DC
PV DC MPPT Voltage Range	60 — 480 V DC
MPPTs	6
Maximum Current per MPPT (I_{mp})	13 A ⁷
Maximum Short Circuit Current per MPPT (I_{sc})	15 A ⁷

⁷Where the DC input current exceeds the MPPT rating, a jumper can be used to combine two MPPTs into a single input to intake DC current up to 26 A I_{MP} / 30 A I_{SC} .

Environmental Specifications

Operating Temperature	−20°C to 50°C (−4°F to 122°F) ⁸
Operating Humidity (RH)	Up to 100%, condensing
Storage Temperature	−20°C to 30°C (−4°F to 86°F), up to 95% RH, non-condensing, State of Energy (SOE): 25% initial
Maximum Elevation	3000 m (9843 ft)
Environment	Indoor and outdoor rated
Enclosure Rating	NEMA 3R
Ingress Rating	IP67 (Battery & Power Electronics) IP55 (Wiring Compartment)
Pollution Rating	PD3
Operating Noise @ 1 m	< 50 db(A) typical < 62 db(A) maximum

⁸ Performance may be de-rated at operating temperatures above 40°C (104°F).

Compliance Information


Certifications	UL 1741, UL 9540, UL 9540A, UL 3741, UL 1741 PCS, UL 1741 SA, UL 1741 SB, UL 1973, UL 1699B, UL 1998, CSA C22.2 No. 0.8, CSA C22.2 No. 107.1, CSA C22.2 No. 330, CSA 22.3 No. 9, IEEE 1547, IEEE 1547A, IEEE 1547.1, CA Rule No.21
Grid Connection	United States and Canada
Emissions	FCC Part 15 Class B, ICES 003
Environmental	RoHS Directive 2011/65/EU
Seismic	AC156, IEEE 693-2005 (high)
Fire Testing	Meets the unit level performance criteria of UL 9540A

Powerwall 3 Technical Specifications

Mechanical Specifications

Dimensions	1105 x 609 x 193 mm (43.5 x 24 x 7.6 in) ⁹
Total Weight of Installed Unit	132 kg (291.2 lb)
Weight of Powerwall 3	124 kg (272.5 lb)
Weight of Glass Front Cover	6.5 kg (14.5 lb)
Weight of Wall Bracket	1.9 kg (4.2 lb)
Mounting Options	Floor or wall mount

⁹ These dimensions include the glass front cover being installed on Powerwall 3.

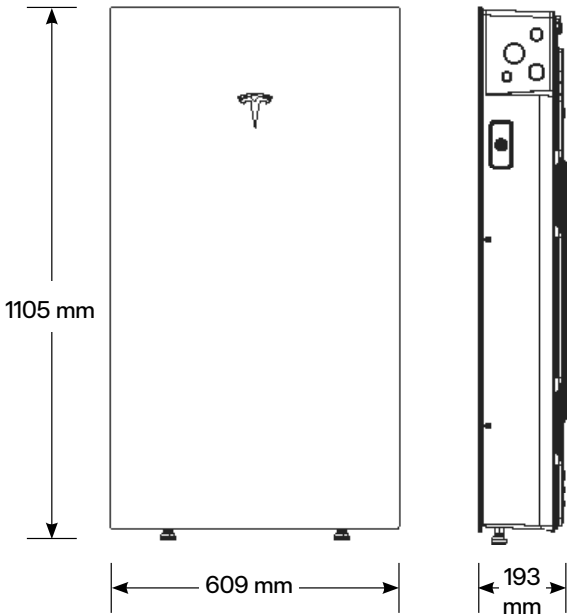

Powerwall 3 Expansion Technical Specifications

Battery Technical Specifications

Model Number	1807000-xx-y
Nominal Battery Energy	13.5 kWh
Voltage Range	52 – 92 V DC ¹⁰

¹⁰ Powerwall 3 Expansion units are connected in parallel and are not field serviceable.

Environmental Specifications

Operating Temperature	–20°C to 50°C (–4°F to 122°F) ¹¹
Operating Humidity (RH)	Up to 100%, condensing
Storage Temperature	–20°C to 30°C (–4°F to 86°F), up to 95% RH, non-condensing, State of Energy (SOE): 25% initial
Maximum Elevation	3000 m (9843 ft)
Environment	Indoor and outdoor rated
Enclosure Rating	NEMA 3R
Ingress Rating	IP67
Pollution Rating	PD3

¹¹ Performance may be de-rated at operating temperatures above 40°C (104°F).

Compliance Information


Certifications	UL 1973, UL 9540
----------------	------------------

Mechanical Specifications

Dimensions	1105 x 609 x 168 mm (43.5 x 24 x 6.6 in) ¹²
Total Weight of Wall-Mounted Expansion Unit	118.5 kg (261.2 lb)
Weight of Expansion Unit	110 kg (242.5 lb)
Weight of Glass Front Cover	6.5 kg (14.5 lb)
Weight of Wall Bracket	1.9 kg (4.2 lb)
Weight of Expansion Accessories	0.7 kg (1.5 lb)
Mounting Options	Floor or wall mount
Stacking Capability (Floor Mount Only)	Up to (3) Expansion units behind a Powerwall 3
Compatibility with Other Systems	Only compatible with Powerwall 3
Connection to Powerwall 3 or Expansions	Powerwall 3 Expansion harness ¹³

¹² These dimensions include the glass front cover being installed on Powerwall 3 Expansion.

¹³ The Powerwall 3 Expansion harness is a listed component of the UL 9540 certification.

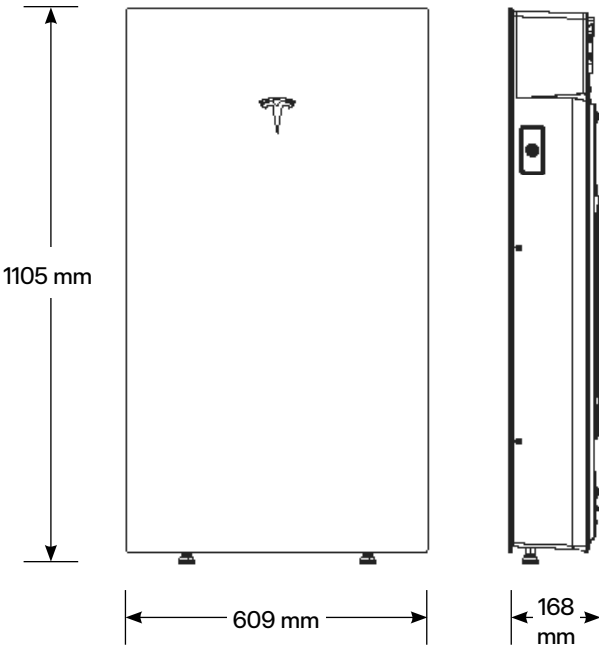

Solar Shutdown Device Technical Specifications

The Solar Shutdown Device is a Mid-Circuit Interrupter (MCI) and is integral to the rapid shutdown (RSD) function required for rooftop PV systems in accordance with Article 690 of the NEC. When paired with Powerwall 3, solar array shutdown is initiated by an External System Shutdown Switch or the On/Off Enable switch located on Powerwall 3. Systems not subject to rapid shutdown requirements must still install one or more MCIs for functional purposes; see the Powerwall 3 installation manual for details.

Electrical Specifications	Model	MCI-1	MCI-2	MCI-2 High Current
	Nominal Input DC Current Rating (I _{MP})	13 A	13 A	15 A
	Maximum Input Short Circuit Current (I _{SC})	19 A	17 A	19 A
	Maximum System Voltage	600 V DC	1000 V DC ¹⁴	1000 V DC ¹⁴
	Maximum Disconnect Voltage ¹⁵	600 V DC	165 V DC	165 V DC
¹⁴ Maximum System Voltage is limited by Powerwall to 600 V DC.				
¹⁵ Maximum Disconnect Voltage is the maximum voltage allowed across each MCI in the open position (Rapid Shutdown Initiated). An individual MCI-2 has a voltage rating of 165V but in combination (connected in the same string) their voltage ratings are additive.				
RSD Module Performance	Maximum Number of Devices per String	5		
	Control	Power Line Excitation		
	Passive State	Normally Open		
	Maximum Power Consumption	7 W		
	Warranty	25 years		
Environmental Specifications	Operating Temperature	-40°C to 50°C (-40°F to 122°F)	-45°C to 70°C (-49°F to 158°F)	
	Storage Temperature	-30°C to 70°C (-22°F to 158°F)	-30°C to 70°C (-22°F to 158°F)	
	Enclosure Rating	NEMA 4X / IP65		
Mechanical Specifications	Electrical Connections	MC4 Connector		
	Housing	Plastic		
	Dimensions	125 x 150 x 22 mm (5 x 6 x 1 in)	173 x 45 x 22 mm (6.8 x 1.8 x 1 in)	
	Weight	350 g (0.77 lb)	120 g (0.26 lb)	
	Mounting Options	ZEP Home Run Clip M4 Screw (#10) M8 Bolt (5/16") Nail / Wood screw	Wire Clip	
Compliance Information	Certifications	UL 1741 PVRSE, UL 3741, PVRSA (Photovoltaic Rapid Shutdown Array)		
	RSD Initiation Method	External System Shutdown Switch or Powerwall 3 Enable Switch		

UL 3741 PV Hazard Control (and PVRSA) Compatibility

See [UL 3741 Application Addendum](#)

Gateway 3

Tesla Gateway 3 controls connection to the grid in a Powerwall system, automatically detecting outages and providing seamless transition to backup power. It provides energy monitoring that is used by Powerwall for solar self-consumption, time-based control, and backup operation.

Performance Specifications

Model Number	1841000-x1-y	AC Meter	+/- 0.5%
Nominal Grid Voltage	120/240 V AC	Communication	CAN
Grid Configuration	Split phase	User Interface	Tesla App
Grid Frequency	60 Hz	Backup Transition	Automatic disconnect for seamless backup
Continuous Current Rating	200 A	Overcurrent Protection Device	100–200 A Service entrance rated Eaton CSR, BWH, or BW, or Square D QOM breakers
Maximum Supply Short Circuit Current	22 kA with Square D or Eaton main breaker 25 kA with Eaton main breaker ¹⁶	Internal Panelboard	200 A 8-space/16 circuit breakers Eaton BR, Siemens QP, or Square D HOM breakers rated to 10–125A
IEC Protective Class	Class I	Warranty	10 years
Overvoltage Category	Category IV		

¹⁶ Only Eaton CSR or BWH main breakers are 25 kA rated.

Environmental Specifications


Operating Temperature	–20°C to 50°C (–4°F to 122°F)
Operating Humidity (RH)	Up to 100%, condensing
Maximum Elevation	3000 m (9843 ft)
Environment	Indoor and outdoor rated
Enclosure Type	NEMA 3R

Compliance Information

Certifications	UL 67, UL 869A, UL 916, UL 1741 PCS, CSA 22.2 107.1, CSA 22.2 29
Emissions	FCC Part 15, Class B, ICES 003

Mechanical Specifications


Dimensions	660 x 411 x 149 mm (26 x 16 x 6 in)
Weight	16.3 kg (36 lb)
Mounting options	Wall mount

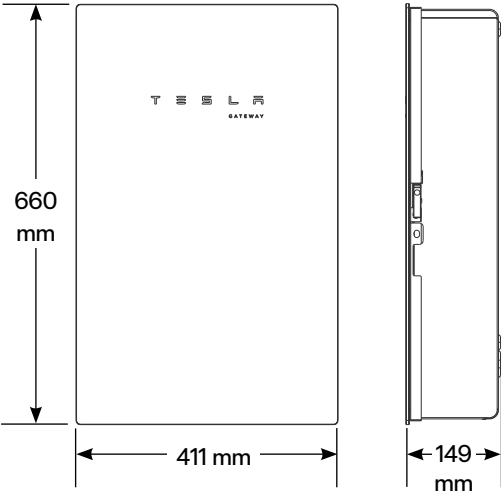

Powerwall 3 Example System Configurations


Powerwall 3 with Gateway 3

Whole Home Backup

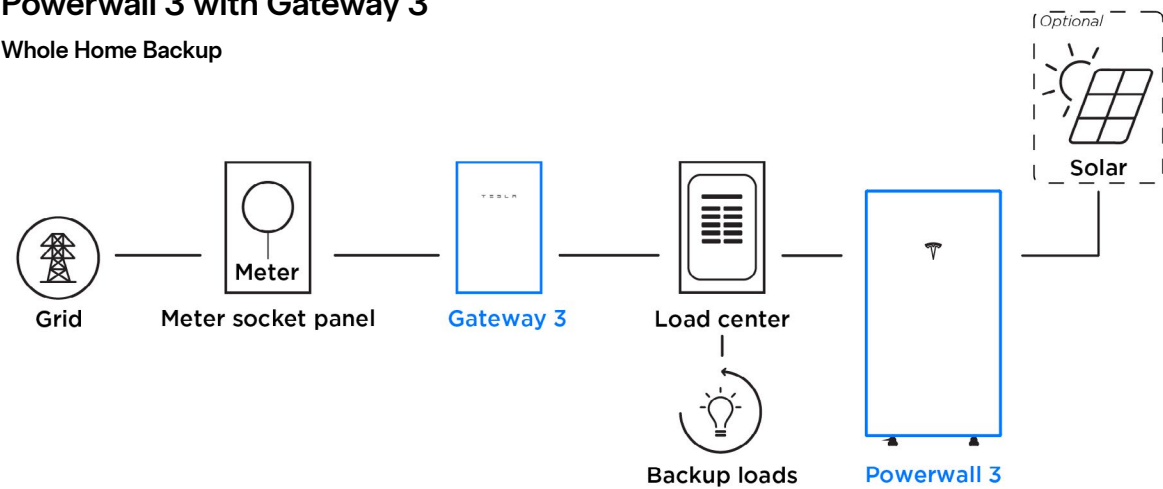


Powerwall 3 with Backup Switch

Whole Home Backup

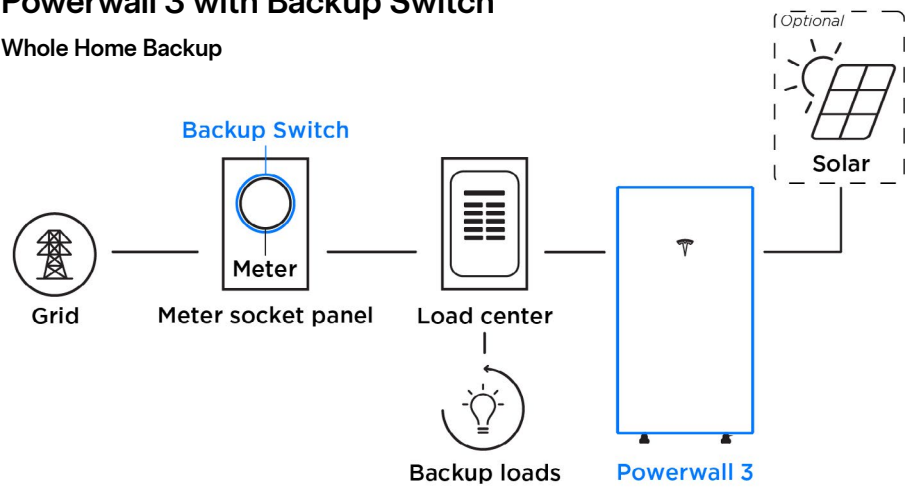

Powerwall 3 with Backup Gateway 2


Partial Home Backup

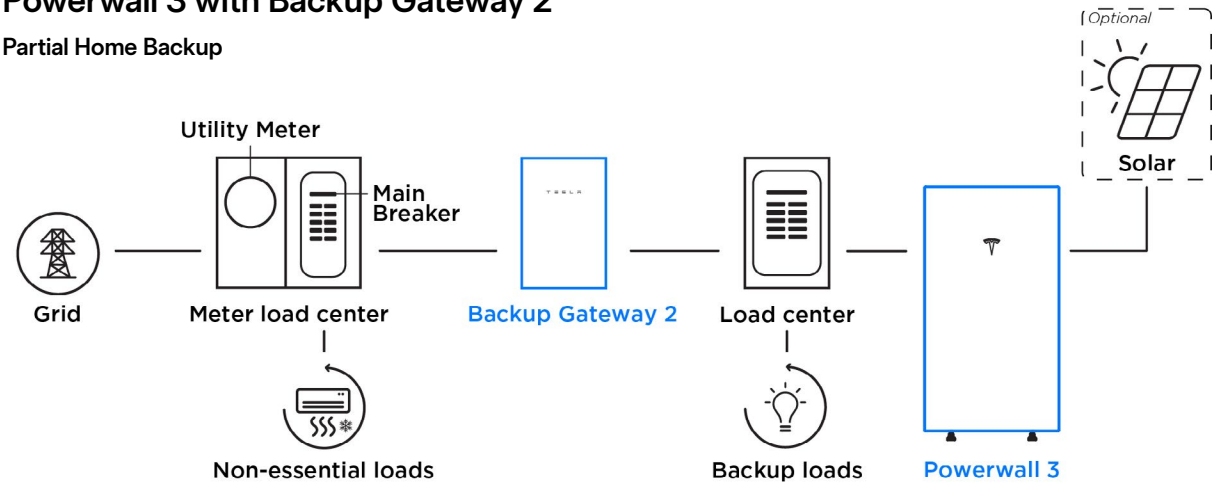

Powerwall 3 Example System Configurations


Powerwall 3 with Gateway 3

(1) Powerwall 3 with (3) Expansion Units

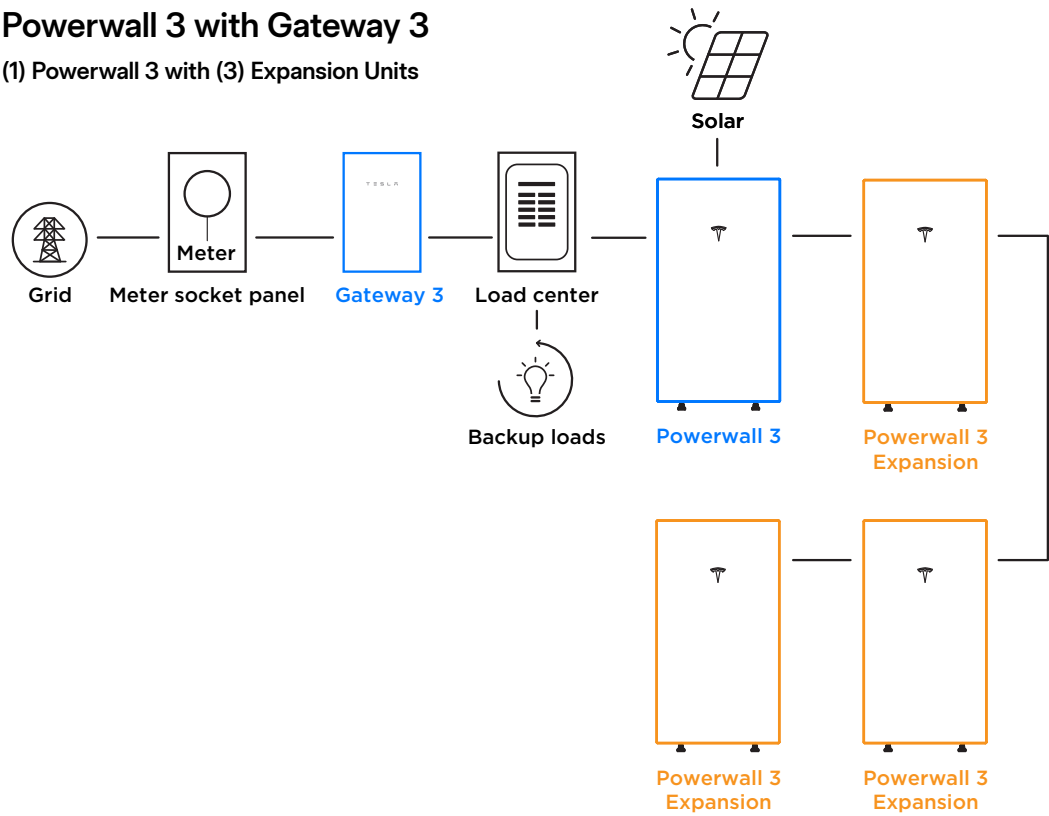

Powerwall 3 with Backup Switch

(4) Powerwall 3 Units with (3) Expansion Units (Maximum System Size)

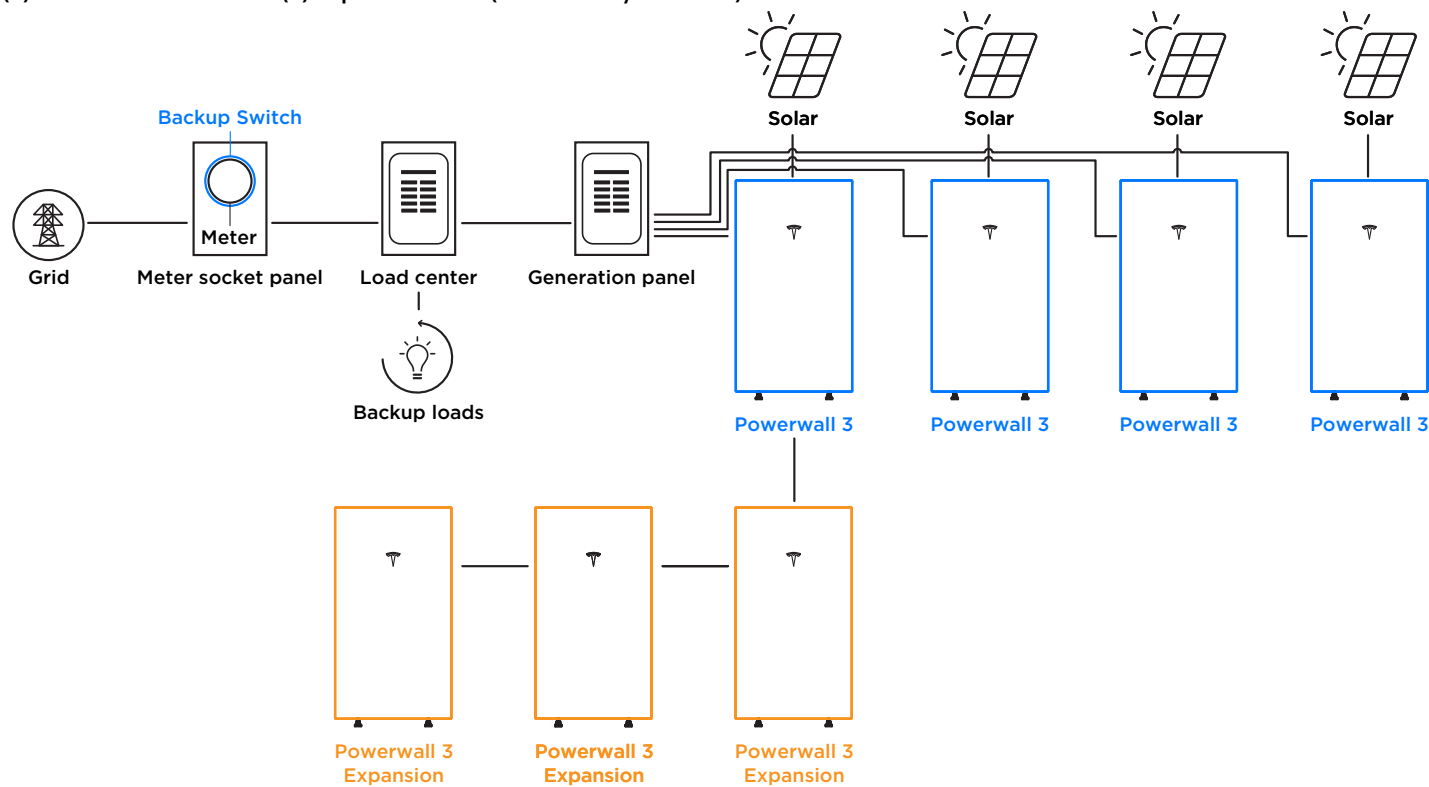

RSTC Enterprises, Inc.
2214 Heimstead Road
Eau Claire, WI 54703
715-830-9997



Outdoor Photovoltaic Enclosures

Composition/Cedar Roof System

ETL listed and labeled

Report # 3171411PRT-002 Revised May, 2018

- UL50 Type 3R, 11 Edition Electrical equipment enclosures
- CSA C22.2 No. 290 Nema Type 3R
- Conforms to UL 1741 Standard

0799 Series Includes:

0799 - 2 Wire size 2/0-14

0799 - 5 Wire size 14-6

0799 - D Wire size 14-8

Models available in Grey, Black or Stainless Steel

Basic Specifications

Material options:

- Powder coated, 18 gauge galvanized 90 steel (1,100 hours salt spray)
- Stainless steel

Process - Seamless draw (stamped)

Flashing - 15.25" x 17.25"

Height - 3"



Cavity - 255 Cubic inches

Base Plate:

- Fastened to base using toggle fastening system
- 5 roof deck knockouts
- Knockout sizes: (3) .5", (1) .75" and (1) 1"
- 8", 35mm slotted din rail
- Ground Block

Passthrough and combiner kits are available for either AC or DC applications.

0799 Series

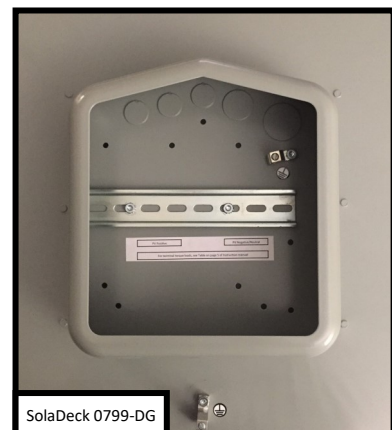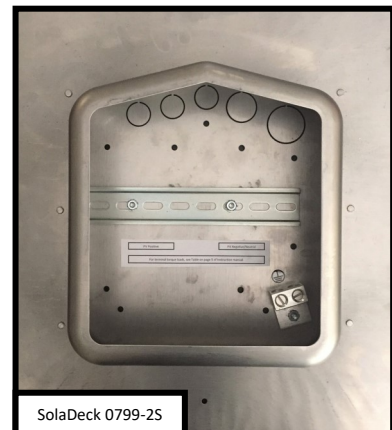

Product data sheet

Specifications



Safety switch, general duty, non fusible, 60A, 2 pole, 10hp, 240VAC, NEMA 3R, bolt on provision

DU222RB

Product availability : Stock - Normally stocked in distribution facility

Price* : 353.00 USD

Main

Product	Single Throw Safety Switch
Duty Rating	General duty
Device Application	Residential
Disconnect Type	Non-fusible disconnect switch
Factory Installed Neutral	None
Phase	3 phase
Number of Poles	2
Current Rating	60 A
Voltage Rating	240 V AC
Enclosure Rating NEMA	NEMA 3R
Motor power hp	10 hp at 240 V AC 60 Hz for 1 phase motors

Complementary

Mounting Type	Surface
Electrical Connection	Lugs
Wiring configuration	2 wires
Wire Size	AWG 12...AWG 3 aluminium AWG 14...AWG 3 copper
Tightening torque	35 lbf.in (3.95 N.m) 0.00...0.01 in² (2.08...5.26 mm²) (AWG 14...AWG 10) 35 lbf.in (3.95 N.m) (AWG 14...AWG 10) 45 lbf.in (5.08 N.m) 0.01 in² (8.37 mm²) (AWG 8) 45 lbf.in (5.08 N.m) 0.02...0.03 in² (12.3...21.12 mm²) (AWG 6...AWG 4) 50 lbf.in (5.65 N.m) 0.04 in² (26.67 mm²) (AWG 3)
Depth	3.75 in (95.25 mm)
Width	7.75 in (196.85 mm)
Height	9.63 in (244.60 mm)
Net Weight	16.98 lb(US) (7.7 kg)

Environment

Certifications	UL listed file E2875
----------------	----------------------

* Price is “List Price” and may be subject to a trade discount – check with your local distributor or retailer for actual price.

Ordering and shipping details

Category	00106-D & DU SW,NEMA3R, 30-200A
Discount Schedule	DE1A
GTIN	785901491491
Returnability	Yes
Country of origin	MX

Packing Units

Unit Type of Package 1	PCE
Number of Units in Package 1	1
Package 1 Height	5.30 in (13.462 cm)
Package 1 Width	7.20 in (18.288 cm)
Package 1 Length	10.00 in (25.4 cm)
Package 1 Weight	4.65 lb(US) (2.109 kg)
Unit Type of Package 2	PAL
Number of Units in Package 2	120
Package 2 Height	36.50 in (92.71 cm)
Package 2 Width	40.00 in (101.6 cm)
Package 2 Length	48.00 in (121.92 cm)
Package 2 Weight	610.00 lb(US) (276.691 kg)
Unit Type of Package 3	CAR
Number of Units in Package 3	5
Package 3 Height	10.70 in (27.178 cm)
Package 3 Width	10.20 in (25.908 cm)
Package 3 Length	23.50 in (59.69 cm)
Package 3 Weight	24.60 lb(US) (11.158 kg)


Offer Sustainability

Sustainable offer status	Green Premium product
California proposition 65	WARNING: This product can expose you to chemicals including: Lead and lead compounds, which is known to the State of California to cause cancer and birth defects or other reproductive harm. For more information go to www.P65Warnings.ca.gov
REACH Regulation	REACH Declaration
REACH free of SVHC	Yes
EU RoHS Directive	Compliant EU RoHS Declaration
Toxic heavy metal free	Yes
Mercury free	Yes
China RoHS Regulation	China RoHS declaration Pro-active China RoHS declaration (out of China RoHS legal scope)
RoHS exemption information	Yes
Environmental Disclosure	Product Environmental Profile
PVC free	Yes

Contractual warranty


Warranty	18 months
----------	-----------

Dimensions

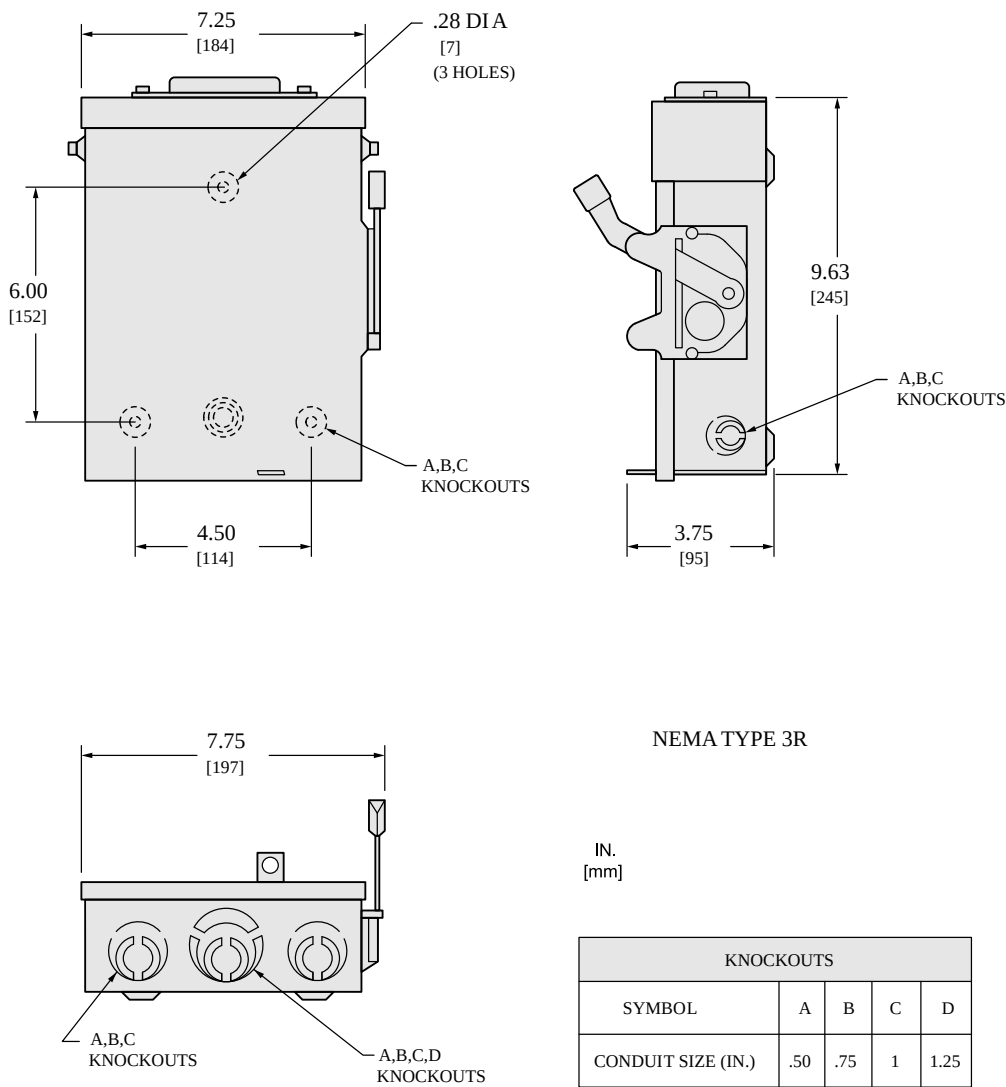

TOP OF NEMA TYPE 3R SWITCHES HAVE PROVISIONS FOR MAXIMUM 2 1/2" BO LT-ON HUB.
ALL DIMENSIONS ARE APPROXIMATE. REFER TO TECHNICAL DRAWINGS AND DOCUMENTATION.


Wiring Diagram

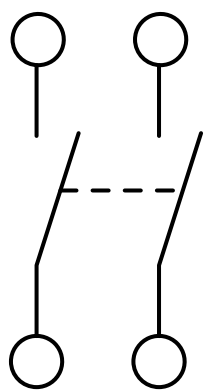

DU222RB


Recommended replacement(s)

XR Rail® Assembly Overview

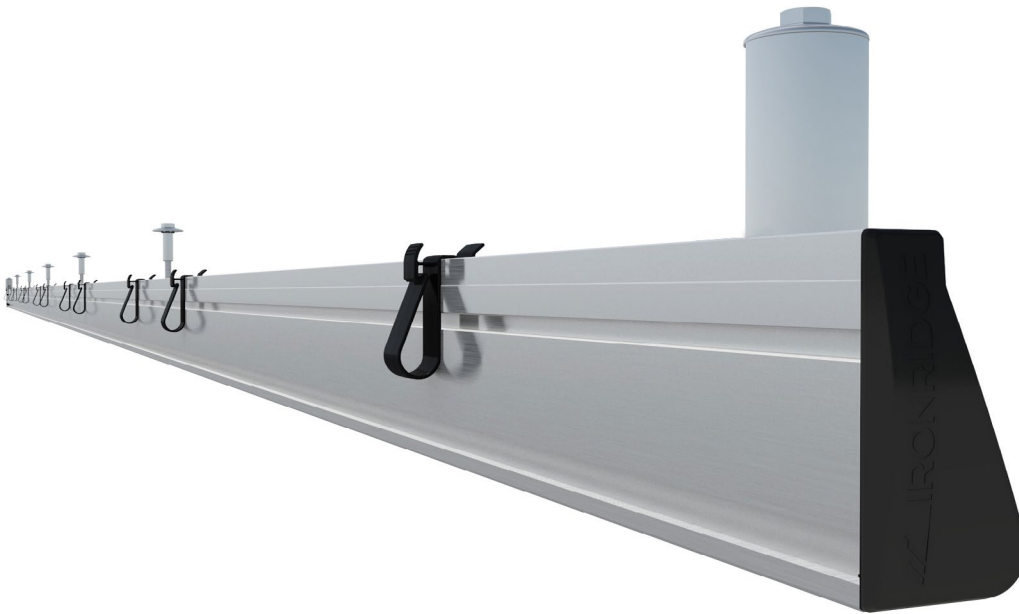

Our product development team strives to keep things simple and intuitive for installers while accommodating a wide range of mounting scenarios. As a result, we offer three complementary types of rail within the XR Rail® Family. Please refer to our website or contact our customer service team so that we can best assist in determining which rail assembly is best for you and your specific project.

XR Rail®

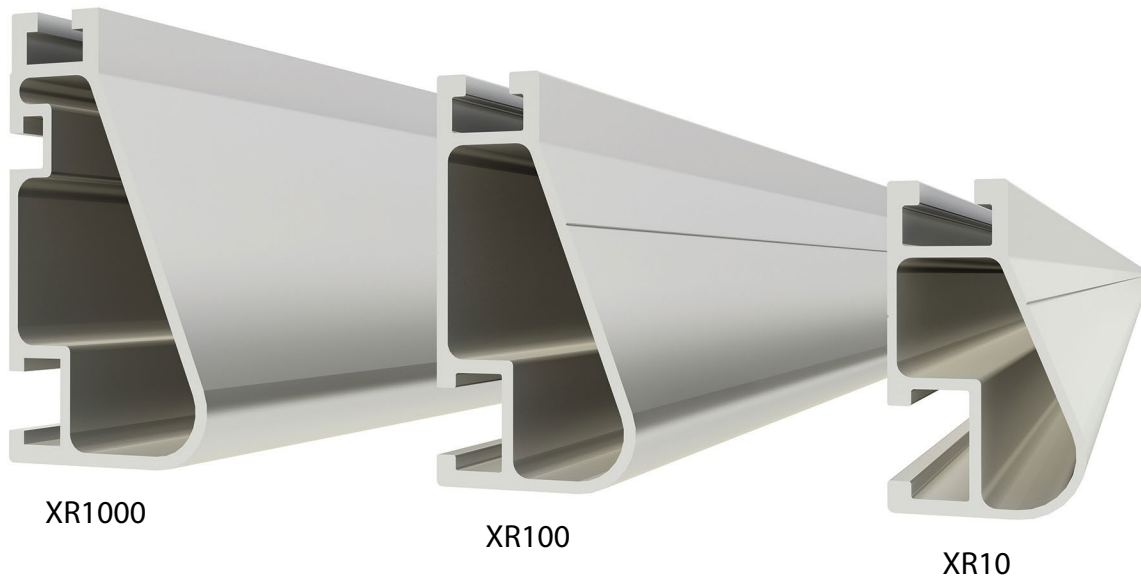

Item Number	Description	Item Number	Description
XR-1000-168A	XR1000, Rail 168" (14 Feet) Clear	XR-10-168A	XR10, Rail 168" (14 Feet) Clear
XR-1000-204A	XR1000, Rail 204" (17 Feet) Clear	XR-10-168B	XR10, Rail 168" (14 Feet) Black
XR-100-168A	XR100, Rail 168" (14 Feet) Clear	XR-10-204A	XR10, Rail 204" (17 Feet) Clear
XR-100-168B	XR100, Rail 168" (14 Feet) Black	XR-10-204B	XR10, Rail 204" (17 Feet) Black
XR-100-204A	XR100, Rail 204" (17 Feet) Clear		
XR-100-204B	XR100, Rail 204" (17 Feet) Black		

The XR Rail Family offers the strength of a curved rail in three targeted sizes. Each size supports specific design loads, while minimizing material costs. Depending on your location, there is an XR Rail to match. XR1000® is a heavyweight among solar mounting rails. It's built to handle extreme climates and spans 12 feet or more for commercial applications. XR100® is the ultimate residential mounting rail. It supports a range of wind and snow conditions, while also maximizing spans. XR10® is a sleek, low-profile mounting rail, perfectly matched to regions with light or no snow. It achieves 6 foot spans, while also staying light and economical.

BOSS® Bonded Structural Splices



Item Number	Description
XR10-BOSS-01-M1	Bonded Strucutral Splice, XR10
XR100-BOSS-01-M1	Bonded Strucutral Splice, XR100
XR1000-BOSS-01-M1	Bonded Strucutral Splice, XR1000

The BOSS® (Bonded Structural Splice) provides a truly seamless, hidden connection for XR Rails®. Built-in, one-piece springs feature bonding teeth that bite inside the rail, creating a bonded rail connection and meeting all UL standards without any extra tools or hardware. In addition, BOSS® eliminates installation restrictions. Place it anywhere except the outside cantilever.

Universal Fastening Objects (UFO®)



Item Number	Description
UFO-CL-01-A1	Universal Module Clamp, Clear
UFO-CL-01-B1	Universal Module Clamp, Black

The IronRidge UFO® (Universal Fastening Object) is a single-size, single-piece fastener, built to quickly and securely bond any solar modules to XR Rails. It comes fully-lubricated and fully-assembled, and it looks just as good as it performs. When combined with a Stopper Sleeve, the UFO® functions as an end clamp. It comes in two finishes: Clear and Black.

Calculating Rail Length

Calculate the row lengths as follows:

1. Add module widths.
2. Add width of UFO® between modules.
3. Add allowances for UFO® and Stopper Sleeves on ends of rail.

Depending on the location of the UFO®, the clearance values will differ.

Location	UFO®
Mid Clamp	0.375"
End Clamp	1.0"

For example, to mount five modules that are each 40" wide (in portrait), the row length is calculated as follows:

Step	UFO®
1. Add module widths	$5 \times 40" = 200"$
2. Add width of mid clamps between modules	$4 \times 0.375" = 1.5"$
3. Add allowances for end clamps	$2 \times 1" = 2$
Total length of row	$203.5" = 16.96'$

Two 17' rails will be required to mount this row of five modules.

IronRidge stock rail lengths: 11', 14', 17'. Custom lengths available via special order. Contact IronRidge Customer Service for additional details at 800-227-9523, or support@ironridge.com.