

NEW PHOTOVOLTAIC SYSTEM 14.260kW DC / 11.500kW AC
NEW ENERGY STORAGE SYSTEM 13.500kWh
335 DEANNE LANE, COATS, NC 27521

AHJ

NC-COUNTY OF HARNETT

UTILITY

DUKE ENERGY (PROGRESS ENERGY CAROLINAS INC)

CODES AND STANDARDS


ELECTRIC CODE: NEC 2017 WITH NC AMENDMENTS
FIRE CODE: NCFC 2018
BUILDING CODE: NCBC 2018
RESIDENTIAL CODE: NCRC 2018
WIND SPEED: 118 MPH SOLAR LAYOUT MEETS 120 MPH DESIGN
SNOW LOAD: 15 PSF WIND SPEED REQUIREMENTS

HIGH TEMP: 36°C, LOW TEMP: -8.5°C

SCOPE OF WORK

(N) 14.260kW DC / 11.500kW AC ROOF MOUNT PV SYSTEM
(N) 13.500kWh ENERGY STORAGE SYSTEM
(31) CANADIAN SOLAR CS6.1-54TM-460H MODULE
(1) TESLA POWERWALL 3 INTEGRATED SOLAR BATTERY
1707000-XX-Y (240V) INVERTER
(18) TESLA SOLAR SHUTDOWN DEVICE (MCI-1)
(1) TESLA GATEWAY 3 (1841000-X1-Y)

VICINITY MAP

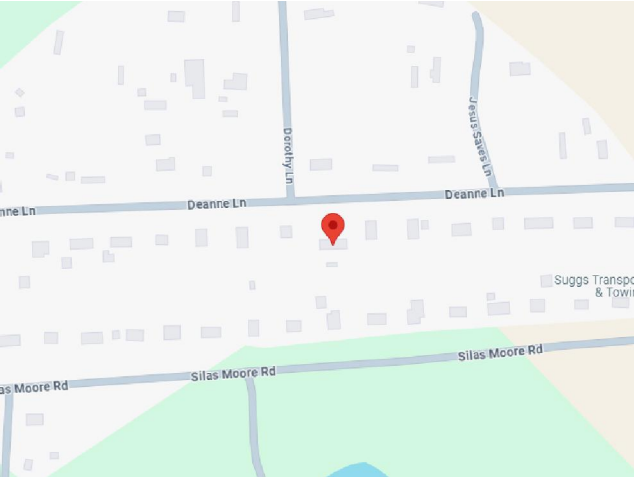

SHEET CATALOG

PV-1	COVER SHEET
PV-1.1	GENERAL NOTES
PV-2	SITE PLAN-1
PV-2.1	SITE PLAN-2
PV-3	MOUNTING DETAILS
PV-3.1	STRUCTURAL DETAILS
PV-4	SINGLE LINE DIAGRAM
PV-4.1	ELECTRICAL CALCULATIONS
PV-5	PLACARDS
SS	SPEC SHEETS

METER NUMBER: 349 487 519

CONTRACTOR INFORMATION



YES SOLAR SOLUTIONS
ADDRESS: 202 NORTH DIXON AVENUE, CARY, NC 27513
PHONE NUMBER: (919) 375-0757
LICENSE NUMBER: NC GC #67356; NC ELECTRIC #U.32326
LICENSE TYPE: NC GC/ELECTRIC

CUSTOMER INFORMATION

NAME: RIDDLE RESIDENCE

ADDRESS: 335 DEANNE LANE, COATS, NC 27521

COORDINATES: 35.437243, -78.620282
APN: 071611005847

14.260kW DC / 11.500kW AC ROOF MOUNT PV SYSTEM
13.500kWh ENERGY STORAGE SYSTEM



STRUCTURAL
05.05.2025
STRUCTURAL REVIEW PROVIDED BY:
RONALD P. BITTLER, PE
RB ENGINEERING, INC. (C-2499)
168 QUADE DRIVE
CARY, NC 27513
919-677-9662
PROJECT #RB-25480

PROJECT ID	AUR-1012369
DATE	5/3/2025
CREATED BY	VK
SIGNATURE	

COVER SHEET
PV-1

NOTES:

- 1. MODULES ARE LISTED UNDER UL 1703 / UL 61730 AND CONFORM TO THE STANDARDS.
- 2. INVERTERS ARE LISTED UNDER UL 1741 AND CONFORM TO THE STANDARDS.
- 3. DRAWINGS ARE DIAGRAMMATIC, INDICATING GENERAL ARRANGEMENT OF THE PV SYSTEM. ACTUAL SITE CONDITIONS MAY VARY.
- 4. WORKING CLEARANCES AROUND THE NEW PV ELECTRICAL EQUIPMENT SHALL BE MAINTAINED IN ACCORDANCE WITH NEC 110.26.
- 5. ALL GROUND WIRING CONNECTED TO THE MAIN SERVICE GROUNDING IN MAIN SERVICE PANEL / SERVICE EQUIPMENT.
- 6. ALL CONDUCTORS SHALL BE 600V, 90°C STANDARD COPPER UNLESS OTHERWISE NOTED.
- 7. WHEN REQUIRED, A LADDER SHALL BE IN PLACE FOR INSPECTION IN COMPLIANCE WITH OSHA REGULATIONS.
- 8. THE SYSTEM WILL NOT BE INTERCONNECTED BY THE CONTRACTOR UNTIL APPROVAL FROM UTILITY IS RECEIVED.
- 9. ROOF ACCESS POINT SHALL BE LOCATED IN AREAS THAT DO NOT REQUIRE THE PLACEMENT OF GROUND LADDERS OVER OPENINGS SUCH AS WINDOWS OR DOORS, AND LOCATED AT STRONG POINTS OF BUILDING CONSTRUCTION WHERE THE ACCESS POINT DOES NOT CONFLICT WITH OVERHEAD OBSTRUCTIONS SUCH AS TREES, WIRES OR SIGNS.
- 10. PV ARRAY COMBINER / JUNCTION BOX PROVIDES TRANSITION FROM ARRAY WIRING TO CONDUIT WIRING.
- 11. RACKING SYSTEM SHALL BE LISTED TO UL 2703.
- 12. FIRE RATING OF EXISTING ROOF ASSEMBLY SHALL BE MAINTAINED WITH ADDITION OF PHOTOVOLTAIC SYSTEM.

CONTRACTOR INFORMATION



YES SOLAR SOLUTIONS

ADDRESS: 202 NORTH DIXON AVENUE, CARY, NC 27513

PHONE NUMBER: (919) 375-0757

LICENSE NUMBER: NC GC #67356; NC ELECTRIC #U.32326

LICENSE TYPE: NC GC/ELECTRIC

CUSTOMER INFORMATION

NAME: RIDDLE RESIDENCE

ADDRESS: 335 DEANNE LANE, COATS, NC 27521

COORDINATES: 35.437243, -78.620282

APN: 071611005847

14.260kW DC / 11.500kW AC ROOF MOUNT PV SYSTEM
13.500kWh ENERGY STORAGE SYSTEM

PROJECT ID AUR-1012369

DATE 5/3/2025

CREATED BY VK

SIGNATURE

GENERAL NOTES
PV-1.1

SCOPE OF WORK

- (N) 14.260kW DC / 11.500kW AC ROOF MOUNT PV SYSTEM
- (N) 13.500kWh ENERGY STORAGE SYSTEM
- (31) CANADIAN SOLAR CS6.1-54TM-460H MODULE
- (1) TESLA POWERWALL 3 INTEGRATED SOLAR BATTERY
- 1707000-XX-Y (240V) INVERTER
- (18) TESLA SOLAR SHUTDOWN DEVICE (MCI-1)
- (1) TESLA GATEWAY 3 (1841000-X1-Y)

TOTAL ARRAY AREA = 680.73 SQ.FT
TOTAL ROOF AREA = 2684.34 SQ.FT
% ARRAY AREA IN ROOF = 25.35%


NOTE: NO GATE AND FENCE.

LEGEND

PROPERTY LINE



SCALE:1" = 30'-0"

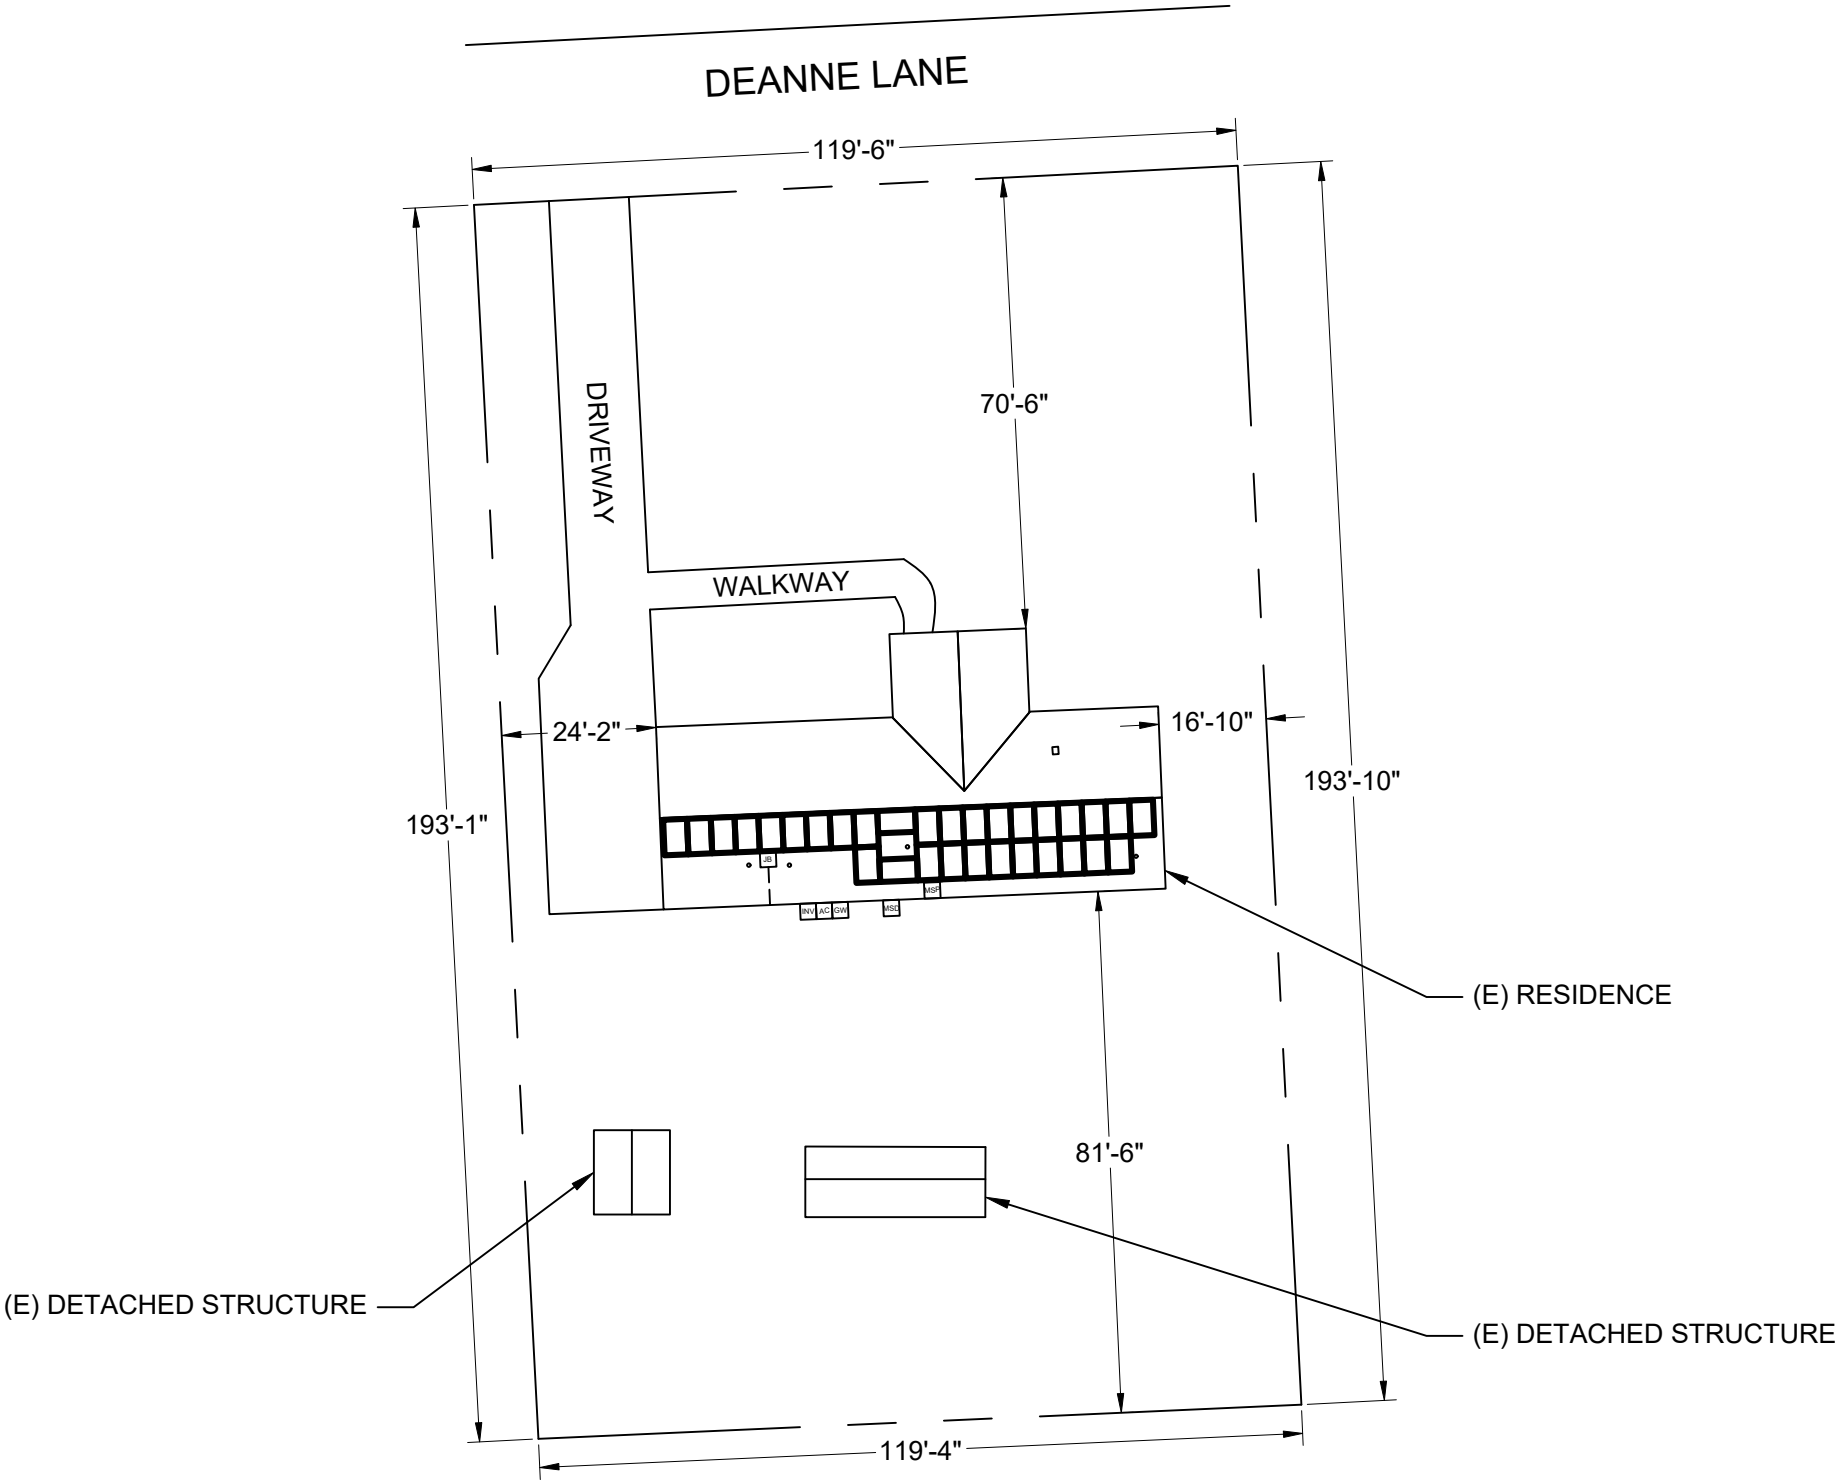

CONTRACTOR INFORMATION



YES SOLAR SOLUTIONS
ADDRESS: 202 NORTH DIXON AVENUE, CARY, NC 27513
PHONE NUMBER: (919) 375-0757
LICENSE NUMBER: NC GC #67356; NC ELECTRIC #U.32326
LICENSE TYPE: NC GC/ELECTRIC

CUSTOMER INFORMATION

NAME: RIDDLE RESIDENCE
ADDRESS: 335 DEANNE LANE, COATS, NC 27521
COORDINATES: 35.437243, -78.620282
APN: 071611005847
14.260kW DC / 11.500kW AC ROOF MOUNT PV SYSTEM
13.500kWh ENERGY STORAGE SYSTEM

PROJECT ID	AUR-1012369
DATE	5/3/2025
CREATED BY	VK
SIGNATURE	

SITE PLAN-1
PV-2

SCOPE OF WORK

- (N) 14.260kW DC / 11.500kW AC ROOF MOUNT PV SYSTEM
- (N) 13.500kWh ENERGY STORAGE SYSTEM
- (31) CANADIAN SOLAR CS6.1-54TM-460H MODULE
- (1) TESLA POWERWALL 3 INTEGRATED SOLAR BATTERY
- 1707000-XX-Y (240V) INVERTER
- (18) TESLA SOLAR SHUTDOWN DEVICE (MCI-1)
- (1) TESLA GATEWAY 3 (1841000-X1-Y)


TOTAL ARRAY AREA = 680.73 SQ.FT
TOTAL ROOF AREA = 2684.34 SQ.FT
% ARRAY AREA IN ROOF = 25.35%

LEGEND

- VENT (ROOF OBSTRUCTION)
- UTILITY METER WITH MAIN SERVICE DISCONNECT
- MAIN SERVICE PANEL
- AC DISCONNECT
- TESLA BACKUP GATEWAY 3
- INVERTER WITH INTEGRATED SOLAR BATTERY
- JUNCTION BOX



SCALE:1" = 10'-0"

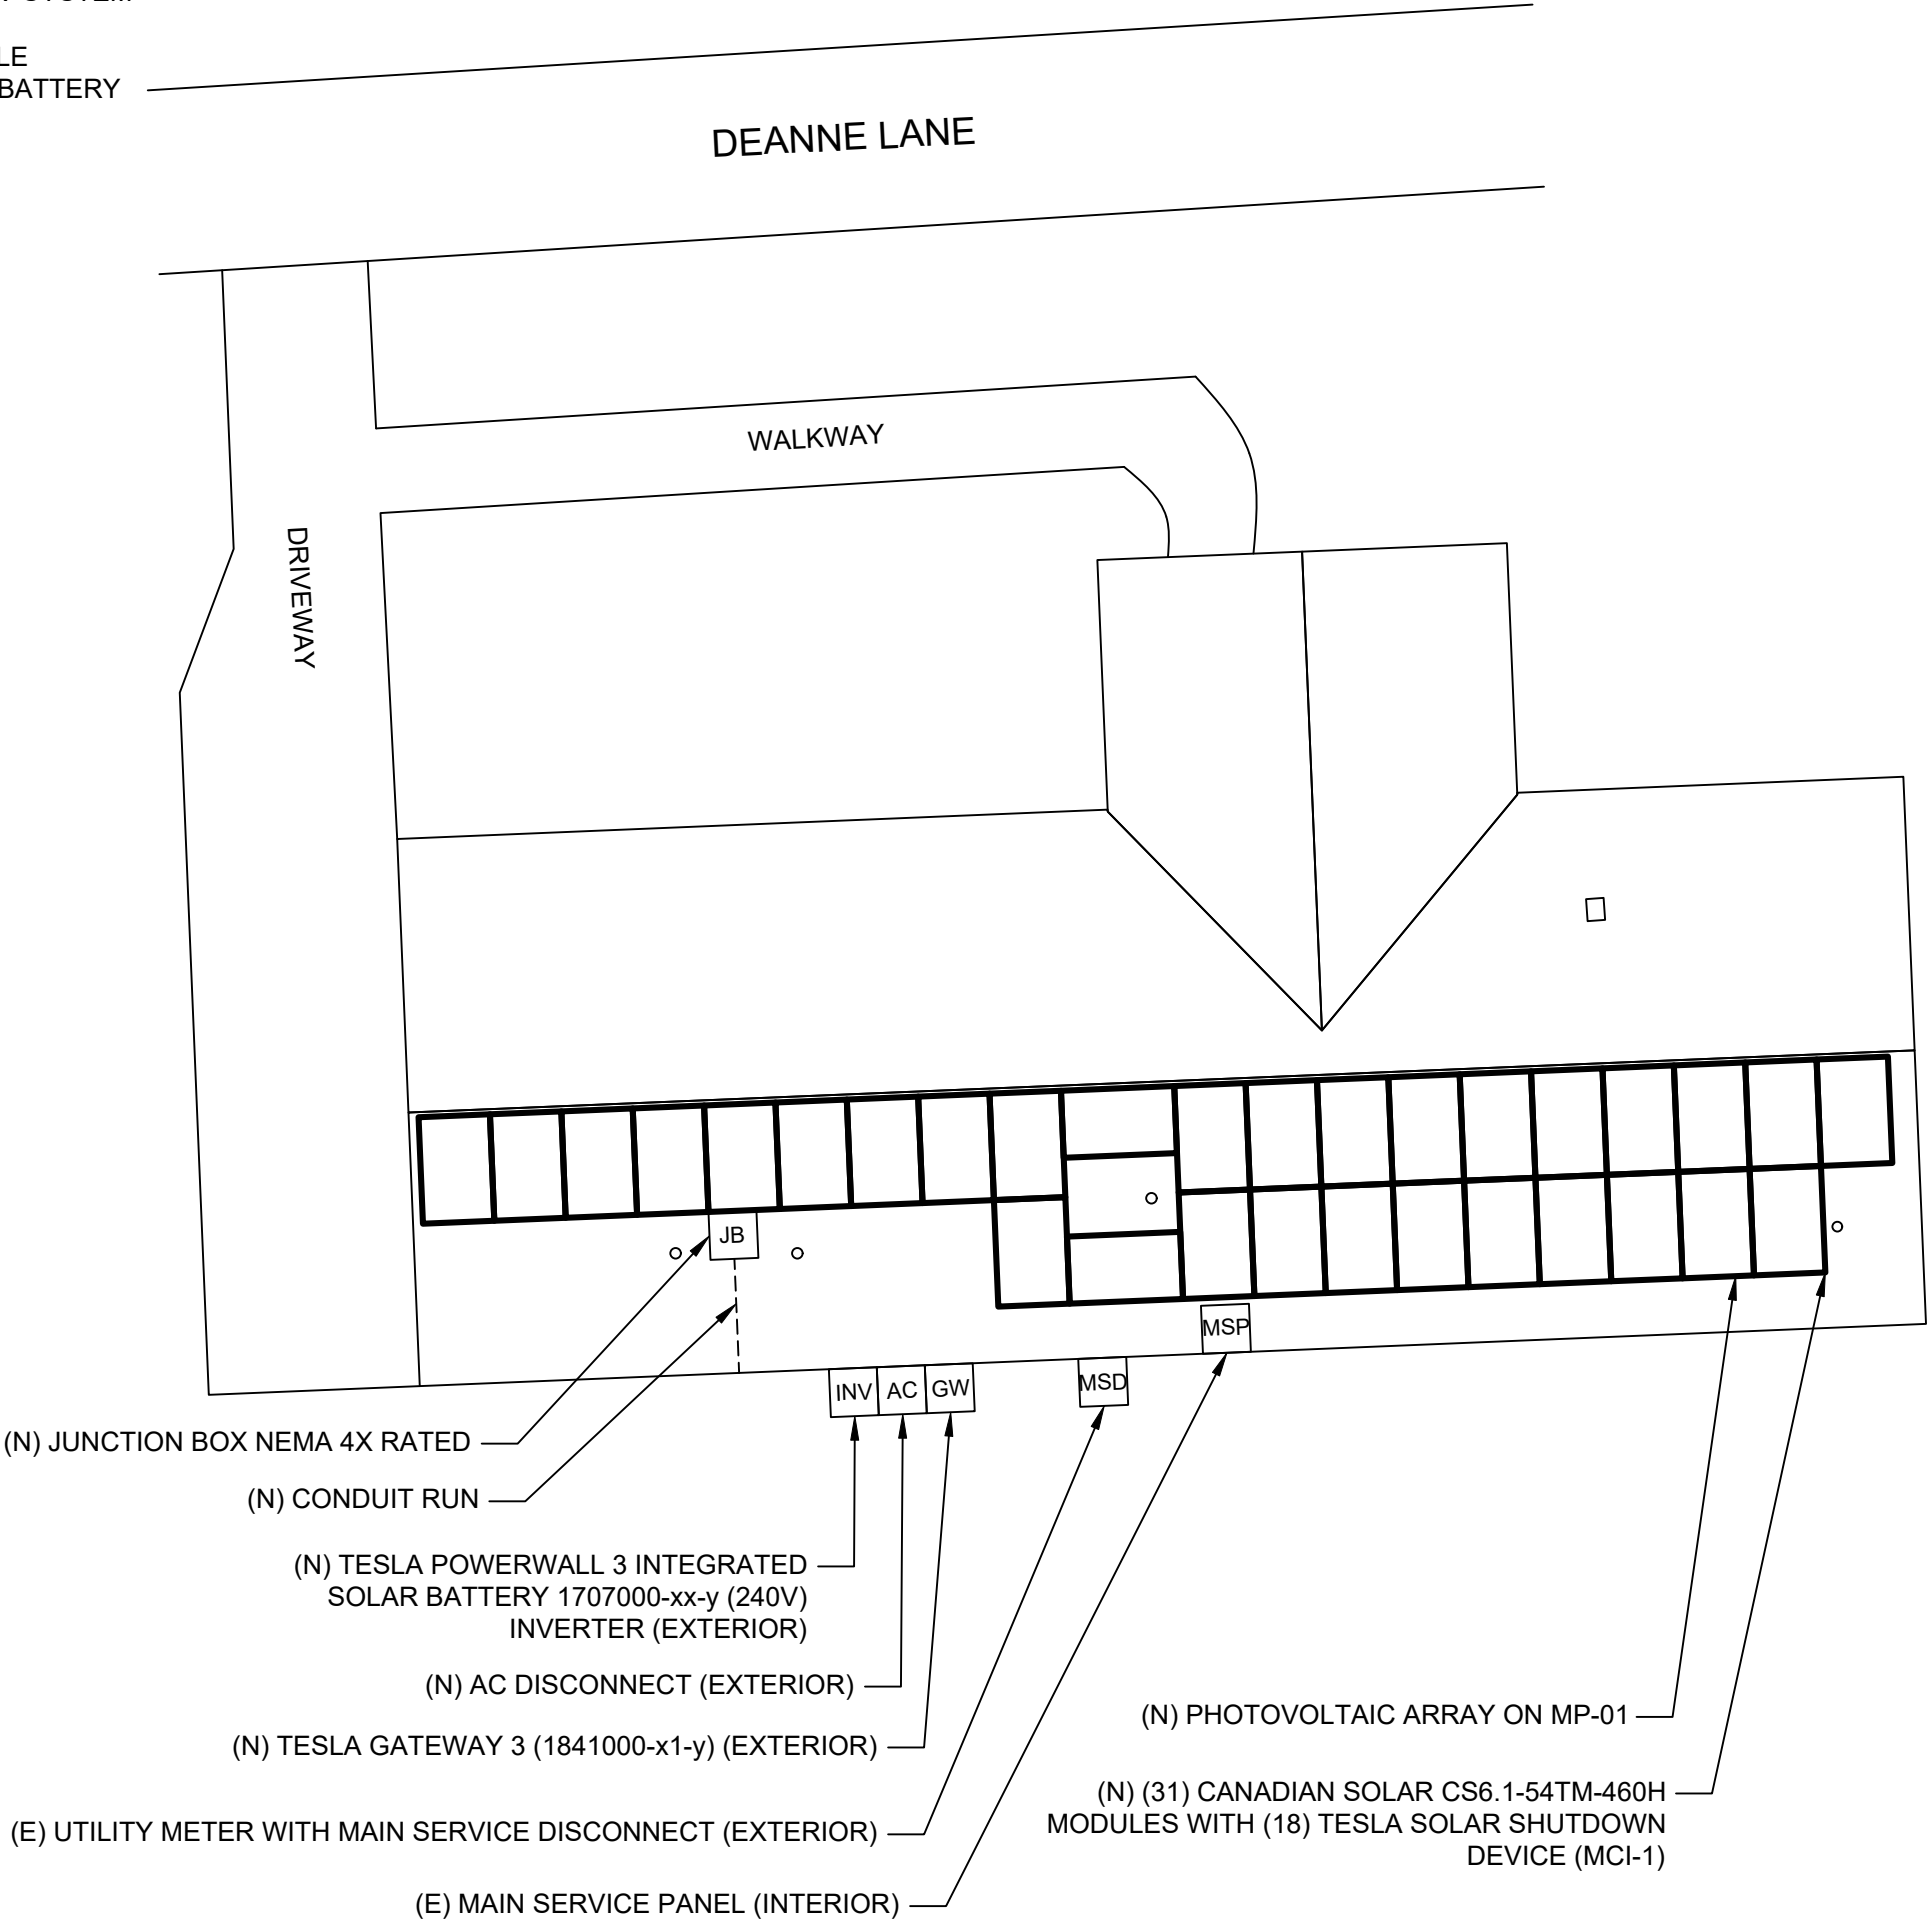

CONTRACTOR INFORMATION



YES SOLAR SOLUTIONS
ADDRESS: 202 NORTH DIXON AVENUE, CARY, NC 27513
PHONE NUMBER: (919) 375-0757
LICENSE NUMBER: NC GC #67356; NC ELECTRIC #U.32326
LICENSE TYPE: NC GC/ELECTRIC

CUSTOMER INFORMATION


NAME: RIDDLE RESIDENCE
ADDRESS: 335 DEANNE LANE, COATS, NC 27521
COORDINATES: 35.437243, -78.620282
APN: 071611005847
14.260kW DC / 11.500kW AC ROOF MOUNT PV SYSTEM
13.500kWh ENERGY STORAGE SYSTEM

PROJECT ID	AUR-1012369
DATE	5/3/2025
CREATED BY	VK
SIGNATURE	

SITE PLAN-2
PV-2.1

WIND SPEED: 118 MPH AND SNOW LOAD: 15 PSF													
S.NO	AZIMUTH	PITCH	NO. OF MODULES	ARRAY AREA (SQ.FT)	ROOF TYPE	ATTACHMENT	ATTACHMENT QUANTITY	ROOF EXPOSURE	FRAME TYPE	FRAME SIZE	FRAME SPACING	MAX ATTACHMENT SPACING	MAX OVER HANG
MP-01	178°	20°	31	680.73	COMPOSITION SHINGLE	SNAPNRACK ULTRA RAIL COMP KIT	71	ATTIC	PRE-FABRICATED TRUSSES	2" X 2"	24" O.C.	4'-0"	1'-6"

NOTE: PENETRATIONS ARE STAGGERED.

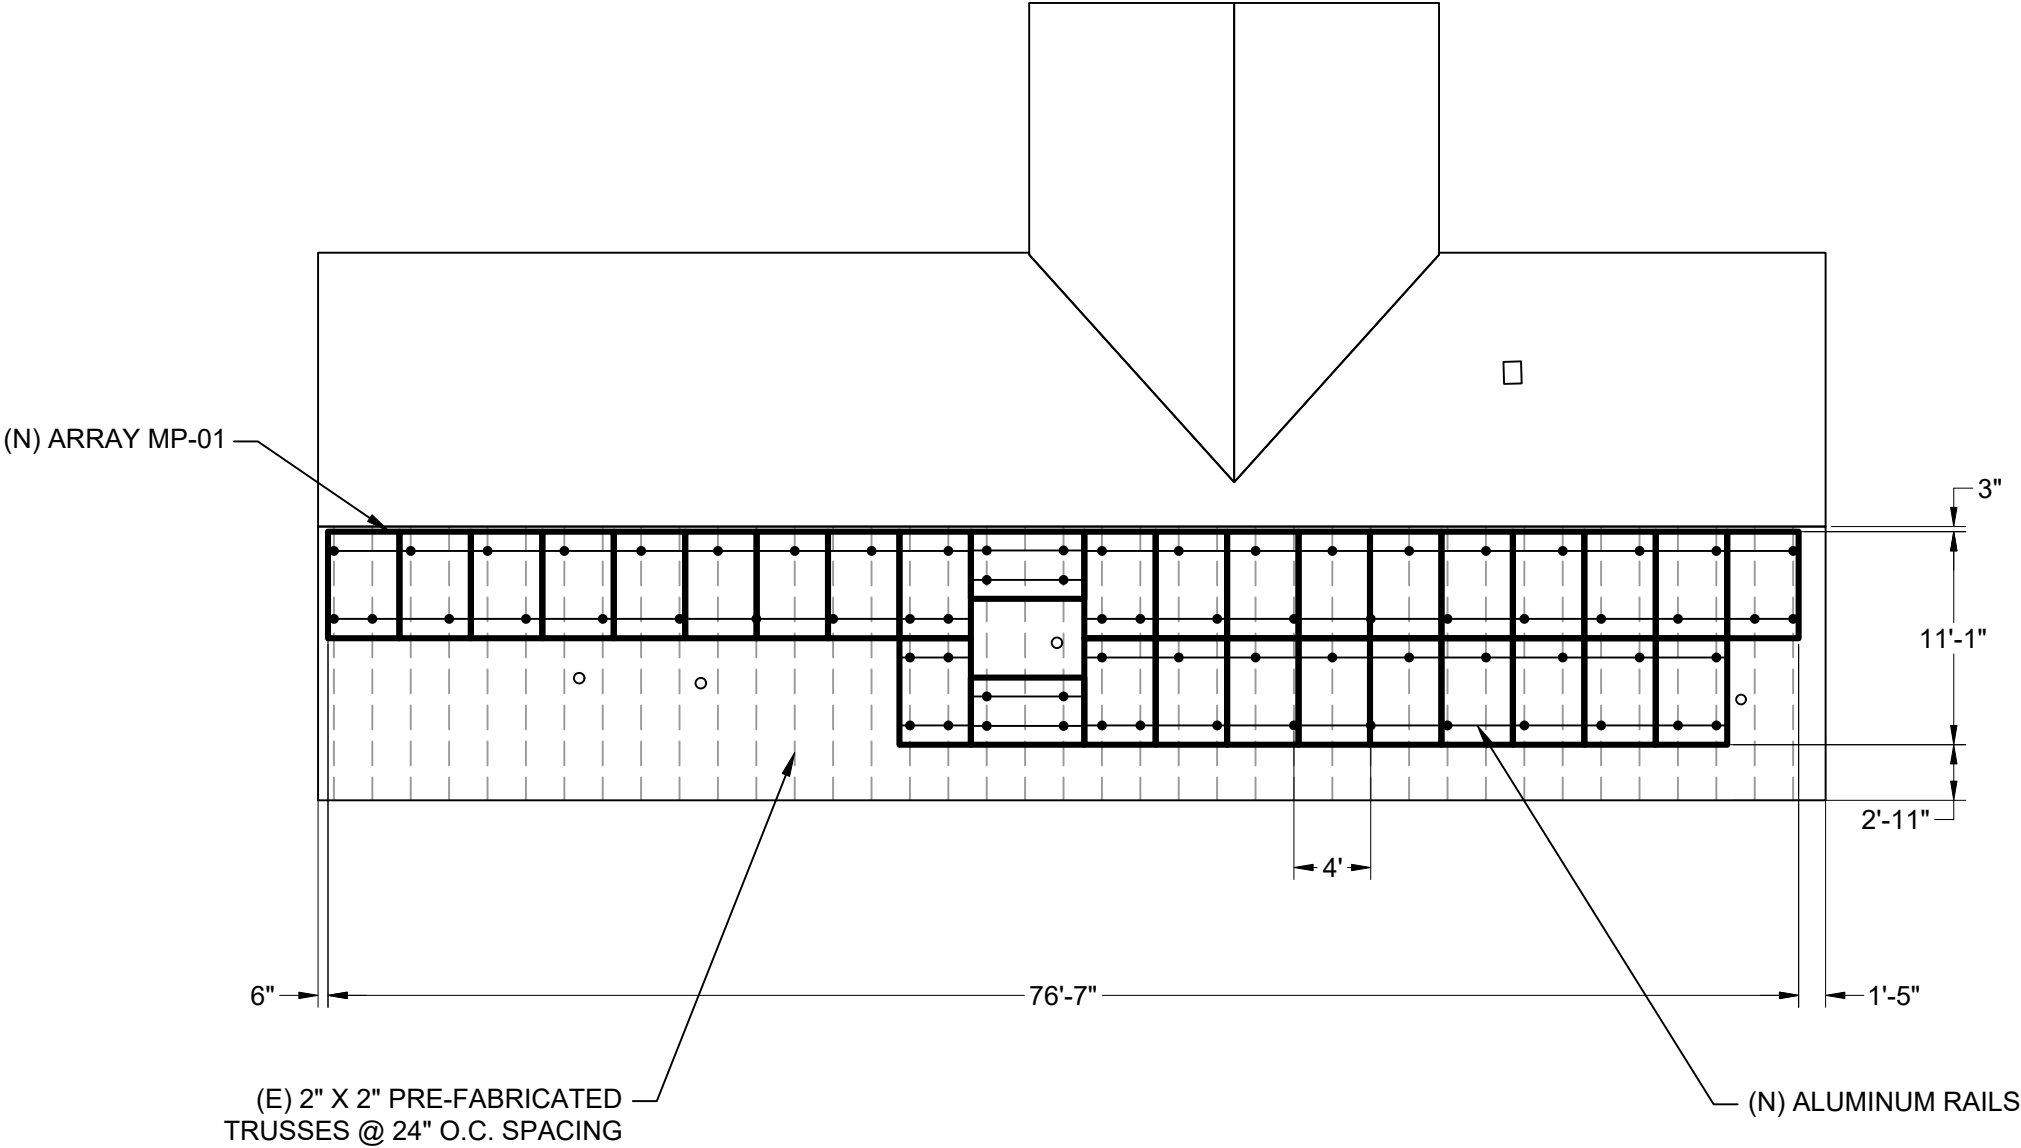

LEGEND

MODULE

RAIL

ATTACHMENT


ROOF FRAME

VENT
(ROOF OBSTRUCTION)



SCALE:1" = 10'-0"

CONTRACTOR INFORMATION



YES SOLAR SOLUTIONS

ADDRESS: 202 NORTH DIXON AVENUE, CARY, NC 27513

PHONE NUMBER: (919) 375-0757

LICENSE NUMBER: NC GC #67356; NC ELECTRIC #U.32326

LICENSE TYPE: NC GC/ELECTRIC

CUSTOMER INFORMATION

NAME: RIDDLE RESIDENCE


ADDRESS: 335 DEANNE LANE, COATS, NC 27521

COORDINATES: 35.437243, -78.620282

APN: 071611005847

14.260kW DC / 11.500kW AC ROOF MOUNT PV SYSTEM

13.500kWh ENERGY STORAGE SYSTEM



05.05.2025

PROJECT ID	AUR-1012369
DATE	5/3/2025
CREATED BY	VK
SIGNATURE	

MOUNTING DETAILS

PV-3

STRUCTURAL NOTES

1. ALL SOLAR PANEL COMPONENTS SHALL BE INSTALLED PER THE MANUFACTURER'S APPROVED INSTALLATION SPECIFICATIONS.

2. THE EXISTING BUILDING'S STRUCTURE SHALL BE VERIFIED AS PROPERLY CONSTRUCTED AND MAINTAINED IN GOOD CONDITION. NO ALLOWANCE HAS BEEN MADE FOR ANY EXISTING DEFICIENCY IN DESIGN, MATERIAL, CONSTRUCTION, OR LACK OF MAINTENANCE FOR THE EXISTING STRUCTURE OR PROPOSED EQUIPMENT. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS, PROPER FIT, AND CLEARANCES IN THE FIELD.

3. IF ANY CONDITION THROUGHOUT THE ASSOCIATED REPORT OR PERMIT DRAWINGS IS NOT REPRESENTED ON-SITE, CONTRACTOR SHALL NOTIFY THE ENGINEER OF RECORD (EOR) OF ANY DISCREPANCIES AND RECEIVE WRITTEN APPROVAL FROM THE EOR BEFORE PROCEEDING WITH INSTALLATION.



4. MISCELLANEOUS ITEMS NOT EXPLICITLY NAMED & SHOWN IN THESE DRAWINGS HAVE NOT BEEN DESIGNED. IT IS RECOMMENDED THAT MATERIAL OF SUITABLE SIZE & STRENGTH BE OBTAINED FROM A REPUTABLE MANUFACTURER FOR MISCELLANEOUS ITEMS.

5. CONTRACTOR SHALL BE RESPONSIBLE TO COMPLETE, SEAL, & WATERPROOF ROOFTOP PENETRATIONS FOR SOLAR RACKING.


6. CONTRACTOR TO PROVIDE MINIMUM 1/4" GAP BETWEEN ALL SOLAR PANELS.

7. PROJECT WINDSPEED IS BASIC WIND SPEED PER CODE UNLESS NOTED OTHERWISE.

DEAD LOAD CALCULATIONS			
BOM	QUANTITY	LBS/UNIT	TOTAL WEIGHT (LBS)
MODULES	31	50.7	1571.7
MID-CLAMP	50	0.17	8.5
END-CLAMP	24	0.3	7.2
RAIL LENGTH	245	0.42	102.9
SPLICE BAR	12	0.52	6.24
SNAPNRACK ULTRA RAIL COMP KIT	71	1.03	73.13
MCI DEVICE	18	0.77	13.86
TOTAL WEIGHT OF THE SYSTEM (LBS)			1783.53
TOTAL ARRAY AREA ON THE ROOF (SQ. FT.)			680.73
WEIGHT PER SQ. FT.(LBS)			2.61
WEIGHT PER PENETRATION (LBS)			25.12

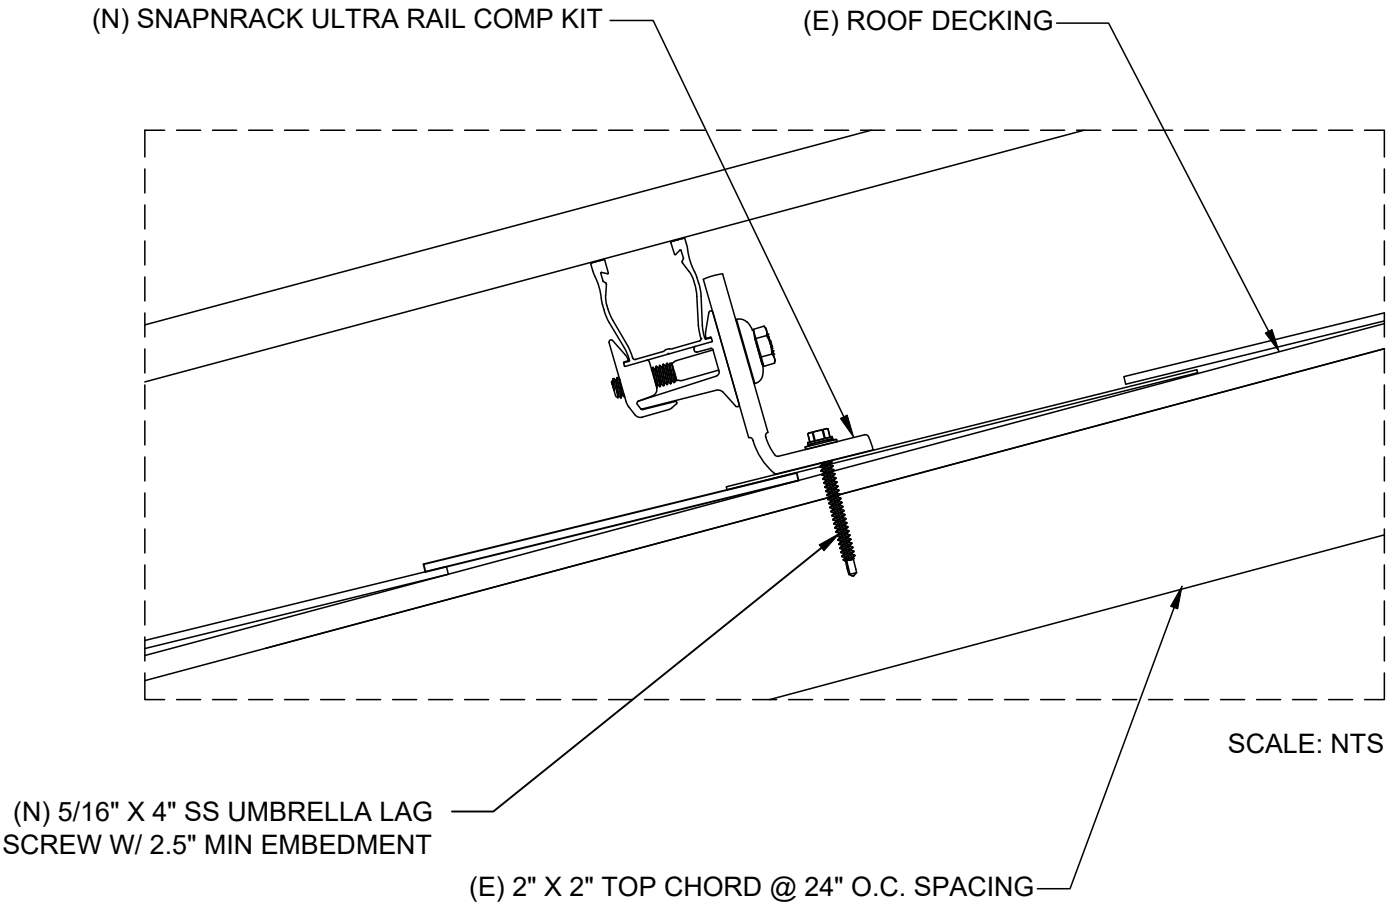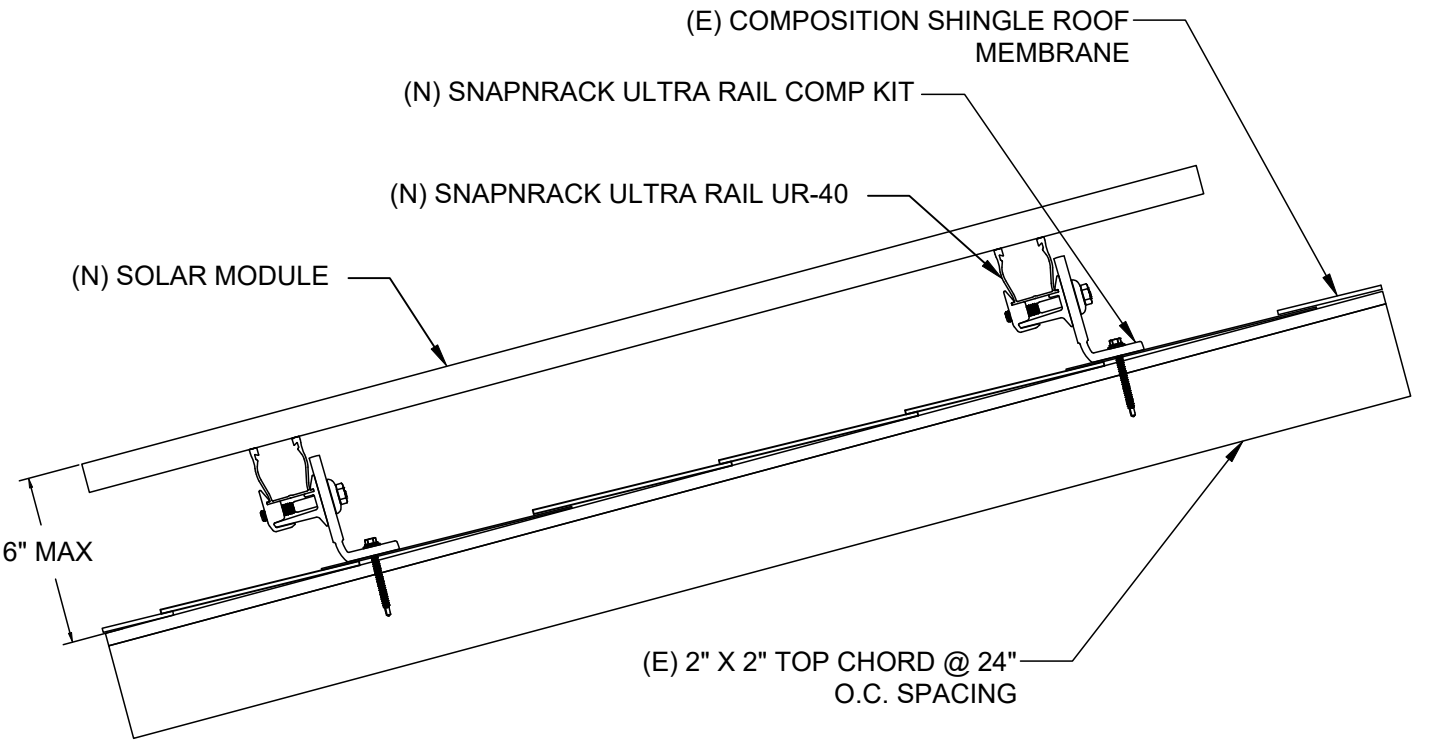

CONTRACTOR INFORMATION



YES SOLAR SOLUTIONS

ADDRESS: 202 NORTH DIXON AVENUE, CARY, NC 27513

PHONE NUMBER: (919) 375-0757

LICENSE NUMBER: NC GC #67356; NC ELECTRIC #U.32326

LICENSE TYPE: NC GC/ELECTRIC

CUSTOMER INFORMATION

NAME: RIDDLE RESIDENCE


ADDRESS: 335 DEANNE LANE, COATS, NC 27521

COORDINATES: 35.437243, -78.620282

APN: 071611005847

14.260kW DC / 11.500kW AC ROOF MOUNT PV SYSTEM

13.500kWh ENERGY STORAGE SYSTEM



05.05.2025

PROJECT ID	AUR-1012369
DATE	5/3/2025
CREATED BY	VK
SIGNATURE	

STRUCTURAL DETAILS
PV-3.1

MODULE SPECIFICATIONS	
MODEL	CANADIAN SOLAR CS6.1-54TM-460H
MODULE POWER @ STC	460W
OPEN CIRCUIT VOLTAGE:Voc	39.7V
MAX POWER VOLTAGE:Vmp	32.4V
SHORT CIRCUIT CURRENT:Isc	14.75A
MAX POWER CURRENT:Imp	14.20A
TEMPERATURE COEFFICIENT:Voc	-0.25%/°C
MODULE DIMENSIONS: L x W x H	70.9" x 44.6" x 1.18"
NUMBER OF MODULES	31

NOTE:

1. SYSTEM TO PROVIDE WHOLE HOME BACKUP.




(ROOF EQUIPMENT)

(GROUND LEVEL EQUIPMENT)




(N) (31) CANADIAN SOLAR CS6.1-54TM-460H
MODULE

(31) MODULE WIRED IN
(1) SERIES OF (6) MODULE (MPPT-1)
(1) SERIES OF (5) MODULE (MPPT-2)
(1) SERIES OF (5) MODULE (MPPT-3)
(1) SERIES OF (5) MODULE (MPPT-4)
(1) SERIES OF (5) MODULE (MPPT-5)
(1) SERIES OF (5) MODULE (MPPT-6)

(N) (18) TESLA SOLAR SHUTDOWN
DEVICE (MCI-1)

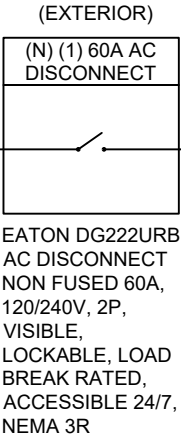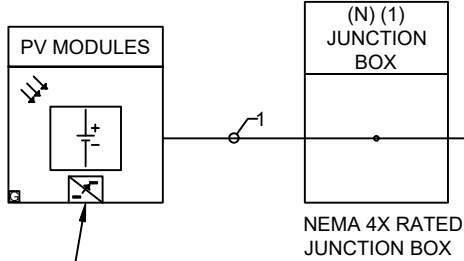


(EXTERIOR)
(N) (1) TESLA BACKUP
GATEWAY 3
(1841000-X1-Y)

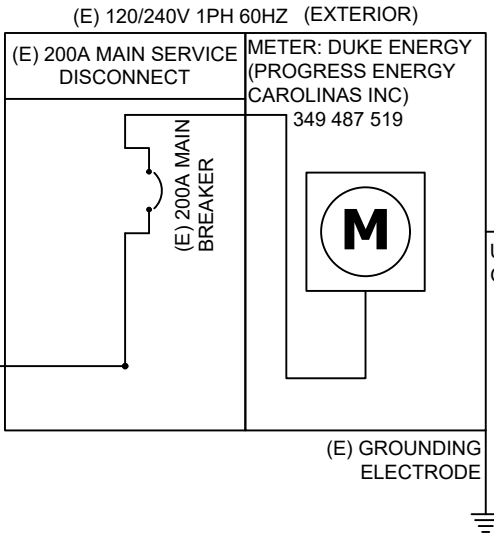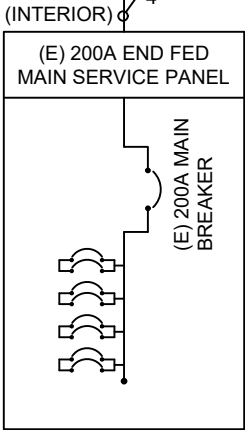

CONDUCTOR SCHEDULE				
TAG ID	CONDUIT SIZE	CONDUCTOR	NEUTRAL	GROUND
1	NONE	(12) 10 AWG PV WIRE	NONE	(1) 6 AWG BARE COPPER, EGC
2	1-1/4" PVC	(12) 8 AWG THHN/THWN-2, Cu	NONE	(1) 10 AWG THHN/THWN-2, EGC
3	1" EMT	(2) 4 AWG THHN/THWN-2, Cu	(1) 4 AWG THHN/THWN-2, Cu	(1) 10 AWG THHN/THWN-2, EGC
4	2" PVC	(2) 3/0 AWG THHN/THWN-2, Cu	(1) 3/0 AWG THHN/THWN-2, Cu	(1) 6 AWG THHN/THWN-2, EGC
5	NONE			(1) 4 AWG BARE COPPER, GEC

INVERTER-1 SPECIFICATIONS	
MODEL	TESLA POWERWALL 3 INTEGRATED SOLAR BATTERY 1707000-XX-Y (240V)
POWER RATING	11500W
MAX OUTPUT CURRENT	48A
CEC WEIGHTED EFFICIENCY	97.5%
MAX INPUT CURRENT	15A
MAX DC VOLTAGE	550V
NUMBER OF INVERTER	1

RSD CHARACTERISTICS	
MODEL	TESLA SOLAR SHUTDOWN DEVICE (MCI-1)
NOMINAL INPUT DC CURRENT	13A
MAX SYSTEM VOLTAGE	600VDC
MAX INPUT SHORT CIRCUIT CURRENT	19A
NUMBER OF RSD	18



YES SOLAR SOLUTIONS

YES SOLAR SOLUTIONS

ADDRESS: 202 NORTH DIXON AVENUE, CARY, NC 27513

PHONE NUMBER: (919) 375-0757

LICENSE NUMBER: NC GC #67356; NC ELECTRIC #U.32326

LICENSE TYPE: NC GC/ELECTRIC

CUSTOMER INFORMATION

NAME: RIDDLE RESIDENCE

ADDRESS: 335 DEANNE LANE, COATS, NC 27521

COORDINATES: 35.437243, -78.620282

APN: 071611005847

14.260kW DC / 11.500kW AC ROOF MOUNT PV SYSTEM

13.500kWh ENERGY STORAGE SYSTEM

PROJECT ID	AUR-1012369
DATE	5/3/2025
CREATED BY	VK
SIGNATURE	

SINGLE LINE DIAGRAM
PV-4


SYSTEM CHARACTERISTICS	
DC SYSTEM SIZE	14260W
MAX OPEN CIRCUIT VOLTAGE	258.14V
OPERATING VOLTAGE	194.4V
MAX SHORT CIRCUIT CURRENT	110.62A
OPERATING CURRENT	85.2A

OCPD CALCULATION	
ALLOWABLE BACKFEED: MAIN PANEL RATING = 200A MAIN BREAKER RATING = 200A	
INVERTER OVERCURRENT PROTECTION: INVERTER OVERCURRENT PROTECTION = INVERTER O/P CURRENT * CONTINUOUS LOAD (1.25) = 48 * 1.25 = 60A PV OVERCURRENT PROTECTION = 60A	

ELECTRICAL NOTES
1. CONDUCTORS EXPOSED TO SUNLIGHT SHALL BE LISTED AS SUNLIGHT RESISTANT PER NEC 310.10(D). 2. CONDUCTORS EXPOSED TO WET LOCATIONS SHALL BE SUITABLE FOR USE IN WET LOCATIONS PER NEC 310.10(C). 3. MAXIMUM DC/AC VOLTAGE DROP SHALL BE NO MORE THAN 2%. 4. ALL CONDUCTORS SHALL BE IN CONDUIT UNLESS OTHERWISE NOTED. 5. BREAKER/FUSE SIZES PER NEC 240. 6. AC EQUIPMENT GROUNDING CONDUCTOR SIZED PER NEC 250.122. 7. AMBIENT TEMPERATURE CORRECTION FACTOR IS BASED ON NEC 310.15(B)(2)(a). 8. MAX. SYSTEM VOLTAGE COEFFICIENT IS FROM MODULE MANUFACTURER OR NEC 690.7 WHEN MANUFACTURER COEFFICIENT UNAVAILABLE. 9. CONDUCTORS ARE SIZED PER NEC TABLE 310.15(B)(16). 10. CONDUIT SHALL BE INSTALLED MINIMUM 7/8" FROM ROOF SURFACE.

DC WIRE SIZING CALCULATIONS BASED ON FOLLOWING EQUATIONS
REQUIRED CONDUCTOR AMPACITY: Isc(A) * # OF PARALLEL STRINGS = MAX CURRENT PER 690.8(A)(1) * 125% = MAX CURRENT PER 690.8(B)(1) CORRECTED AMPACITY CALCULATIONS: DERATED CONDUCTOR AMPACITY PER 690.8(B)(2) = AMPACITY * TEMPERATURE DERATE FACTOR * CONDUIT FILL DERATE DERATED CONDUCTOR AMPACITY CHECK : MAX CURRENT PER 690.8(B)(1) < DERATED CONDUCTOR AMPACITY
AC WIRE SIZING CALCULATIONS BASED ON FOLLOWING EQUATIONS
REQUIRED CONDUCTOR AMPACITY: INVERTER OUTPUT CURRENT * # OF INVERTERS = MAX CURRENT PER 690.8(A)(3) * 125% = MAX CURRENT PER 690.8(B)(1) CORRECTED AMPACITY CALCULATIONS: DERATED CONDUCTOR AMPACITY PER 690.8(B)(2) = AMPACITY * TEMPERATURE DERATE FACTOR * CONDUIT FILL DERATE DERATED CONDUCTOR AMPACITY CHECK : MAX CURRENT PER 690.8(B)(1) < DERATED CONDUCTOR AMPACITY

WIRE SIZE CALCULATIONS
AMBIENT TEMPERATURE @ 36°C
TAG 1: (DC) REQUIRED CONDUCTOR AMPACITY (14.75 * 1.25 * 1.25) = 23.04A CORRECTED AMPACITY CALCULATION (0.91 * 1 * 40) = 36.4A 23.04A < 36.4A (#10 AWG PV WIRE) TAG 2: (DC) REQUIRED CONDUCTOR AMPACITY (14.75 * 1.25 * 1.25) = 23.04A CORRECTED AMPACITY CALCULATION (0.91 * 0.5 * 55) = 25.02A 23.04A < 25.02A (1-1/4" PVC, #8 AWG THHN/THWN-2, Cu) TAG 3: (AC) REQUIRED CONDUCTOR AMPACITY (48 * 1 * 1.25) = 60A CORRECTED AMPACITY CALCULATION (0.88 * 1 * 85) = 74.8A 60A < 74.8A (1" EMT, #4 AWG THHN/THWN-2, Cu)

CONTRACTOR INFORMATION	
<div></div> <div>YES SOLAR SOLUTIONS</div> <div>ADDRESS: 202 NORTH DIXON AVENUE, CARY, NC 27513</div> <div>PHONE NUMBER: (919) 375-0757</div> <div>LICENSE NUMBER: NC GC #67356; NC ELECTRIC #U.32326</div> <div>LICENSE TYPE: NC GC/ELECTRIC</div>	
CUSTOMER INFORMATION	
NAME: RIDDLE RESIDENCE	
ADDRESS: 335 DEANNE LANE, COATS, NC 27521	
COORDINATES: 35.437243, -78.620282 APN: 071611005847	
14.260kW DC / 11.500kW AC ROOF MOUNT PV SYSTEM 13.500kWh ENERGY STORAGE SYSTEM	
PROJECT ID	AUR-1012369
DATE	5/3/2025
CREATED BY	VK
SIGNATURE	
ELECTRICAL CALCULATIONS PV-4.1	

⚠

WARNING

ELECTRIC SHOCK HAZARD

TERMINALS ON BOTH LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION

DC VOLTAGE IS ALWAYS PRESENT WHEN SOLAR MODULES ARE EXPOSED TO SUNLIGHT

LABEL LOCATION
AC DISCONNECT, POINT OF INTERCONNECTION
PER CODE: NEC 690.13

WARNING:PHOTOVOLTAIC
POWER SOURCE

LABEL LOCATION
CONDUIT, INVERTER DC DISCONNECT
PER CODE: NEC 690.31(G)(3)

PHOTOVOLTAIC

AC DISCONNECT

LABEL LOCATION
AC DISCONNECT, POINT OF INTERCONNECTION
PER CODE: NEC 690.13(B)

SOLAR PV SYSTEM EQUIPPED
WITH RAPID SHUTDOWN

TURN RAPID SHUTDOWN
SWITCH TO THE
"OFF" POSITION TO
SHUT DOWN PV SYSTEM
AND REDUCE
SHOCK HAZARD
IN THE ARRAY

SOLAR ELECTRIC
PV PANELS

LABEL LOCATION
AC DISCONNECT, INVERTER DC DISCONNECT,
POINT OF INTERCONNECTION
PER CODE: NEC 690.56(C)(1)(a)

RAPID SHUTDOWN
SWITCH FOR SOLAR PV
SYSTEM

LABEL LOCATION
INVERTER DC DISCONNECT
PER CODE: NEC 690.56(C)(3)

PHOTOVOLTAIC SYSTEM AC DISCONNECT SWITCH

RATED AC OPERATING CURRENT **48.00**AMPS AC
AC NOMINAL OPERATING VOLTAGE **240** VAC

LABEL LOCATION
AC DISCONNECT, POINT OF INTERCONNECTION
PER CODE: NEC 690.54

⚠

WARNING

TRI POWER SOURCE SECOND
SOURCE IS PHOTOVOLTAIC
SYSTEM THIRD SOURCE IS
BATTERY BACKUP SYSTEM.

LABEL LOCATION
POINT OF INTERCONNECTION
PER CODE: NEC 705.12(B)(3)

INVERTER-1

RATED MAXIMUM POWER-
POINT CURRENT(Imp)

85.2

A

RATED MAXIMUM POWER-
POINT VOLTAGE (Vmp)

194.4

V

MAXIMUM SYSTEM
VOLTAGE (Voc)

258.14

V

MAXIMUM CIRCUIT
CURRENT (Isc)

110.62

A

LABEL LOCATION
INVERTER DC DISCONNECT
PER CODE: NEC 690.53

CAUTION:MULTIPLE SOURCES
OF POWER

POWER TO THIS BUILDING IS ALSO
SUPPLIED FROM THE FOLLOWING
SOURCES WITH DISCONNECTS LOCATED
AS SHOWN

⚠

N

(N) PV ARRAY

(N) INVERTER WITH
INTEGRATED SOLAR
BATTERY (EXTERIOR)

(N) AC DISCONNECT (EXTERIOR)

(E) MAIN SERVICE PANEL (INTERIOR)

(E) UTILITY METER WITH MAIN
SERVICE DISCONNECT (EXTERIOR)

(N) TESLA GATEWAY 3
(EXTERIOR)

335 DEANNE LANE, COATS, NC 27521

NOTES

1.PLACARDS SHALL MEET THE REQUIREMENTS
OF ARTICLES 690 AND 705, UNLESS
OTHERWISE SPECIFIED PER LOCAL AHJ
REQUIREMENTS.

2.PLACARDS SHALL MEET THE REQUIREMENTS
OF SECTION 110.21(B) AS REQUIRED AND
SHALL COMPLY WITH ANSI Z535.4-2011,
PRODUCT SAFETY SIGNS AND LABELS.

3.PLACARDS SHALL BE PERMANENTLY AFFIXED
TO THE EQUIPMENT OR WIRING METHOD.

4.PLACARDS SHALL BE SUFFICIENT
DURABILITY TO WITHSTAND THE
ENVIRONMENT INVOLVED AND SHALL NOT BE
HANDWRITTEN.

5.PLACARDS SHALL NOT COVER EXISTING
MANUFACTURER LABELS.

6.WARNING SIGNAGE TEXT SHALL BE MINIMUM
3/8" TALL.

LABEL LOCATION
SERVICE PANEL
PER CODE: NEC 705.10

CONTRACTOR INFORMATION

YES SOLAR
SOLUTIONS

YES SOLAR SOLUTIONS

ADDRESS: 202 NORTH DIXON
AVENUE, CARY, NC 27513

PHONE NUMBER: (919) 375-0757

LICENSE NUMBER: NC GC #67356; NC
ELECTRIC #U.32326

LICENSE TYPE: NC GC/ELECTRIC

CUSTOMER INFORMATION

NAME: RIDDLE RESIDENCE

ADDRESS: 335 DEANNE LANE,
COATS, NC 27521

COORDINATES: 35.437243, -78.620282

APN: 071611005847

14.260kW DC / 11.500kW AC ROOF
MOUNT PV SYSTEM
13.500kWh ENERGY STORAGE
SYSTEM

PROJECT ID

AUR-1012369

DATE

5/3/2025

CREATED BY


VK

SIGNATURE

PLACARDS
PV-5



Preliminary Technical
Information Sheet

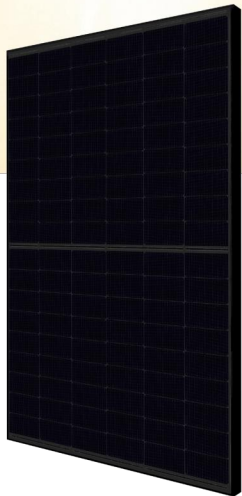

TOPHiKu6 (All-Black)

N-type TOPCon Technology

440 W ~ 460 W

CS6.1-54TM-440 | 445 | 450 | 455 | 460H

MORE POWER



Module power up to 460 W
Module efficiency up to 22.5 %



Excellent anti-LeTID & anti-PID performance.
Low power degradation, high energy yield



Lower temperature coefficient (Pmax): -0.29%/°C,
increases energy yield in hot climate



Lower LCOE & system cost

MORE RELIABLE



Minimizes micro-crack impacts



Heavy snow load up to 8100 Pa,
wind load up to 5000 Pa*

25
Years

Industry Leading Product Warranty on Materials
and Workmanship*

30
Years

Linear Power Performance Warranty*

1st year power degradation no more than 1%
Subsequent annual power degradation no more than 0.4%

*Subject to the terms and conditions contained in the applicable Canadian Solar Limited
Warranty Statement. Also this 25-year limited product warranty is available only for prod-
ucts installed and operating on residential rooftops in certain regions.

MANAGEMENT SYSTEM CERTIFICATES*

ISO 9001:2015 / Quality management system
ISO 14001:2015 / Standards for environmental management system
ISO 45001: 2018 / International standards for occupational health & safety
IEC62941: 2019 / Photovoltaic module manufacturing quality system

PRODUCT CERTIFICATES*

* The specific certificates applicable to different module types and markets will vary, and
therefore not all of the certifications listed herein will simultaneously apply to the products
you order or use. Please contact your local Canadian Solar sales representative to confirm
the specific certificates available for your Product and applicable in the regions in which
the products will be used.


CSI Solar Co., Ltd. is committed to providing high quality solar
photovoltaic modules, solar energy and battery storage solu-
tions to customers. The company was recognized as the No. 1
module supplier for quality and performance/price ratio in the
IHS Module Customer Insight Survey. Over the past 22 years, it
has successfully delivered around 100 GW of premium-quality
solar modules across the world.

* For detailed information, please refer to the Installation Manual.


CSI Solar Co., Ltd.
199 Lushan Road, SND, Suzhou, Jiangsu, China, 215129, www.csisolar.com, support@csisolar.com

ENGINEERING DRAWING (mm)

Rear View

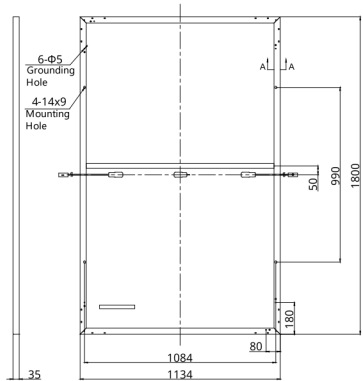

Frame Cross Section

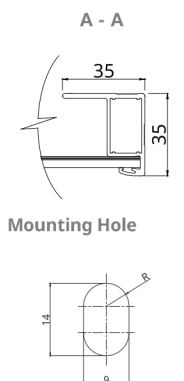

ELECTRICAL DATA | STC*

CS6.1-54TM	440H	445H	450H	455H	460H
Nominal Max. Power (Pmax)	440 W	445 W	450 W	455 W	460 W
Opt. Operating Voltage (Vmp)	31.6 V	31.8 V	32.0 V	32.2 V	32.4 V
Opt. Operating Current (Imp)	13.93 A	14.00 A	14.07 A	14.14 A	14.20 A
Open Circuit Voltage (Voc)	38.9 V	39.1 V	39.3 V	39.5 V	39.7 V
Short Circuit Current (Isc)	14.48 A	14.55 A	14.61 A	14.68 A	14.75 A
Module Efficiency	21.6%	21.8%	22.0%	22.3%	22.5%
Operating Temperature	-40°C ~ +85°C				
Max. System Voltage	1000V (IEC/UL)				
Module Fire Performance	TYPE 2 (UL 61730 1000V) or CLASS C (IEC 61730)				
Max. Series Fuse Rating	25 A				
Application Classification	Class A				
Power Tolerance	0 ~ + 10 W				

* Under Standard Test Conditions (STC) of irradiance of 1000 W/m2, spectrum AM 1.5 and cell
temperature of 25°C.

ELECTRICAL DATA | NMOT*


CS6.1-54TM	440H	445H	450H	455H	460H
Nominal Max. Power (Pmax)	333 W	337 W	340 W	344 W	348 W
Opt. Operating Voltage (Vmp)	29.9 V	30.1 V	30.3 V	30.4 V	30.6 V
Opt. Operating Current (Imp)	11.14 A	11.18 A	11.25 A	11.30 A	11.36 A
Open Circuit Voltage (Voc)	36.8 V	37.0 V	37.2 V	37.4 V	37.6 V
Short Circuit Current (Isc)	11.68 A	11.73 A	11.78 A	11.84 A	11.89 A

* Under Nominal Module Operating Temperature (NMOT), irradiance of 800 W/m² spectrum AM
1.5, ambient temperature 20°C, wind speed 1 m/s.

* The specifications and key features contained in this datasheet may deviate slightly from our actu-
al products due to the on-going innovation and product enhancement. CSI Solar Co., Ltd. reserves
the right to make necessary adjustment to the information described herein at any time without
further notice.
Please be kindly advised that PV modules should be handled and installed by qualified people who
have professional skills and please carefully read the safety and installation instructions before
using our PV modules.

CSI Solar Co., Ltd.
199 Lushan Road, SND, Suzhou, Jiangsu, China, 215129, www.csisolar.com, support@csisolar.com

CS6.1-54TM-455H / I-V CURVES

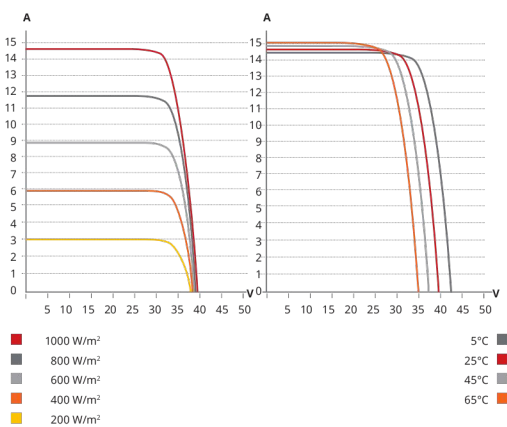

MECHANICAL DATA

Specification	Data
Cell Type	TOPCon cells
Cell Arrangement	108 [2 X (9 X 6)]
Dimensions	1800 × 1134 × 35 mm (70.9 × 44.6 × 1.38 in)
Weight	23 kg (50.7 lbs)
Front Cover	3.2 mm tempered glass with anti-ref- lective coating
Frame	Anodized aluminium alloy
J-Box	IP68, 3 bypass diodes
Cable	4 mm² (IEC), 12 AWG (UL)
Connector	T6 or MC4 or MC4-EVO2 or MC4- EVO2A
Cable Length (Including Connector)	Portrait: 350 mm (13.8 in) (+) / 250 mm (9.8 in) (-); landscape: 1150 mm (45.3 in)*
Per Pallet	31 pieces
Per Container (40' HQ)	744 pieces

* For detailed information, please contact your local Canadian Solar sales and
technical representatives.

TEMPERATURE CHARACTERISTICS

Specification	Data
Temperature Coefficient (Pmax)	-0.29 % / °C
Temperature Coefficient (Voc)	-0.25 % / °C
Temperature Coefficient (Isc)	0.05 % / °C
Nominal Module Operating Temperature	41 ± 3°C

PARTNER SECTION



July 2023. All rights reserved, PV Module Product Datasheet V1.0C25_EN

CONTRACTOR INFORMATION



YES SOLAR SOLUTIONS

ADDRESS: 202 NORTH DIXON
AVENUE, CARY, NC 27513

PHONE NUMBER: (919) 375-0757

LICENSE NUMBER: NC GC #67356; NC
ELECTRIC #U.32326

LICENSE TYPE: NC GC/ELECTRIC

CUSTOMER INFORMATION

NAME: RIDDLE RESIDENCE

ADDRESS: 335 DEANNE LANE,
COATS, NC 27521

COORDINATES: 35.437243, -78.620282

APN: 071611005847

14.260kW DC / 11.500kW AC ROOF
MOUNT PV SYSTEM
13.500kWh ENERGY STORAGE
SYSTEM

PROJECT ID AUR-1012369

DATE 5/3/2025

CREATED BY VK

SIGNATURE

MODULE SPEC SHEET
SS

Powerwall 3

Power Everything

Powerwall 3 is a fully integrated solar and battery system, designed to accelerate the transition to sustainable energy. Customers can receive whole home backup, cost savings, and energy independence by producing and consuming their own energy while participating in grid services. Once installed, customers can manage their system using the Tesla App to customize system behavior to meet their energy goals.

Powerwall 3 achieves this by supporting up to 20 kW DC of solar and providing up to 11.5 kW AC of continuous power per unit. It has the ability to start heavy loads rated up to 185 LRA, meaning a single unit can support the power needs of most homes. Powerwall 3 Expansions make it easier and more affordable to scale up customers' systems to meet their current or future needs. Powerwall 3 is designed for fast and efficient installations, modular system expansion, and simple connection to any electrical service.



Powerwall 3 Technical Specifications

System Technical Specifications

Model Number	1707000-xx-y			
Nominal Grid Voltage (Input & Output)	120/240 VAC			
Grid Type	Split phase			
Frequency	60 Hz			
Nominal Battery Energy	13.5 kWh AC ¹			
Nominal Output Power (AC)	5.8 kW	7.6 kW	10 kW	11.5 kW
Maximum Apparent Power	5,800 VA	7,600 VA	10,000 VA	11,500 VA
Maximum Continuous Current	24 A	31.7 A	41.7 A	48 A
Overcurrent Protection Device ²	30 A	40 A	60 A	60 A
Configurable Maximum Continuous Discharge Power Off-Grid (PV Only, -20°C to 25°C)	15.4 kW ³			
Maximum Continuous Charge Current / Power (Powerwall 3 only)	20.8 A AC / 5 kW			
Maximum Continuous Charge Current / Power (Powerwall 3 with up to (3) Expansion units)	33.3 A AC / 8 kW			
Output Power Factor Rating	0 – 1 (Grid Code configurable)			
Maximum Output Fault Current (1 s)	160 A			
Maximum Short-Circuit Current Rating	10 kA			
Load Start Capability	185 LRA			
Solar to Battery to Home/Grid Efficiency	89% ^{1,4}			
Solar to Home/Grid Efficiency	97.5% ⁵			
Power Scalability	Up to 4 Powerwall 3 units supported			
Energy Scalability	Up to 3 Expansion units (for a maximum total of 7 units)			
Supported Islanding Devices	Gateway 3, Backup Switch, Backup Gateway 2			
Connectivity	Wi-Fi (2.4 and 5 GHz), Ethernet, Cellular (LTE/4G ⁶)			
Hardware Interface	Dry contact relay, Rapid Shutdown (RSD) certified switch and 2-pin connector, RS-485 for meters			
AC Metering	Revenue Grade (+/- 0.5%, ANSI C12.20)			
Protections	Integrated arc fault circuit interrupter (AFCI), Isolation Monitor Interrupter (IMI), PV Rapid Shutdown (RSD) using Tesla Mid-Circuit Interrupters			
Customer Interface	Tesla Mobile App			
Warranty	10 years			

¹Values provided for 25°C (77°F), at beginning of life. 3.3 kW charge/discharge power.
²See [Powerwall 3 Installation Manual](#) for fuse requirements if using fuse for overcurrent protection.
³15.4kW off-grid maximum continuous discharge power is only available if on-grid rating is 11.5 kW. If enabled, Powerwall 3 must be installed with an 80 A breaker and appropriately sized conductors.
⁴Typical solar shifting use case.
⁵Tested using CEC weighted efficiency methodology.
⁶The customer is expected to provide internet connectivity for Powerwall 3; cellular should not be used as the primary mode of connectivity. Cellular connectivity subject to network operator service coverage and signal strength.

CONTRACTOR INFORMATION



YES SOLAR SOLUTIONS
ADDRESS: 202 NORTH DIXON AVENUE, CARY, NC 27513
PHONE NUMBER: (919) 375-0757
LICENSE NUMBER: NC GC #67356; NC ELECTRIC #U.32326
LICENSE TYPE: NC GC/ELECTRIC

CUSTOMER INFORMATION

NAME: RIDDLE RESIDENCE

ADDRESS: 335 DEANNE LANE, COATS, NC 27521

COORDINATES: 35.437243, -78.620282
APN: 071611005847

14.260kW DC / 11.500kW AC ROOF MOUNT PV SYSTEM
13.500kWh ENERGY STORAGE SYSTEM

PROJECT ID	AUR-1012369
DATE	5/3/2025
CREATED BY	VK
SIGNATURE	

INVERTER SPEC SHEET
SS

Powerwall 3 Technical Specifications

Solar Technical Specifications

Maximum Solar STC Input	20 kW
Withstand Voltage	600 V DC
PV DC Input Voltage Range	60 — 550 V DC
PV DC MPPT Voltage Range	60 — 480 V DC
MPPTs	6
Maximum Current per MPPT (I _{mp})	15 A ^{7,8}
Maximum Short Circuit Current per MPPT (I _{sc})	19 A ⁸

⁷Only applicable to Powerwall 3 units with 15 A I_{MP} on the product label. Otherwise, Powerwall 3 has an I_{MP} of 13 A.

⁸When PV strings are combined on the roof and the DC input current exceeds the MPPT rating, a jumper can be used to combine two MPPTs into a single input to intake DC current up to 30 A I_{MP} / 38 A I_{SC} (or 26 A I_{MP} / 30 A I_{SC} if Powerwall 3 is labeled with 13 A I_{MP} / 15 A I_{SC}).

Environmental Specifications

Operating Temperature	−20°C to 50°C (−4°F to 122°F) ⁹
Operating Humidity (RH)	Up to 100%, condensing
Storage Temperature	−20°C to 30°C (−4°F to 86°F), up to 95% RH, non-condensing, State of Energy (SOE): 25% initial
Maximum Elevation	3000 m (9843 ft)
Environment	Indoor and outdoor rated
Enclosure Rating	NEMA 3R
Ingress Rating	IP67 (Battery & Power Electronics) IP55 (Wiring Compartment)
Pollution Rating	PD3
Operating Noise @ 1 m	< 50 db(A) typical < 62 db(A) maximum

⁹Performance may be de-rated at operating temperatures above 40°C (104°F).

Compliance Information


Certifications	UL 1741, UL 9540, UL 9540A, UL 3741, UL 1741 PCS, UL 1741 SA, UL 1741 SB, UL 1973, UL 1699B, UL 1998, CSA C22.2 No. 0.8, CSA C22.2 No. 107.1, CSA C22.2 No. 330, CSA 22.3 No. 9, IEEE 1547, IEEE 1547A, IEEE 1547.1, CA Rule No.21
Grid Connection	United States and Canada
Emissions	FCC Part 15 Class B, ICES 003
Environmental	RoHS Directive 2011/65/EU
Seismic	AC156, IEEE 693-2005 (high)
Fire Testing	Meets the unit level performance criteria of UL 9540A

Powerwall 3 Technical Specifications

Mechanical Specifications

Dimensions	1105 x 609 x 193 mm (43.5 x 24 x 7.6 in) ¹⁰
Total Weight of Installed Unit	132 kg (291.2 lb)
Weight of Powerwall 3	124 kg (272.5 lb)
Weight of Glass Front Cover	6.5 kg (14.5 lb)
Weight of Wall Bracket	1.9 kg (4.2 lb)
Mounting Options	Floor or wall mount

¹⁰These dimensions include the glass front cover being installed on Powerwall 3.

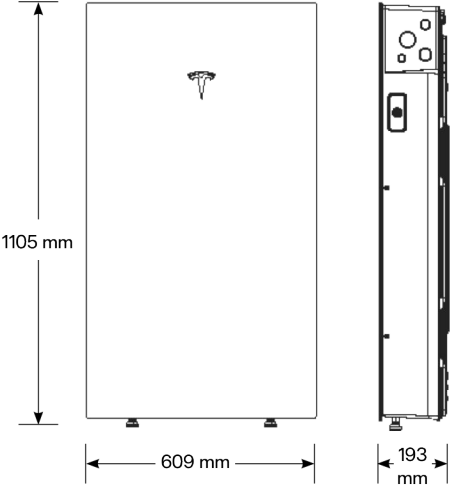

CONTRACTOR INFORMATION



YES SOLAR SOLUTIONS

ADDRESS: 202 NORTH DIXON AVENUE, CARY, NC 27513

PHONE NUMBER: (919) 375-0757

LICENSE NUMBER: NC GC #67356; NC ELECTRIC #U.32326

LICENSE TYPE: NC GC/ELECTRIC

CUSTOMER INFORMATION

NAME: RIDDLE RESIDENCE

ADDRESS: 335 DEANNE LANE, COATS, NC 27521

COORDINATES: 35.437243, -78.620282
APN: 071611005847

14.260kW DC / 11.500kW AC ROOF MOUNT PV SYSTEM
13.500kWh ENERGY STORAGE SYSTEM

PROJECT ID AUR-1012369

DATE 5/3/2025

CREATED BY VK

SIGNATURE

INVERTER SPEC SHEET
SS

Solar Shutdown Device Technical Specifications

The Solar Shutdown Device is a Mid-Circuit Interrupter (MCI) and is integral to the rapid shutdown (RSD) function required for rooftop PV systems in accordance with Article 690 of the NEC. When paired with Powerwall 3, solar array shutdown is initiated by an External System Shutdown Switch or the On/Off Enable switch located on Powerwall 3. Systems not subject to rapid shutdown requirements must still install one or more MCIs for functional purposes; see the Powerwall 3 installation manual for details.

Electrical Specifications

Model	MCI-1	MCI-2	MCI-2 High Current
Nominal Input DC Current Rating (I_{MP})	13 A	13 A	15 A
Maximum Input Short Circuit Current (I_{SC})	19 A	17 A	19 A
Maximum System Voltage	600 V DC	1000 V DC ¹⁵	1000 V DC ¹⁵
Maximum Disconnect Voltage ¹⁶	600 V DC	165 V DC	165 V DC

¹⁵ Maximum System Voltage is limited by Powerwall to 600 V DC.
¹⁶ Maximum Disconnect Voltage is the maximum voltage allowed across each MCI in the open position (Rapid Shutdown Initiated). An individual MCI-2 has a voltage rating of 165V but in combination (connected in the same string) their voltage ratings are additive.

RSD Module Performance

Maximum Number of Devices per String	5
Control	Power Line Excitation
Passive State	Normally Open
Maximum Power Consumption	7 W
Warranty	25 years

Environmental Specifications

Operating Temperature	-40°C to 50°C (-40°F to 122°F)	-45°C to 70°C (-49°F to 158°F)
Storage Temperature	-30°C to 70°C (-22°F to 158°F)	-30°C to 70°C (-22°F to 158°F)
Enclosure Rating	NEMA 4X / IP65	

Mechanical Specifications

Electrical Connections	MC4 Connector	
Housing	Plastic	
Dimensions	125 x 150 x 22 mm (5 x 6 x 1 in)	173 x 45 x 22 mm (6.8 x 1.8 x 1 in)
Weight	350 g (0.77 lb)	120 g (0.26 lb)
Mounting Options	ZEP Home Run Clip M4 Screw (#10) M8 Bolt (5/16") Nail / Wood screw	Wire Clip

Compliance Information

Certifications	UL 1741 PVRSE, UL 3741, PVRSA (Photovoltaic Rapid Shutdown Array)
RSD Initiation Method	External System Shutdown Switch or Powerwall 3 Enable Switch

UL 3741 PV Hazard Control (and PVRSA) Compatibility

See [UL 3741 Application Addendum](#)

CONTRACTOR INFORMATION



YES SOLAR SOLUTIONS

ADDRESS: 202 NORTH DIXON
AVENUE, CARY, NC 27513

PHONE NUMBER: (919) 375-0757

LICENSE NUMBER: NC GC #67356; NC
ELECTRIC #U.32326

LICENSE TYPE: NC GC/ELECTRIC

CUSTOMER INFORMATION

NAME: RIDDLE RESIDENCE

ADDRESS: 335 DEANNE LANE,
COATS, NC 27521

COORDINATES: 35.437243, -78.620282
APN: 071611005847

14.260kW DC / 11.500kW AC ROOF
MOUNT PV SYSTEM
13.500kWh ENERGY STORAGE
SYSTEM

PROJECT ID AUR-1012369

DATE 5/3/2025

CREATED BY VK

SIGNATURE

RAPID SHUTDOWN SPEC SHEET
SS

Gateway 3

Tesla Gateway 3 controls connection to the grid in a Powerwall system, automatically detecting outages and providing seamless transition to backup power. It provides energy monitoring that is used by Powerwall for solar self-consumption, time-based control, and backup operation.

Performance Specifications

Model Number	1841000-x1-y	AC Meter	+/- 0.5%
Nominal Grid Voltage	120/240 V AC	Communication	CAN
Grid Configuration	Split phase	User Interface	Tesla App
Grid Frequency	60 Hz	Backup Transition	Automatic disconnect for seamless backup
Continuous Current Rating	200 A	Overcurrent Protection Device	100–200 A Service entrance rated Eaton CSR, BWH, or BW, or Square D QOM breakers
Maximum Supply Short Circuit Current	22 kA with Square D or Eaton main breaker 25 kA with Eaton main breaker ¹⁷	Internal Panelboard	200 A 8-space/16 circuit breakers Eaton BR, Siemens QP, or Square D HOM breakers rated to 10–125A
IEC Protective Class	Class I	Warranty	10 years
Overvoltage Category	Category IV		

¹⁷ Only Eaton CSR or BWH main breakers are 25 kA rated.

Environmental Specifications


Operating Temperature	–20°C to 50°C (–4°F to 122°F)
Operating Humidity (RH)	Up to 100%, condensing
Maximum Elevation	3000 m (9843 ft)
Environment	Indoor and outdoor rated
Enclosure Type	NEMA 3R

Compliance Information

Certifications	UL 67, UL 869A, UL 916, UL 1741 PCS, CSA 22.2 107.1, CSA 22.2 29
Emissions	FCC Part 15, Class B, ICES 003

Mechanical Specifications

Dimensions	660 x 411 x 149 mm (26 x 16 x 6 in)
Weight	16.3 kg (36 lb)
Mounting options	Wall mount

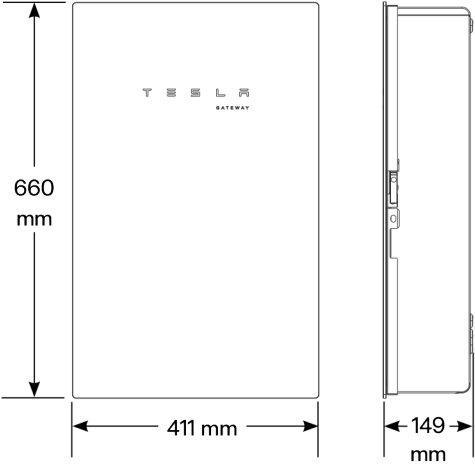

CONTRACTOR INFORMATION



YES SOLAR SOLUTIONS
ADDRESS: 202 NORTH DIXON AVENUE, CARY, NC 27513
PHONE NUMBER: (919) 375-0757
LICENSE NUMBER: NC GC #67356; NC ELECTRIC #U.32326
LICENSE TYPE: NC GC/ELECTRIC

CUSTOMER INFORMATION

NAME: RIDDLE RESIDENCE

ADDRESS: 335 DEANNE LANE, COATS, NC 27521


COORDINATES: 35.437243, -78.620282
APN: 071611005847

14.260kW DC / 11.500kW AC ROOF MOUNT PV SYSTEM
13.500kWh ENERGY STORAGE SYSTEM

PROJECT ID	AUR-1012369
DATE	5/3/2025
CREATED BY	VK
SIGNATURE	


GATEWAY SPEC SHEET
SS

DESCRIPTION:	DRAWN BY:	<div>SnapNrack®</div> <div>595 MARKET STREET, 29TH FLOOR • SAN FRANCISCO, CA 94105 USA PHONE (415) 580-6900 • FAX (415) 580-6902</div> <div>THE INFORMATION IN THIS DRAWING IS CONFIDENTIAL AND PROPRIETARY. ANY REPRODUCTION, DISCLOSURE, OR USE THEREOF IS PROHIBITED WITHOUT THE WRITTEN CONSENT OF SUNRUN SOUTH LLC.</div>
<div>SNAPNRACK, ULTRA RAIL COMP KIT</div>	mwatkins	
PART NUMBER(S):	REVISION:	
SEE BELOW	C	

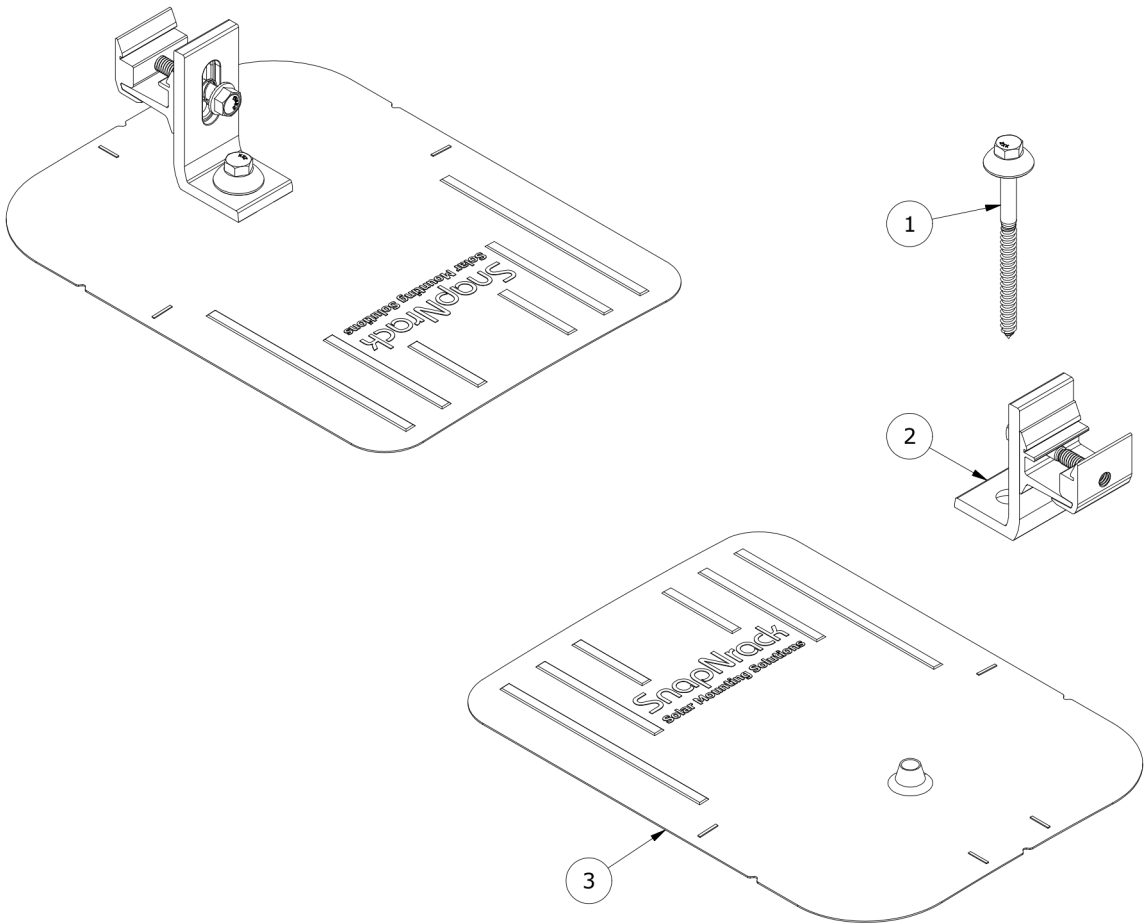

PARTS LIST			
ITEM	QTY	PART NUMBER	DESCRIPTION
1	1	242-92266	SNAPNRACK, UMBRELLA LAG, TYPE 3, 4IN, SS
2	1	242-01219, 242-01220	SNAPNRACK, ULTRA RAIL UMBRELLA L FOOT, SILVER / BLACK
3	1	232-01375, 232-01376, 232-01377	SNAPNRACK, COMP FLASHING, 9IN X 12IN, SILVER / BLACK
MATERIALS:		6000 SERIES ALUMINUM, STAINLESS STEEL, RUBBER	
DESIGN LOAD (LBS):		802 UP, 1333 DOWN, 356 SIDE	
ULTIMATE LOAD (LBS):		2005 UP, 4000 DOWN, 1070 SIDE	
TORQUE SPECIFICATION:		12 LB-FT	
CERTIFICATION:		UL 2703, FILE E359313; WIND-DRIVEN RAIN TEST FROM UL SUBJECT 2582	
WEIGHT (LBS):		0.79 - 1.03	

DESCRIPTION:	DRAWN BY:	<div>SnapNrack®</div> <div>595 MARKET STREET, 29TH FLOOR • SAN FRANCISCO, CA 94105 USA PHONE (415) 580-6900 • FAX (415) 580-6902</div> <div>THE INFORMATION IN THIS DRAWING IS CONFIDENTIAL AND PROPRIETARY. ANY REPRODUCTION, DISCLOSURE, OR USE THEREOF IS PROHIBITED WITHOUT THE WRITTEN CONSENT OF SUNRUN SOUTH LLC.</div>
<div>SNAPNRACK, ULTRA RAIL COMP KIT</div>	mwatkins	
PART NUMBER(S):	REVISION:	
SEE BELOW	C	

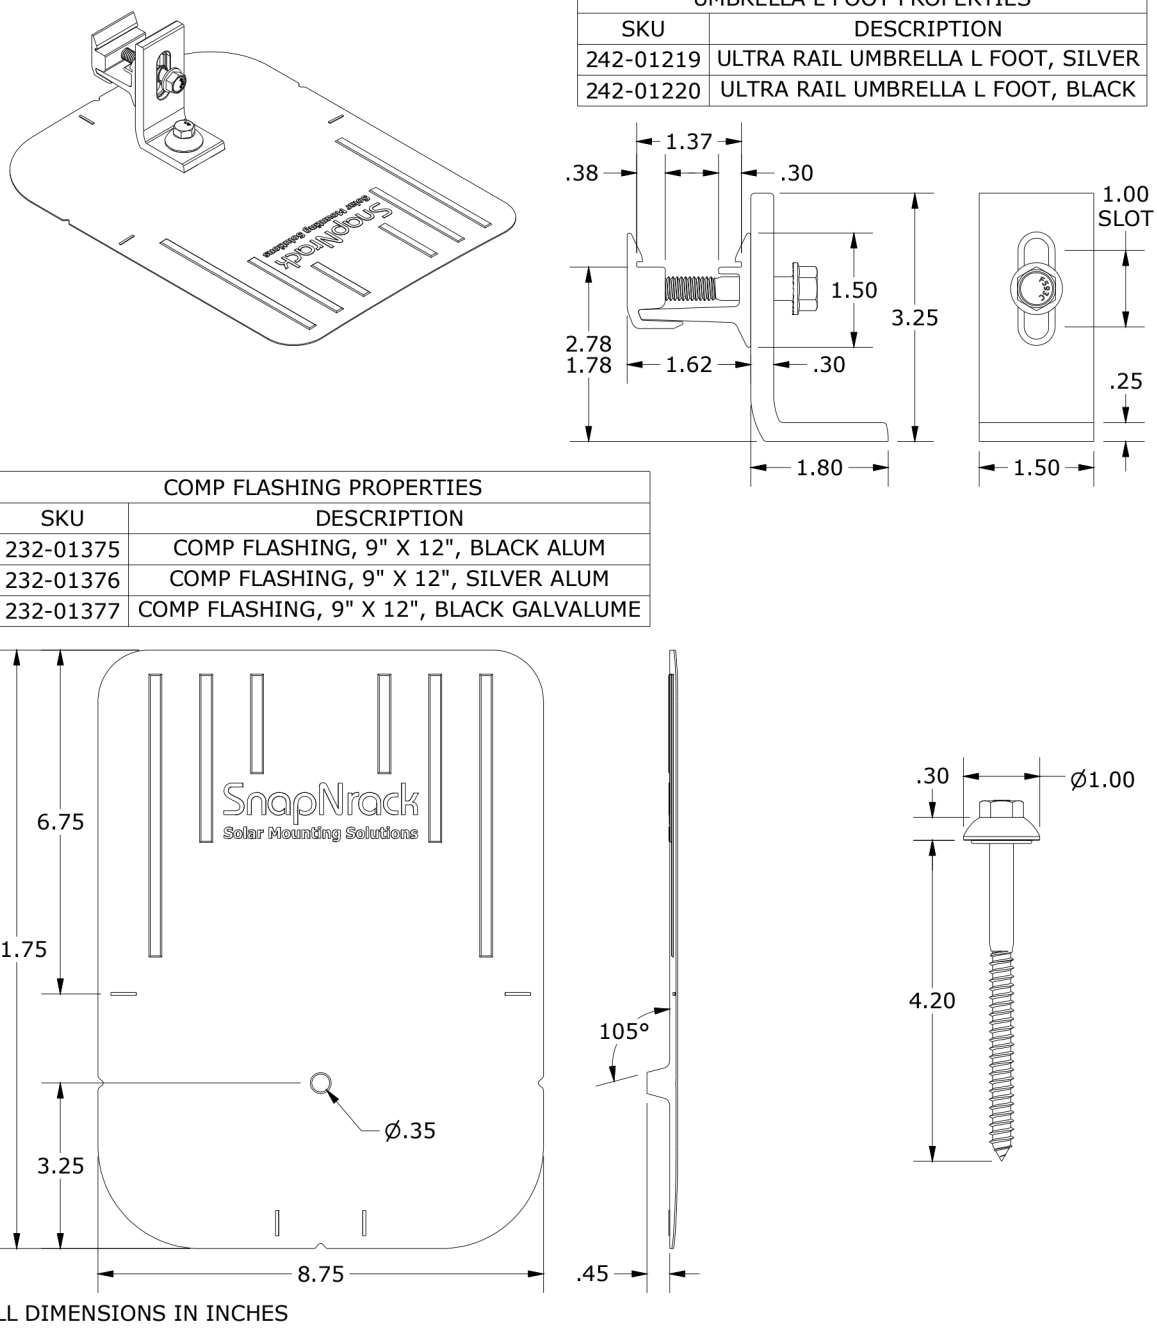

CONTRACTOR INFORMATION



YES SOLAR SOLUTIONS
ADDRESS: 202 NORTH DIXON AVENUE, CARY, NC 27513
PHONE NUMBER: (919) 375-0757
LICENSE NUMBER: NC GC #67356; NC ELECTRIC #U.32326
LICENSE TYPE: NC GC/ELECTRIC

CUSTOMER INFORMATION


NAME: RIDDLE RESIDENCE
ADDRESS: 335 DEANNE LANE, COATS, NC 27521
COORDINATES: 35.437243, -78.620282
APN: 071611005847
14.260kW DC / 11.500kW AC ROOF MOUNT PV SYSTEM
13.500kWh ENERGY STORAGE SYSTEM

PROJECT ID	AUR-1012369
DATE	5/3/2025
CREATED BY	VK
SIGNATURE	

MOUNT SPEC SHEET
SS

Ultra Rail

UR-40
UR-60

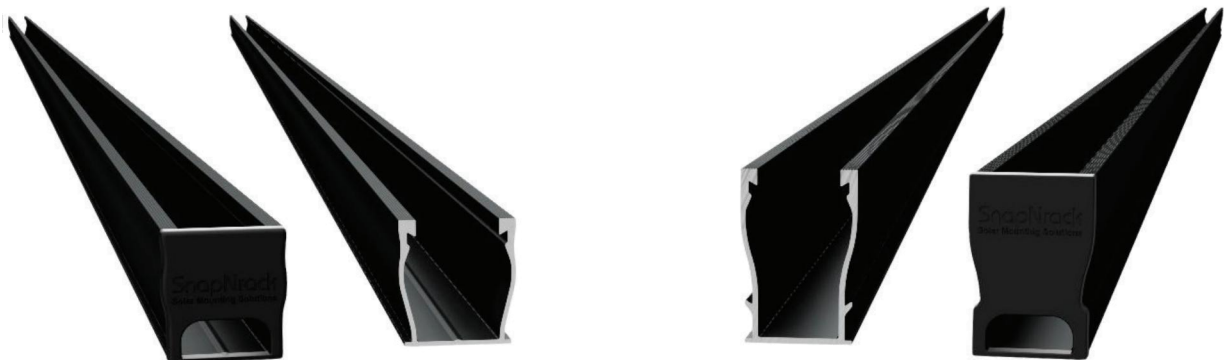

The Ultimate Value in Rooftop Solar

 Industry leading Wire Management Solutions

 Single Tool Installation

 Mounts available for all roof types

 All SnapNrack Module Clamps & Accessories are compatible with both rail profiles

Start Installing Ultra Rail Today

RESOURCES
DESIGN
WHERE TO BUY


snapnrack.com/resources
snapnrack.com/configurator
snapnrack.com/where-to-buy

SnapNrack Ultra Rail System

A sleek, straightforward rail solution for mounting solar modules on all roof types. Ultra Rail features two rail profiles; UR-40 is a lightweight rail profile that is suitable for most geographic regions and maintains all the great features of SnapNrack rail, while UR-60 is a heavier duty rail profile that provides a larger rail channel and increased span capabilities. Both are compatible with all existing mounts, module clamps, and accessories for ease of install.

The Entire System is a Snap to Install

- New Ultra Rail Mounts include snap-in brackets for attaching rail
- Compatible with all the SnapNrack Mid Clamps and End Clamps customers love
- Universal End Clamps and snap-in End Caps provide a clean look to the array edge

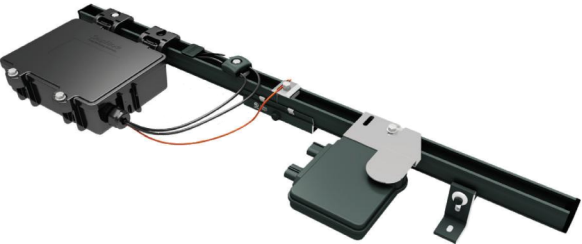

Unparalleled Wire Management

- Open rail channel provides room for running wires resulting in a long-lasting quality install
- Industry best wire management offering includes Junction Boxes, Universal Wire Clamps, MLPE Attachment Kits, and Conduit Clamps
- System is fully bonded and listed to UL 2703 Standard

Heavy Duty UR-60 Rail

- UR-60 rail profile provides increased span capabilities for high wind speeds and snow loads
- Taller, stronger rail profile includes profile-specific rail splice and end cap
- All existing mounts, module clamps, and accessories are retained for the same great install experience



Quality. Innovative. Superior.

SnapNrack Solar Mounting Solutions are engineered to optimize material use and labor resources and improve overall installation quality and safety.

877-732-2860 www.snapnrack.com contact@snapnrack.com

© 2019 by SnapNrack Solar Mounting Solutions. All rights reserved

CONTRACTOR INFORMATION



YES SOLAR SOLUTIONS
ADDRESS: 202 NORTH DIXON AVENUE, CARY, NC 27513
PHONE NUMBER: (919) 375-0757
LICENSE NUMBER: NC GC #67356; NC ELECTRIC #U.32326
LICENSE TYPE: NC GC/ELECTRIC

CUSTOMER INFORMATION

NAME: RIDDLE RESIDENCE
ADDRESS: 335 DEANNE LANE, COATS, NC 27521
COORDINATES: 35.437243, -78.620282
APN: 071611005847
14.260kW DC / 11.500kW AC ROOF MOUNT PV SYSTEM
13.500kWh ENERGY STORAGE SYSTEM

PROJECT ID	AUR-1012369
DATE	5/3/2025
CREATED BY	VK
SIGNATURE	

RAIL SPEC SHEET
SS