



BLUE RAVEN SOLAR, LLC.
Firm License No. D-0449
1403 North Research Way , Bldg. J
Orem, UT 84097

June 9, 2025

To: Blue Raven Solar
1403 North Research Way, Building J
Orem, UT. 84097

Subject: Certification Letter
Ibe Residence
134 Emma Ct
Lindon, NC. 28356

To Whom It May Concern,

A jobsite observation of the condition of the existing framing system was performed by an audit team of Blue Raven Solar. All review is based on these observations and the design criteria listed below and only deemed valid if provided information is true and accurate.

On the above referenced project, the roof structural framing has been reviewed for additional loading due to the installation of the solar PV addition to the roof. The structural review only applies to the section of the roof that is directly supporting the solar PV system and its supporting elements. The observed roof framing is described below. If field conditions differ, contractor to notify engineer prior to starting construction.

The roof structures of (MP1&2) consist of composition shingle on roof plywood that is supported by pre-manufactured trusses that are spaced at @ 24" o.c.. The top chords, sloped at 37 degrees, are 2x4 sections, the bottom chords are 2x4 sections and the web members are 2x4 sections. The truss members are connected by steel gusset plates. The max unsupported projected horizontal top chord span is approximately 7'-4".

The existing roof framing systems of (MP1&2) are judged to be adequate to withstand the loading imposed by the installation of the solar panels. No reinforcement is necessary.

The spacing of the solar standoffs should be kept at 72" o.c. for landscape and 48" o.c. for portrait orientation, with a staggered pattern to ensure proper distribution of loads.

The scope of this report is strictly limited to an evaluation of the fastener attachment, underlying framing and supporting structure only. The attachment's to the existing structure are required to be in a staggered pattern to ensure proper distribution of loading. All panels, racking and hardware shall be installed per manufacturer specifications and within specified design limitations. All waterproofing shall be provided by the manufacturer.

Note: Seismic check is not required since $S_s < .4g$ and Seismic Design Category (SDC) < B

Design Criteria:

- Applicable Codes = 2018 North Carolina State Building Code (NCSBC), ASCE 7-10
- Roof Dead Load = 7 psf (MP1&2)
- Roof Live Load = 20 psf
- Wind Speed = 115 mph (Vult), Exposure C, Risk Category II
- Ground Snow Load = 15 psf - Roof Snow Load = 10.5 psf
- Attachment: 2 - #14 Wood Screws with 2.5 inch min. embedment depth, at spacing shown above.

Please contact me with any further questions or concerns regarding this project.

Sincerely,

John Calvert, P.E.
Project Engineer



Digitally signed
by John A. Calvert
Date: 2025.06.09
16:51:49 -06'00'

Ibe Lindon NC 1



Gravity Loading

Roof Snow Load Calculations		
p_g = Ground Snow Load =	15 psf	
$p_f = 0.7 C_e C_t I p_g$		(ASCE7 - Eq 7-1)
C_e = Exposure Factor =	1	(ASCE7 - Table 7-2)
C_t = Thermal Factor =	1	(ASCE7 - Table 7-3)
I = Importance Factor =	1	
p_f = Flat Roof Snow Load =	10.5 psf	
$p_s = C_s p_f$		(ASCE7 - Eq 7-2)
C_s = Slope Factor =	1	
p_s = Sloped Roof Snow Load =	10.5 psf	
PV Dead Load = 3 psf (Per Blue Raven Solar)		
DL Adjusted to 37 Degree Slope	3.76 psf	
PV System Weight		
Weight of PV System (Per Blue Raven Solar)	3.0 psf	
X Standoff Spacing =	4.00 ft	
Y Standoff Spacing =	3.04 ft	
Standoff Tributary Area =	12.17 sft	
Point Loads of Standoffs	37 lb	
Note: PV standoffs are staggered to ensure proper distribution of loading		
Roof Live Load = 20 psf		
Note: Roof live load is removed in area's covered by PV array.		
Roof Dead Load (MP1&2)		
Composition Shingle	4.00	
Roof Plywood	2.00	
2x4 Top Chords @ 24"o.c.	0.73	
Vaulted Ceiling	0.00	(Ceiling Not Vaulted)
Miscellaneous	0.27	
Total Roof DL (MP1&2)	7.0 psf	
DL Adjusted to 37 Degree Slope	8.8 psf	



Wind Calculations

Per ASCE 7-10 Components and Cladding

Input Variables	
Wind Speed	115 mph
Exposure Category	C
Roof Shape	Hip/Gable
Roof Slope	37 degrees
Mean Roof Height	20 ft
Effective Wind Area	21.3 ft

Design Wind Pressure Calculations	
Wind Pressure $P = qh \cdot G \cdot C_n$	
$qh = 0.00256 \cdot K_z \cdot K_{zt} \cdot K_d \cdot V^2$	(Eq. 30.3-1)
K_z (Exposure Coefficient) = 0.9	(Table 30.3-1)
K_{zt} (topographic factor) = 1	(Fig. 26.8-1)
K_d (Wind Directionality Factor) = 0.85	(Table 26.6-1)
V (Design Wind Speed) = 115 mph	(Fig. 26.5-1A)
Risk Category = II	(Table 1.5-1)
$qh = 25.90$	
$0.6 \cdot qh = 15.54$	

Standoff Uplift Calculations-Portrait				
	Zone 1	Zone 2	Zone 3	Positive
$GC_p =$	-0.94	-1.15	-1.15	0.86
Uplift Pressure =	-14.55 psf	-17.80 psf	-17.80 psf	22.4 psf
X Standoff Spacing =	4.00	4.00	2.67	
Y Standoff Spacing =	3.04	3.041666667	3.041666667	
Tributary Area =	12.17	12.17	8.11	
Dead Load on Attachment=	36.50	36.50	24.33	
Footing Uplift (0.6D+0.6W)=	-155 lb	-195 lb	-130 lb	

Standoff Uplift Calculations-Landscape				
	Zone 1	Zone 2	Zone 3	Positive
$GC_p =$	-0.94	-1.15	-1.15	0.86
Uplift Pressure =	-14.55 psf	-17.80 psf	-17.80 psf	10.5 psf
X Standoff Spacing =	6.00	6.00	4.00	
Y Standoff Spacing =	1.75	1.75	1.75	
Tributary Area =	10.50	10.50	7.00	
Dead Load on Attachment=	31.50	31.50	21.00	
Footing Uplift (0.6D+0.6W) =	-134 lb	-168 lb	-112 lb	

Standoff Uplift Check	
Maximum Design Uplift =	-195 lb
Standoff Uplift Capacity =	400 lb
400 lb capacity > 195 lb demand	Therefore, OK

Fastener Capacity Check	
Fastener =	2 - #14 Wood Screws
Number of Fasteners =	2
Embedment Depth =	2.5
Pullout Capacity Per Inch =	150 lb
Fastener Capacity =	750 lb
w/ F.S. of 1.5 & DOL of 1.6=	800 lb
800 lb capacity > 195 lb demand	Therefore, OK




Framing Check

(MP1&2)

PASS

Dead Load 8.8 psf
PV Load 3.8 psf
Live Load 20.0 psf

Governing Load Combo = DL + LL
Total Load 32.5 psf

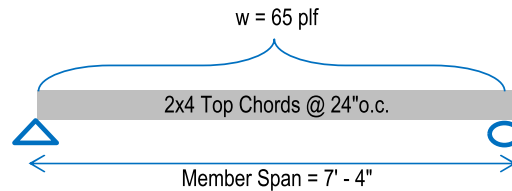

Member Properties

Member Size	S (in ³)	I (in ⁴)	Lumber Sp/Gr	Member Spacing
2x4	3.06	5.36	DF#2	@ 24"o.c.

Check Bending Stress

Fb (psi) =	f _b	x	C _d	x	C _f	x	C _r	(NDS Table 4.3.1)
	900	x	1.25	x	1.5	x	1.15	

Allowed Bending Stress = 1940.6 psi

Maximum Moment = $(wL^2) / 8$
= 437.2316 ft#
= 5246.779 in#

Actual Bending Stress = (Maximum Moment) / S
= 1713.3 psi

Allowed > Actual -- 88.3% Stressed -- Therefore, OK

Check Deflection

Allowed Deflection (Total Load) = $L/180$ (E = 1600000 psi Per NDS)
= 0.488 in

Deflection Criteria Based on = Continuous Span
Actual Deflection (Total Load) = $(wL^4) / (185 \cdot E \cdot I)$
= 0.205 in
= $L/430 > L/180$ **Therefore OK**

Allowed Deflection (Live Load) = $L/240$
= 0.366 in
Actual Deflection (Live Load) = $(wL^4) / (185 \cdot E \cdot I)$
= 0.127 in
= $L/693 > L/240$ **Therefore OK**

Check Shear

Member Area = 5.3 in² F_v (psi) = 180 psi (NDS Table 4A)
Allowed Shear = F_v * A = 945 lb Max Shear (V) = $w * L / 2 = 238 \text{ lb}$

Allowed > Actual -- 25.3% Stressed -- Therefore, OK