





WARNING
DO NOT TOUCH THE SURFACE OF THE SOLAR PANELS. THE SURFACE IS HOT AND CAN CAUSE BURNS. ALWAYS WEAR PROTECTIVE GLOVES WHEN HANDLING THE PANELS.

CAUTION
DO NOT TOUCH THE SURFACE OF THE SOLAR PANELS. THE SURFACE IS HOT AND CAN CAUSE BURNS. ALWAYS WEAR PROTECTIVE GLOVES WHEN HANDLING THE PANELS.

WARNING
DO NOT TOUCH THE SURFACE OF THE SOLAR PANELS. THE SURFACE IS HOT AND CAN CAUSE BURNS. ALWAYS WEAR PROTECTIVE GLOVES WHEN HANDLING THE PANELS.

DO NOT DISCONNECT
UNDER LOAD







17 Panels
Jenifer
Lamney
15015 11th St
ccwin nrc













A/C POWER SOURCE























CAUTION

DO NOT TOUCH THE SURFACE OF THE INVERTER. THE SURFACE OF THE INVERTER CAN BECOME HOT. TO PREVENT BURNING, DO NOT TOUCH THE SURFACE OF THE INVERTER. TO PREVENT BURNING, DO NOT TOUCH THE SURFACE OF THE INVERTER. TO PREVENT BURNING, DO NOT TOUCH THE SURFACE OF THE INVERTER.

WARNING

AVERTISSEMENT

NE PAS TOUCHER LA SURFACE DE L'INVERSEUR. LA SURFACE DE L'INVERSEUR PEUT DEVENIR CHAUDE. POUR ÉVITER LES BRÛLURES, NE PAS TOUCHER LA SURFACE DE L'INVERSEUR. POUR ÉVITER LES BRÛLURES, NE PAS TOUCHER LA SURFACE DE L'INVERSEUR. POUR ÉVITER LES BRÛLURES, NE PAS TOUCHER LA SURFACE DE L'INVERSEUR.

FC

InterLogic Technologies Ltd.
Power Optimizer

InterLogic Technologies Ltd.
Power Optimizer




CAUTION

WARNING

ADVERTISSEMENT

FC

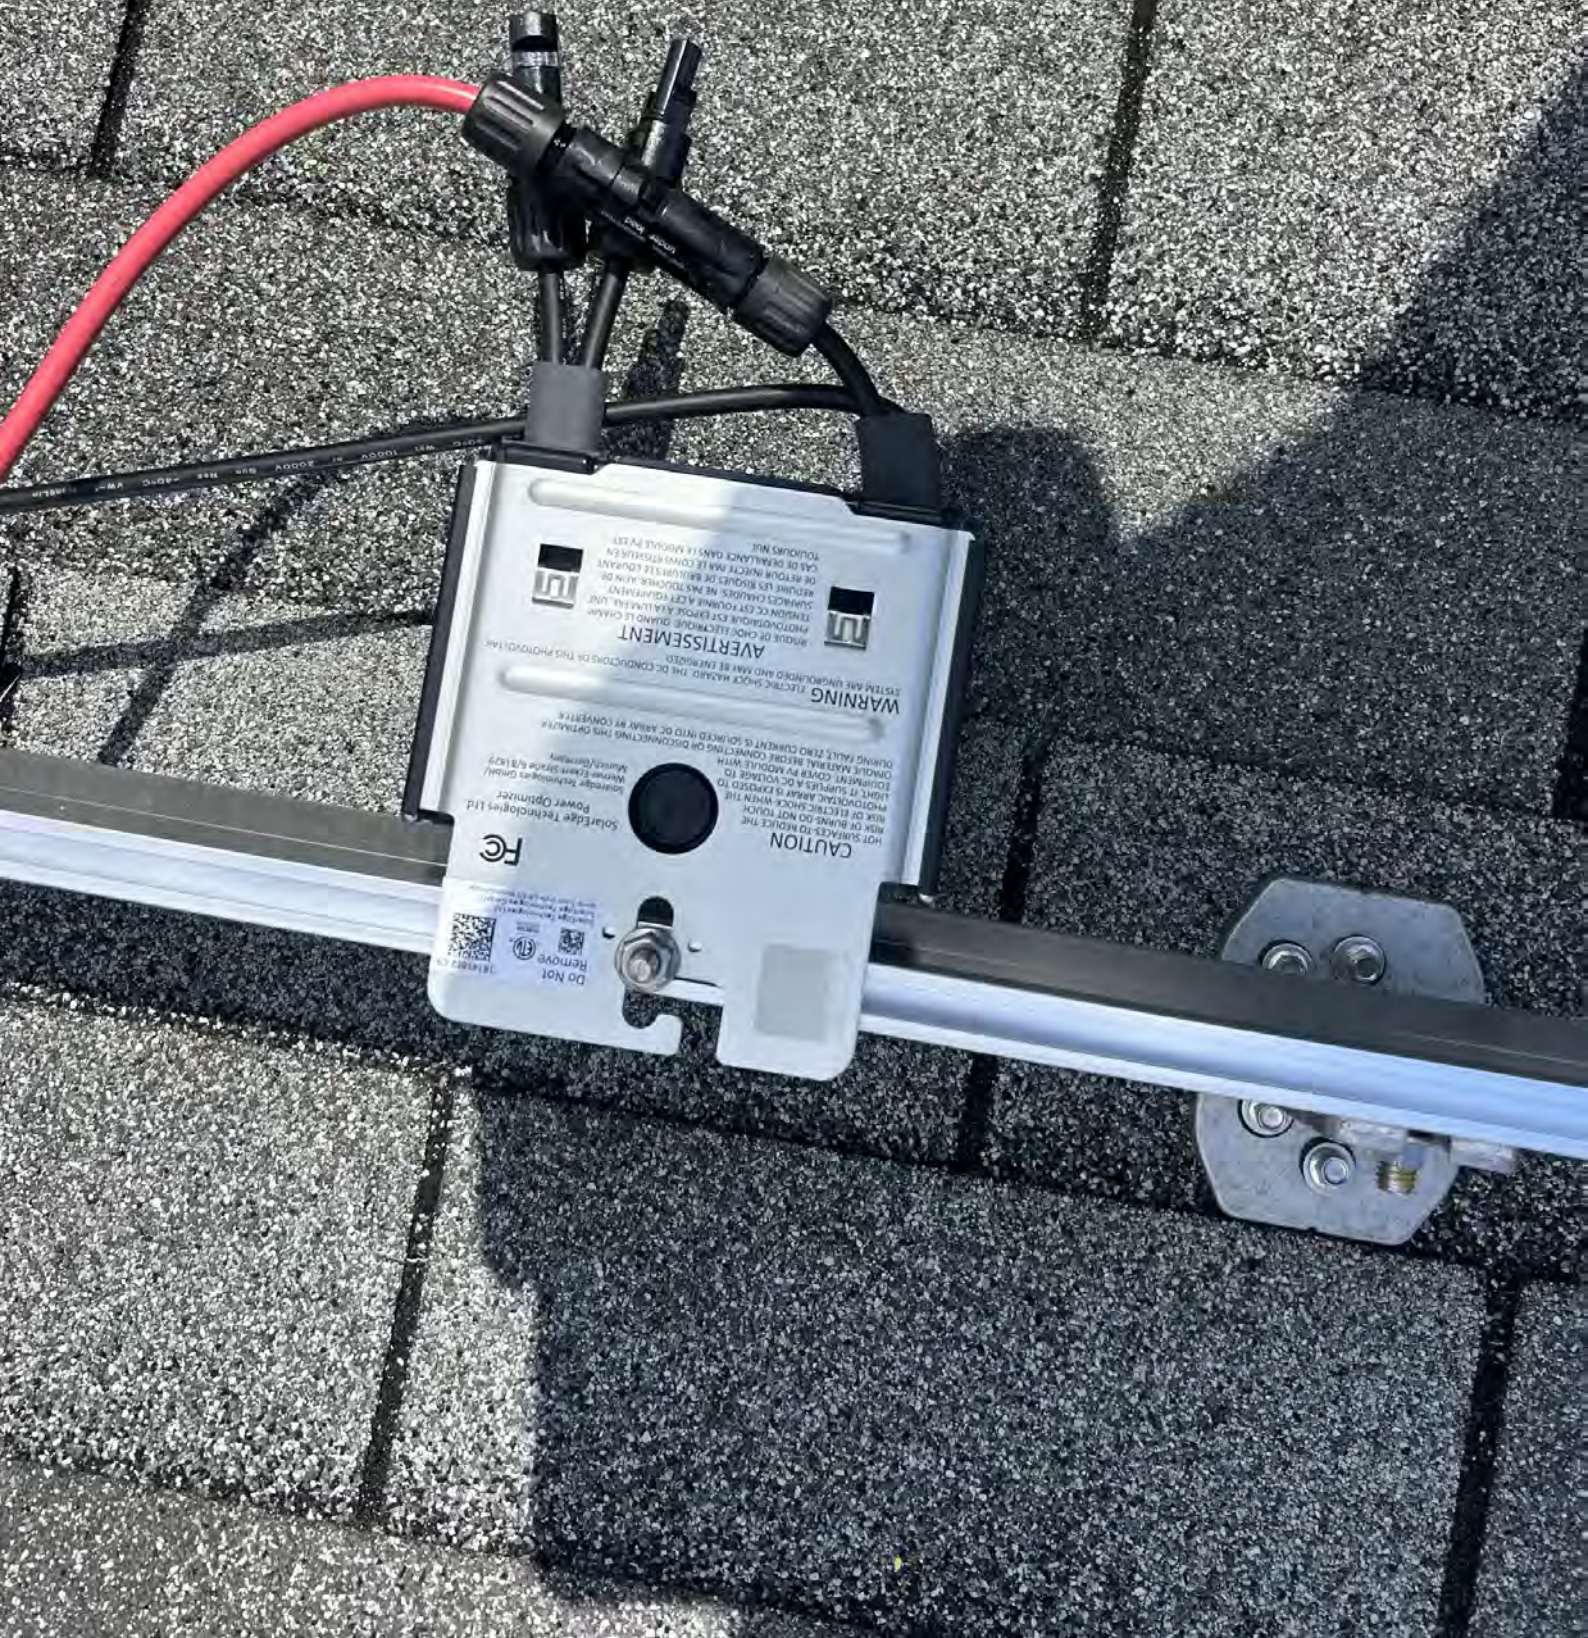















(1) CHAÎNE DES
 (2) MOI
 interrupteur lorsque le
 (3) (4) (5)
 (6) (7) (8)
 (9) (10) (11)
 (12) (13) (14)
 (15) (16) (17)
 (18) (19) (20)
 (21) (22) (23)
 (24) (25) (26)
 (27) (28) (29)
 (30) (31) (32)
 (33) (34) (35)
 (36) (37) (38)
 (39) (40) (41)
 (42) (43) (44)
 (45) (46) (47)
 (48) (49) (50)
 (51) (52) (53)
 (54) (55) (56)
 (57) (58) (59)
 (60) (61) (62)
 (63) (64) (65)
 (66) (67) (68)
 (69) (70) (71)
 (72) (73) (74)
 (75) (76) (77)
 (78) (79) (80)
 (81) (82) (83)
 (84) (85) (86)
 (87) (88) (89)
 (90) (91) (92)
 (93) (94) (95)
 (96) (97) (98)
 (99) (100) (101)
 (102) (103) (104)
 (105) (106) (107)
 (108) (109) (110)
 (111) (112) (113)
 (114) (115) (116)
 (117) (118) (119)
 (120) (121) (122)
 (123) (124) (125)
 (126) (127) (128)
 (129) (130) (131)
 (132) (133) (134)
 (135) (136) (137)
 (138) (139) (140)
 (141) (142) (143)
 (144) (145) (146)
 (147) (148) (149)
 (150) (151) (152)
 (153) (154) (155)
 (156) (157) (158)
 (159) (160) (161)
 (162) (163) (164)
 (165) (166) (167)
 (168) (169) (170)
 (171) (172) (173)
 (174) (175) (176)
 (177) (178) (179)
 (180) (181) (182)
 (183) (184) (185)
 (186) (187) (188)
 (189) (190) (191)
 (192) (193) (194)
 (195) (196) (197)
 (198) (199) (200)
 (201) (202) (203)
 (204) (205) (206)
 (207) (208) (209)
 (210) (211) (212)
 (213) (214) (215)
 (216) (217) (218)
 (219) (220) (221)
 (222) (223) (224)
 (225) (226) (227)
 (228) (229) (230)
 (231) (232) (233)
 (234) (235) (236)
 (237) (238) (239)
 (240) (241) (242)
 (243) (244) (245)
 (246) (247) (248)
 (249) (250) (251)
 (252) (253) (254)
 (255) (256) (257)
 (258) (259) (260)
 (261) (262) (263)
 (264) (265) (266)
 (267) (268) (269)
 (270) (271) (272)
 (273) (274) (275)
 (276) (277) (278)
 (279) (280) (281)
 (282) (283) (284)
 (285) (286) (287)
 (288) (289) (290)
 (291) (292) (293)
 (294) (295) (296)
 (297) (298) (299)
 (300) (301) (302)
 (303) (304) (305)
 (306) (307) (308)
 (309) (310) (311)
 (312) (313) (314)
 (315) (316) (317)
 (318) (319) (320)
 (321) (322) (323)
 (324) (325) (326)
 (327) (328) (329)
 (330) (331) (332)
 (333) (334) (335)
 (336) (337) (338)
 (339) (340) (341)
 (342) (343) (344)
 (345) (346) (347)
 (348) (349) (350)
 (351) (352) (353)
 (354) (355) (356)
 (357) (358) (359)
 (360) (361) (362)
 (363) (364) (365)
 (366) (367) (368)
 (369) (370) (371)
 (372) (373) (374)
 (375) (376) (377)
 (378) (379) (380)
 (381) (382) (383)
 (384) (385) (386)
 (387) (388) (389)
 (390) (391) (392)
 (393) (394) (395)
 (396) (397) (398)
 (399) (400) (401)
 (402) (403) (404)
 (405) (406) (407)
 (408) (409) (410)
 (411) (412) (413)
 (414) (415) (416)
 (417) (418) (419)
 (420) (421) (422)
 (423) (424) (425)
 (426) (427) (428)
 (429) (430) (431)
 (432) (433) (434)
 (435) (436) (437)
 (438) (439) (440)
 (441) (442) (443)
 (444) (445) (446)
 (447) (448) (449)
 (450) (451) (452)
 (453) (454) (455)
 (456) (457) (458)
 (459) (460) (461)
 (462) (463) (464)
 (465) (466) (467)
 (468) (469) (470)
 (471) (472) (473)
 (474) (475) (476)
 (477) (478) (479)
 (480) (481) (482)
 (483) (484) (485)
 (486) (487) (488)
 (489) (490) (491)
 (492) (493) (494)
 (495) (496) (497)
 (498) (499) (500)
 (501) (502) (503)
 (504) (505) (506)
 (507) (508) (509)
 (510) (511) (512)
 (513) (514) (515)
 (516) (517) (518)
 (519) (520) (521)
 (522) (523) (524)
 (525) (526) (527)
 (528) (529) (530)
 (531) (532) (533)
 (534) (535) (536)
 (537) (538) (539)
 (540) (541) (542)
 (543) (544) (545)
 (546) (547) (548)
 (549) (550) (551)
 (552) (553) (554)
 (555) (556) (557)
 (558) (559) (560)
 (561) (562) (563)
 (564) (565) (566)
 (567) (568) (569)
 (570) (571) (572)
 (573) (574) (575)
 (576) (577) (578)
 (579) (580) (581)
 (582) (583) (584)
 (585) (586) (587)
 (588) (589) (590)
 (591) (592) (593)
 (594) (595) (596)
 (597) (598) (599)
 (600) (601) (602)
 (603) (604) (605)
 (606) (607) (608)
 (609) (610) (611)
 (612) (613) (614)
 (615) (616) (617)
 (618) (619) (620)
 (621) (622) (623)
 (624) (625) (626)
 (627) (628) (629)
 (630) (631) (632)
 (633) (634) (635)
 (636) (637) (638)
 (639) (640) (641)
 (642) (643) (644)
 (645) (646) (647)
 (648) (649) (650)
 (651) (652) (653)
 (654) (655) (656)
 (657) (658) (659)
 (660) (

235-6

 LISTED

ENCLOSED SWITCH
INTERRUPTEUR EN GABINETTE
INTERRUPTEUR SOUS COFFRET

ISSUE NO. AL-72

NOM-367 

[illegible]

**SNAP-IN
2ND**

**SNAP-IN
2ND**

REINSTALL AFTER WIRING

REINSTALE DESPUÉS DEL CABLEADO

REINSTALLER APRÈS L'INSTALLATION ÉLECTRIQUE

INSTALL 1ST

Southside
300 CHINA
COVER



CAUTION
A CAJA CON
LO ADJUNTO,
NEUTRO Y
PRENO DE LA CAJA
30-19348







solaredge

Made in USA 
from imported parts


DC DISCONNECT

RAPID SHUTDOWN
SWITCH FOR
SOLAR PV SYSTEM

RAPID SHUTDOWN
SWITCH FOR
SOLAR PV SYSTEM

solar-edge

SOLAR PV SYSTEM
EQUIPPED WITH
RAPID SHUTDOWN



TURN RAPID SHUTDOWN SWITCH TO
THE "OFF" POSITION TO SHUT DOWN
PV SYSTEM AND REDUCE
SHOCK HAZARD IN THE ARRAY

AC DISCONNECT
PHOTOVOLTAIC SYSTEM
POWER SOURCE

RATED AC
OUTPUT CURRENT **24** AMPS
NOMINAL OPERATING
AC VOLTAGE **240** VOLTS

WARNING

POWER SOURCE
OUTPUT CONNECTION
DO NOT RELOCATE THIS
OVERCURRENT DEVICE

WARNING

ELECTRIC SHOCK HAZARD

TERMINALS ON THE LINE AND
LOAD SIDES MAY BE ENERGIZED
IN THE OPEN POSITION

RAPID SHUTDOWN
SWITCH FOR
SOLAR PV SYSTEM

CAUTION
SOLAR ELECTRIC SYSTEM CONNECTED


EATON

General Duty Safety Switch
interrupteur de sécurité à usage général
interruptor de seguridad de servicio general
60 A, 240 V~ 60 Hz
Complete ratings inside
Valeurs nominales complètes à l'intérieur
Información completa de capacidades en el
interior
Further instructions inside
Autres instructions à l'intérieur
Instrucciones adicionales en el interior
Made in U.S.A. / Fabriqué aux E.-U. / Hecho en E.U.A.

⚡ DANGER
DO NOT TOUCH LINES, WIRE, CABLES
OR ELECTRICAL EQUIPMENT. THIS COULD
CAUSE SEVERE INJURY OR DEATH.
NE PAS TOUCHER LES LIGNES, LES CÂBLES
OU L'ÉQUIPEMENT ÉLECTRIQUE. CELA POURRAIT
CAUSER DE GRAVES BLESSURES OU LA MORT.
NO TOQUE LAS LÍNEAS, LOS CABLES
O EL EQUIPAMIENTO ELÉCTRICO. ESTO PODRÍA
CAUSAR HERIDAS GRAVES O LA MUERTE.




CAUTION:
MULTIPLE SOURCES OF POWER.
THE SERVICE DISCONNECT IS LOCATED
INSIDE OPPOSITE THE UTILITY METER.

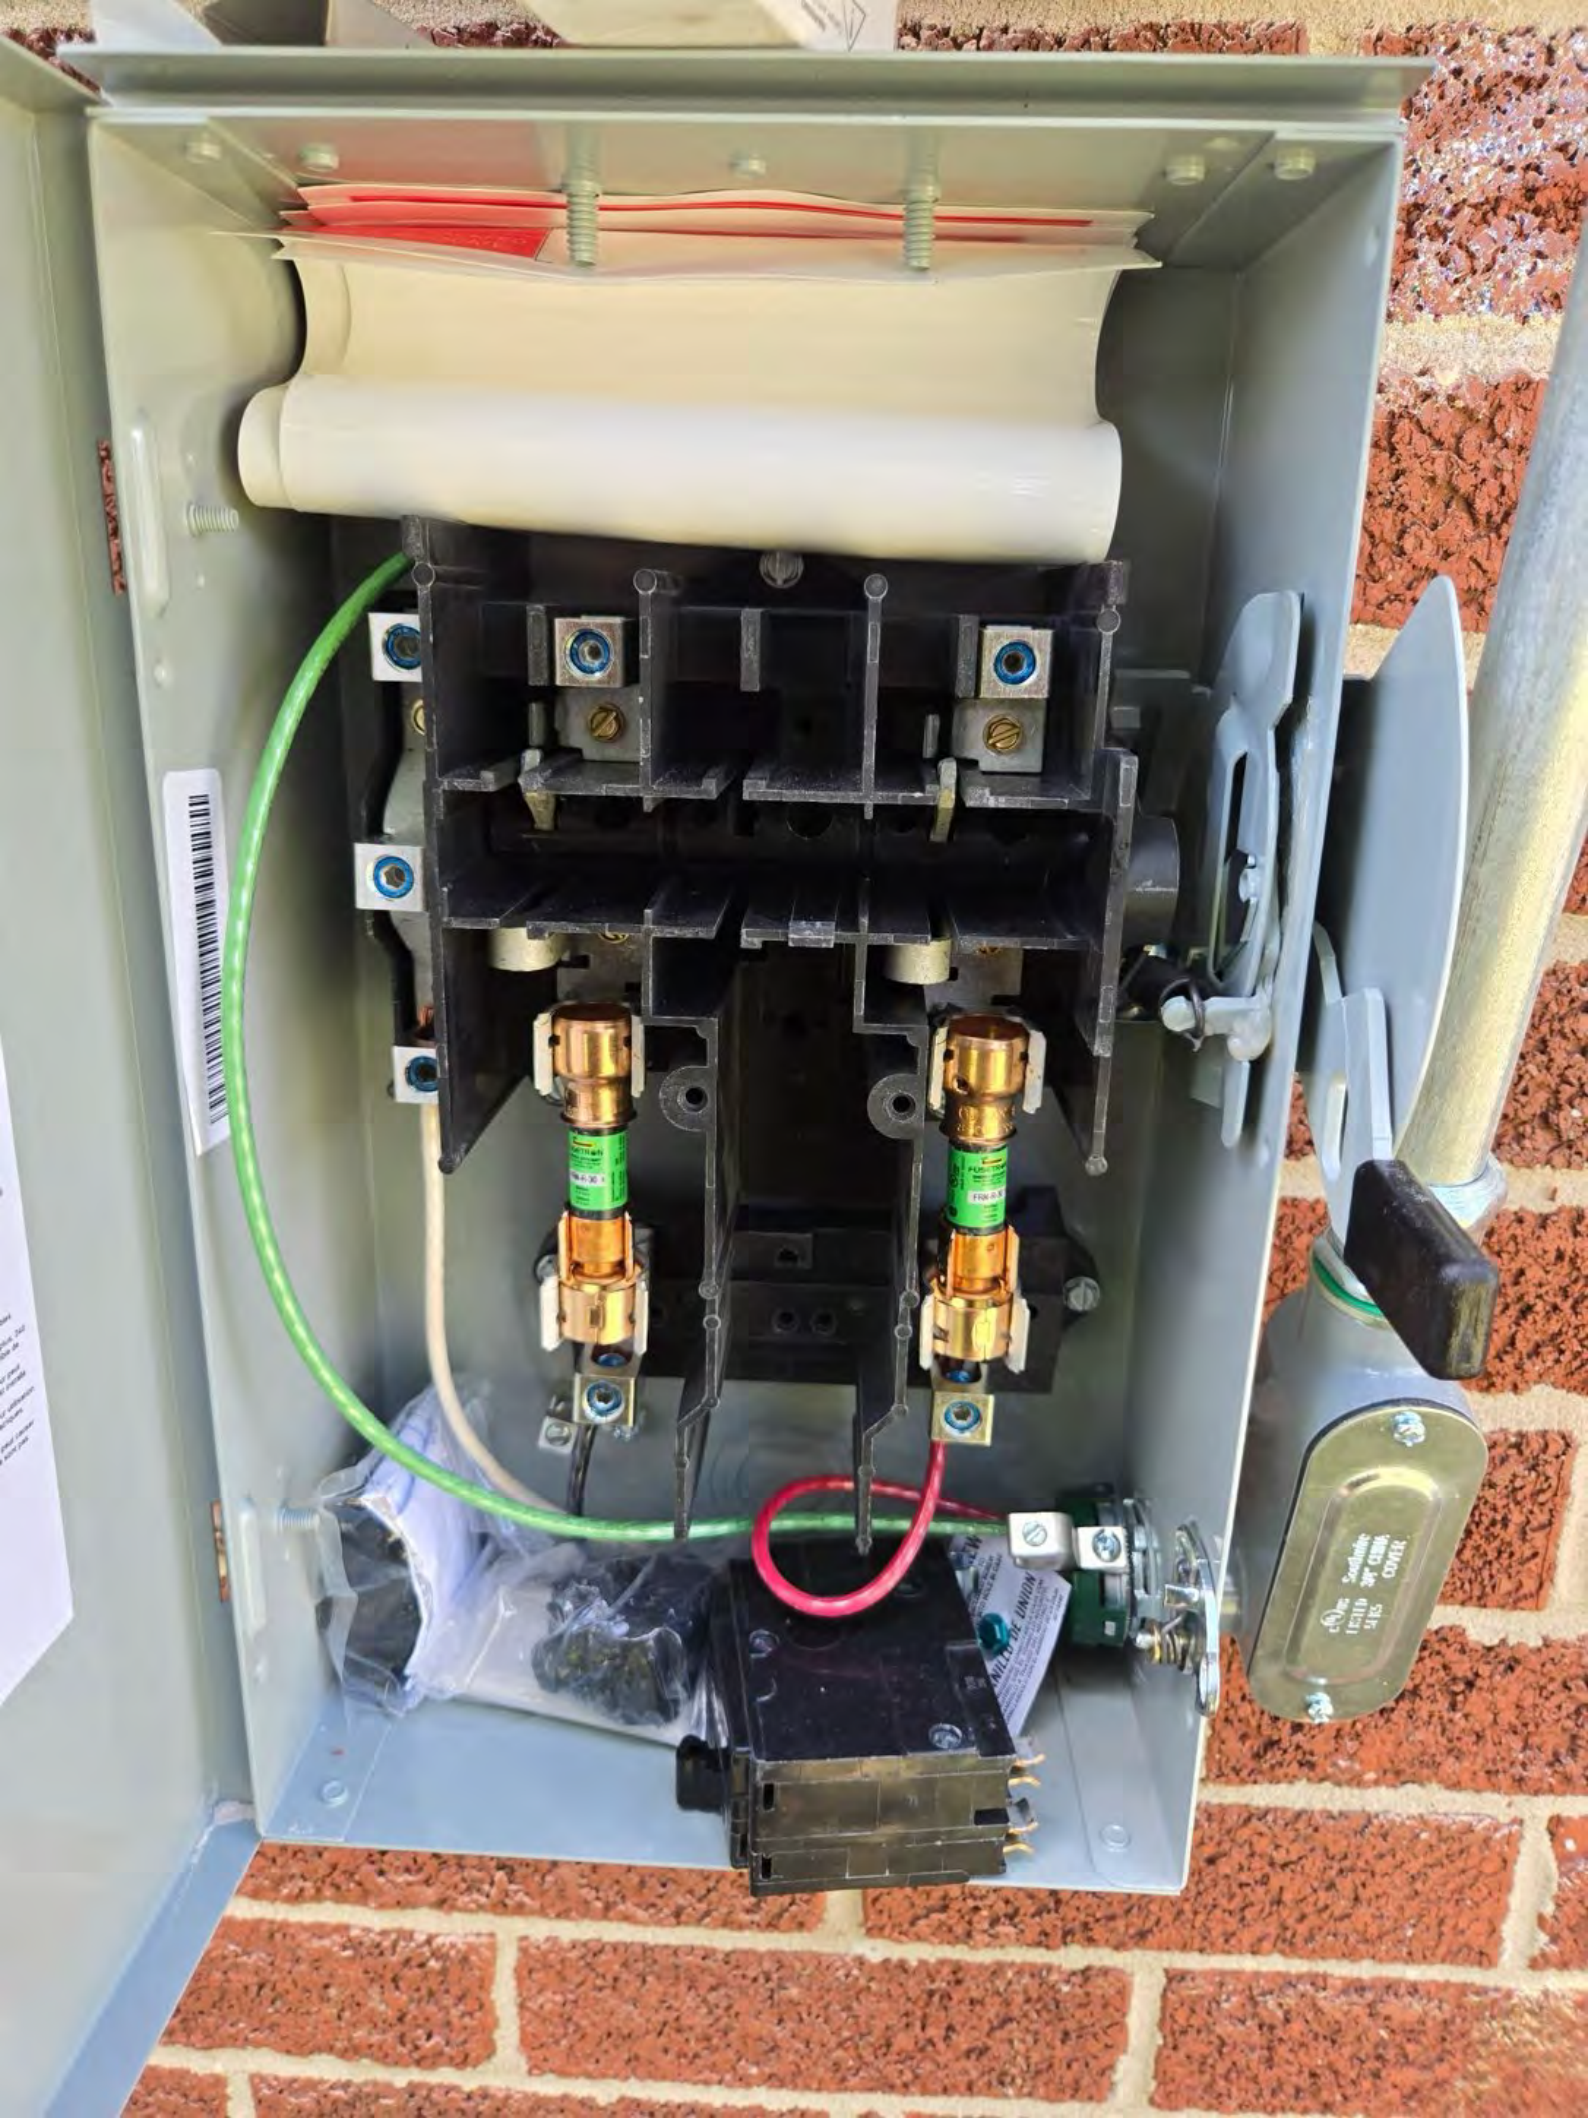

12/110

METER

FUSE BLOCK

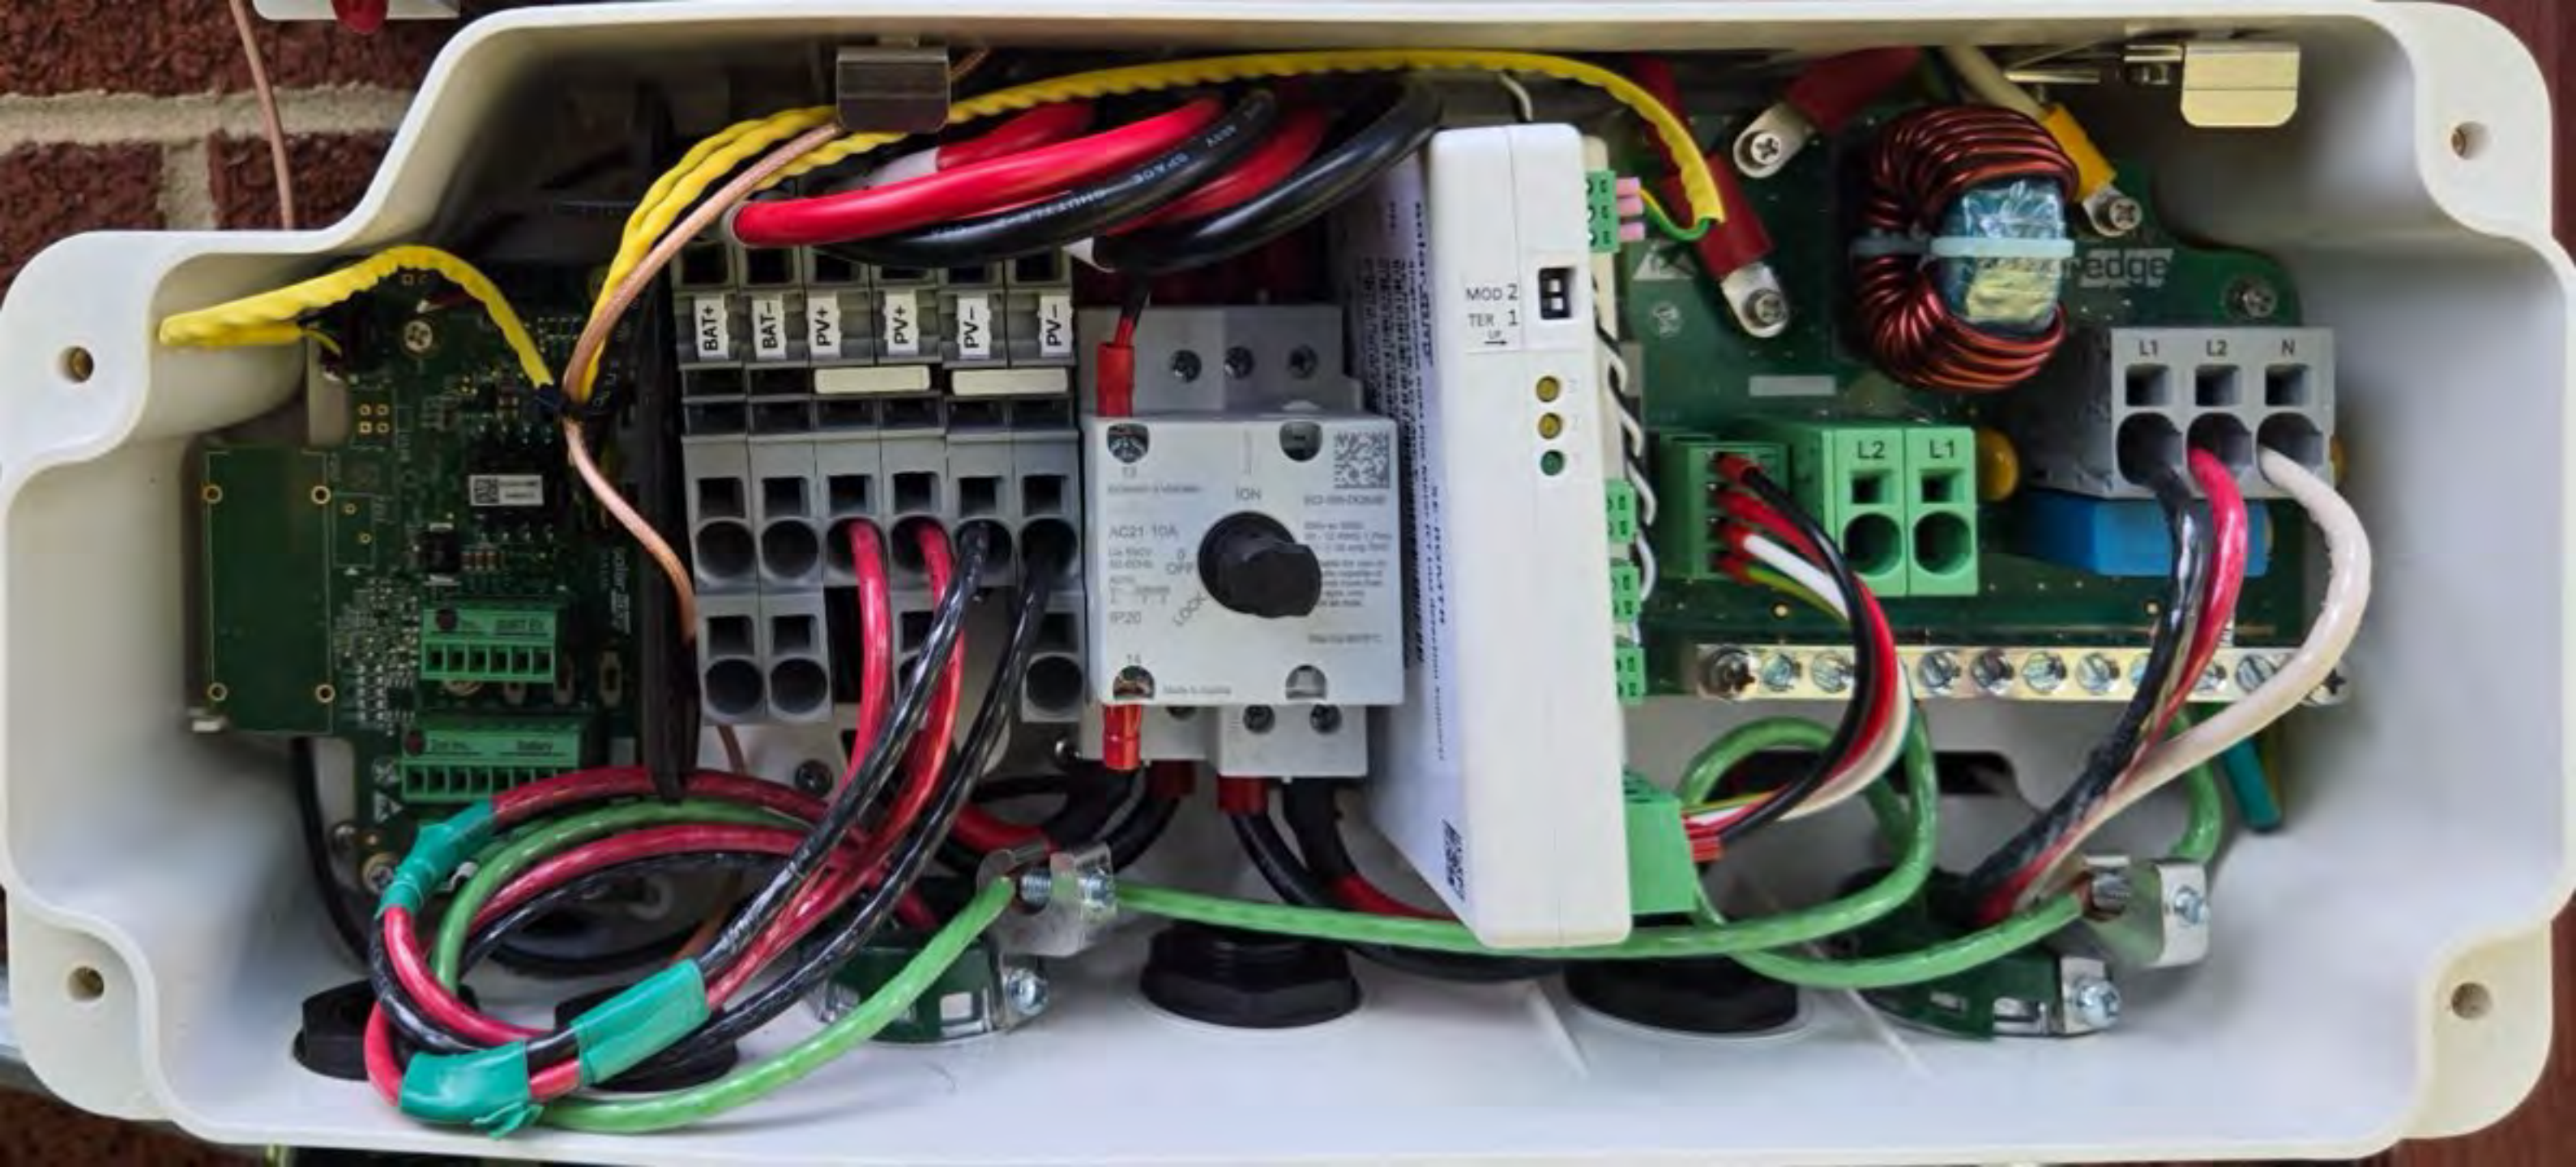



CB-1

FUSETRON
ENERGY EFFICIENT
FUSIBLE THERMAL RELAY
CIRCUIT BREAKER
FRN-R-30
300VAC
125VDC
30A
1000A

FUSETRON
ENERGY EFFICIENT
FUSIBLE THERMAL RELAY
CIRCUIT BREAKER
FRN-R-30
300VAC
125VDC
30A
1000A

UNION
CONECTAR LA CABLE CON
PINILLO ADJUNTO
DEL NEUTRO Y
TIPO DE LA CABLE
30-18348







KOBALT

40A 400A

Temp °C °F

Ω CAP

V Hz

OFF NCV AUTO POWER OFF

DT-9180D

08.13 V

RANGE MODE MAX MIN

AC TRMS CLAMP METER











LINE

SNAP-IN
2ND


SNAP-IN
2ND

REINSTALL AFTER WIRING

REINSTALE DESPUÉS DEL CABLEADO

REINSTALLER APRÈS L'INSTALLATION ÉLECTRIQUE

INSTALL 1ST

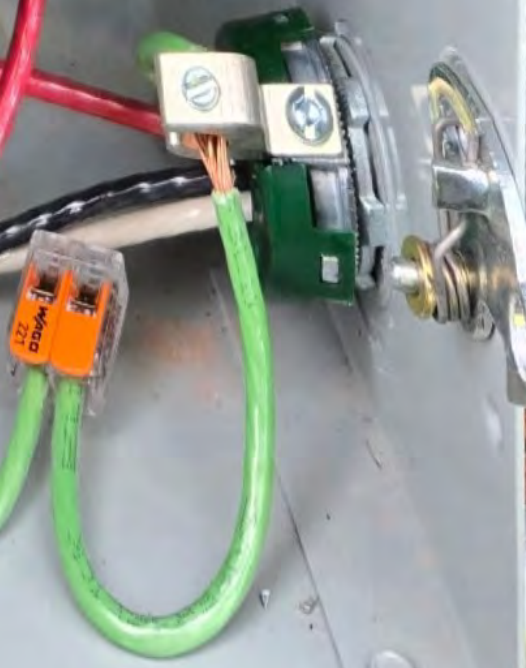



WARNING

DUAL POWER SUPPLY
SOURCES: UTILITY GRID
AND PV SOLAR
ELECTRIC SYSTEM

SOLAR POINT OF INTERCONNECTION

WARNING

POWER SOURCE
OUTPUT CONNECTION
DO NOT RELOCATE THIS
OVERCURRENT DEVICE

CAUTION:

MULTIPLE SOURCES OF POWER
THE PV DISCONNECT IS LOCATED
BESIDE THE SERVICE METER





MAIN



SOLAR PV BREAKER
BREAKER IS BACKFEED

QO LOAD CENTER

CAT. QOC 30MG225
SERIES L4

TO DISCONNECT ENTIRE SERVICE, SWITCH OFF THE HANDLE MARKED **MAIN** OR **MAIN** DISCONNECT.

UNDERWRITERS' LABORATORIES, INC.
LISTED
ELECTRIC CABINET FRONT
ISSUE NO. H-903

SERVICE RATING AMPS.
ELECTRICAL INSPECTION BY

ON
OFF
TRIPPED

HANDLE AT MID POSITION OR RED TRIP INDICATOR SHOWS BREAKER IS TRIPPED. TO RESET, PUSH HANDLE TO OFF POSITION, THEN TURN ON.

1 FURNACE	Bed rooms LTS	2
3 Bed room 5 Rec.	Over head kitchen chandelier	4
5 Refrigerator	WALL FAN	6
7	AIR COND	8
9 Kit GFCI #1	Bath room LTS	10
11 Dishwasher	Range Hood Recpt.	12
13 WATER HYD	OUT Side Light	14
15	Leak Detector	16
17 Central A.C	ATTIC FAN	18
19	GARAGE	20
21 DRYER	Kit GFCI #2	22
23	Hall Rec.	24
25 RANGE	Bath room Rec. GFCI	26
27		28
29		30

R - HANDLES

SQUARE D COMPANY
MADE IN U.S.A.

LOAD CENTER
20-40MVA
LS

