

# PHOTOVOLTAIC ROOF MOUNT SYSTEM

(E) 26 + (N) 4 MODULES-ROOF MOUNTED - 12.020 kW DC, 8.700 kW AC

580 NEW CASTLE LN, SPRING LAKE, NC 28390




TOP TIER SOLAR SOLUTIONS

1530 CENTER PARK DR #2911,  
CHARLOTTE, NC 28217,  
UNITED STATES

REVISIONS

DESCRIPTION	DATE	REV
INITIAL DESIGN	07/30/2025	



Reviewed and approved  
Richard Pantel, P.E.  
NC Lic. No. 043326  
07/30/2025

PROJECT NAME & ADDRESS

JOSHUA SPRAGUE  
RESIDENCE

580 NEW CASTLE LN,  
SPRING LAKE, NC 28390

DRAWN BY

ESR

SHEET NAME

COVER SHEET

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

PV-1

PROJECT DATA

PROJECT ADDRESS 580 NEW CASTLE LN,  
SPRING LAKE, NC 28390

OWNER: JOSHUA SPRAGUE

DESIGNER: ESR

SCOPE: (N)1.620 kW DC ROOF MOUNT  
SOLAR PV SYSTEM WITH  
4 JA SOLAR: JAM54S31-405/MR 405W  
PV MODULES WITH  
(N)4 ENPHASE IQ8PLUS-72-2-US 290W  
MICRO INVERTERS EQUIPPED WITH  
RAPID SHUTDOWN


EXISTING:  
(E) 7.540 KW DC ROOF MOUNT  
SOLAR PV SYSTEM WITH  
(E) (26) HANWHA SOLAR : Q.PEAK DUO BLK  
ML-G10+ 400W PV MODULES WITH  
(E) (26) ENPHASE IQ8PLUS-72-2-US 290W  
MICRO INVERTERS EQUIPPED WITH RAPID  
SHUTDOWN

AUTHORITIES HAVING JURISDICTION:  
BUILDING: HARNETT COUNTY  
ZONING: HARNETT COUNTY  
UTILITY: SOUTH RIVER EMC

SHEET INDEX

PV-1 COVER SHEET  
PV-2 SITE PLAN  
PV-3 ROOF PLAN & MODULES  
PV-4 ELECTRICAL PLAN  
PV-5 STRUCTURAL DETAIL  
PV-6 ELECTRICAL LINE DIAGRAM  
PV-7 WIRING CALCULATIONS  
PV-8 LABELS  
PV-9+ EQUIPMENT SPECIFICATIONS


SIGNATURE




GENERAL NOTES

- ALL COMPONENTS ARE UL LISTED AND CEC CERTIFIED, WHERE WARRANTED.
- THE SOLAR PV SYSTEM WILL BE INSTALLED IN ACCORDANCE WITH ARTICLE 690 OF THE NEC 2017.
- THE UTILITY INTERCONNECTION APPLICATION MUST BE APPROVED AND PV SYSTEM INSPECTED PRIOR TO PARALLEL OPERATION.
- ALL CONDUCTORS OF A CIRCUIT, INCLUDING THE EGC, MUST BE INSTALLED IN THE SAME RACEWAY, OR CABLE, OR OTHERWISE RUN WITH THE PV ARRAY CIRCUIT CONDUCTORS WHEN THEY LEAVE THE VICINITY OF THE PV ARRAY.
- WHERE METALLIC CONDUIT CONTAINING DC CONDUCTORS IS USED INSIDE THE BUILDING, IT SHALL BE IDENTIFIED AS "CAUTION: SOLAR CIRCUIT" EVERY 10FT.
- HEIGHT OF THE AC DISCONNECT SHALL NOT EXCEED 6'-7" PER NEC CODE 240.24.
- A GROUNDING ELECTRODE SYSTEM IN ACCORDANCE WITH CEC 690.47 AND 250.50 THROUGH 60 AND 250-166 SHALL BE PROVIDED. PER NEC GROUNDING ELECTRODE SYSTEM OF EXISTING BUILDING MAY BE USED AND BONDED TO THE SERVICE ENTRANCE. IF EXISTING SYSTEM IS INACCESSIBLE OR INADEQUATE A SUPPLEMENTAL GROUNDING ELECTRODE WILL BE USED AT THE INVERTER LOCATION CONSISTING OF A UL LISTED 8 FT. GROUND ROD WITH ACORN CLAMP. GROUNDING ELECTRODE CONDUCTORS SHALL BE NO LESS THAN #8 AWG AND NO LARGER THAN #6 AWG COPPER AND BONDED TO THE EXISTING GROUNDING ELECTRODE TO PROVIDE FOR A COMPLETE SYSTEM.
- PHOTOVOLTAIC MODULES ARE TO BE CONSIDERED NON-COMBUSTIBLE.
- PHOTOVOLTAIC INSTALLATION WILL NOT OBSTRUCT ANY PLUMBING. MECHANICAL, OR BUILDING ROOF VENTS.
- ALL WIRING MUST BE PROPERLY SUPPORTED BY DEVICES OR MECHANICAL MEANS DESIGNED AND LISTED FOR SUCH USE. WIRING MUST BE PERMANENTLY AND COMPLETELY HELD OFF THE ROOF SURFACE.
- ALL SINAGE TO BE PLACED IN ACCORDANCE WITH THE LOCAL BUILDING CODE. IF EXPOSED TO SUNLIGHT, IT SHALL BE UV RESISTANT. ALL PLAQUES AND SINAGE WILL BE INSTALLED AS REQUIRED BY THE NEC AND AHJ.
- INVERTER(S) USED IN UNGROUNDED SYSTEM SHALL BE UL 1741 LISTED.
- THE INSTALLATION OF EQUIPMENT AND ALL ASSOCIATED WIRING AND INTERCONNECTION SHALL BE PERFORMED ONLY BY QUALIFIED PERSONS [NEC 690.4(C)]
- ALL OUTDOOR EQUIPMENT SHALL BE NEMA 3R RATED (OR BETTER), INCLUDING ALL ROOF MOUNTED TRANSITION BOXES AND SWITCHES.
- ALL EQUIPMENT SHALL BE PROPERLY GROUNDED AND BONDED IN ACCORDANCE WITH NEC ARTICLE 250.
- SYSTEM GROUNDING SHALL BE IN ACCORDANCE WITH NEC 690.41.
- PV SYSTEM CIRCUITS INSTALLED ON OR IN BUILDINGS SHALL INCLUDE A RAPID SHUTDOWN FUNCTION IN ACCORDANCE WITH NEC 690.12
- DISCONNECTING MEANS SHALL BE LOCATED IN A VISIBLE, READILY ACCESSIBLE LOCATION WITHIN THE PV SYSTEM EQUIPMENT OR A MAXIMUM OF 10 FEET AWAY FROM THE SYSTEM [NEC 690.13(A)]
- ALL WIRING METHODS SHALL BE IN ACCORDANCE WITH NEC 690.31
- WORK CLEARANCES AROUND ELECTRICAL EQUIPMENT WILL BE MAINTAINED PER NEC 110.26(A)(1), 110.26(A)(2) AND 110.26(A)(3).
- ROOFTOP MOUNTED PHOTOVOLTAIC PANELS AND MODULES SHALL BE TESTED, LISTED & IDENTIFIED IN ACCORDANCE WITH UL1703
- ELECTRICAL CONTRACTOR TO PROVIDE CONDUIT EXPANSION JOINTS AND ANCHOR CONDUIT RUNS AS REQUIRED PER NEC.

VICINITY MAP

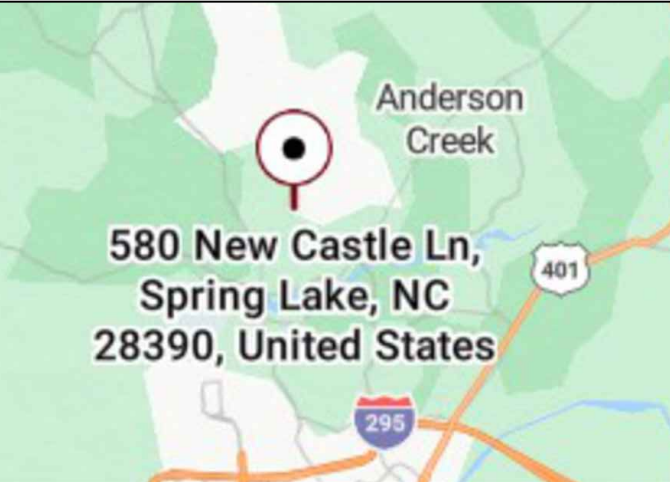

HOUSE PHOTO

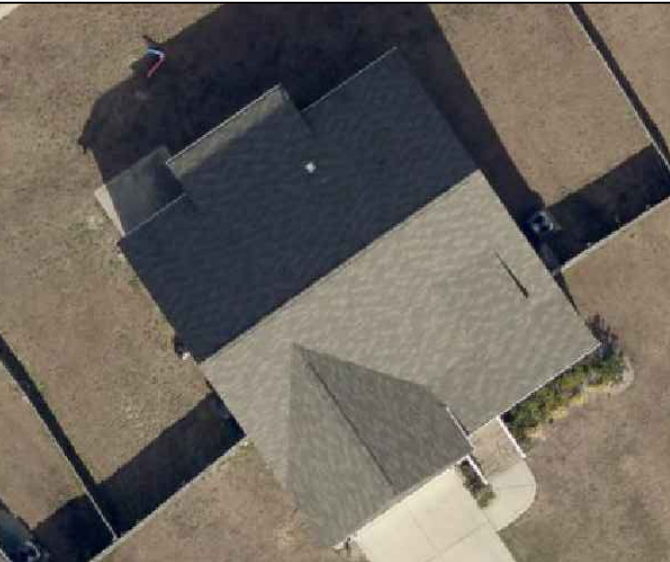

CODE REFERENCES

2018 NORTH CAROLINA BUILDING CODE  
2018 NORTH CAROLINA RESIDENTIAL CODE  
2018 NORTH CAROLINA FIRE CODE  
2017 NATIONAL ELECTRICAL CODE



PROJECT DESCRIPTION:



(N) 4 X JA SOLAR: JAM54S31-405/MR 405W MONO MODULES AND  
(E) (26) HANWHA SOLAR : Q.PEAK DUO BLK ML-G10+ 400W MONO MODULES  
ROOF MOUNTED SOLAR PHOTOVOLTAIC MODULES  
DC SYSTEM SIZE: (N) 4 X 405W + (E) 26 X 400W = 12.020 kW DC  
AC SYSTEM SIZE: (N) 4 X 290W + (E) 26 X 290W = 8.700 kW AC

EQUIPMENT SUMMARY

(N) 4 JA SOLAR: JAM54S31-405/MR 405W MONO MODULES  
(N) 4 ENPHASE IQ8PLUS-72-2-US 290W MICRO  
INVERTERS EQUIPPED WITH RAPID SHUTDOWN  
(E) (26) HANWHA SOLAR : Q.PEAK DUO BLK ML-G10+  
400W MONO MODULES  
(E) (26) ENPHASE IQ8PLUS-72-2-US 290W MICRO  
INVERTERS EQUIPPED WITH RAPID SHUTDOWN

(N) ROOF ARRAY AREA #1:- 42.02 SQ FT.  
(N) ROOF ARRAY AREA #2:- 42.02 SQ FT.

NOTE: VISIBLE, LOCKABLE, LABELED AC  
DISCONNECT  
LOCATED WITHIN 10' OF UTILITY METER

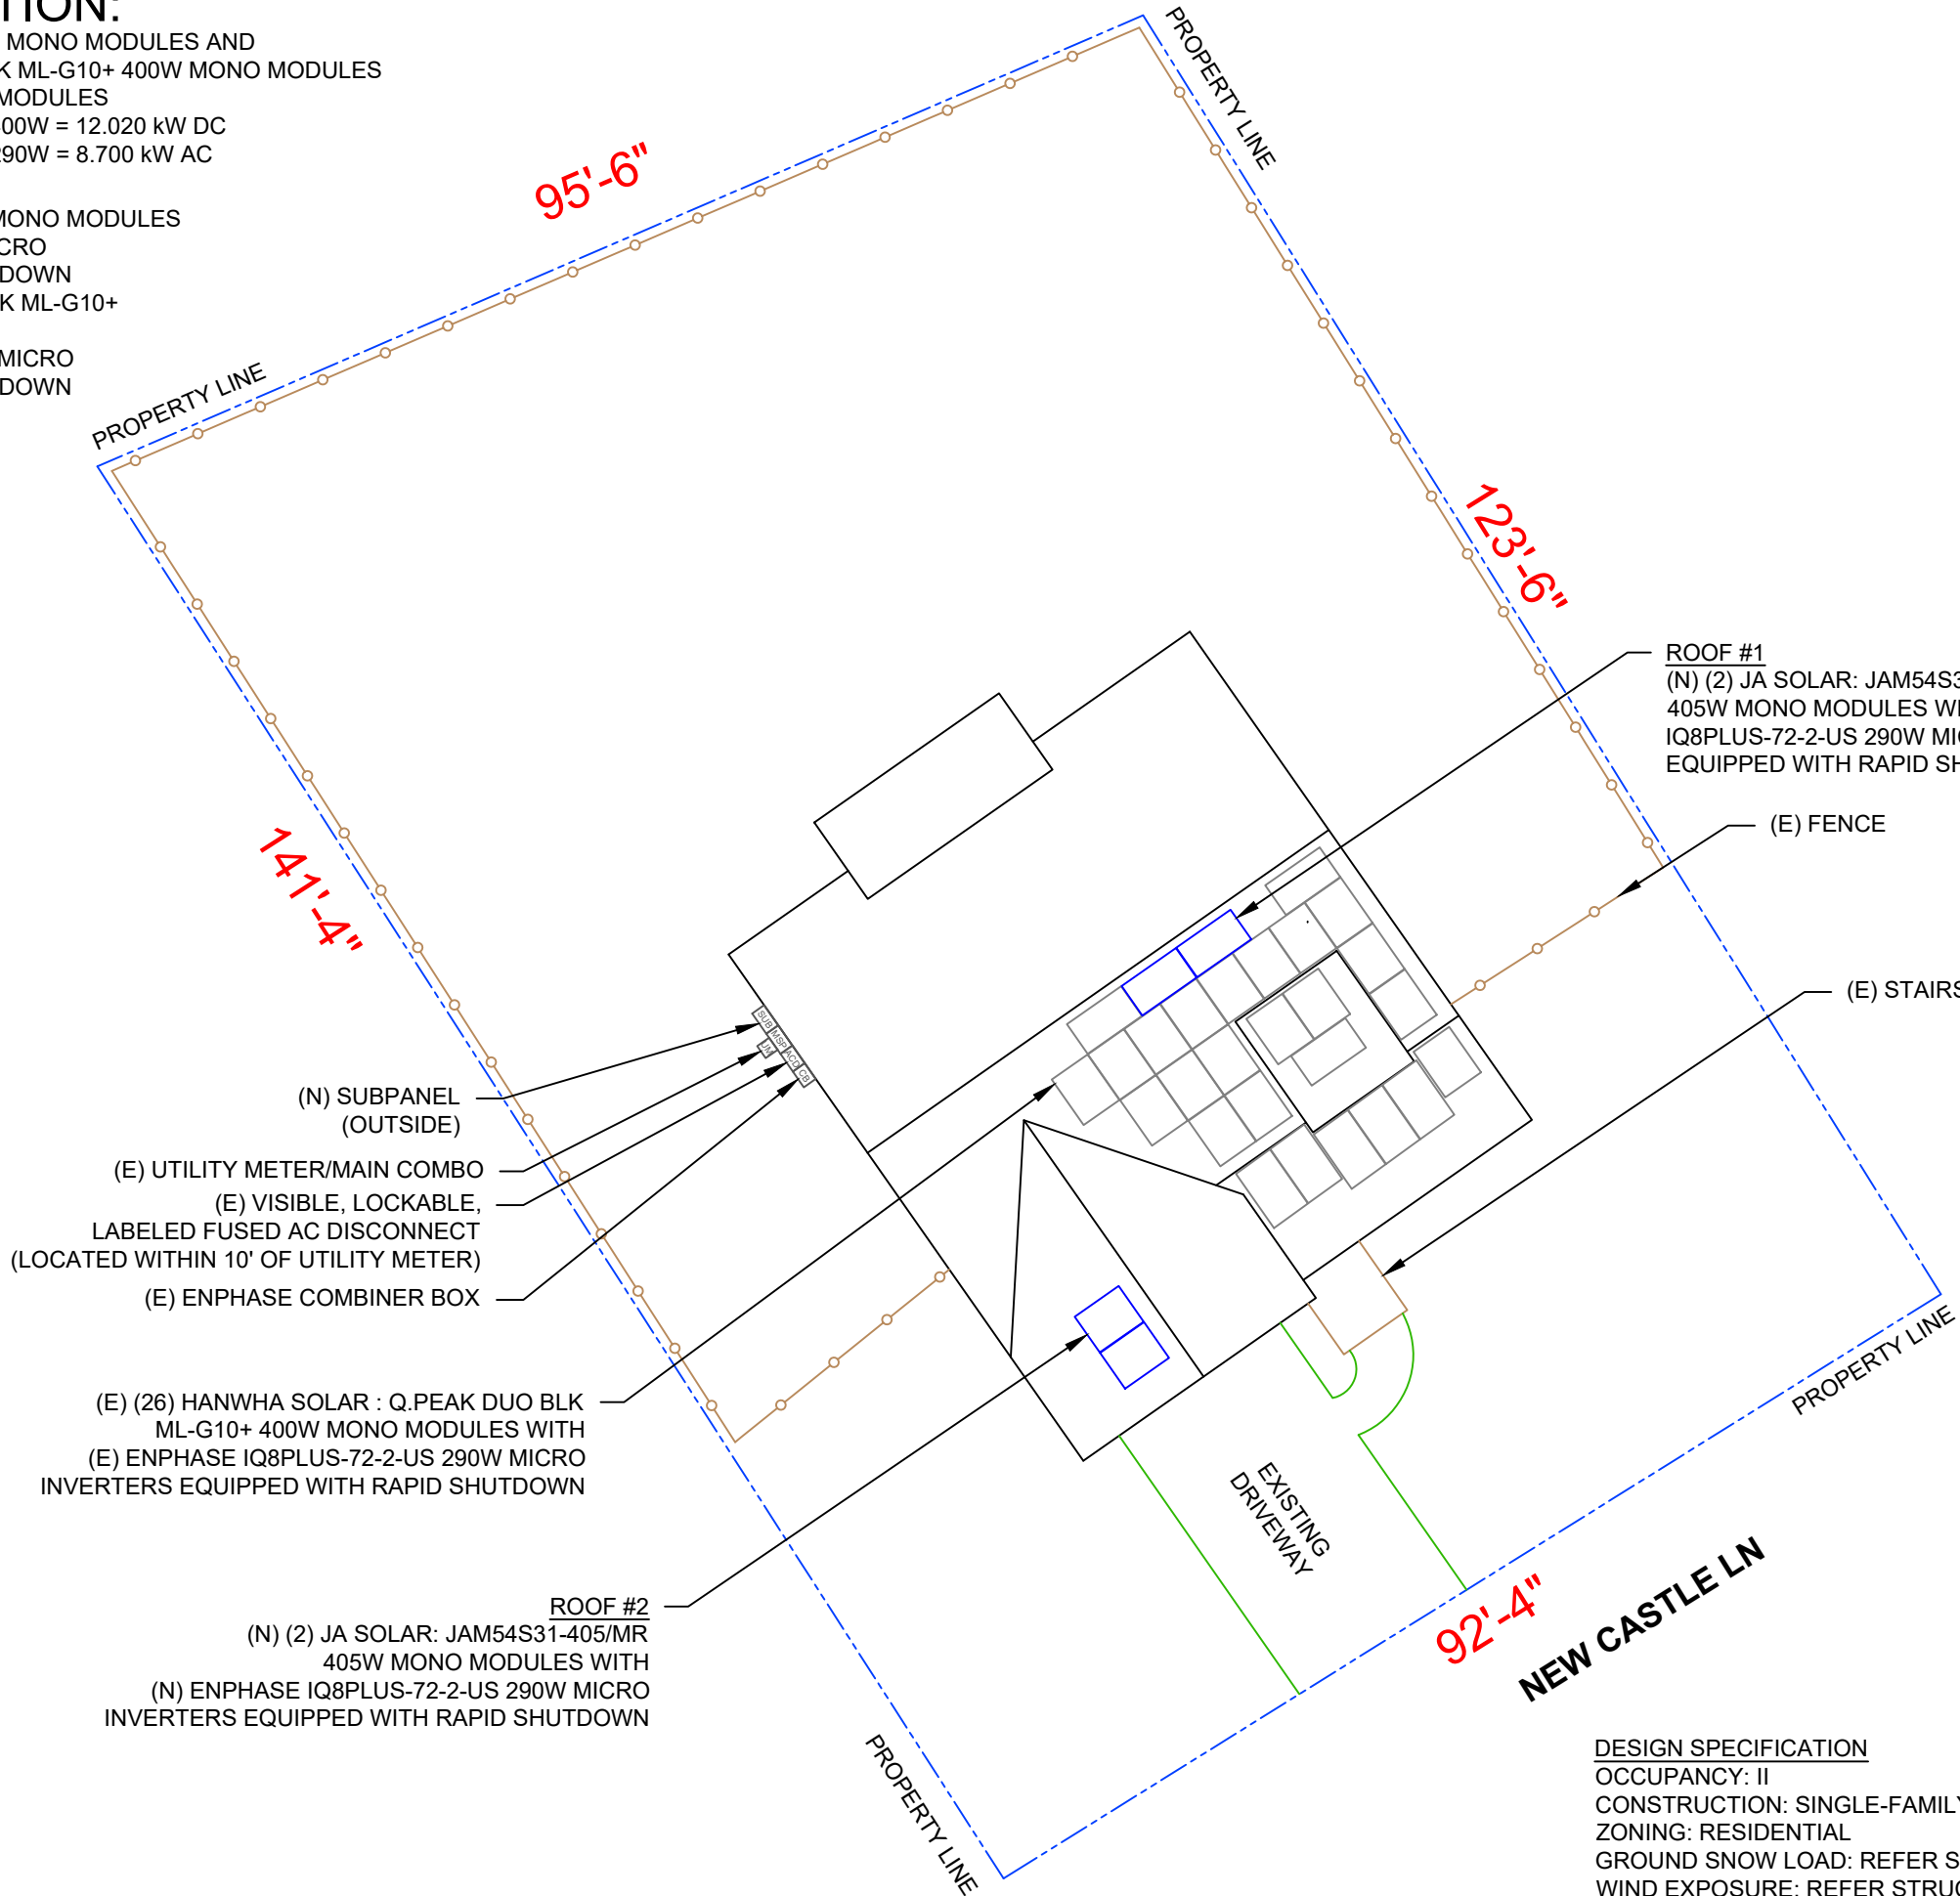

ROOF #1  
(N) (2) JA SOLAR: JAM54S31-405/MR  
405W MONO MODULES WITH (N) ENPHASE  
IQ8PLUS-72-2-US 290W MICRO INVERTERS  
EQUIPPED WITH RAPID SHUTDOWN

(E) FENCE  
(E) STAIRS

(N) SUBPANEL  
(OUTSIDE)  
(E) UTILITY METER/MAIN COMBO  
(E) VISIBLE, LOCKABLE,  
LABELED FUSED AC DISCONNECT  
(LOCATED WITHIN 10' OF UTILITY METER)  
(E) ENPHASE COMBINER BOX

(E) (26) HANWHA SOLAR : Q.PEAK DUO BLK  
ML-G10+ 400W MONO MODULES WITH  
(E) ENPHASE IQ8PLUS-72-2-US 290W MICRO  
INVERTERS EQUIPPED WITH RAPID SHUTDOWN

ROOF #2  
(N) (2) JA SOLAR: JAM54S31-405/MR  
405W MONO MODULES WITH  
(N) ENPHASE IQ8PLUS-72-2-US 290W MICRO  
INVERTERS EQUIPPED WITH RAPID SHUTDOWN


DESIGN SPECIFICATION  
OCCUPANCY: II  
CONSTRUCTION: SINGLE-FAMILY  
ZONING: RESIDENTIAL  
GROUND SNOW LOAD: REFER STRUCTURAL LETTER  
WIND EXPOSURE: REFER STRUCTURAL LETTER  
WIND SPEED: REFER STRUCTURAL LETTER



TOP TIER SOLAR SOLUTIONS

1530 CENTER PARK DR #2911,  
CHARLOTTE, NC 28217,  
UNITED STATES

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL DESIGN	07/30/2025	



Reviewed and approved  
Richard Pantel, P.E.  
NC Lic. No. 043326  
07/30/2025

PROJECT NAME & ADDRESS

JOSHUA SPRAGUE  
RESIDENCE  
580 NEW CASTLE LN,  
SPRING LAKE, NC 28390

DRAWN BY

ESR

SHEET NAME

SITE PLAN

SHEET SIZE


ANSI B  
11" X 17"

SHEET NUMBER

PV-2

MODULE TYPE, DIMENSIONS & WEIGHT


NUMBER OF MODULES = 4 MODULES  
MODULE TYPE = JA SOLAR: JAM54S31-405/MR 405W MONO MODULES  
MODULE WEIGHT = 46.3 LBS / 21.0KG.  
MODULE DIMENSIONS = (67.79" x 44.65")/144 = 21.01 SF



ROOF #1  
(N) (2) JA SOLAR: JAM54S31-405/MR 405W MONO MODULES WITH  
(N) ENPHASE IQ8PLUS-72-2-US 290W MICRO INVERTERS EQUIPPED WITH RAPID SHUTDOWN

4'-0" ALTERNATE MAX SPAN FOR DECK MOUNTING


(N) SUBPANEL (OUTSIDE)  
(E) UTILITY METER/MAIN COMBO

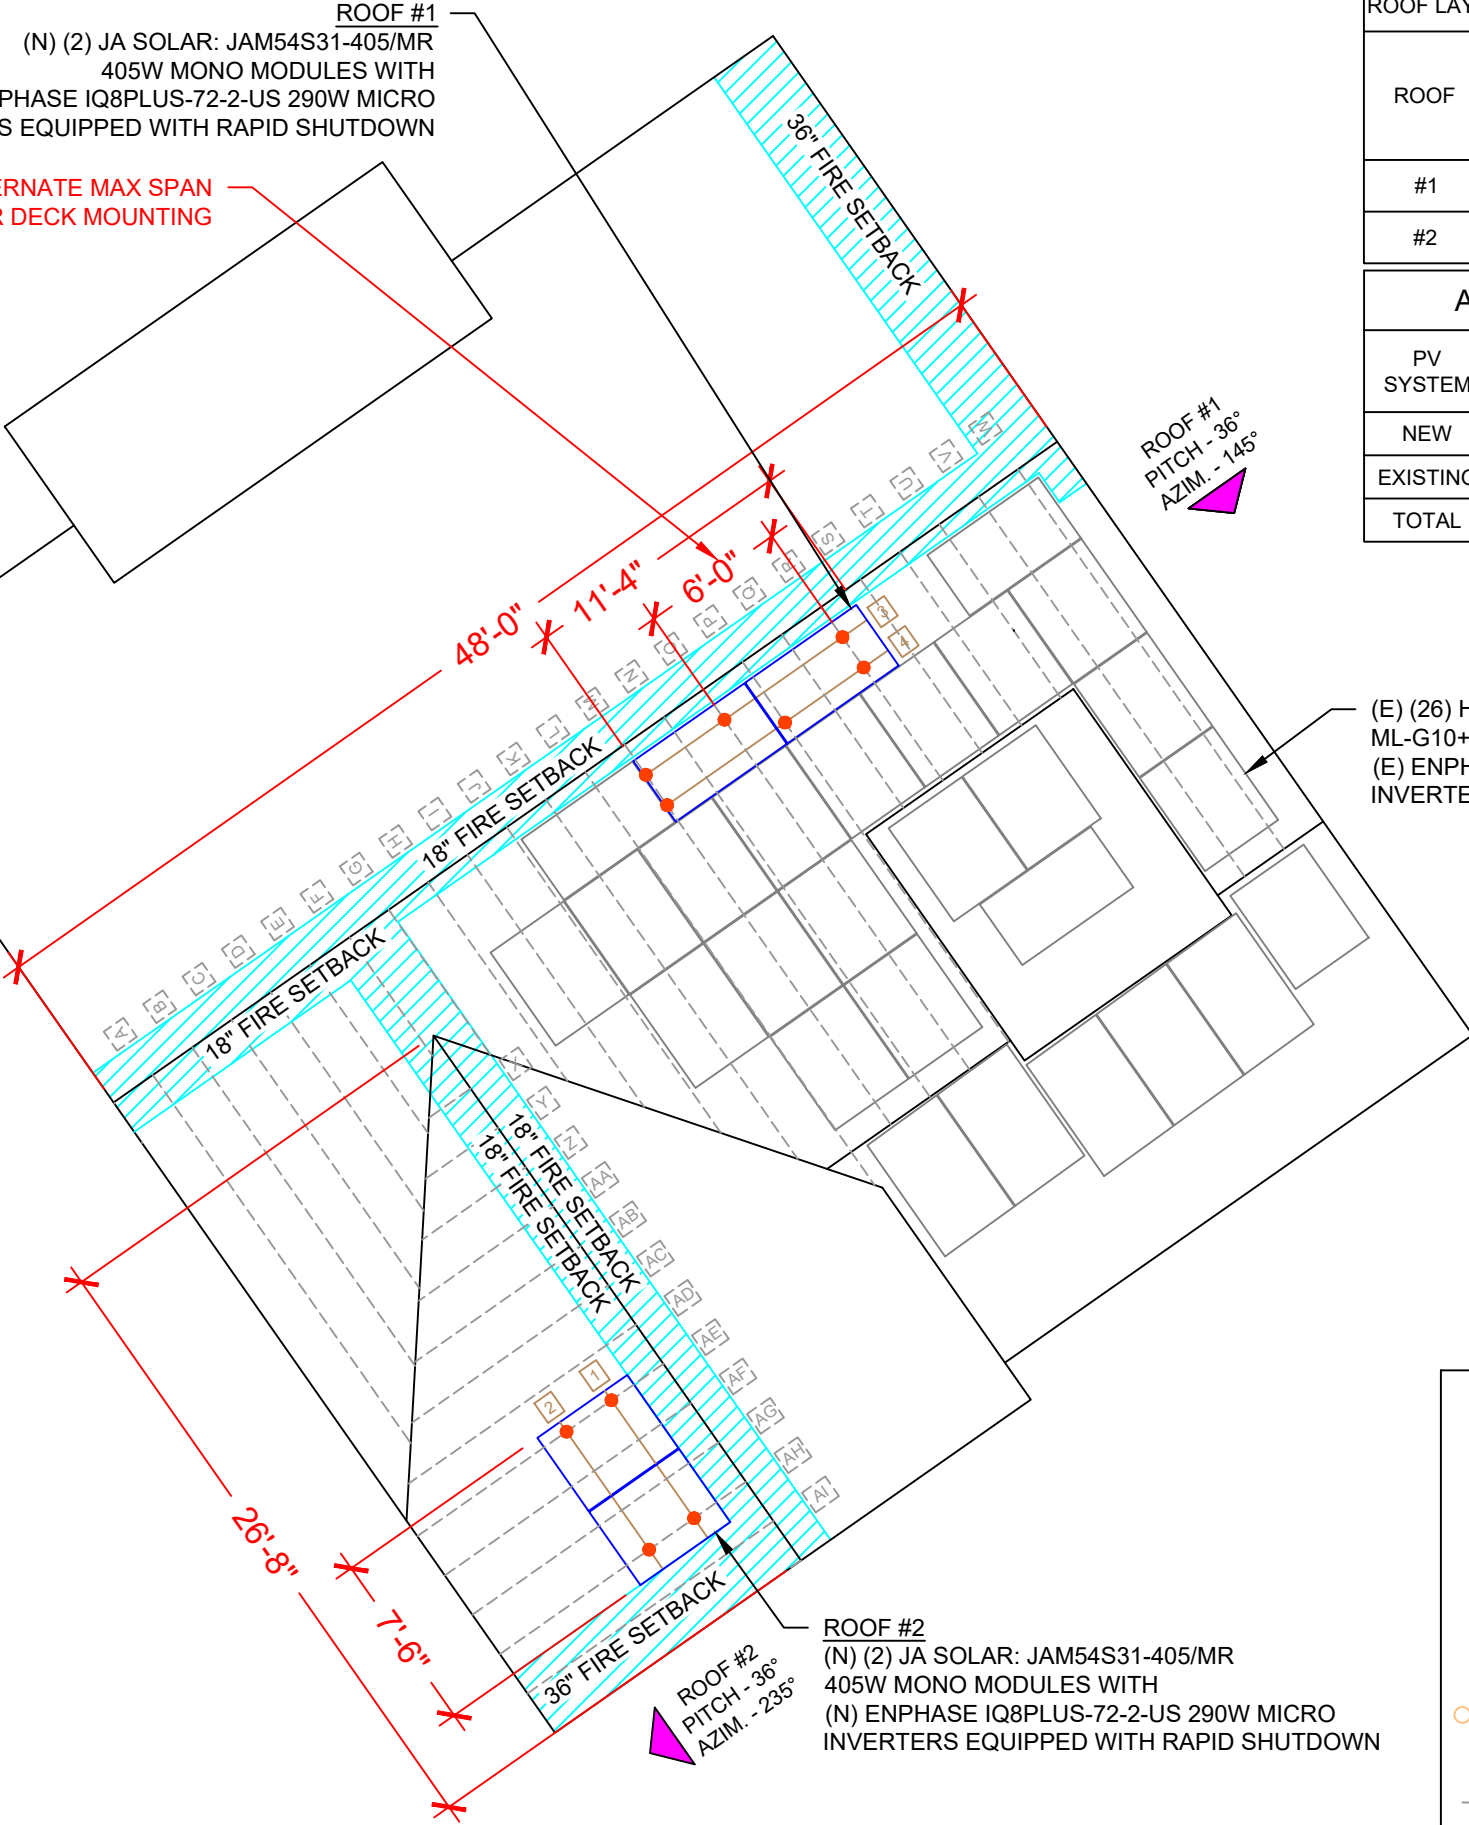

ROOF DESCRIPTION					
ROOF TYPE			ASPHALT SHINGLE		
ROOF LAYER			1 LAYER		
ROOF	# OF MODULES	ROOF PITCH	AZIMUTH	TRUSS SIZE	TRUSS SPACING
#1	2	36°	145°	2"X4"	24"
#2	2	36°	235°	2"X4"	24"

ARRAY AREA & ROOF AREA CALC'S			
PV SYSTEM	TOTAL PV ARRAY AREA (SQ. FT.)	TOTAL ROOF AREA (Sq. Ft.)	ROOF AREA COVERED BY ARRAY (%)
NEW	69.68	2581.60	3
EXISTING	554.58	2581.60	21
TOTAL	615.94	2581.60	24

(E) (26) HANWHA SOLAR : Q.PEAK DUO BLK ML-G10+ 400W MONO MODULES WITH  
(E) ENPHASE IQ8PLUS-72-2-US 290W MICRO INVERTERS EQUIPPED WITH RAPID SHUTDOWN

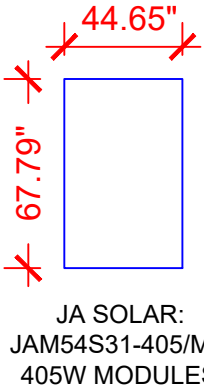


LEGEND

- JB - JUNCTION BOX
- CB - COMBINER BOX
- ACD - AC DISCONNECT
- UM - UTILITY METER
- MSP - MAIN SERVICE PANEL
- SUB - SUBPANEL
- - VENT, ATTIC FAN (ROOF OBSTRUCTION)
- - ROOF ATTACHMENT
- - TRUSS
- - CONDUIT



TOP TIER SOLAR SOLUTIONS  
1530 CENTER PARK DR #2911,  
CHARLOTTE, NC 28217,  
UNITED STATES

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL DESIGN	07/30/2025	



Reviewed and approved  
Richard Pantel, P.E.  
NC Lic. No. 043326  
07/30/2025

PROJECT NAME & ADDRESS

JOSHUA SPRAGUE  
RESIDENCE  
580 NEW CASTLE LN,  
SPRING LAKE, NC 28390

DRAWN BY  
ESR

SHEET NAME  
ROOF PLAN &  
MODULES

SHEET SIZE  
ANSI B  
11" X 17"

SHEET NUMBER  
PV-3

1 ROOF PLAN & MODULES


PV-3

SCALE: 1/8" = 1'-0"



DC SYSTEM SIZE: (N) 4 X 405W + (E) 26 X 400W = 12.020 kW DC  
AC SYSTEM SIZE: (N) 4 X 290W + (E) 26 X 290W = 8.700 kW AC  
(N) (4) JA SOLAR: JAM54S31-405/MR 405W MONO MODULES  
WITH (N) (4) ENPHASE IQ8PLUS-72-2-US 290W MICRO  
INVERTERS EQUIPPED WITH RAPID SHUTDOWN  
(E) (26) HANWHA SOLAR : Q.PEAK DUO BLK ML-G10+  
400 W MONO MODULES  
(E) (26) ENPHASE IQ8PLUS-72-2-US 290W MICRO INVERTERS  
EQUIPPED WITH RAPID SHUTDOWN

CIRCUIT LEGENDS	
<span style="color: red;">---</span>	(N)+(E) CIRCUIT #1
<span style="color: cyan;">---</span>	(N)+(E) CIRCUIT #2
<span style="color: orange;">---</span>	CIRCUIT #3



(N) JUNCTION BOX(TYP.)

CIRCUIT #3  
(E)8+(N) MODULES

BILL OF MATERIALS	
EQUIPMENT DESCRIPTION	QTY
SOLAR PV MODULES: JA SOLAR: JAM54S31-405/MR 405W MODULE	4
MICRO INVERTERS: ENPHASE IQ8PLUS-72-2-US 290W MICRO INVERTERS EQUIPPED WITH RAPID SHUTDOWN	4
JUNCTION BOX: JUNCTION BOX UL 1741, NEMA 3R CSA C22.2 NO.290	2
20A BREAKERS	1
FUSES: 50A FUSES 240V NEMA 3R, UL LISTED	2
IRONRIDGE XR10 RAIL (RAIL 168" (14 FEET) CLEAR) (XR-10-168A)	4
UNIVERSAL MODULE CLAMP, CLEAR (UFO-CL-01-A1)	4
STOPPER SLEEVE, 40MM, MILL (UFO-STP-40MM-M1)	8
GROUNDING LUG (XR-LUG-03-A1)	2
IRONRIDGE HALO ULTRAGRIP ATTACHMENTS (QM-HUG-01-M1)	10
RD STRUCTURAL SCREW,3.0L (HW-RD1430-01-M1)	20
T-BOLT BONDING HARDWARE (BHW-SQ-02-A1 )	10
MICRO INVERTER BONDING HARDWARE T-BOLT (BHW-MI-01-A1) (PRODUCT CODE 270-0152)	4



TOP TIER SOLAR SOLUTIONS

1530 CENTER PARK DR #2911,  
CHARLOTTE, NC 28217,  
UNITED STATES

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL DESIGN	07/30/2025	



PROJECT NAME & ADDRESS

JOSHUA SPRAGUE  
RESIDENCE

580 NEW CASTLE LN,  
SPRING LAKE, NC 28390

DRAWN BY

ESR

SHEET NAME

ELECTRICAL PLAN

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

PV-4

(N) SUBPANEL  
(OUTSIDE)  
(E) UTILITY METER/MAIN COMBO  
(E) VISIBLE, LOCKABLE,  
LABELED FUSED AC DISCONNECT  
(LOCATED WITHIN 10' OF UTILITY  
METER)  
(E) ENPHASE COMBINER BOX

CIRCUIT #1  
(N) 2+(E) 8 MODULES

(E) (26) ENPHASE IQ8PLUS-72-2-US  
290W MICRO INVERTERS EQUIPPED  
WITH RAPID SHUTDOWN  
LOCATED UNDER EACH PANEL (240V)

NEW CASTLE LN

CIRCUIT #2  
(N) 2+(E) 8 MODULES

(N) (4) ENPHASE IQ8PLUS-72-2-US 290W  
MICRO INVERTERS EQUIPPED WITH  
RAPID SHUTDOWN  
LOCATED UNDER EACH PANEL (240V)

LEGEND


	- JUNCTION BOX
	- COMBINER BOX
	- AC DISCONNECT
	- UTILITY METER
	- MAIN SERVICE PANEL
	- SUBPANEL
	- VENT, ATTIC FAN (ROOF OBSTRUCTION)
	- ROOF ATTACHMENT
	- TRUSS
	- CONDUIT

1


ELECTRICAL PLAN

PV-4

SCALE: 1/8" = 1'-0"

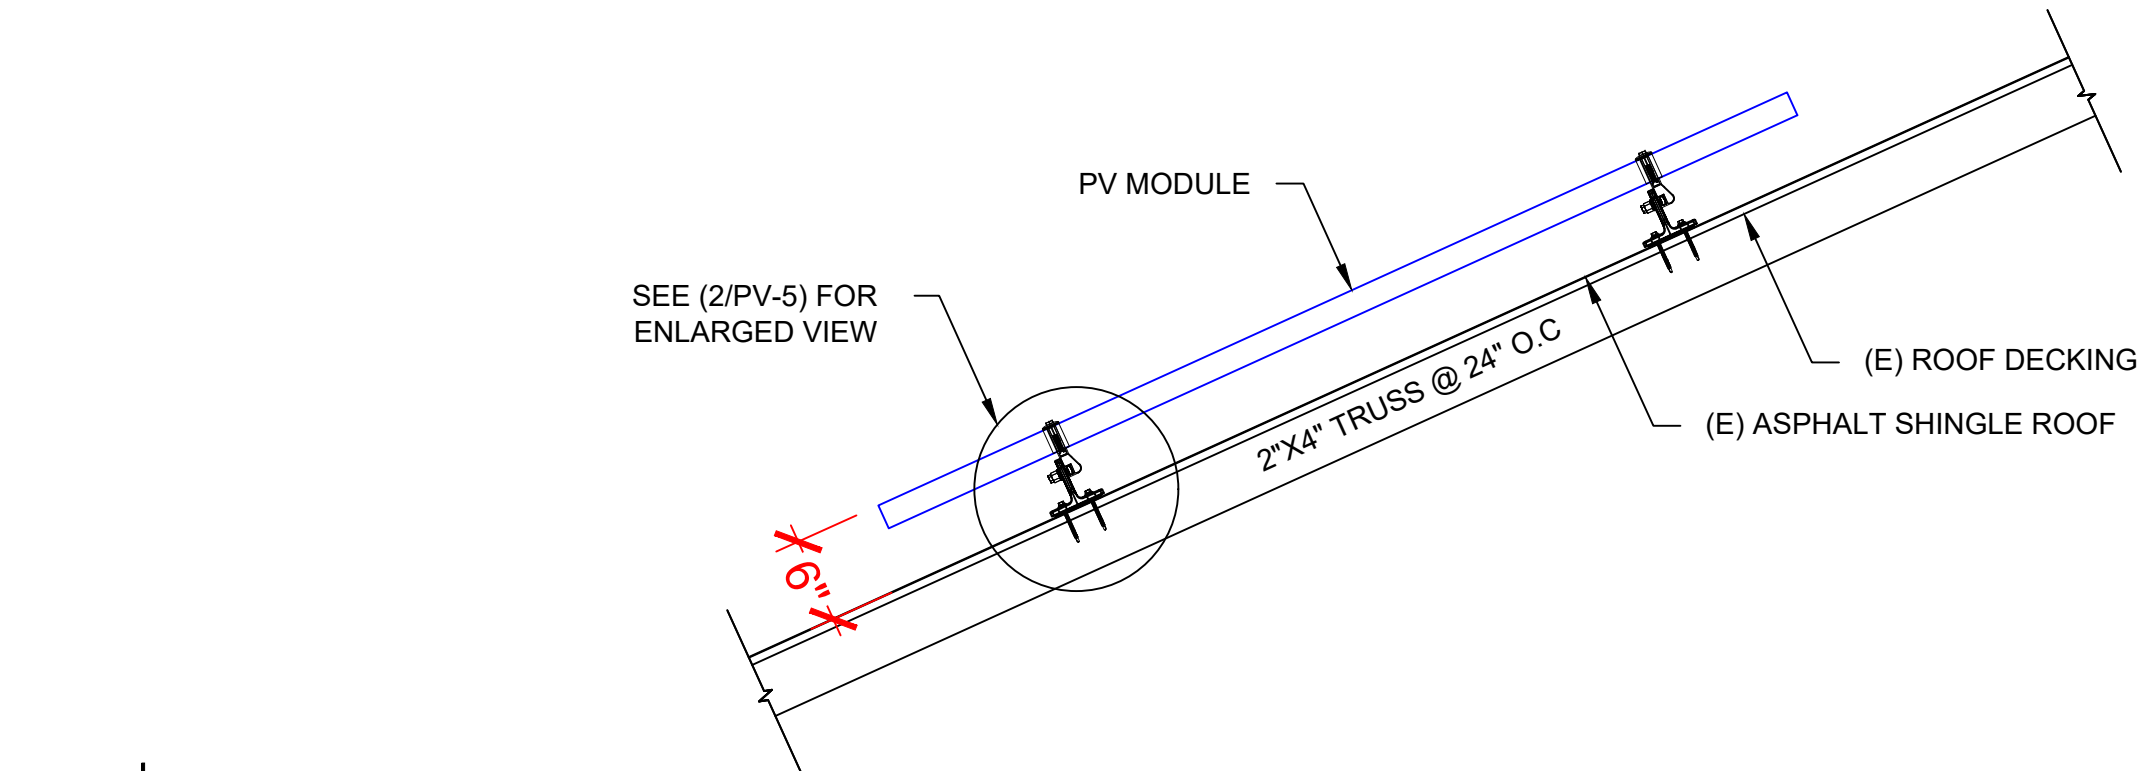

1 | STRUCTURAL ATTACHMENT (Side view)  
PV-5 | SCALE: N.T.S

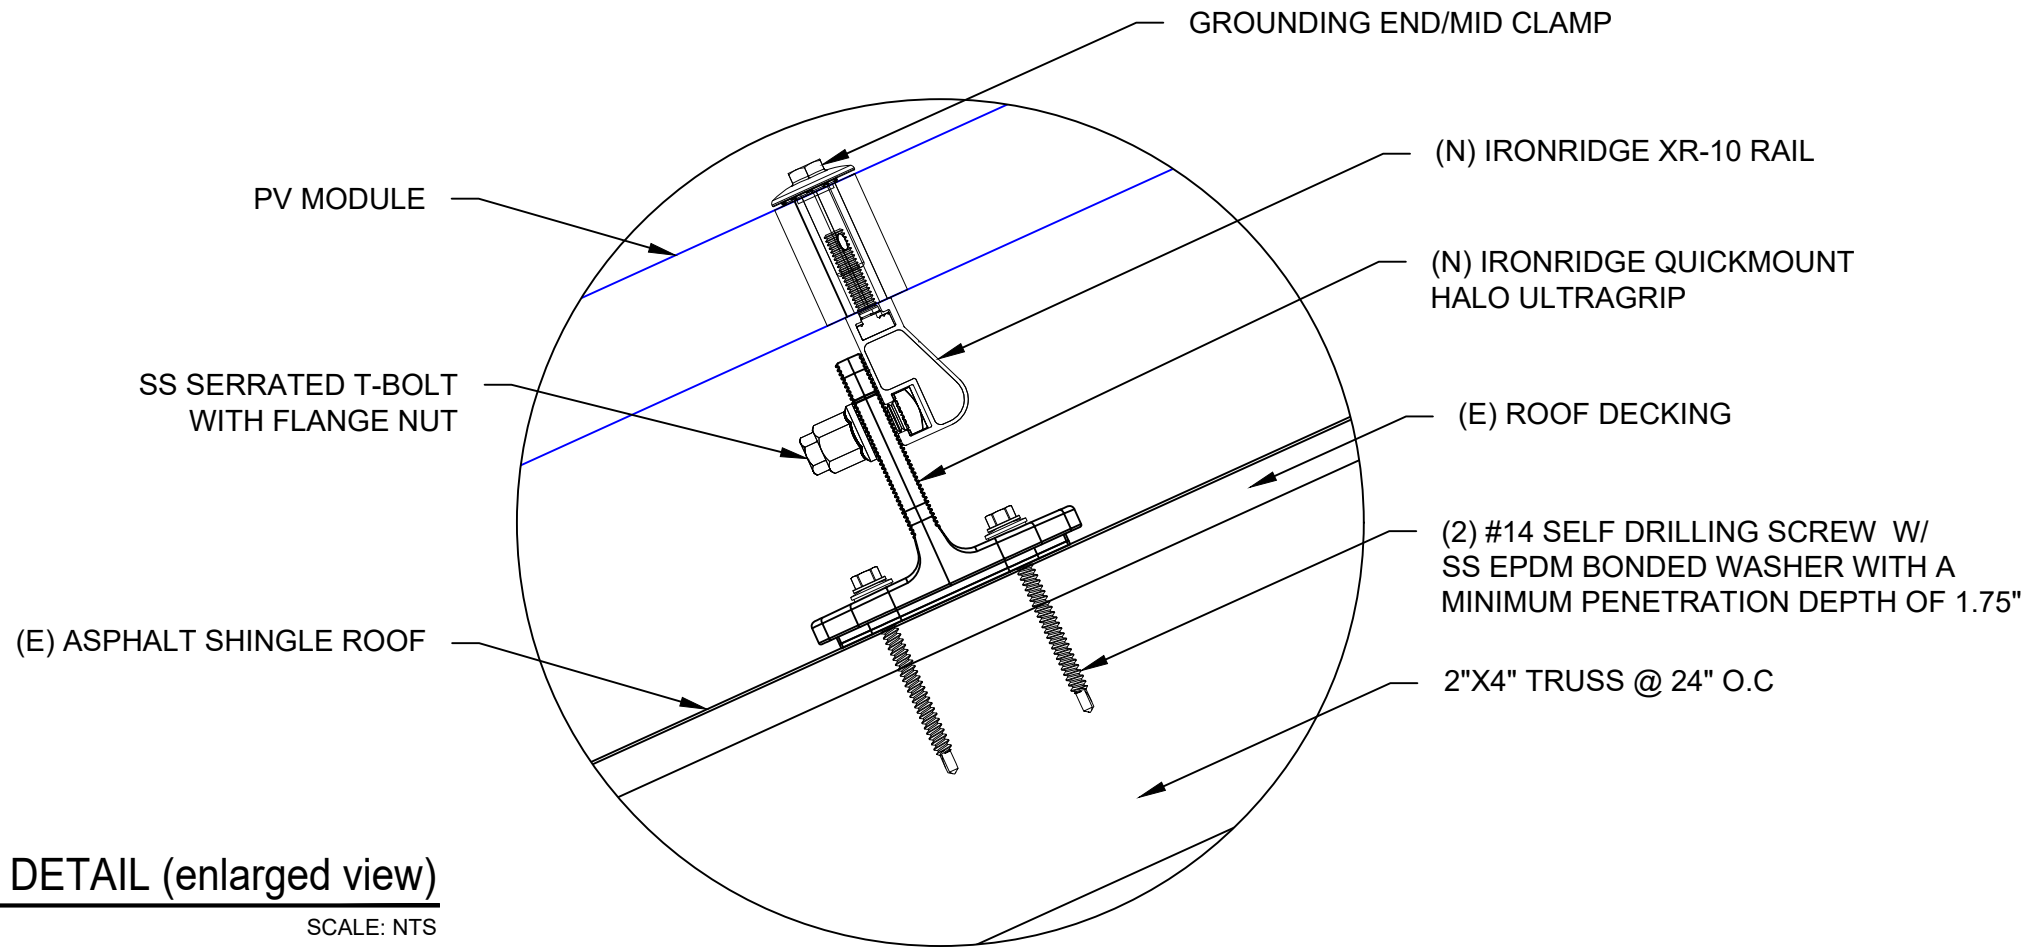


2 | ATTACHMENT DETAIL (enlarged view)  
PV-5 | SCALE: NTS



TOP TIER SOLAR SOLUTIONS

1530 CENTER PARK DR #2911,  
CHARLOTTE, NC 28217,  
UNITED STATES

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL DESIGN	07/30/2025	



Reviewed and approved  
Richard Pantel, P.E.  
NC Lic. No. 043326  
07/30/2025


PROJECT NAME & ADDRESS	
JOSHUA SPRAGUE RESIDENCE	580 NEW CASTLE LN, SPRING LAKE, NC 28390

DRAWN BY ESR
SHEET NAME STRUCTURAL DETAIL
SHEET SIZE ANSI B 11" X 17"
SHEET NUMBER PV-5

DC SYSTEM SIZE: (N) 4 X 405W + (E) 26 X 400W = 12.020 kW DC  
AC SYSTEM SIZE: (N) 4 X 290W + (E) 26 X 290W = 8.700 kW AC

(N) (4) JA SOLAR: JAM54S31-405/MR 405W MONO MODULES  
WITH (N) (4) ENPHASE IQ8PLUS-72-2-US 290W MICRO INVERTERS EQUIPPED WITH RAPID SHUTDOWN  
(E) (26) HANWHA SOLAR : Q.PEAK DUO BLK ML-G10+ 400W MONO MODULES  
(E) (26) ENPHASE IQ8PLUS-72-2-US 290W MICRO INVERTERS EQUIPPED WITH RAPID SHUTDOWN  
(02) BRANCH CIRCUITS OF (N) 2 + (E) 8 MODULES AND  
(01) BRANCH CIRCUIT OF (E) 10 MODULES ARE CONNECTED IN PARALLEL

**BACKFEED BREAKER CALCULATION (120% RULE):**  
(MAIN BUS X 1.2 - MAIN BREAKER) >= (PV BREAKER)  
(100A X 1.2 - 60A) >= (50A)  
(60A) >= (50A) HENCE OK

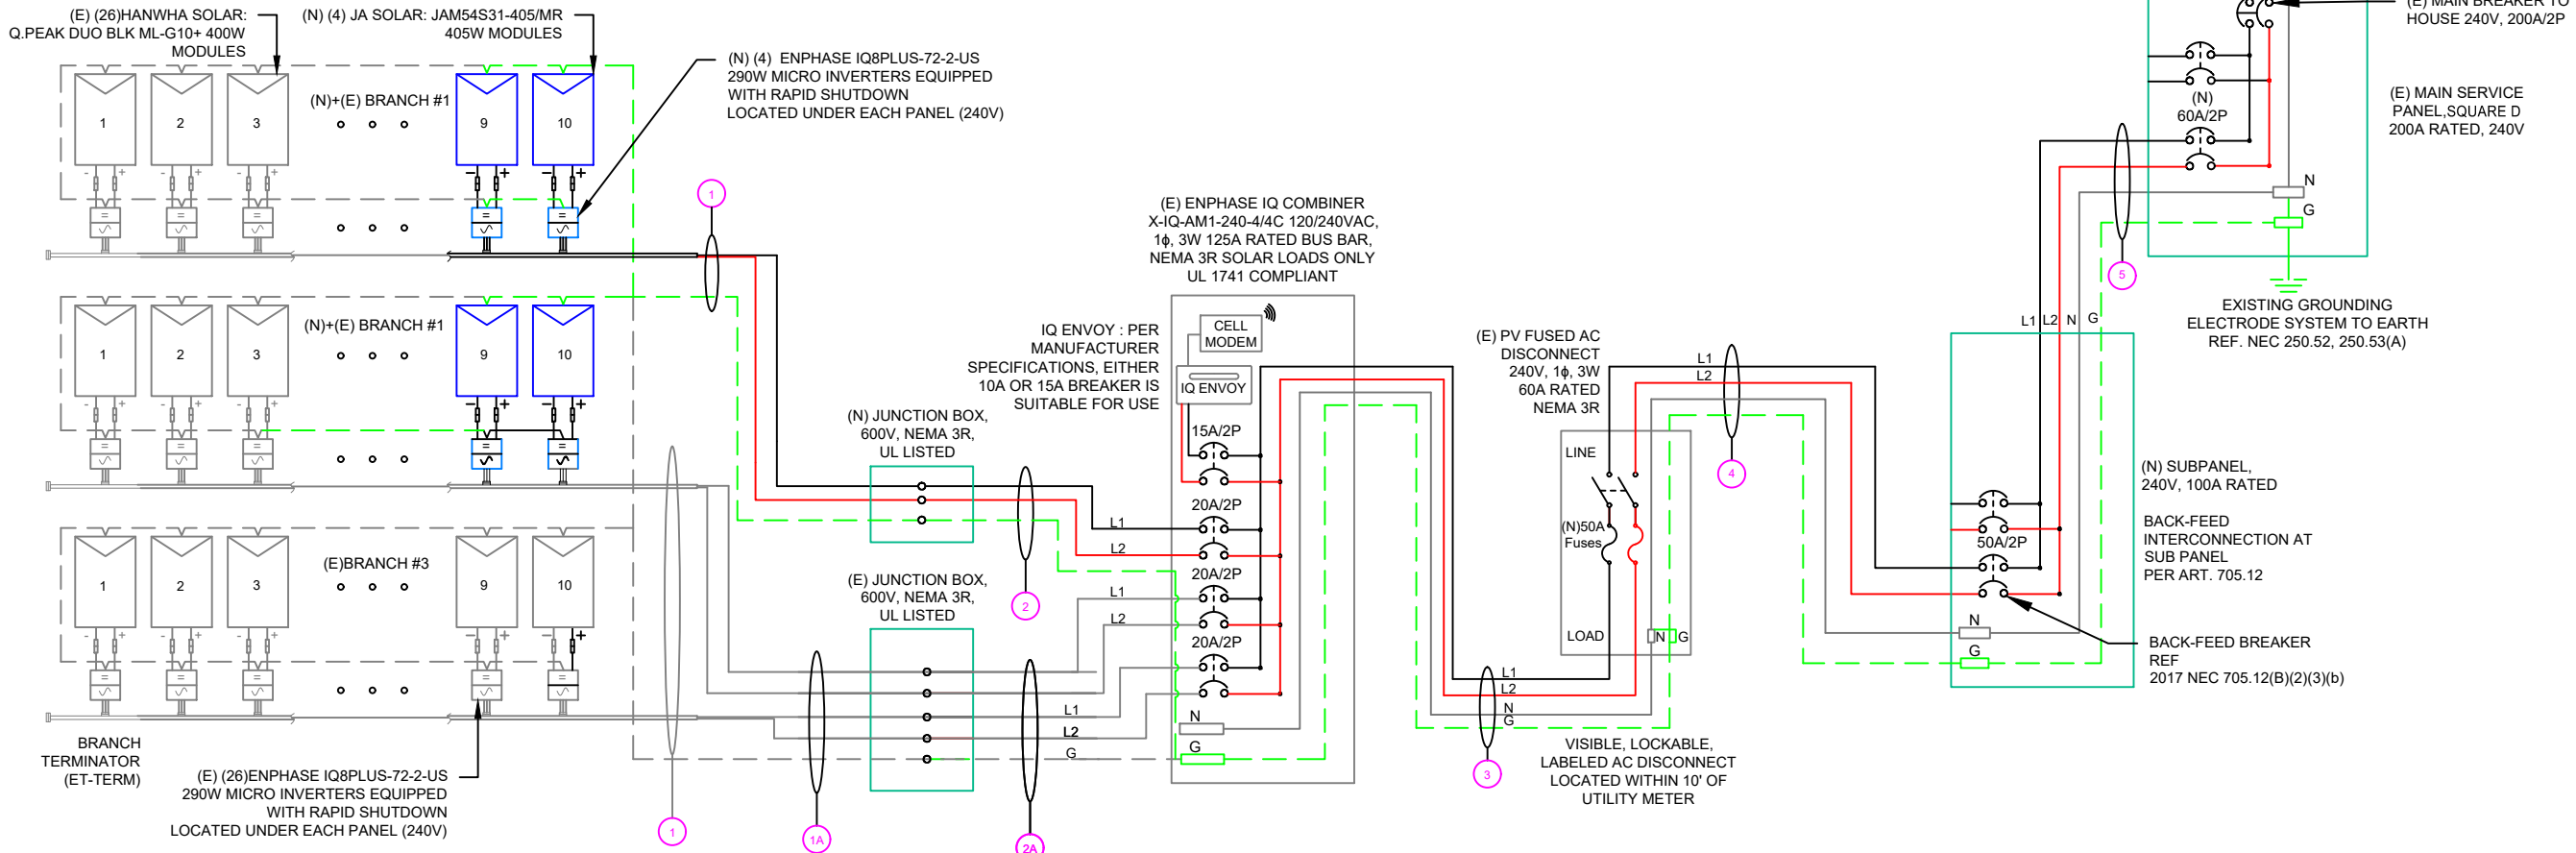

**INTERCONNECTION NOTES:**

- INTERCONNECTION SIZING, LIMITATIONS AND COMPLIANCE DETERMINED IN ACCORDANCE WITH [NEC 705.12], AND [NEC 690.59].
- GROUND FAULT PROTECTION IN ACCORDANCE WITH [NEC 215.9], [NEC 230.95].
- ALL EQUIPMENT TO BE RATED FOR BACKFEEDING.
- PV BREAKER TO BE POSITIONED AT THE OPPOSITE END OF THE BUSBAR RELATIVE TO THE MAIN BREAKER.

**DISCONNECT NOTES:**

- DISCONNECTING SWITCHES SHALL BE WIRED SUCH THAT WHEN THE SWITCH IS OPENED THE CONDUCTORS REMAINING LIVE ARE CONNECTED TO THE TERMINALS MARKED "LINE SIDE" (TYPICALLY THE UPPER TERMINALS)
- AC DISCONNECT MUST BE ACCESSIBLE TO QUALIFIED UTILITY PERSONNEL, BE LOCKABLE, AND BE A VISIBLE-BREAK SWITCH
- DISCONNECT MEANS AND THEIR LOCATION SHALL BE IN ACCORDANCE WITH [NEC 225.31] AND [NEC 225.32].

**GROUNDING & GENERAL NOTES:**

- PV GROUNDING ELECTRODE SYSTEM NEEDS TO BE INSTALLED IN ACCORDANCE WITH [NEC 690.43]
- PV INVERTER IS UNGROUNDED, TRANSFORMER-LESS TYPE.
- DC GEC AND AC EGC TO REMAIN UNSPLICED, OR SPLICED TO EXISTING ELECTRODE
- ANY EXISTING WIRING INVOLVED WITH PV SYSTEM CONNECTION THAT IS FOUND TO BE INADEQUATE PER CODE SHALL BE CORRECTED PRIOR TO FINAL INSPECTION.
- JUNCTION BOX QUANTITIES, AND PLACEMENT SUBJECT TO CHANGE IN THE FIELD - JUNCTION BOX DEPICTED ON ELECTRICAL DIAGRAM REPRESENT WIRE TYPE TRANSITIONS.
- AC DISCONNECT NOTED IN EQUIPMENT SCHEDULE OPTIONAL IF OTHER AC DISCONNECTING MEANS IS LOCATED WITHIN 10' OF SERVICE DISCONNECT.
- RACEWAYS AND CABLES EXPOSED TO SUNLIGHT ON ROOFTOPS SHOULD BE INSTALLED MORE THAN 7/8" ABOVE THE ROOF USING CONDUIT SUPPORTS.

**RACKING NOTE:**

- BOND EVERY OTHER RAIL WITH #6 BARE COPPER

NOTE: CONDUIT TO BE UL LISTED FOR WET LOCATIONS AND UV PROTECTED

NOTE: WIRE SCHEDULE CALLOUT "1A & 2A " ARE EXISTING SYSTEMS

QTY	CONDUCTOR INFORMATION		CONDUIT TYPE	CONDUIT SIZE
1	(2)	#12AWG - ENPHASE ENGAGE CABLE (L1 & L2 NO NEUTRAL)	N/A	N/A
	(1)	#6AWG - BARE COPPER IN FREE AIR		
1A	(4)	#12AWG - ENPHASE ENGAGE CABLE (L1 & L2 NO NEUTRAL)	N/A	N/A
	(1)	#6AWG - BARE COPPER IN FREE AIR		
2	(2)	#10AWG - CU,THWN-2	EMT OR LFMC IN ATTIC	3/4"
	(1)	#10AWG - CU,THWN-2 GND		
2A	(2)	#10AWG - CU,THWN-2	EMT OR LFMC IN ATTIC	3/4"
	(1)	#10AWG - CU,THWN-2 GND		
3	(2)	#8AWG - CU,THWN-2	EMT, LFMC OR PVC	3/4"
	(1)	#8AWG - CU,THWN-2 N		
4	(2)	#8AWG - CU,THWN-2	EMT, LFMC OR PVC	3/4"
	(1)	#8AWG - CU,THWN-2 N		
5	(2)	#6AWG - CU,THWN-2	EMT, LFMC OR PVC	3/4"
	(1)	#6AWG - CU,THWN-2 N		
	(2)	#10AWG - CU,THWN-2		
	(1)	#10AWG - CU,THWN-2 GND		



**TOP TIER SOLAR SOLUTIONS**

1530 CENTER PARK DR #2911,  
CHARLOTTE, NC 28217,  
UNITED STATES

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL DESIGN	07/30/2025	



**PROJECT NAME & ADDRESS**

JOSHUA SPRAGUE  
RESIDENCE

580 NEW CASTLE LN,  
SPRING LAKE, NC 28390

**DRAWN BY**

ESR

**SHEET NAME**

ELECTRICAL LINE DIAGRAM

**SHEET SIZE**

ANSI B  
11" X 17"

**SHEET NUMBER**

PV-6

INVERTER SPECIFICATIONS	
MANUFACTURER / MODEL #	ENPHASE IQ8PLUS-72-2-US 290W MICRO INVERTERS EQUIPPED WITH RAPID SHUTDOWN
MIN/MAX DC VOLT RATING	30V MIN/ 58V MAX
MAX INPUT POWER	235W-440W
NOMINAL AC VOLTAGE RATING	240V/ 211-264V
MAX AC CURRENT	1.21A
MAX MODULES PER CIRCUIT	13 (SINGLE PHASE)
MAX OUTPUT POWER	290 VA

SOLAR MODULE SPECIFICATIONS	
MANUFACTURER / MODEL #	JA SOLAR: JAM54S31-405/MR 405 W MODULE
VMP	32.37V
IMP	13.13A
VOC	38.95V
ISC	13.58A
TEMP. COEFF. VOC	-0.275%/°C
MODULE DIMENSION	67.79"L x 44.65"W x 1.18"D (In Inch)

AMBIENT TEMPERATURE SPECS	
AMBIENT TEMP (HIGH TEMP 2%)	38°
RECORD LOW TEMP	-11°
MODULE TEMPERATURE COEFFICIENT OF Voc	-0.275%/°C
PERCENT OF VALUES	NUMBER OF CURRENT CARRYING CONDUCTORS IN EMT
.80	4-6
.70	7-9
.50	10-20

AC CALCULATIONS																						
CIRCUIT ORIGIN	CIRCUIT DESTINATION	VOLTAGE (V)	FULL LOAD AMPS "FLA" (A)	FLA*1.25 (A)	OCPD SIZE (A)	NEUTRAL SIZE	GROUND SIZE	CONDUCTOR SIZE	75°C AMPACITY (A)	AMPACITY CHECK #1	AMBIENT TEMP. (°C)	TOTAL CC CONDUCTORS IN RACEWAY	90°C AMPACITY (A)	DERATION FACTOR FOR AMBIENT TEMPERATURE NEC 310.15(B)(2)(a)	DERATION FACTOR FOR CONDUCTORS PER RACEWAY NEC 310.15(B)(3)(a)	90°C AMPACITY DERATED (A)	AMPACITY CHECK #2	FEEDER LENGTH (FEET)	CONDUCTOR RESISTANCE (OHM/KFT)	VOLTAGE DROP AT FLA (%)	CONDUIT SIZE	CONDUIT FILL (%)
CIRCUIT 1	(N) JUNCTION BOX	240	12.1	15.125	20	N/A	BARE COPPER #6 AWG	CU #12 AWG	25	PASS	38	2	30	0.91	1	27.3	PASS			0.31	N/A	#N/A
CIRCUIT 1	(E) JUNCTION BOX	240	12.1	15.125	20	N/A	BARE COPPER #6 AWG	CU #12 AWG	25	PASS	38	2	30	0.91	1	27.3	PASS			0.39	N/A	#N/A
CIRCUIT 3	(E) JUNCTION BOX	240	12.1	15.125	20	N/A	BARE COPPER #6 AWG	CU #12 AWG	25	PASS	38	2	30	0.91	1	27.3	PASS			0.39	N/A	#N/A
(N) JUNCTION BOX	COMBINER BOX	240	12.1	15.125	20	N/A	CU #10 AWG	CU #10 AWG	35	PASS	38	2	40	0.91	1	36.4	PASS	20	1.24	0.250	3/4" EMT	11.87617
(E) JUNCTION BOX	COMBINER BOX	240	12.1	15.125	20	N/A	CU #10 AWG	CU #10 AWG	35	PASS	38	4	40	0.91	0.8	29.12	PASS	20	1.24	0.250	3/4" EMT	19.79362
COMBINER BOX	AC DISCONNECT	240	36.3	45.375	50	CU #8 AWG	CU #10 AWG	CU #8 AWG	50	PASS	38	2	55	0.91	1	50.05	PASS	5	0.778	0.118	3/4" EMT	24.5591
AC DISCONNECT	SUB PANEL	240	36.3	45.375	50	CU #8 AWG	CU #10 AWG	CU #8 AWG	50	PASS	38	2	55	0.91	1	50.05	PASS	5	0.778	0.118	3/4" EMT	24.5591
SUB PANEL	MMC	240	60	60	60	CU #6 AWG	CU #10 AWG	CU #6 AWG	65	PASS	38	2	75	0.91	1	68.25	PASS	5	0.491	0.123	3/4" EMT	32.49531

Circuit 1 Voltage Drop	0.795
Circuit 2 Voltage Drop	0.875
Circuit 3 Voltage Drop	0.875

ELECTRICAL NOTES


1. ALL EQUIPMENT TO BE LISTED BY UL OR OTHER NRTL, AND LABELED FOR ITS APPLICATION.
2. ALL CONDUCTORS SHALL BE RATED UPTO 600V FOR RESIDENTIAL AND 1000V FOR COMMERCIAL AND 90 DEGREE C WET ENVIRONMENT.
3. WIRING, CONDUIT, AND RACEWAYS MOUNTED ON ROOFTOPS SHALL BE ROUTED DIRECTLY TO, AND LOCATED AS CLOSE AS POSSIBLE TO THE NEAREST RIDGE, HIP, OR VALLEY.
4. WORKING CLEARANCES AROUND ALL NEW AND EXISTING ELECTRICAL EQUIPMENT SHALL COMPLY WITH NEC 110.26.
5. DRAWINGS INDICATE THE GENERAL ARRANGEMENT OF SYSTEMS. CONTRACTOR SHALL FURNISH ALL NECESSARY OUTLETS, SUPPORTS, FITTINGS AND ACCESSORIES TO FULFILL APPLICABLE CODES AND STANDARDS.
6. WHERE SIZES OF JUNCTION BOX, RACEWAYS, AND CONDUITS ARE NOT SPECIFIED, THE CONTRACTOR SHALL SIZE THEM ACCORDINGLY.
7. ALL WIRE TERMINATIONS SHALL BE APPROPRIATELY LABELED AND READILY VISIBLE.
8. MODULE GROUNDING CLIPS TO BE INSTALLED BETWEEN MODULE FRAME AND MODULE SUPPORT RAIL, PER THE GROUNDING CLIP MANUFACTURER'S INSTRUCTION.
9. MODULE SUPPORT RAIL TO BE BONDED TO CONTINUOUS COPPER G.E.C. VIA WEEB LUG OR ILSCO GBL-4DBT LAY-IN LUG.
10. TEMPERATURE RATINGS OF ALL CONDUCTORS, TERMINATIONS, BREAKERS, OR OTHER DEVICES ASSOCIATED WITH THE SOLAR PV SYSTEM SHALL BE RATED FOR AT LEAST 75 DEGREE C.



**TOP TIER SOLAR SOLUTIONS**

1530 CENTER PARK DR #2911,  
CHARLOTTE, NC 28217,  
UNITED STATES

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL DESIGN	07/30/2025	



PROJECT NAME & ADDRESS

JOSHUA SPRAGUE  
RESIDENCE

580 NEW CASTLE LN,  
SPRING LAKE, NC 28390


DRAWN BY  
ESR

SHEET NAME  
WIRING CALCULATIONS

SHEET SIZE  
ANSI B  
11" X 17"

SHEET NUMBER  
PV-7





**WARNING**

DUAL POWER SUPPLY

SOURCES: UTILITY GRID  
AND PV SOLAR  
ELECTRIC SYSTEM

LABEL- 1:  
LABEL LOCATION:  
MAIN SERVICE PANEL & SUBPANEL  
CODE REF: NEC 705.12(B) & NEC 690.59

SOLAR POINT OF INTERCONNECTION

LABEL- 2:  
LABEL LOCATION:  
MAIN SERVICE PANEL & SUB PANEL  
CODE REF: NEC 690.13 (F), NEC 705.12(B) (3-4) & NEC 690.59

SOLAR PV BREAKER

BREAKER IS BACKFED  
DO NOT RELOCATE

LABEL- 3:  
LABEL LOCATION:  
MAIN SERVICE PANEL & SUB PANEL  
(ONLY IF SOLAR IS BACK-FED)  
CODE REF: NEC 705.12(D) & 690.59

AC DISCONNECT

PHOTOVOLTAIC SYSTEM  
POWER SOURCE


NOMINAL OPERATING AC VOLATGE

240 V

RATED AC OUTPUT CURRENT

36.30 A

LABEL- 4:  
LABEL LOCATION:  
AC DISCONNECT  
CODE REF: NEC 690.54



**WARNING**


**ELECTRIC SHOCK HAZARD**

TERMINALS ON THE LINE AND LOAD SIDES MAY  
BE ENERGIZED IN THE OPEN POSITION

LABEL- 5:  
LABEL LOCATION:  
AC DISCONNECT  
CODE REF: NEC 706.15(C)(4) & NEC 690.13(B)

SOLAR PV SYSTEM EQUIPPED  
WITH RAPID SHUTDOWN

TURN RAPID SHUTDOWN  
SWITCH TO THE  
"OFF" POSITION TO  
SHUT DOWN PV SYSTEM  
AND REDUCE  
SHOCK HAZARD  
IN THE ARRAY



LABEL- 6:  
LABEL LOCATION:  
COMBINER BOX  
CODE REF: IFC 605.11.3.1(1) & NEC 690.56(C)



**WARNING**

THIS EQUIPMENT FED BY MULTIPLE  
SOURCES, TOTAL RATING OF ALL  
OVERCURRENT DEVICES,  
EXCLUDING MAIN SUPPLY  
OVERCURRENT DEVICE, SHALL NOT  
EXCEED AMPACITY OF BUSBAR

LABEL- 7:  
LABEL LOCATION:  
COMBINER PANEL  
CODE REF: 705.12 (B) (3) (3)

PHOTOVOLTAIC POWER SOURCE

LABEL- 8:  
LABEL LOCATION:  
EMT/CONDUIT RACEWAY  
SOLADECK / JUNCTION BOX  
CODE REF: NEC 690.31 (D) (2)

PHOTOVOLTAIC  
SYSTEM kWh METER

LABEL- 9:  
LABEL LOCATION:  
PRODUCTION METER (ONLY IF PRODUCTION METER IS USED)

**TOP TIER**

SOLAR SOLUTIONS

**TOP TIER SOLAR SOLUTIONS**

1530 CENTER PARK DR #2911,  
CHARLOTTE, NC 28217,  
UNITED STATES

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL DESIGN	07/30/2025	



PROJECT NAME & ADDRESS

JOSHUA SPRAGUE  
RESIDENCE

580 NEW CASTLE LN,  
SPRING LAKE, NC 28390

DRAWN BY

ESR

SHEET NAME

LABELS

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

PV-8





# Harvest the Sunshine

## DEEP BLUE 3.0 Light

**Mono**

**405W MBB  
Half-cell Black Module**  
JAM54S31 380-405/MR Series

### Introduction

Assembled with 11BB PERC cells, the half-cell configuration of the modules offers the advantages of higher power output, better temperature-dependent performance, reduced shading effect on the energy generation, lower risk of hot spot, as well as enhanced tolerance for mechanical loading.

## PV-9



AUTHORIZATION TO MARK

This authorizes the application of the Certification Mark(s) shown below to the models described in the Product(s) Covered section when made in accordance with the conditions set forth in the Certification Agreement and Listing Report. This authorization also applies to multiple listee model(s) identified on the correlation page of the Listing Report.

This document is the property of Intertek Testing Services and is not transferable. The certification mark(s) may be applied only at the location of the Party Authorized To Apply Mark.

**Applicant:** Shanghai JA Solar Technology Co., Ltd. **Manufacturer:** JA SOLAR VIET NAM COMPANY LIMITED.

**Address:** No. 118, Lane 3111, West Huancheng Road, Fengxian District, 201401 Shanghai **Address:** Lot G, Quang Chau industrial park, Quang Chau Ward, Viet Yen Town, Bac Giang Province, 236110

**Country:** P. R. China **Country:** Vietnam

**Party Authorized To Apply Mark:** Same as Manufacturer  
**Report Issuing Office:** Intertek Testing Services Shanghai Limited

**Control Number:** 5020189 **Authorized by:**  for L. Matthew Snyder, Certification Manager



This document supersedes all previous Authorizations to Mark for the noted Report Number.

This Authorization to Mark is for the exclusive use of Intertek's Client and is provided pursuant to the Certification agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this Authorization to Mark. Only the Client is authorized to permit copying or distribution of this Authorization to Mark and then only in its entirety. Use of Intertek's Certification mark is restricted to the conditions laid out in the agreement and in this Authorization to Mark. Any further use of the Intertek name for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. Initial Factory Assessments and Follow up Services are for the purpose of assuring appropriate usage of the Certification mark in accordance with the agreement, they are not for the purposes of production quality control and do not relieve the Client of their obligations in this respect.

Intertek Testing Services NA Inc.  
545 East Algonquin Road, Arlington Heights, IL 60005  
Telephone 800-345-3851 or 847-439-5667 Fax 312-283-1672

Standard(s):	Terrestrial Photovoltaic (PV) Modules - Design Qualification And Type Approval - Part 1: Test Requirements [UL 61215-1:2017 Ed.1 ]
	Terrestrial Photovoltaic (PV) Modules - Design Qualification And Type Approval - Part 1-1: Special Requirements For Testing Of Crystalline Silicon Photovoltaic (PV) Modules [UL 61215-1-1:2017 Ed.1 ]
	Terrestrial Photovoltaic (PV) Modules - Design Qualification And Type Approval - Part 2: Test Procedures [UL 61215-2:2017 Ed.1 ]
	Photovoltaic (PV) Module Safety Qualification - Part 1: Requirements For Construction [UL 61730-1:2017 Ed.1]
	Photovoltaic (PV) Module Safety Qualification - Part 2: Requirements For Testing [UL 61730-2:2017 Ed.1]
	Photovoltaic (PV) Module Safety Qualification - Part 1: Requirements for Construction [CSA C22.2#61730-1:2019 Ed.2]
	Photovoltaic (PV) Module Safety Qualification - Part 2: Requirements for Testing [CSA C22.2#61730-2:2019 Ed.2]

AUTHORIZATION TO MARK

Product:	Crystalline Silicon Photovoltaic modules
Brand Name:	JA SOLAR 晶澳
Models:	JAM72S03-385/PR, JAP72S03-340/SC, JAM72S10- followed by 395, 400, 405, 410 or 415 followed by /MB, JAM60S10- followed by 330, 335, 340 or 345 followed by /MB, JAM72S10- followed by 395, 400, 405, 410 or 415 followed by /MR, JAM66S10- followed by 365, 365, 370, 375 or 380 followed by /MR, JAM60S10- followed by 330, 335, 340 or 345 followed by /MR, JAM72S09- followed by 370, 375, 380, 385, 390, 395 or 400 followed by /PR, JAM60S09- followed by 310, 315, 320 or 325 followed by /PR, JAM72S09- followed by 375, 380 or 385 followed by /BP, JAM60S09- followed by 315 or 320 followed by /BP, JAM72S10- followed by 385, 390, 395 or 400 followed by /BP, JAM60S10- followed by 320, 325 or 330 followed by /BP, JAM72S10- followed by 380, 385, 390, 395, 400 or 405 followed by /PR, JAM60S10- followed by 320, 325, 330 or 335 followed by /PR, JAM72S12- followed by 365, 370, 375, 380 or 385 followed by /PR, JAM60S12- followed by 305, 310, 315 or 320 followed by /PR, 1JAM78S10- followed by 435, 440, 445, 450 or 455 followed by /MR, 1JAM6(K)-72-335/4BB/1500V, JAM60S17- followed by 320, 325, or 330 followed by /MR, JAM72S20- followed by 430, 435, 440, 445, 450, 455, 460, 465 or 470 followed by /MR, JAM60S20- followed by 355, 360, 365, 370, 375, 380, 385 or 390 followed by /MR, JAM72S30- followed by 530, 535, 540, 545, 550 or 555 followed by /MR, JAM66S30- followed by 490, 495 or 500 followed by /MR, JAM68S11- followed by 355, 360 or 365 followed by /PR, JAM68S11- followed by 345, 350, 355, 360 or 365 followed by /PR(B), JAM76S11- followed by 395, 400, 405, 410 or 415 followed by /PR(B), JAM76S11- followed by 395, 400, 405, 410 or 415 followed by /PR(B)/1000V, JAM78S30-followed by 575, 580, 585, 590, 595, 600, 605 or 610 followed by /GR, JAM72S30-followed by 535, 540, 545, 550, 555 or 560 followed by /GR, JAM66S30-followed by 490, 495, 500 or 505 followed by /GR, JAM60S30-followed by 445, 450, 455 or 460 followed by /GR, JAM54S30-followed by 400, 405, 410, 415 or 420 followed by /GR, JAM78S31-followed by 570, 575, 580, 585 or 590 followed by /GR, JAM72S31-followed by 530, 535 or 540 followed by /GR, JAM66S31-followed by 485, 490 or 495 followed by /GR, JAM60S31-followed by 440, 445 or 450 followed by /GR, JAM54S31-followed by 395, 400, 405, 410 or 415 followed by /GR, JAM60S31-followed by 430, 435, 440, 445 or 450 followed by /GR/1000V, JAM54S31-followed by 390, 395, 400, 405, 410 or 415 followed by /GR/1000V, JAM54S30-followed by 400, 405, 410, 415, 420 or 425 followed by /MR, JAM72S31-followed by 510, 515, 520, 525, 530, 535, 540 or 545 followed by /MR, JAM54S31-followed by 385, 390, 395, 400 or 405 followed by /MR, JAM54S30-followed by 400, 405, 410, 415, 420 or 425 followed by /MR/1000V, JAM72S31-followed by 510, 515, 520, 525, 530,535, 540 or 545 followed by /MR/1000V, JAM54S31-followed by 385, 390, 395, 400 or 405 followed by /MR/1000V, JAM72S17-followed by 390, 395, 400 or 405 followed by /MR, JAM72S17-followed by 390, 395, 400 or 405 followed by /MR/1000V, JAM78S30- followed by 580, 585, 590, 595, 600 or 605 followed by /MR,JAM72S30-followed by 555, 560, 565, 570, 575, 580 followed by /LR, JAM54S30-followed by 415, 420, 425, 430, 435 followed by /LR, JAM54S31-followed by 415, 420 followed by /LR, JAM54S30-followed by 385, 390, 395, 400, 405, 410 followed by /MB, JAM54S31-followed by 385, 390, 395, 400, 405 followed by /MB, JAM54S30-followed by 410, 415, 420, 425 followed by /LB, JAM54S31-followed by 410, 415 followed by /LB , JAM72S30-followed by 535, 540, 545, 550 followed by /MB, JAM72S31-followed by 525, 530, 535, 540 followed by /MB.



TOP TIER SOLAR SOLUTIONS

1530 CENTER PARK DR #2911,  
CHARLOTTE, NC 28217,  
UNITED STATES

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL DESIGN	07/30/2025	



PROJECT NAME & ADDRESS

JOSHUA SPRAGUE  
RESIDENCE  
580 NEW CASTLE LN,  
SPRING LAKE, NC 28390

DRAWN BY  
ESR

SHEET NAME  
EQUIPMENT  
SPECIFICATION

SHEET SIZE  
ANSI B  
11" X 17"

SHEET NUMBER  
PV-10





DATA SHEET



# IQ8 and IQ8+ Microinverters

Our newest IQ8 Microinverters are the industry's first microgrid-forming, software-defined microinverters with split-phase power conversion capability to convert DC power to AC power efficiently. The brain of the semiconductor-based microinverter is our proprietary application-specific integrated circuit (ASIC) which enables the microinverter to operate in grid-tied or off-grid modes. This chip is built in advanced 55nm technology with high speed digital logic and has super-fast response times to changing loads and grid events, alleviating constraints on battery sizing for home energy systems.



Part of the Enphase Energy System, IQ8 Series Microinverters integrate with the Enphase IQ Battery, Enphase IQ Gateway, and the Enphase App monitoring and analysis software.



IQ8 Series Microinverters redefine reliability standards with more than one million cumulative hours of power-on testing, enabling an industry-leading limited warranty of up to 25 years.



Connect PV modules quickly and easily to IQ8 Series Microinverters using the included Q-DCC-2 adapter cable with plug-n-play MC4 connectors.



IQ8 Series Microinverters are UL Listed as PV Rapid Shut Down Equipment and conform with various regulations, when installed according to manufacturer's instructions.

## Easy to install

- Lightweight and compact with plug-n-play connectors
- Power Line Communication (PLC) between components
- Faster installation with simple two-wire cabling

## High productivity and reliability

- Produce power even when the grid is down\*
- More than one million cumulative hours of testing
- Class II double-insulated enclosure
- Optimized for the latest high-powered PV modules

## Microgrid-forming

- Complies with the latest advanced grid support\*\*
- Remote automatic updates for the latest grid requirements
- Configurable to support a wide range of grid profiles
- Meets CA Rule 21 (UL 1741-SA) requirements

\* Only when installed with IQ System Controller 2, meets UL 1741.

\*\* IQ8 and IQ8Plus supports split phase, 240V installations only.

# IQ8 and IQ8+ Microinverters

INPUT DATA (DC)		IQ8-60-2-US	IQ8PLUS-72-2-US
Commonly used module pairings <sup>1</sup>	W	235 – 350	235 – 440
Module compatibility		60-cell/120 half-cell	60-cell/120 half-cell, 66-cell/132 half-cell and 72-cell/144 half-cell
MPPT voltage range	V	27 – 37	29 – 45
Operating range	V	25 – 48	25 – 58
Min/max start voltage	V	30 / 48	30 / 58
Max input DC voltage	V	50	60
Max DC current <sup>2</sup> [module Isc]	A	15	
Overvoltage class DC port		II	
DC port backfeed current	mA	0	
PV array configuration		1x1 Ungrounded array; No additional DC side protection required; AC side protection requires max 20A per branch circuit	
OUTPUT DATA (AC)		IQ8-60-2-US	IQ8PLUS-72-2-US
Peak output power	VA	245	300
Max continuous output power	VA	240	290
Nominal (L-L) voltage/range <sup>3</sup>	V	240 / 211 – 264	
Max continuous output current	A	1.0	1.21
Nominal frequency	Hz	60	
Extended frequency range	Hz	50 – 68	
AC short circuit fault current over 3 cycles	A <sub>rms</sub>	2	
Max units per 20 A (L-L) branch circuit <sup>4</sup>		16	13
Total harmonic distortion		<5%	
Overvoltage class AC port		III	
AC port backfeed current	mA	30	
Power factor setting		1.0	
Grid-tied power factor (adjustable)		0.85 leading – 0.85 lagging	
Peak efficiency	%	97.5	97.6
CEC weighted efficiency	%	97	97
Night-time power consumption	mW	60	
MECHANICAL DATA			
Ambient temperature range		-40°C to +60°C (-40°F to +140°F)	
Relative humidity range		4% to 100% (condensing)	
DC Connector type		MC4	
Dimensions (HxWxD)		212 mm (8.3") x 175 mm (6.9") x 30.2 mm (1.2")	
Weight		1.08 kg (2.38 lbs)	
Cooling		Natural convection – no fans	
Approved for wet locations		Yes	
Pollution degree		PD3	
Enclosure		Class II double-insulated, corrosion resistant polymeric enclosure	
Environ. category / UV exposure rating		NEMA Type 6 / outdoor	
COMPLIANCE			
Certifications		CA Rule 21 (UL 1741-SA), UL 62109-1, UL1741/IEEE1547, FCC Part 15 Class B, ICES-0003 Class B, CAN/CSA-C22.2 NO. 1071-01  This product is UL Listed as PV Rapid Shut Down Equipment and conforms with NEC 2014, NEC 2017, and NEC 2020 section 690.12 and C22.1-2018 Rule 64-218 Rapid Shutdown of PV Systems, for AC and DC conductors, when installed according to manufacturer's instructions.	

(1) No enforced DC/AC ratio. See the compatibility calculator at <https://link.enphase.com/module-compatibility>  
(2) Maximum continuous input DC current is 10.6A (3) Nominal voltage range can be extended beyond nominal if required by the utility. (4) Limits may vary. Refer to local requirements to define the number of microinverters per branch in your area.

IQ8SP-DS-0002-01-EN-US-2022-03-17

TOP TIER  
SOLAR SOLUTIONS

## TOP TIER SOLAR SOLUTIONS

1530 CENTER PARK DR #2911,  
CHARLOTTE, NC 28217,  
UNITED STATES

### REVISIONS

DESCRIPTION	DATE	REV
INITIAL DESIGN	07/30/2025	

### PROJECT NAME & ADDRESS

JOSHUA SPRAGUE  
RESIDENCE

580 NEW CASTLE LN,  
SPRING LAKE, NC 28390

### DRAWN BY

ESR

### SHEET NAME

EQUIPMENT  
SPECIFICATION

### SHEET SIZE

ANSI B  
11" X 17"

### SHEET NUMBER

PV-11







Tech Brief

XR Rail® Family

Solar Is Not Always Sunny

Over their lifetime, solar panels experience countless extreme weather events. Not just the worst storms in years, but the worst storms in 40 years. High winds capable of ripping panels from a roof, and snowfalls weighing enough to buckle a panel frame.

XR Rails® are the structural backbone preventing these results. They resist uplift, protect against buckling and safely and efficiently transfer loads into the building structure. Their superior spanning capability requires fewer roof attachments, reducing the number of roof penetrations and the amount of installation time.

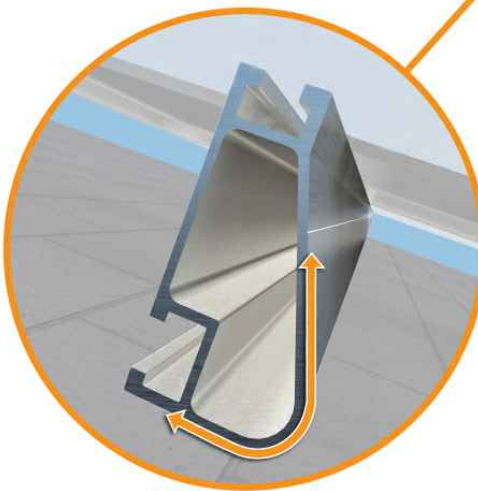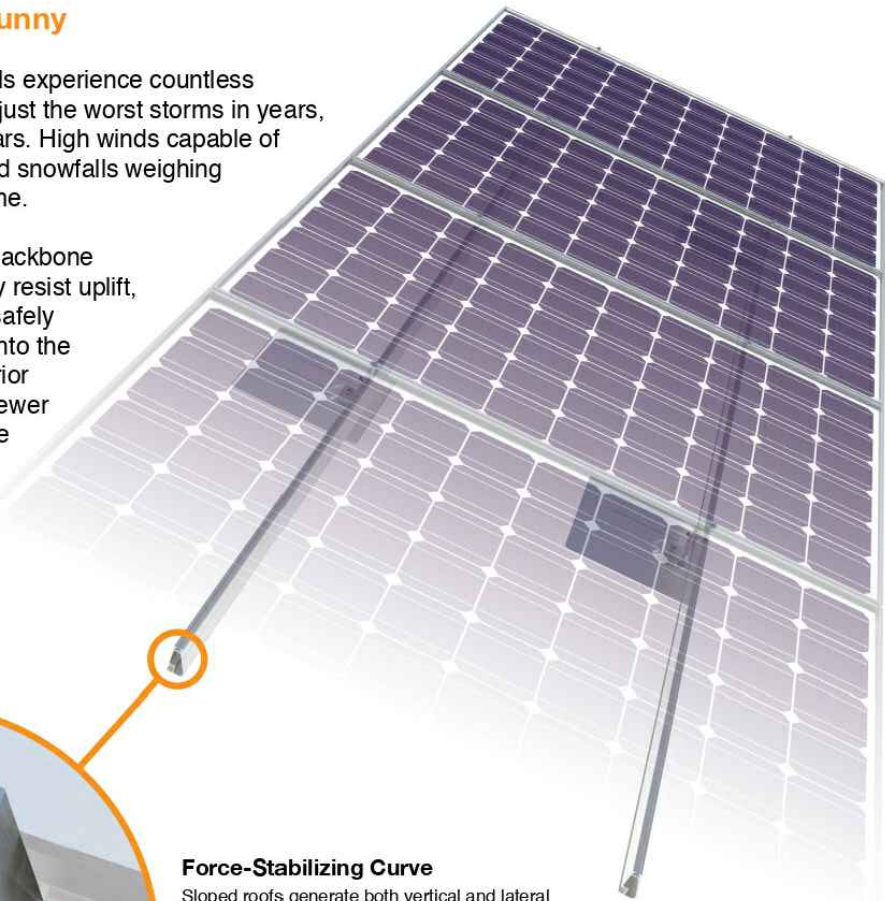

**Force-Stabilizing Curve**  
Sloped roofs generate both vertical and lateral forces on mounting rails which can cause them to bend and twist. The curved shape of XR Rails® is specially designed to increase strength in both directions while resisting the twisting. This unique feature ensures greater security during extreme weather and a longer system lifetime.

**Compatible with Flat & Pitched Roofs**

XR Rails® are compatible with FlashFoot® and other pitched roof attachments.

IronRidge® offers a range of tilt leg options for flat roof mounting applications.

**Corrosion-Resistant Materials**

All XR Rails® are made of 6000-series aluminum alloy, then protected with an anodized finish. Anodizing prevents surface and structural corrosion, while also providing a more attractive appearance.

XR Rail® Family

The XR Rail® Family offers the strength of a curved rail in three targeted sizes. Each size supports specific design loads, while minimizing material costs. Depending on your location, there is an XR Rail® to match.



**XR10**  
XR10 is a sleek, low-profile mounting rail, designed for regions with light or no snow. It achieves spans up to 6 feet, while remaining light and economical.

- 6' spanning capability
- Moderate load capability
- Clear & black anodized finish
- Internal splices available



**XR100**  
XR100 is a residential and commercial mounting rail. It supports a range of wind and snow conditions, while also maximizing spans up to 10 feet.

- 10' spanning capability
- Heavy load capability
- Clear & black anodized finish
- Internal splices available



**XR1000**  
XR1000 is a heavyweight among solar mounting rails. It's built to handle extreme climates and spans up to 12 feet for commercial applications.

- 12' spanning capability
- Extreme load capability
- Clear anodized finish
- Internal splices available

Rail Selection

The table below was prepared in compliance with applicable engineering codes and standards.\* Values are based on the following criteria: ASCE 7-16, Gable Roof Flush Mount, Roof Zones 1 & 2e, Exposure B, Roof Slope of 8 to 20 degrees and Mean Building Height of 30 ft. Visit IronRidge.com for detailed certification letters.

Load		Rail Span					
Snow (PSF)	Wind (MPH)	4'	5' 4"	6'	8'	10'	12'
None	90	XR10		XR100		XR1000	
	120						
	140						
	160						
20	90						
	120						
	140						
	160						
30	90						
	160						
40	90						
	160						
80	160						
120	160						

\*Table is meant to be a simplified span chart for conveying general rail capabilities. Use approved certification letters for actual design guidance.



**TOP TIER SOLAR SOLUTIONS**  
1530 CENTER PARK DR #2911,  
CHARLOTTE, NC 28217,  
UNITED STATES

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL DESIGN	07/30/2025	



PROJECT NAME & ADDRESS

JOSHUA SPRAGUE  
RESIDENCE

580 NEW CASTLE LN,  
SPRING LAKE, NC 28390

DRAWN BY  
**ESR**

SHEET NAME  
**EQUIPMENT  
SPECIFICATION**

SHEET SIZE  
**ANSI B  
11" X 17"**

SHEET NUMBER  
**PV-13**







## UFO® Family of Components


Tech Brief

### Simplified Grounding for Every Application

The UFO® family of components eliminates the need for separate grounding hardware by bonding solar modules directly to IronRidge® XR Rails®. All system types that feature the UFO® family—Flush Mount®, Tilt Mount® and Ground Mount®—are fully listed to the UL 2703 standard.

UFO® hardware forms secure electrical bonds with both the module and the rail, resulting in many parallel grounding paths throughout the system. This leads to safer and more reliable installations.


Only for installation and use with IronRidge products in accord with written instructions. See [IronRidge.com/UFO](https://www.ironridge.com/UFO)

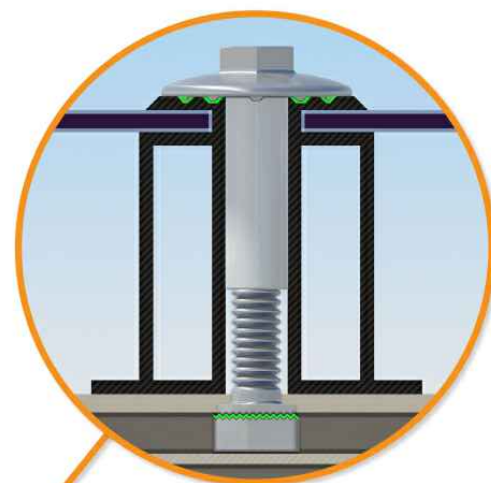

#### Universal Fastening Object (UFO®)

The UFO® securely bonds solar modules to XR Rails®. It comes assembled and lubricated, and can fit a wide range of module heights.

### System Diagram

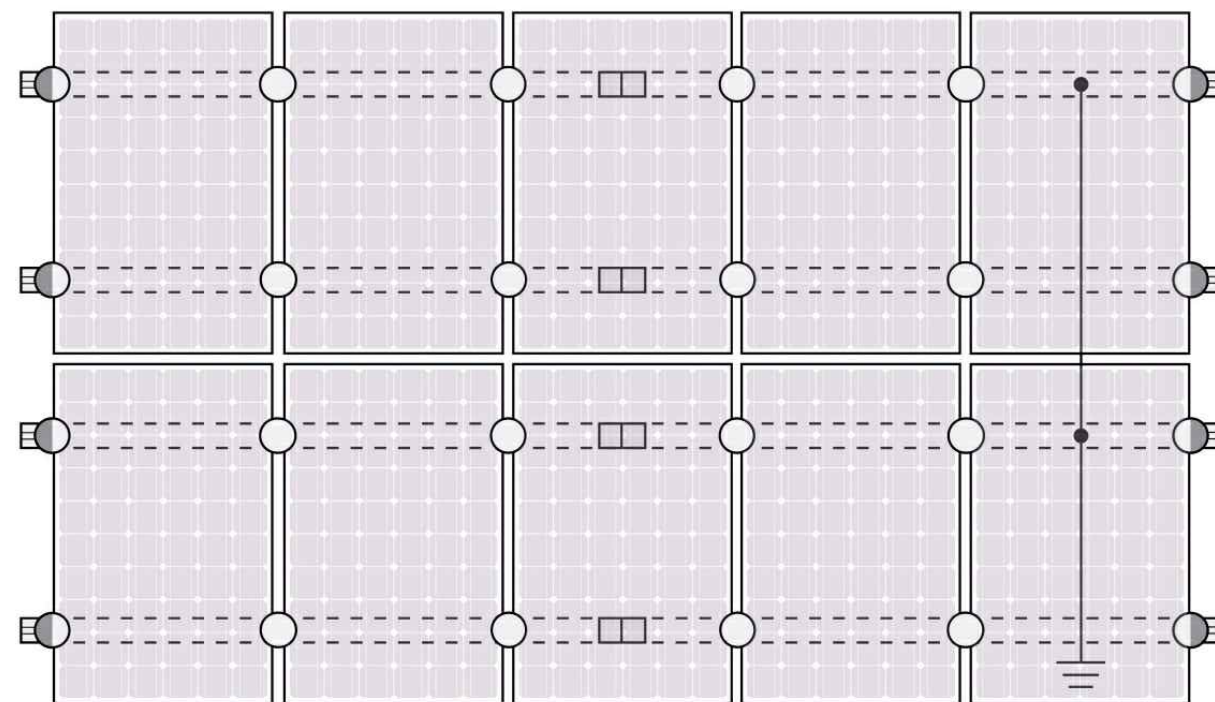

○ UFO    ◐ Stopper Sleeve    ● Grounding Lug    □ BOSS™ Splice    — Ground Wire

⚠ Approved Enphase microinverters can provide equipment grounding of IronRidge systems, eliminating the need for grounding lugs and field installed equipment ground conductors (EGC). A minimum of two microinverters mounted to the same rail and connected to the same Engage cable is required. Refer to installation manuals for additional details.

### UL Certification

The IronRidge® Flush Mount®, Tilt Mount®, and Ground Mount Systems have been listed to UL 2703 by Intertek Group plc.

UL 2703 is the standard for evaluating solar mounting systems. It ensures these devices will maintain strong electrical and mechanical connections over an extended period of time in extreme outdoor environments.

 [Go to IronRidge.com/UFO](https://www.ironridge.com/UFO)

### Cross-System Compatibility

Feature	Flush Mount	Tilt Mount	Ground Mount
XR Rails®	✓	✓	XR100 & XR1000
UFO®/Stopper	✓	✓	✓
BOSS® Splice	✓	✓	N/A
Grounding Lugs	1 per Row	1 per Row	1 per Array
Microinverters & Power Optimizers	Compatible with most MLPE manufacturers. Refer to system installation manual.		
Fire Rating	Class A	Class A	N/A
Modules	Tested or Evaluated with over 400 Framed Modules. Refer to installation manuals for a detailed list.		

Tech Brief

**TOP TIER**  
SOLAR SOLUTIONS

### TOP TIER SOLAR SOLUTIONS

1530 CENTER PARK DR #2911,  
CHARLOTTE, NC 28217,  
UNITED STATES

#### REVISIONS

DESCRIPTION	DATE	REV
INITIAL DESIGN	07/30/2025	

#### PROJECT NAME & ADDRESS

JOSHUA SPRAGUE  
RESIDENCE

580 NEW CASTLE LN,  
SPRING LAKE, NC 28390

#### DRAWN BY

ESR

#### SHEET NAME

EQUIPMENT  
SPECIFICATION

#### SHEET SIZE

ANSI B  
11" X 17"

#### SHEET NUMBER


PV-14





QuickMount® Halo UltraGrip

Cut Sheet

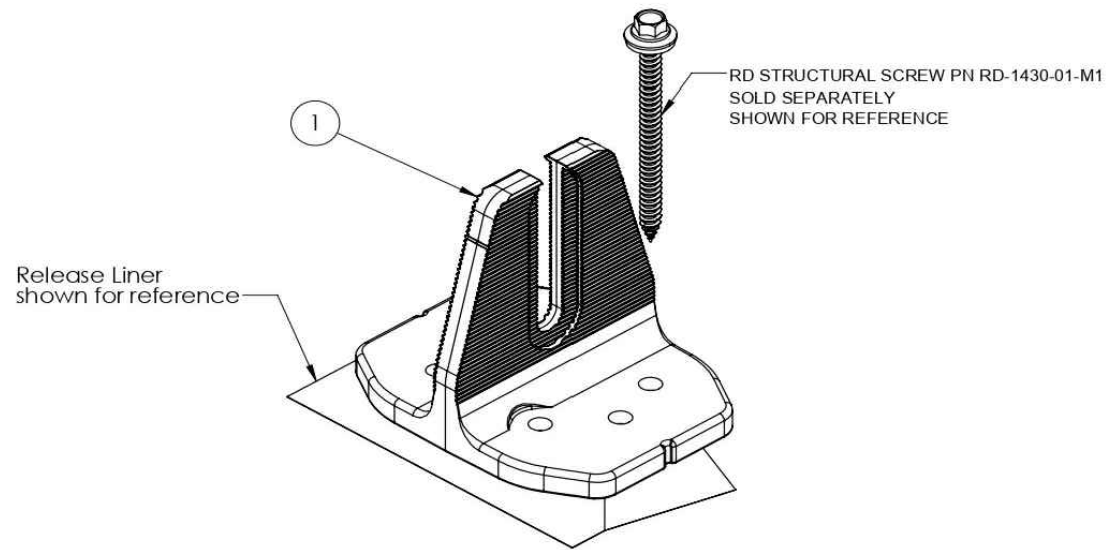

ITEM NO	DESCRIPTION	QTY IN KIT
1	QM Halo UltraGrip(Mill or Black)	1

PART NUMBER	DESCRIPTION
QM-HUG-01-M1	Halo UltraGrip - Mill
QM-HUG-01-B1	Halo UltraGrip - Black




© 2022 IronRidge, Inc. All rights reserved. Visit [www.ir-patents.com](http://www.ir-patents.com) for patent information.

QM-HUG-01-B1 or QM-HUG-01-M1 Cut Sheet Rev 1.0

Cut Sheet

1. Halo UltraGrip

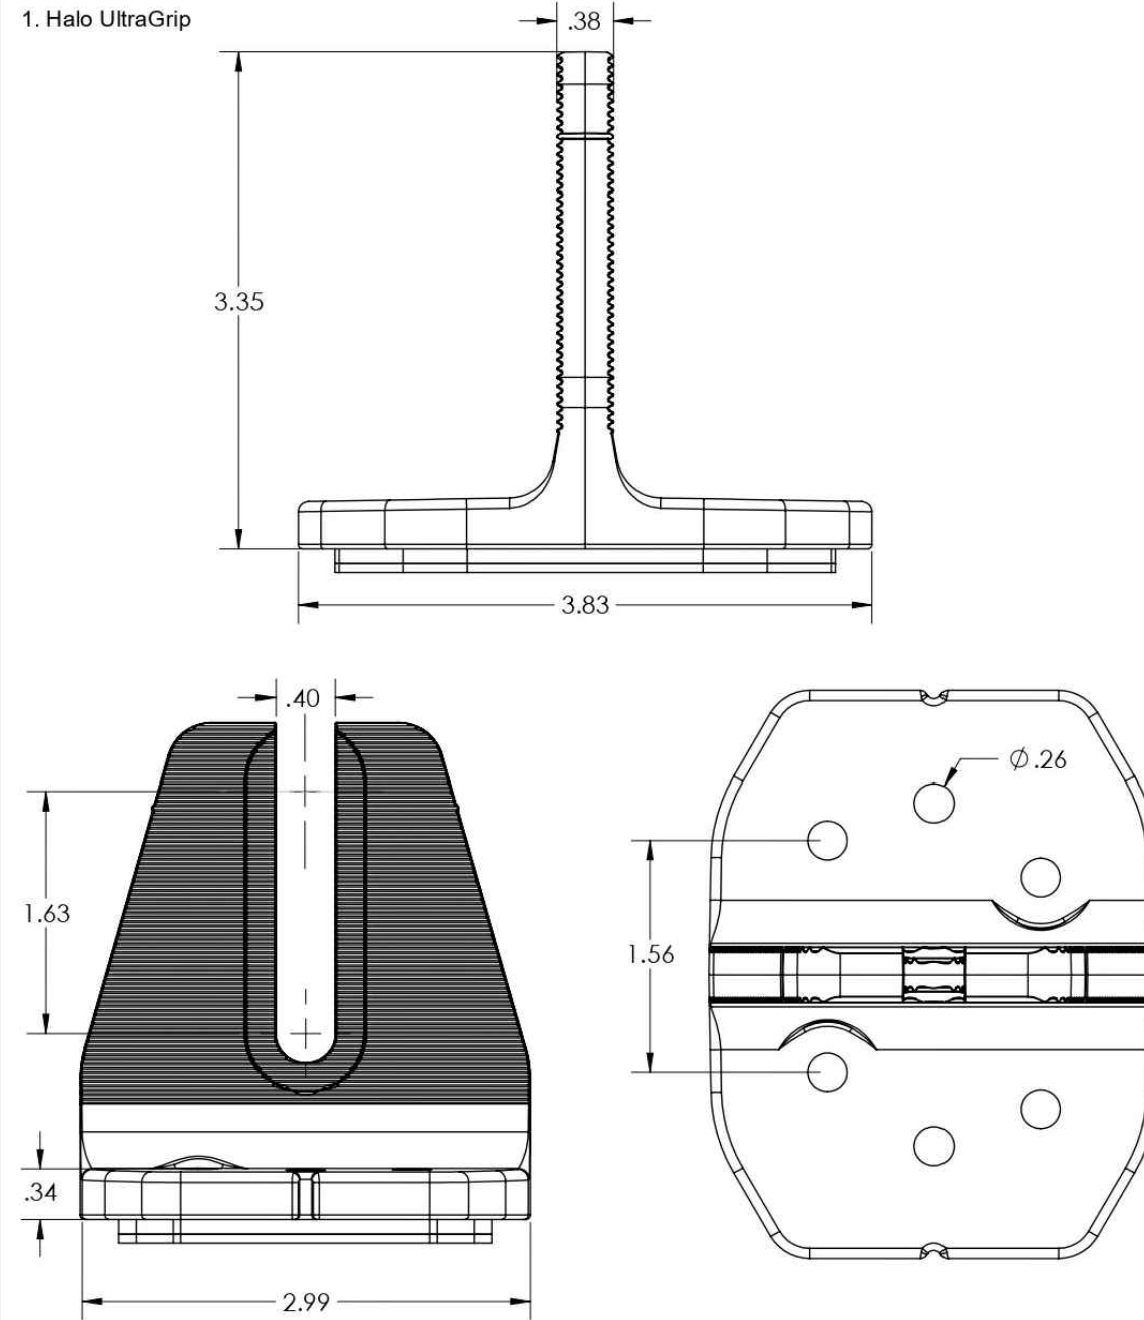

Property	Value
Material	3000 Series Aluminium
Finish	Mill or Black



© 2022 IronRidge, Inc. All rights reserved. Visit [www.ir-patents.com](http://www.ir-patents.com) for patent information.


QM-HUG-01-B1 or QM-HUG-01-M1 Cut Sheet Rev 1.0



TOP TIER SOLAR SOLUTIONS

1530 CENTER PARK DR #2911,  
CHARLOTTE, NC 28217,  
UNITED STATES

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL DESIGN	07/30/2025	



PROJECT NAME & ADDRESS	
JOSHUA SPRAGUE RESIDENCE	580 NEW CASTLE LN, SPRING LAKE, NC 28390

DRAWN BY ESR
-----------------

SHEET NAME EQUIPMENT SPECIFICATION
--

SHEET SIZE ANSI B 11" X 17"
-----------------------------------


SHEET NUMBER PV-15
-----------------------





QuickMount® RD Structural Screw


Cut Sheet

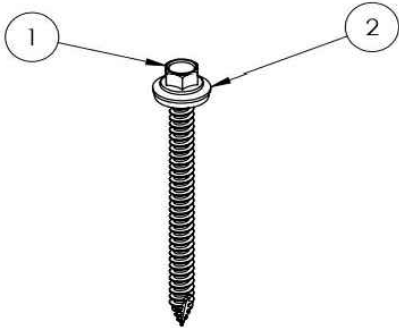

ITEM NO	DESCRIPTION	QTY IN KIT
1	Self Drilling Screw, #14, Wood Tip	1
2	Washer, EPDM Backed	1

PART NUMBER	DESCRIPTION
RD-1430-01-M1	RD Structural Screw

1. Self Drilling Screw, #14, Wood Tip

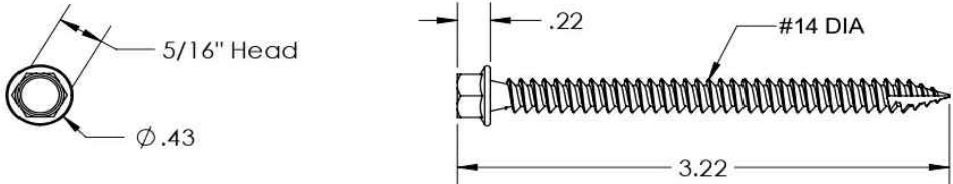

Property	Value
Material	300 Series Stainless Steel
Finish	Clear

2. Washer, EPDM Backed



Property	Value
Material	300 Series Stainless Steel
Finish	Clear



TOP TIER SOLAR SOLUTIONS

1530 CENTER PARK DR #2911,  
CHARLOTTE, NC 28217,  
UNITED STATES

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL DESIGN	07/30/2025	



PROJECT NAME & ADDRESS

JOSHUA SPRAGUE  
RESIDENCE  
580 NEW CASTLE LN,  
SPRING LAKE, NC 28390

DRAWN BY
ESR

SHEET NAME
EQUIPMENT SPECIFICATION

SHEET SIZE
ANSI B 11" X 17"

SHEET NUMBER
PV-16



PHONE: 385-202-4150  
WWW.EZSOLARPRODUCTS.COM



PHONE: 385-202-4150  
WWW.EZSOLARPRODUCTS.COM

ITEM NO.	PART NUMBER	DESCRIPTION	QTY
1	JB-1.2 BODY	POLYCARBONATE WITH UV INHIBITORS	1
2	JB-1.2 LID	POLYCARBONATE WITH UV INHIBITORS	1
3	#10 X 1-1/4" PHILLIPS PAN HEAD SCREW		6
4	#8 X 3/4" PHILLIPS PAN HEAD SCREW		6

SIZE <b>B</b>	DWG. NO. <b>JB-1.2</b>	REV
SCALE: 1:2	WEIGHT: 1.45 LBS	SHEET 1 OF 3

TORQUE SPECIFICATION:	15-20 LBS
CERTIFICATION:	UL 1741, NEMA 3R CSA C22.2 NO. 290
WEIGHT:	1.45 LBS



SIZE <b>B</b>	DWG. NO. <b>JB-1.2</b>	REV
SCALE: 1:2	WEIGHT: 1.45 LBS	SHEET 2 OF 3

**TOP TIER**  
SOLAR SOLUTIONS

**TOP TIER SOLAR SOLUTIONS**

1530 CENTER PARK DR #2911,  
CHARLOTTE, NC 28217,  
UNITED STATES

REVISIONS		
DESCRIPTION	DATE	REV
INITIAL DESIGN	07/30/2025	

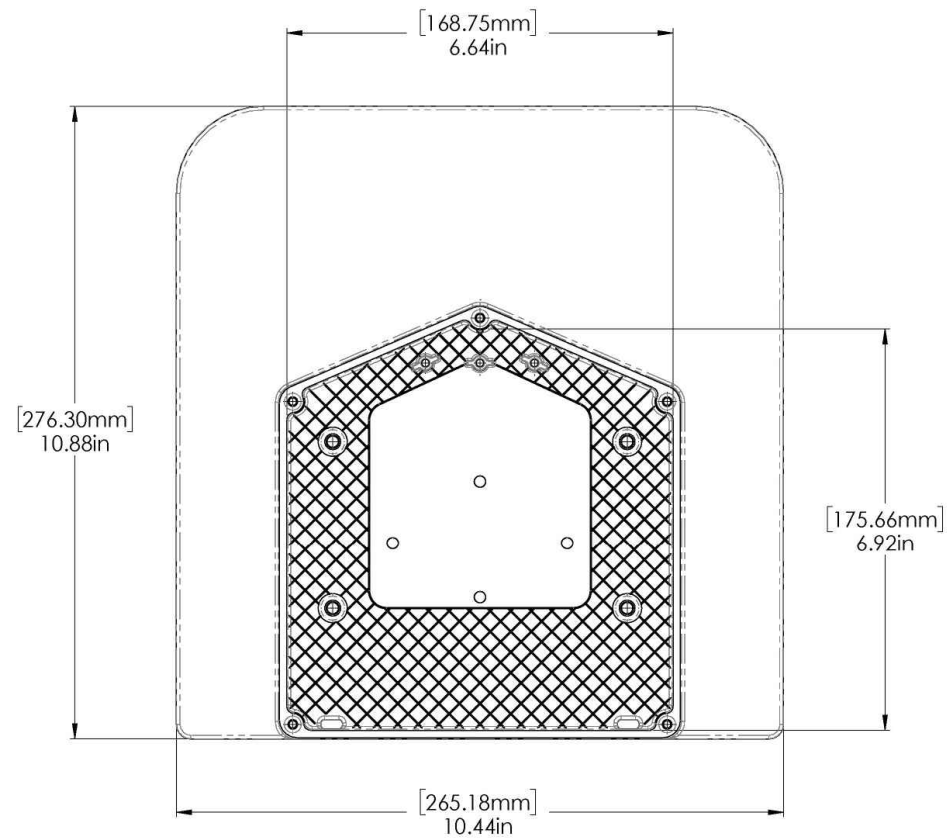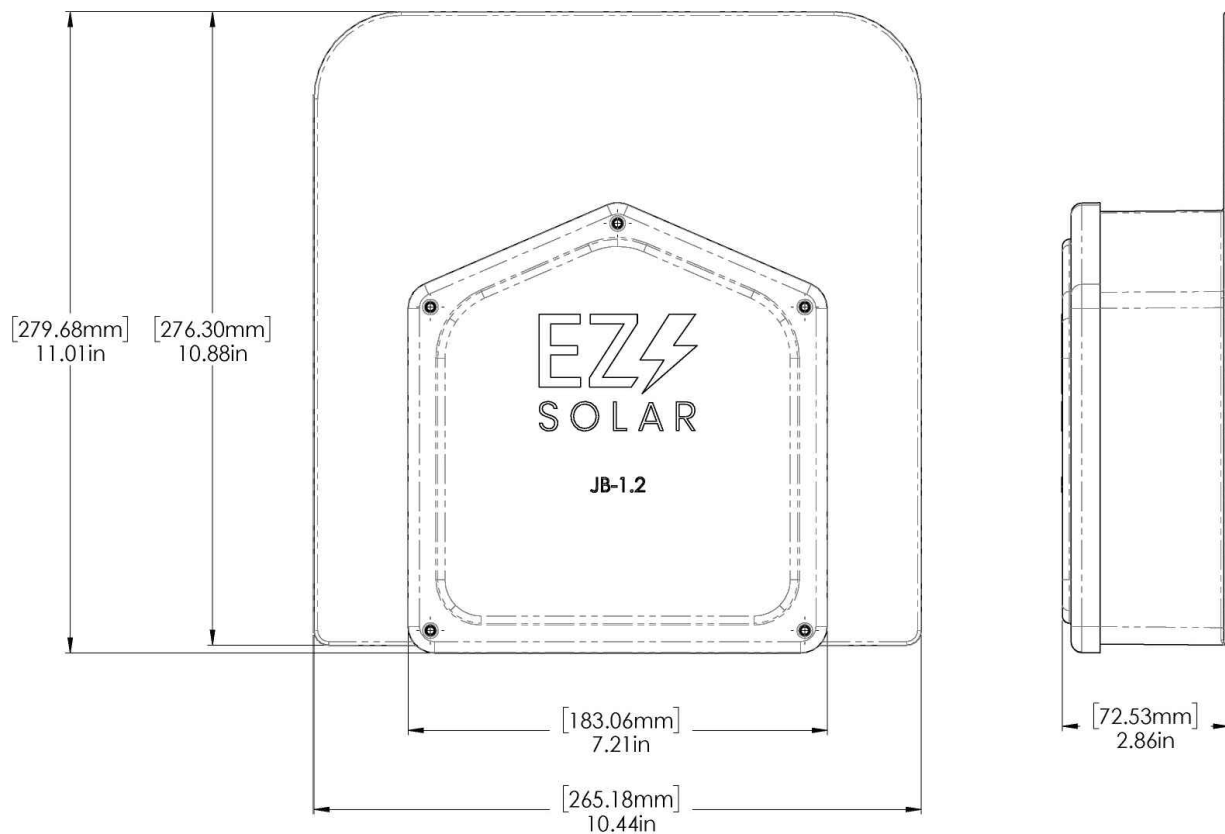

**PROPRIETARY AND CONFIDENTIAL:** THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF EZ SOLAR. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF EZ SOLAR IS PROHIBITED.



**PROPRIETARY AND CONFIDENTIAL:** THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF EZ SOLAR. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF EZ SOLAR IS PROHIBITED.



## PROJECT NAME & ADDRESS

JOSHUA SPRAGUE  
RESIDENCE

580 NEW CASTLE LN,  
SPRING LAKE, NC 28390

DRAWN BY

ESR

SHEET NAME  
EQUIPMENT  
SPECIFICATION

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

PV-17