# **ROOF MOUNTED PHOTOVOLTAIC SYSTEM AT**

<u>Ketan R Patel</u>

# 211 St Clair Dr Fuquay-Varina, NC 27526



# FRONT VIEW OF THE BUILDING

SYSTEM DETAILS				
10.92 KW ROOF MOUNTED SOLAR SYSTEM WITH MAX. 10.0 KVAC OUTPUT CAPACITY				
SOLAR PANELS MODEL	Canadian Solar CS6.1-54TM-455H			
NO. OF SOLAR PANELS	24			
INVERTER + BATTERY	01 X TESLA POWER WALL 3			
NO. OF INVERTER	1			
RAPID SHUT DOWN DEVICE (RSD)	MCI - 2 (High Current)			
NO.OF RSD	09			
RACKING PEGASUS (PSR-B84 RAILS)				
MOUNTING DETAILS	INSTAFLASH2			



# **AERIAL VIEW OF THE BUILDING**

	SHEET INDEX				
G01	COVER SHEET				
E01	ELECTRICAL NOTES				
PV01	SITE LAYOUT				
PV02	STRING MAPPING				
PV03	ELECTRICAL ONE LINE DIAGRAM				
PV04	ELECTRICAL DETAILED WIRING DIAGRAM				
PV05	GROUNDING PLAN				
PV06	WARNING LABELS AND LOCATION				
PV07	RACKING DETAILS				
PV08	BILL OF MATERIALS				
SS01	PRODUCT SPEC. SHEETS				



		7526	
CUSTOMER INFORMATION	NAME Ketan R Patel	ADDRESS 211 St Clair Dr Fuquay-Varina, NC 27526	APPROVAL
NUMBER	25-339-KP	E SIZE	24" x 36"








		 	 	_	
REV	٧				
DATE	7.02/2025				
DESCRIPTION					


1					
	UTILITY COMPANY	PERMIT ISSUER (AHJ)	SCOPE OF WORK	DESIGN CRITERIA	[H <
K	DUKE ENERGY	Harnett County	INSTALLATION OF UTILITY INTERACTIVE PHOTOVOLTAIC SOLAR SYSTEM	WIND SPEED = 120MPH GROUND SNOW LOAD = 15PSF WIND EXPOSURE FACE	CTOR = <b>B</b> DRAWING # G01
	1 2	3 4	5   6   7	8   9   10   11   12	13 14 15

### ABBREVIATION LEGEND - GENERAL CODE AND STANDARDS DARK LINE INDICATES NEW OR WITHIN THE SCOPE OF PROJECT AMPERE FRAME LIGHT LINE INDICATES EXISTING OR BEYOND THE SCOPE OF PROJECT THE INSTALLATION OF SOLAR ARRAYS AND PHOTOVOLTAIC POWER SYSTEMS SHALL ARC FAULT DETECTION & INTERRUPTER AFDI DASHED LINE INDICATES EQUIPMENT AT A DIFFERENT LOCATION COMPLY WITH THE FOLLOWING CODES: AIC AMPS INTERRUPTING CAPACITY ΑТ AMPERE TRIP 2020 NATIONAL ELECTRICAL CODE **LEGEND - PLAN SYMBOLS** AUTOMATIC TRANSFER SWITCH ATS 2018 NORTH CAROLINA RESIDENTIAL CODE AWG AMERICAN WIRE GAUGE 2018 NORTH CAROLINA BUILDING CODE BKR CIRCUIT BREAKER ALL OTHER ORDINANCE ADOPTED BY THE LOCAL GOVERNING AGENCIES RACEWAY TURNING UP OR TOWARDS OBSERVER CONDUIT СВ COMBINER BOX $\odot$ CKT CIRCUIT SITE NOTES / OSHA REGULATION CP CONTROL PANEL 1. A LADDER SHALL BE IN PLACE FOR INSPECTION IN COMPLIANCE WITH OSHA CU COPPER P OR P REGULATIONS. DISC DISCONNECT CUSTOMER INFORMATION J OR J JUNCTION BOX EQUIPMENT GROUNDING CONDUCTOR THE SOLAR PV INSTALLATION SHALL NOT OBSTRUCT ANY PLUMBING, FGC ELECTRIC. ELECTRICAL FLEC r Dr MECHANICAL, OR BUILDING ROOF VENTS. **EMERG** EMERGENCY Clair I 3. ROOFTOP MOUNTED PHOTOVOLTAIC PANELS AND MODULES SHALL BE EMT ELECTRICAL METALLIC TUBING Φ SIMPLEX RECEPTACLE, RATED: 125 - VOLTS AC, 20A TESTED, LISTED AND IDENTIFIED BY RECOGNIZED ELECTRICAL TESTING **EQUIP** EQUIPMENT $\bigcirc$ G, GND GROUND DUPLEX RECEPTACLE, RATED: 125 - VOLTS AC, 20A LABORATORY. GROUNDING ELECTRODE CONDUCTOR 211 GEC MODULES AND SUPPORT STRUCTURES SHALL BE GROUNDED $\bigcirc$ WEATHERPROOF DUPLEX RECEPTACLE. RATED: 125 - VOLTS AC. 20A GROUND-FAULT CIRCUIT INTERRUPTER GECL SOLAR INVERTER SHALL BE LISTED TO UL1741 GFCI 5 GROUND-FAULT PROTECTION OF EQUIPMENT GFPF GROUND FAULT CIRCUIT INTERRUPTER DUPLEX RECEPTACLE, RATED: 125 - VOLTS AC, 20A HIGH - INTENSITY DISCHARGE (LIGHTING) HID 6. ALL CONDUCTORS SHALL BE COPPER AND SHOULD BE 75 AND 90 DEG RATED DOUBLE DUPLEX (QUAD) RECEPTACLE CEILING / PENDANT - MOUNT H7 REMOVAL OF AN INTERACTIVE INVERTER OR OTHER EQUIPMENT SHALL NOT INTERMEDIATE METALLIC CONDUIT apo IMC LIGHT. SEE FIXTURE SCHEDULE FOR TYPE DISCONNECT THE BONDING CONNECTION BETWEEN THE GROUNDING 1000 AMPS INTERRUPT CAPACITY KAIC. WALL - MOUNT LIGHT, SEE FIXTURE SCHEDULE FOR TYPE ELECTRODE CONDUCTOR, THE PHOTOVOLTAIC SOURCE AND OUTPUT CIRCUIT KCMIL 1000 CIRCULAR MILLS KILO - VOLT AMPERE KVA OB NUMBER GROUNDED CONDUCTORS. GROLIND ROD ΚW (o) SIZE LIVE PARTS OF PV SOURCE CIRCUITS AND PV OUTPUT CIRCUITS OVER 150V TO GROUND ROD W / TEST WELL LIGHTNING & SURGE ARRESTOR LA GROUND SHALL NOT BE ACCESSIBLE TO OTHER THAN QUALIFIED PERSONS WHILE LIGHT - EMITTING DIODE LEGEND - ONE LINE DIAGRAM AND WIRING DIAGRAM SYMBOLS LED PAGE ( LONG, SHORT, INSTANTANEOUS, & GROUND FAULT ENERGIZED. I SIG **⊸**⊶ CIRCUIT BREAKER, FRAME SIZE AND TRIP SETTING AS NOTED LTG LIGHTING ALL PV MODULES AND ASSOCIATED EQUIPMENT AND WIRING SHALL BE 9 ~~~ MAX MAXIMUM PROTECTED FROM PHYSICAL DAMAGE. MFG MANUFACTURER INVERTER NFPA 855 ONLY PERMITS RESIDENTIAL ESS TO BE INSTALLED IN THE MAIN LUGS ONLY MI O MPPT MAXIMUM POWER POINT TRACKING FOLLOWING AREAS: ATTACHED GARAGES, DETACHED GARAGES, ON EXTERIOR NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION BUS CONNECTION POINT NEMA CERTIFIED WALLS AT LEAST 3 FT AWAY FROM DOORS OR WINDOWS, OUTDOORS AT LEAST 3 NOT TO SCALE NTS FT AWAY FROM DOORS OR WINDOWS, UTILITY CLOSETS, STORAGE OR UTILITY CROSSING POINT (NO CONNECTION) PV Installation POLE PF POWER FACTOR SPACES. PROGRAMMABLE LOGIC CONTROLLER NORMALLY CLOSED - NORMALLY OPEN CONTACTS PLC. PVIP #031310-32 PW/P POWER SOLAR CONTRACTOR POI POINT OF INTERCONNECTION FUSE SIZE / RATING AS NOTED MODULE CERTIFICATIONS INCLUDE UL1703, IEC61646, IEC61370. PRIMARY PVC POLYVINYL CHLORIDE 2. IF APPLICABLE, MODULE GROUNDING LUGS MUST BE INSTALLED AT THE T FUSE DISCONNECT SWITCH RCPT RECEPTACLE MARKED GROUNDING LUG HOLES PER THE MANUFACTURERS INSTALLATION RGS RIGID GAI VANIZED STEEL CONDUIT REQUIREMENTS RIGID METAL CONDUIT RMC 3. AS INDICATED BY DESIGN, OTHER NRTL LISTED MODULE GROUNDING DEVICES SURGE ARRESTOR SEC SECONDARY MAY BE USED IN PLACE OF STANDARD GROUNDING LUGS AS SHOWN IN SURGE PROTECTION DEVICE SPD MANUFACTURER DOCUMENTATION AND APPROVED BY THE AHJ. PUSHBUTTON SWITCHES: NUMBER AND TYPE OF CONTACT BLOCKS MAY VARY SSR.I SUPPLY SIDE BONDING JUMPER 4. ALL MICROINVERTERS, PHOTOVOLTAIC MODULES, AC COMBINERS, DC-AC ST SHUNT TRIP SWITCH CONVERTERS AND SOURCE CIRCUIT COMBINERS INTENDED FOR USE IN A PUSHBUTTON SWITCHES MUSHROOM HEAD: NUMBER AND TYPE OF CONTACT BLOCKS MAY VARY TBD TO BE DETERMINED PHOTOVOLTAIC POWER SYSTEM WILL BE IDENTIFIED AND LISTED FOR THE TWISTED PAIR TP APPLICATION PER NEC690.4(B). 09-15-2025 TYP TYPICAL (K)KEYED INTERLOCK (KIRK KEY OR EQ) 5. ALL SIGNAGE TO BE INSTALLED IN ACCORDANCE WITH LOCAL BUILDING V VOLT VΑ VOLT - AMPERE CODE. (ST) w WATT SHUNT TRIP COIL 6. TERMINALS AND LUGS WILL BE TIGHTENED TO MANUFACTURER TORQUE WEATHER PROOF SPECIFICATIONS XFMR TRANSFORMER (WHEN PROVIDED) IN ACCORDANCE WITH NEC CODE 110.14(D) ON ALL TRANSFORMER CONTROL / POWER, SIZE AND RATING AS NOTED ELECTRICAL CONNECTIONS. 7. MAX DC VOLTAGE CALCULATED USING MANUFACTURER PROVIDED TEMP UTILITY DISCONNECT SWITCH REQUIREMENTS COEFFICIENT FOR VOC UNLESS NOT AVAILABLE. THE UTILITY REQUIRES A SINGLE LOCKABLE AND VISIBLE DISCONNECTING MEANS BY WHICH THE GENERATION SOURCE CAN BE ISOLATED FROM ANY AND ALL PARTS OF THE UTILITY SYSTEM WHEN NECESSARY.THIS DISCONNECTING DRAWING# MEAN SHOULD BE VISIBLE, ACCESSIBLE AND OPERABLE BY UTILITY PERSONNEL. POTENTIAL TRANSFORMER E01

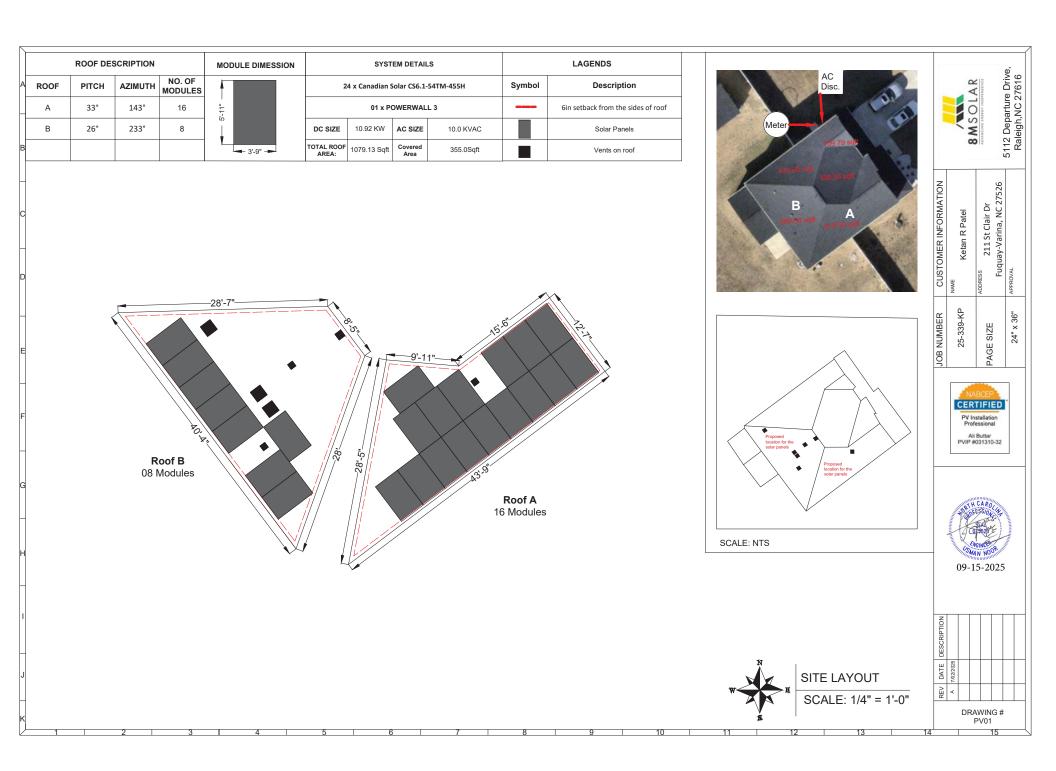

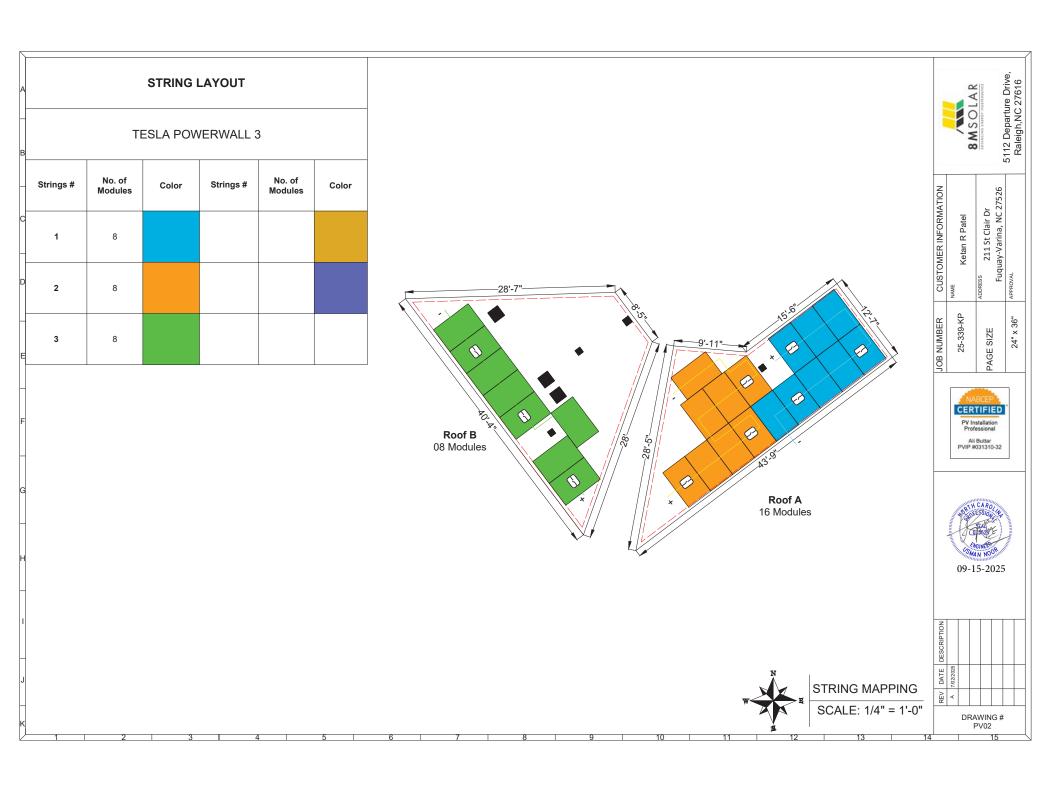

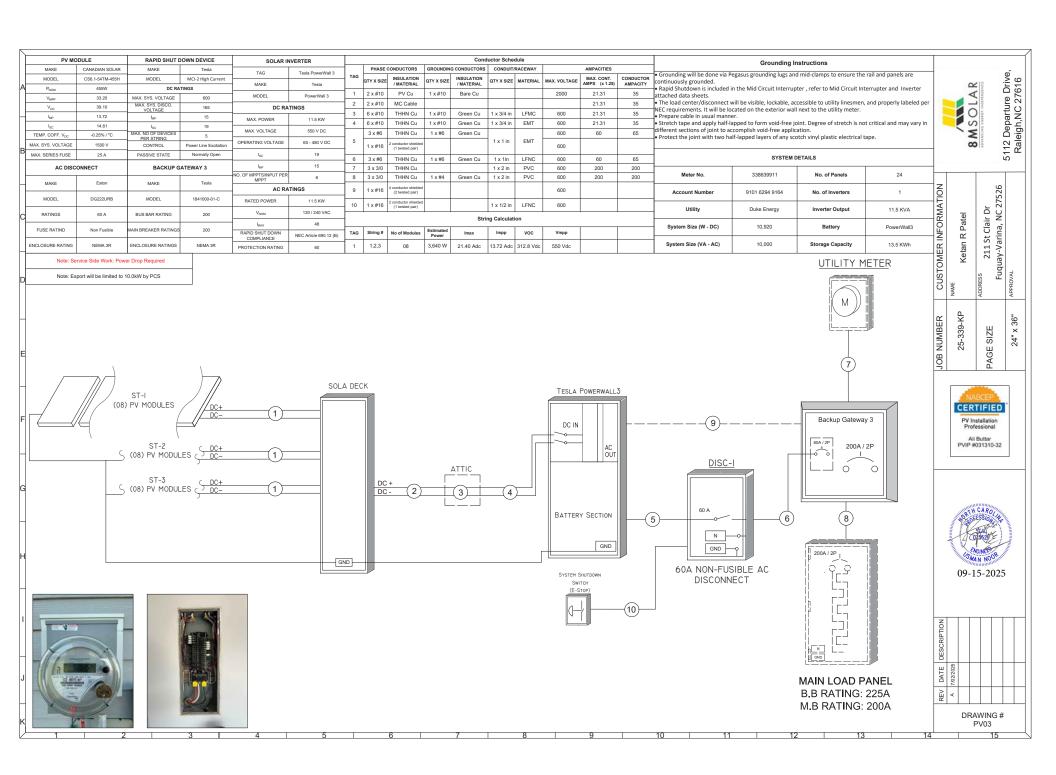

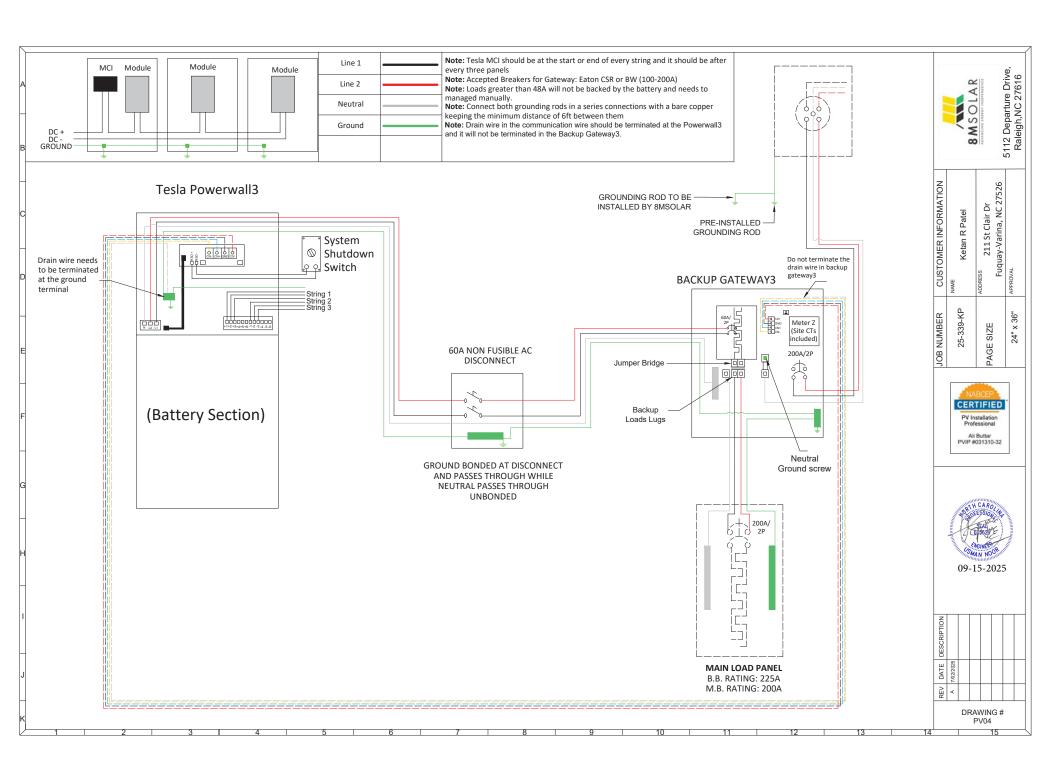

### **GROUNDING PLAN**



5112 Departure Drive, Raleigh,NC 27616

r Dr Ketan R Patel 211 St Clair [ ay-Varina, NC

CUSTOMER INFORMATION

JOB NUMBER

CONDUIT IN

PAGE SIZE

24"

CERTIFIED PV Installation PVIP #031310-32





DESCRIP'				
DATE	7.02/2025			
REV	٧			

DRAWING# PV05

REPRESENTATIVE CONDUCTORS CONTINUOUS GROUND GROUND SCREW ENCLOSURE WALL NPT THREADED HUB CONDUIT

> MYERS HUB GROUNDING SCALE: NONE

GROUNDING


ENCLOSURE

BUSHINGS

NOTES:

1. EACH SUBARRAY CONNECTED TO AN INVERTER SHALL HAVE AN EGC RUN TO THAT INVERTER

2. PV MODULES AND RAILS GROUNDED PER NEC 690.43



6 ARRAY GROUNDING
SCALE: NONE

3 PULL BOX/TROUGH GROUNDING SCALE: NONE

CONDUIT BUSHING GROUNDING

NEC 250.102(C)(2) SSBJ IS SIZED PER TABLE 250.102(C)(1) BASED ON THE COMBINED AREA OF PARALLEL PHASE CONDUCTORS

REPRESENTATIVE CONDUCTORS

GROUND BUSHING WITH

COMPRESSION FITTING

LAY-IN LUG

LOCK NUT

CONDUIT

INDIVIDUAL COMBINED

CONTINUOUS BONDING JUMPER, STRIP INSULATION AT LUG. ALTERNATIVELY, THE EGC MAY BE USED (AS SHOWN).

GROUND LUGS USED

RATED.

ENCLOSURE WALL

OUTDOORS MUST BE DIRECT BURIAL/OUTDOOR

NFC\_250.102(C)(1)
CSSBJ IS SIZED PER TABLE
250.102(C)(1) BASED ON THE SIZE OF PHASE
CONDUCTORS IN EACH
INDIVIDUAL CONDUIT

TABLE 250.102(C)(1)						
EQUIVALENT AREA FOR	OUNDED CONDUCTOR OR PARALLEL CONDUCTORS /KCMIL)		DED CONDUCTOR OR BONDING IPER (AWG/KCMIL)			
COPPER ALUMINUM OR COPPER-CLAD ALUMINUM		COPPER	ALUMINUM OR COPPER-CLAD ALUMINUM			
2 OR SMALLER	1/0 OR SMALLER	8	6			
1 OR 1/0	2/0 OR 3/0	6	4			
2 OR 2/0	4/0 OR 250	4	2			
OVER 3/0 THROUGH 350	OVER 250 THROUGH 500	2	1/0			
OVER 350 THROUGH 600 OVER 500 THROUGH 900		1/0	3/0			
OVER 600 THROUGH 1100 OVER 900 THROUGH 1750		2/0	4/0			
OVER 1100	OVER 1750	REFER TO NOTI	ES IN NEC TABLE 250.102(C)(1)			

(SSBJ) SUPPLY SIDE BONDING JUMPERS (SSBJ)

### A) FOR CONCENTRIC KNOCKOUTS, USE BONDING JUMPERS AS FOLLOWS:

TABL	E 250.122	FOR PARALLEL FEEDERS - NEC 250.102(D)	
OVER CURRENT DEVICE	SIZE (A	AWG OR KCMIL)	EQUIPMENT BONDING JUMPER IS SIZED PER
(AMPERES)	COPPER	ALUMINUM	TABLE 250.122, REGARDLESS IF COMBINED OR INDIVIDUAL BONDING JUMPERS ARE USED
15	14	12	
20	12	10	4) 1110111101111
60	10	8	1) <u>INDIVIDUAL</u>
100	8	6	
200	6	4	1
300	4	2	1 1124 \ 1
400	3	1	
500	2	1/0	
600	- 1	2/0	
800	1/0	3/0	1
1000	2/0	4/0	2) <u>COMBINED</u>
1200	3/0	250	
1600	4/0	350	•• G
2000	250	400	] [ 🖰
2500	350	600	
3000	400	600	l <u>- 1 - 1 - 1 - 1 - 1 - 1 - 1 - 1 - 1 - </u>
4000	500	750	~~


- B) FOR NON-CONCENTRIC KNOCKOUTS, THE FOLLOWING METHODS SHALL BE PERMITTED (PER NEC 250.97)
- PERMITTED LYPER NEC 200.97)

  1) THEADLESS COUPLINGS AND CONNECTORS FOR CABLES WITH METAL SHEATHS

  2) TWO LOCKWUTS, ON RIGID METAL CONDUIT OR INTERMEDIATE METAL CONDUIT, ONE
  INSIDE AND ONE OUTSIDE OF FOXES AND CABINETS

  3) FITTINGS WITH SHOULDERS THAT SEAT FIRMLY AGAINST THE BOX OR CABINET, SUCH AS
  ELECTRICAL METALLIC TUBBLE CONNECTORS, ECKIPLE METAL CONDUIT CONNECTORS,
  AD CABLE CONNECTORS, WITH ON LOCKMUT ON THE INSIDE OF BOXES AND CABINETS

  4) USTED FITTINGS (SUCH AS WERS HUB)
- (5) LOAD SIDE EQUIPMENT BONDING JUMPER SCALE: NONE

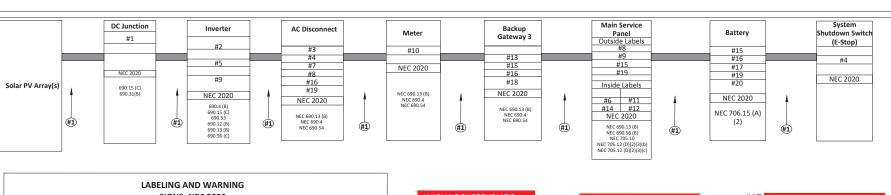

# SIGNS: NEC 2020

### PURPOSE

PROVIDE EMERGENCY RESPONDERS WITH APPROPRIATE WARNING AND GUIDANCE WITH RESPECT TO ISOLATING THE SOLAR ELECTRIC SYSTEM. THIS CAN FACILITATE IDENTIFYING ENERGIZED ELECTRICAL LINES THAT CONNECT THE SOLAR PANELS TO THE INVERTER, AS SHOULD NOT BE CUT WHEN VENTING FOR SMOKE REMOVAL.

### В. MAIN SERVICE DISCONNECT:

- RESIDENTIAL BUILDINGS- THE MARKING MAY BE PLACED WITHIN THE MAIN SERVICE 1. DISCONNECT. THE MARKING SHALL BE PLACED ON THE OUTSIDE COVER IF THE MAIN SERVICE DISCONNECT IS OPERABLE WITH THE SERVICE PANEL CLOSED.
- COMMERCIAL BUILDINGS- THE MARKINGS SHALL BE PLACED ADJACENT TO THE MAIN SERVICE DISCONNECTCLEARLY VISIBLE FROM THE LOCATION WHERE THE LEVER IS OPERATED
- 3. MARKINGS, VERBIAGE, FORMAT AND TYPE OF MATERIA
- a. VERBIAGE: CAUTION; SOLAR ELECTRIC SYSTEM CONNECTED
- b. FORMAT:
- WHITE LETTERING ON A RED BACKGROUND (1)
- (2) MINIMUM 3/8 INCH LETTER HEIGHT
- (3) ALL LETTERS SHALL BE CAPITALIZED
- (4) ARIAL OR SIMILAR FONT, NON-BOLD
- С. MATERIAL:
- REFLECTIVE, WEATHER RESISTANT MATERIAL SUITABLE FOR THE ENVIRONMENT (USE UL-969) AS STANDARD FOR WEATHER RATING): DURABLE ADHESIVE MATERIALS MEET THIS REQUIREMENT.
- MARKING REQUIREMENTS ON DC CONDUIT, RACEWAYS, ENCLOSURES, CABLE ASSEMBLIES, DC COMBINERS AND JUNCTION BOXES;
- 1. MARKING: PLACEMENT, VERBIAGE, FORMAT AND TYPE OF MATERIAL.
- PLACEMENT: MARKINGS SHALL BE PLACED EVERY 10 (TEN) FEET ON ALL INTERIOR AND EXTERIOR DC CONDUITS, RACEWAYS, ENCLOSURES AND CABLE ASSEMBLIES, AT TURNS ABOVE AND/OR BELOW PENETRATIONS, ALL DC COMBINERS AND JUNCTION BOXES.
- **VERBIAGE: CAUTION SOLAR CIRCUIT** B.
- C. THE FORMAT AND TYPE OF MATERIAL SHALL ADHERE TO SECTION B-3.B & C ABOVE
- D. INVERTERS ARE NOT REQUIRED TO HAVE CAUTION MARKINGS



**RAPID SHUTDOWN SWITCH FOR SOLAR PV SYSTEM** 

#5 MAXIMUM VOLTAGE 550Vdc MAX. RATED CIRCUIT CURRENT 13.72Add OF THE CHARGE CONTOLLER OR C-TO-DC CONVERTER (IF INSTALLE

240 PERATING AC VOLTAGE **MAXIMUN OPERATING** 48 OUTPUT CURRENT

#7 PHOTOVOLTAIC SYSTEM RATED AC 48 AMPS OMINAL OPERATING 240 VOLTS

#8 WARNING FLECTRIC SHOCK HAZARD TERMINAL ON THE LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION

#9 WARNING THREE POWER SOURCES SOURCES: UTILITY GRID, BATTERY AND

PV SOLAR ELECTRIC SYSTEM

#10 ∕!\ WARNING ∕!\ THREE POWER SOURCES SOURCES: UTILITY GRID, BATTERY AND PV SOLAR ELECTRIC SYSTEM

**WARNING** 

TURN OFF PHOTOVOLTAIC AC DISCONNECT PRIOR TO WORKING INSIDE PANEL

#12 **WARNING** 

#11

POWER SOURCE **OUTPUT CONNECTION** DO NOT RELOCATE THIS OVERCURRENT DEVICE

#13 **WARNING** SOLAR ELECTRIC **CIRCUIT BREAKER** 

IS BACKFEED

ή

#14 SOLAR PV SYSTEM EQUIPPED WITH RAPID SHUTDOWN TURN RAPID SHUTDOWN SWITCH TO THE "OFF" POSITION TO SHUT DOW

PV SYSTEM AND REDUCE SHOCK HAZARD IN TH ARRAY

#15 SOLAR AC DISCONNECT OCATED AT NORTH-WEST SIDE WALL OF THE HOUSE BESIDE THE UTILITY METER

#16 ERIVCE DISCONNECT LOCATED IN THE BACKUP GATEWAY3 **PANEL** 

#17 **BATTERY** 

#18 MAIN BATTERY SYSTEM DISCONNECT

#19 ATTERY DISCONNECT LOCATED IN THE BACKUP GATEWAY3 PANEL

#20 **ENERGY STORAGE** SYSTEM DISCONNECT IOMINAL ESS AC VOLTAGE 240V

NOMINAL ESS DC VOLTAGE 550V AVAILABLE FAULT CURRENT 160A DERIVED FROM THE ESS D 7/02/202 DATE CALCULATION PERFORME



5112 Departure Drive Raleigh,NC 27616


CUSTOMER INFORMATION r Dr Ketan R Patel St Clair ina, 211 36" OB NUMBER PAGE SIZE 24"





DATE

DRAWING# PV07

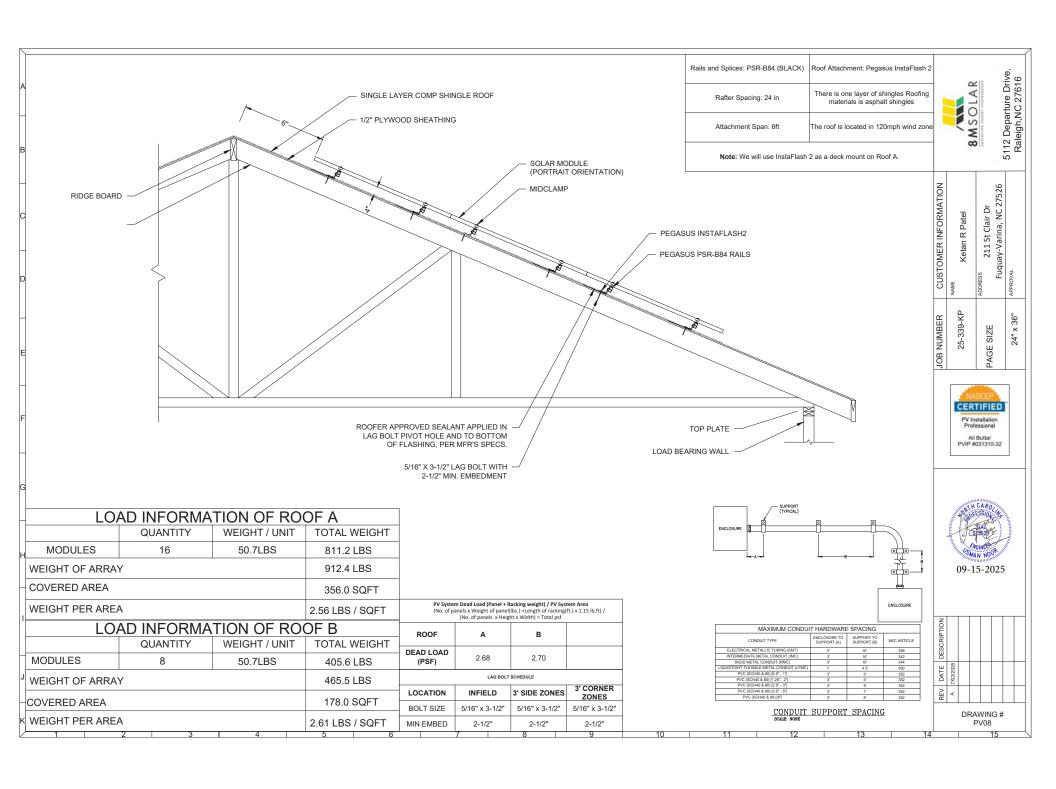

RAILS AND MOUNTING SYSTEM					
	MA	AKE	Pegasus		
SR. NO	QTY	PRODUCT NUMBER	DESCRIPTION		
1	32	PSR-B84	Pegasus Rail, Black, 84" (7 Feet)		
2	18	PSR-SPLS	Pegasus - Bonded, Structural Splice		
3	34	PSR-MCB	Pegasus - Multiclamp, Mid/End, 30 to 40 mm, Black		
4	28	PSR-HEC	Pegasus - Hidden End Clamp		
5	7	PSR-LUG	Pegasus - Grounding Lug		
6	60	PSR-WMC	Pegasus - Wire Management Clip		
7	5	PSR-CBG	Pegasus - Cable Grip		
8	28	PSR-CAP	Pegasus - End Cap		
9	49	PIF2-BDT	INSTAFLASH2 - DECK OR RAFTER ATTACH - WITH DOVETAIL T-BOLT		
10	230	PF-DRW85	PEGASUS FASTENER - DECK-RAFTER 85MM		
11	48	S6405	Heyco Wire Clips		
12	2	GEOC GC66100	SEALANT 2300 10.3OZ CLEAR (20) GEOCEL 230 TRIPOLY CLEAR		
13	15	MULTI 32.0017P0001-UR	PV MC4 MALE (10) [1000]		
14	15	MULTI 32.0016P0001-UR	PV MC4 FEMALE (10) [1000]		

SOLAR MODULES				
QTY	MODEL	MAKE		
24	CS6.1-54TM-455H	Canadian Solar		
	INVERTER ANI	D SUPPORTING ITEMS		
1	1707000-00-J	Tesla Powerwall3		
9	1879359-15-B	Tesla MCI-2 High Current		
1	1841000-01-C	Backup Gateway 3		
1	1549184-00X	2" Conduit Hub Kit		
	•	WIRE		
1	WIRPV 2KVPV10STRBLK500	#10 PV WIRE BLK (Cu) 500ft		
	ELECT	FRICAL ITEMS		
1	BW2200	Gateway Main Breaker-Eaton BW2200		
1	BR260	Eaton BR 60/2		
1	DG222URB	250volt/60amp/2pole non fusible disconnect (NEMA 3R)		
1	EATON M22PVK01	22.5MM PB EMG STOP W/ CONTACTOR		
1	Eaton M22I1PG	SFC MTG ENC Emergency Stop Enclosure		
1	EZSLR JB-1.2	SolaDeck		

LABELS AND SIGNAGE				
SR. NO	QTY	PRODUCT NUMBER		
1	12	02-314		
2	1	03-301		
3	1	03-302		
4	2	02-316		
5	1	03-308		
6	1	03-390		
7	1	03-306		
8	2	05-215		
9	2	05-230		
10	1	03-230		
11	1	05-372		
12	1	05-216		
13	1	05-342		
14	1	07-111		
15	3	8M-001		
16	3	8M-002		
17	1	03-395		
18	1	04-304		
19	3	8M-004		
20	1	03-511		



5112 Departure Drive, Raleigh,NC 27616

Į.				
	CUSTOMER INFORMATION	NAME Ketan R Patel	ADDRESS 211 St Clair Dr Fuquay-Varina, NC 27526	APPROVAL
	JOB NUMBER	25-339-KP	PAGE SIZE	24" x 36"







DESCRIPTION								
DATE	7/02/2025							
REV	A A							
DRAWING # PV09								

Note: Instaflash2 will be used as deck mount on Roof A









RSD Module Performance

-BYCKETT |-BYCKETT -BYCKETT |-BYCKETT -81% 50% 1-87% 50% -50% 50% 1-27% 500% 1000-0-788

Marie Marie

(4 Province (4 Sec. Public Processor Basic Ryallow & Science States States Sales Seasons Clinia Sales




INSTAFLASH'2















5112 Departure Drive, Raleigh,NC 27616

27526

211 St Clair Dr Fuquay-Varina, NC 27

x 36"

24"

8 M S O L A R

CUSTOMER INFORMATION

Ketan R Patel



						Ш			
DESCRIPTION									
DATE	7.02/2025								
Æ	٧								
DRAWING # SS01									

control and backup of		underly that because by the	second to sole ad-	outstyle, the beat	
Performance	Michigan Nagaribasi	SHEEDING	ACTION	+150	
Specifications	Number Cost Williago	TOTO DEC V AC	Demyster	1289	
	the Configuration	Spirgroup	parteidus.	Tecs. App.	
	Get Propancy	69	Setting Swedter	Automotic disconnect for matrices bankup:	
	Continues Current	300.6	Description	NO-REA	
	Monthlyn Egypty Short Group Garnel	Children by Strange Season State of Season	State of State	Sendor-emprounted Satur-CSR, Stone, or Shift or Sayan S (S) to page 1	
		bridge.	Sternal Fundament	200 A E-page /W proof broaders	
	BC Prosume Clean	Chef			
	Overvolvage Calcagner	Singer N		S C COL	
	"Coplan-CH or better	and the second second	Statety	E'pain	
Environmental	Spenitry Temperature		-province-re	+an	
Specifications	Opening Agently (8)		Spin SSN, continu	PS .	
	Motinge Devotes		(0000 to (0040 ft)		
	Enterent		Notice pel sylder o	ted:	
	findings lips		904.90		
Compliance	Ortholos		15.00 15.000A, 15.0 170-22.2 917.100A	MLUL ENERGO. SC 2 29	
	trinen.		ACCION N. Comb.	CTS REE	
Mechanical	Direction	Miles of a billione.	1		
Specifications -	Mary .	Miller (MW)			
	the basins	Westman		33 H	
			÷	1	








# TOPHiKu6 (All-Black)

N-type TOPCon Technology

435 W ~ 465 W

CS6.1-54TM-435 | 440 | 445 | 450 | 455 | 460 | 465H

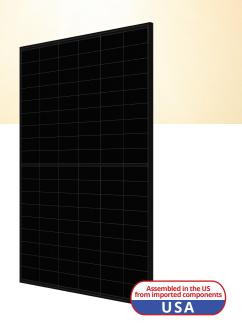

### **MORE POWER**



Module power up to 465 W Module efficiency up to 22.8 %



Excellent anti-LeTID & anti-PID performance. Low power degradation, high energy yield



Lower temperature coefficient (Pmax): -0.29%/°C, increases energy yield in hot climate



Lower LCOE & system cost

### **MORE RELIABLE**



Minimizes micro-crack impacts



Heavy snow load up to 8100 Pa, wind load up to 6000 Pa\*

**Industry Leading Product Warranty on Materials** and Workmanship



**Linear Power Performance Warranty\*** 

# 1st year power degradation no more than 1% Subsequent annual power degradation no more than 0.4%

\*Subject to the terms and conditions contained in the applicable Canadian Solar Limited Warranty Statement. Also this 25-year limited product warranty is available only for products installed and operating on rooftops in certain regions.

### **MANAGEMENT SYSTEM CERTIFICATES\***

ISO 9001:2015 / Quality management system ISO 14001:2015 / Standards for environmental management system ISO 45001: 2018 / International standards for occupational health & safety IEC62941: 2019 / Photovoltaic module manufacturing quality system

### **PRODUCT CERTIFICATES\***

IEC 61215 / IEC 61730 / CE / CGC CEC listed (US California) / FSEC (US Florida) UL 61730 / IEC 61701 / IEC 62716 / IEC 60068-2-68









<sup>\*</sup> The specific certificates applicable to different module types and markets will vary, and therefore not all of the certifications listed herein will simultaneously apply to the products you order or use. Please contact your local Canadian Solar sales representative to confirm the specific certificates available for your Product and applicable in the regions in which the products will be used.


CSI Solar Co., Ltd. is committed to providing high quality solar photovoltaic modules, solar energy and battery storage solutions to customers. The company was recognized as the No. 1 module supplier for quality and performance/price ratio in the IHS Module Customer Insight Survey. Over the past 23 years, it has successfully delivered over 150 GW of premium-quality solar modules across the world.

<sup>\*</sup> For detailed information, please refer to the Installation Manual.

### **ENGINEERING DRAWING (mm)**

# Rear View Frame Cross Section A - A A - A Mounting Hole 1084 1084 1134

### CS6.1-54TM-455H / I-V CURVES

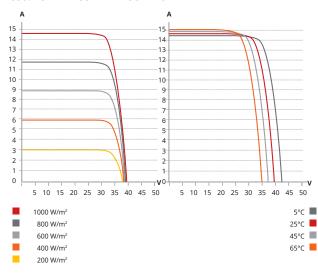

# **ELECTRICAL DATA | STC\***

CS6.1-54TM	435H	440H	445H	450H	455H	460H	465H
Nominal Max. Power (Pmax)	435 W	440 W	445 W	450 W	455 W	460 W	465 W
Opt. Operating Voltage (Vmp)	32.4 V	32.6 V	32.8 V	33.0 V	33.2 V	33.4 V	33.6 V
Opt. Operating Current (Imp)	13.45 A	13.52 A	13.59 <i>A</i>	13.66 A	13.72 <i>A</i>	13.78 <i>A</i>	13.85 A
Open Circuit Voltage (Voc)	38.3 V	38.5 V	38.7 V	38.9 V	39.1 V	39.3 V	39.5 V
Short Circuit Current (Isc)	14.33 A	14.41 A	14.48 <i>A</i>	14.55 A	14.61 <i>A</i>	14.69 A	14.77 A
Module Efficiency	21.3%	21.6%	21.8%	22.0%	22.3%	22.5%	22.8%
Operating Temperature	-40°C ~	+85°C					
Max. System Voltage	1000V	(IEC/UL)	)				
Module Fire Performance	TYPE 2	(UL 617	30 1000	OV) or CI	_ASS C (	IEC 617	30)
Max. Series Fuse Rating	25 A						
Protection Class	Class II						
Power Tolerance	0 ~ + 10	) W					

 $<sup>\</sup>star$  Under Standard Test Conditions (STC) of irradiance of 1000 W/m2, spectrum AM 1.5 and cell temperature of 25°C.

### **MECHANICAL DATA**

Specification	Data
Cell Type	TOPCon cells
Cell Arrangement	108 [2 X (9 X 6) ]
Dimensions	1800 × 1134 × 35 mm
Dimensions	(70.9 × 44.6 × 1.38 in)
Weight	23 kg (50.7 lbs)
Front Cover	3.2 mm tempered glass with anti-ref- lective coating
Frame	Anodized aluminium alloy
J-Box	IP68, 3 bypass diodes
Cable	4 mm <sup>2</sup> (IEC), 12 AWG (UL)
Connector	T6 or MC4 or MC4-EVO2 or MC4-EVO2A
Cable Length (Including Connector)	1500 mm (61.0 in) (+) / 1100 mm (43.3 in) (-)
Per Pallet	30 pieces
Per Container (40' HQ)	720 pieces

# **ELECTRICAL DATA | NMOT\***

CS6.1-54TM	435H	440H	445H	450H	455H	460H	465H
Nominal Max. Power (Pmax)	328 W	332 W	335 W	339 W	343 W	347 W	351 W
Opt. Operating Voltage (Vmp)	30.5 V	30.7 V	30.9 V	31.1 V	31.3 V	31.5 V	31.7 V
Opt. Operating Current (Imp)	10.74 A	10.80 A	10.85 <i>A</i>	10.91 A	10.96 A	11.02 A	11.07 A
Open Circuit Voltage (Voc)	36.2 V	36.4 V	36.5 V	36.7 V	36.9 V	37.1 V	37.3 V
Short Circuit Current (Isc)	11.56 A	11.63 <i>A</i>	11.68 <i>A</i>	11.74	11.79 A	11.85 A	11.92 A

<sup>\*</sup> Under Nominal Module Operating Temperature (NMOT), irradiance of 800 W/ $m^2$  spectrum AM 1.5, ambient temperature 20°C, wind speed 1 m/s.

# **TEMPERATURE CHARACTERISTICS**

Specification	Data
Temperature Coefficient (Pmax)	-0.29 % / °C
Temperature Coefficient (Voc)	-0.25 % / °C
Temperature Coefficient (Isc)	0.05 % / °C
Nominal Module Operating Temperatu	re 42 ± 3°C

### **PARTNER SECTION**

<sup>\*</sup> The specifications and key features contained in this datasheet may deviate slightly from our actual products due to the on-going innovation and product enhancement. CSI Solar Co., Ltd. reserves the right to make necessary adjustment to the information described herein at any time without further notice. Please be kindly advised that PV modules should be handled and installed by qualified people who have professional skills and please carefully read the safety and installation instructions before using our PV modules.

# Powerwall 3

# **Power Everything**

Powerwall 3 is a fully integrated solar and battery system, designed to accelerate the transition to sustainable energy. Customers can receive whole home backup, cost savings, and energy independence by producing and consuming their own energy while participating in grid services. Once installed, customers can manage their system using the Tesla App to customize system behavior to meet their energy goals.

Powerwall 3 achieves this by supporting up to 20 kW DC of solar and providing up to 11.5 kW AC of continuous power per unit. It has the ability to start heavy loads rated up to 185 LRA, meaning a single unit can support the power needs of most homes. Powerwall 3 Expansions make it easier and more affordable to scale up customers' systems to meet their current or future needs. Powerwall 3 is designed for fast and efficient installations, modular system expansion, and simple connection to any electrical service.



# **Powerwall 3 Technical Specifications**

# System Technical Specifications

Nominal Grid Voltage (Input & Output)   120/240 VAC	Model Number	1707000-xx	( <b>-</b> y			
Frequency	Nominal Grid Voltage (Input & Output)	120/240 VA	С			
Nominal Battery Energy         13.5 kWh AC¹           Nominal Output Power (AC)         5.8 kW         7.6 kW         10 kW         11.5 kW           Maximum Apparent Power         5,800 VA         7,600 VA         10,000 VA         11,500 VA           Maximum Continuous Current         24 A         31.7 A         41.7 A         48 A           Overcurrent Protection Device²         30 A         40 A         60 A         60 A           Configurable Maximum Continuous Discharge Power Off-Grid (PV Only, -20°C to 25°C)         15.4 kW³	Grid Type	Split phase				
Nominal Output Power (AC)  5.8 kW  7.6 kW  10 kW  11.5 kW  Maximum Apparent Power  5,800 VA  7,600 VA  10,000 VA  11,500 VA  Maximum Continuous Current  24 A  31.7 A  41.7 A  48 A  Overcurrent Protection Device²  30 A  40 A  60 A  60 A  60 A  Configurable Maximum Continuous Discharge Power Off-Grid (PV Only, -20°C to 25°C)  Maximum Continuous Charge Current / Power (Powerwall 3 only)  Maximum Continuous Charge Current / Power (Powerwall 3 with up to (3) Expansion units)  Output Power Factor Rating  0 - 1 (Grid Code configurable)  Maximum Output Fault Current (1 s)  160 A  Maximum Short-Circuit Current Rating  10 kA  Load Start Capability  185 LRA  Solar to Battery to Home/Grid Efficiency  97.5% 5  Power Scalability  Up to 4 Powerwall 3 units supported  Energy Scalability  Up to 3 Expansion units (for a maximum total of 7 units)  Supported Islanding Devices  Gateway 3, Backup Switch, Backup Gateway 2  Connectivity  Wi-Fi (2.4 and 5 GHz), Ethernet, Cellular (LTE/4G°)  Hardware Interface  Dry contact relay, Rapid Shutdown (RSD) certified switch and 2-pin connector, RS-485 for meters  AC Metering  Revenue Grade (+/- 0.5%, ANSI C12.20)  Protections  Customer Interface  Tesla Mobile App	Frequency	60 Hz				
Maximum Apparent Power  5,800 VA 7,600 VA 10,000 VA 11,500 VA  Maximum Continuous Current  24 A 31.7 A 41.7 A 48 A  Overcurrent Protection Device²  30 A 40 A 60 A 60 A  Configurable Maximum Continuous Discharge Power Off-Grid (PV Only, -20°C to 25°C)  Maximum Continuous Charge Current / Power (Powerwall 3 only)  Maximum Continuous Charge Current / Power (Powerwall 3 with up to (3) Expansion units)  Output Power Factor Rating  0 - 1 (Grid Code configurable)  Maximum Output Fault Current (1 s)  160 A  Maximum Short-Circuit Current Rating  10 kA  Load Start Capability  89% \(^1^4\)  Solar to Battery to Home/Grid Efficiency  97.5% \(^5\)  Power Scalability  Up to 4 Powerwall 3 units supported  Energy Scalability  Up to 4 Powerwall 3 units (for a maximum total of 7 units)  Supported Islanding Devices  Gateway 3, Backup Switch, Backup Gateway 2  Connectivity  Wi-Fi (2.4 and 5 GHz), Ethernet, Cellular (LTE/4G°)  Hardware Interface  Dry contact relay, Rapid Shutdown (RSD) certified switch and 2-pin connector, RS-485 for meters  AC Metering  Protections  Lostomer Interface  Tesla Mobile App	Nominal Battery Energy	13.5 kWh A0	<b>D</b> <sup>1</sup>			
Maximum Continuous Current  24 A 31.7 A 41.7 A 48 A  Overcurrent Protection Device 2  30 A 40 A 60 A 60 A  Configurable Maximum Continuous Discharge Power Off-Grid (PV Only, -20°C to 25°C)  Maximum Continuous Charge Current / Power (Powerwall 3 only)  Maximum Continuous Charge Current / Power (Powerwall 3 with up to (3) Expansion units)  Output Power Factor Rating  O - 1 (Grid Code configurable)  Maximum Output Fault Current (1 s)  Maximum Short-Circuit Current Rating  10 kA  Load Start Capability  Solar to Home/Grid Efficiency  97.5% 5  Power Scalability  Up to 4 Powerwall 3 units supported  Energy Scalability  Up to 3 Expansion units (for a maximum total of 7 units)  Supported Islanding Devices  Gateway 3, Backup Switch, Backup Gateway 2  Connectivity  Wi-Fi (2.4 and 5 GHz), Ethernet, Cellular (LTE/4G°)  Hardware Interface  Dry contact relay, Rapid Shutdown (RSD) certified switch and 2-pin connector, RS-485 for meters  AC Metering  Protections  Lostomer Interface  Tesla Mobile App	Nominal Output Power (AC)	5.8 kW	7.6 kW	10 kW	11.5 kW	
Overcurrent Protection Device <sup>2</sup> 30 A 40 A 60 A 60 A  Configurable Maximum Continuous Discharge Power Off-Grid (PV Only, -20°C to 25°C)  Maximum Continuous Charge Current / Power (Powerwall 3 only)  Maximum Continuous Charge Current / Power (Powerwall 3 with up to (3) Expansion units)  Output Power Factor Rating  0 - 1 (Grid Code configurable)  Maximum Output Fault Current (1 s)  160 A  Maximum Short-Circuit Current Rating  10 kA  Load Start Capability  185 LRA  Solar to Battery to Home/Grid Efficiency  97.5%  Power Scalability  Up to 4 Powerwall 3 units supported  Energy Scalability  Up to 3 Expansion units (for a maximum total of 7 units)  Supported Islanding Devices  Gateway 3, Backup Switch, Backup Gateway 2  Connectivity  Wi-Fi (2.4 and 5 GHz), Ethernet, Cellular (LTE/4G°)  Hardware Interface  AC Metering  Revenue Grade (+/- 0.5%, ANSI C12.20)  Protections  Integrated arc fault circuit interrupter (AFCl), Isolation Monitor Interrupters  Customer Interface  Tesla Mobile App	Maximum Apparent Power	5,800 VA	7,600 VA	10,000 VA	11,500 VA	
Configurable Maximum Continuous Discharge Power Off-Grid (PV Only, -20°C to 25°C)  Maximum Continuous Charge Current / Power (Powerwall 3 only)  Maximum Continuous Charge Current / Power (Powerwall 3 with up to (3) Expansion units)  Output Power Factor Rating  O - 1 (Grid Code configurable)  Maximum Output Fault Current (1 s)  Maximum Short-Circuit Current Rating  Load Start Capability  Solar to Battery to Home/Grid Efficiency  Power Scalability  Up to 4 Powerwall 3 units supported  Energy Scalability  Up to 3 Expansion units (for a maximum total of 7 units)  Supported Islanding Devices  Connectivity  Wi-Fi (2.4 and 5 GHz), Ethernet, Cellular (LTE/4G°)  Dry contact relay, Rapid Shutdown (RSD) certified switch and 2-pin connector, RS-485 for meters  AC Metering  Revenue Grade (+/- 0.5%, ANSI C12.20)  Integrated arc fault circuit Interrupter (AFCI), Isolation Monitor Interrupter (IMI), PV Rapid Shutdown (RSD) using Tesla Midl-Circuit Interrupters  Tesla Mobile App	Maximum Continuous Current	24 A	31.7 A	41.7 A	48 A	
Power Off-Grid (PV Only, -20°C to 25°C)  Maximum Continuous Charge Current / Power (Powerwall 3 only)  Maximum Continuous Charge Current / Power (Powerwall 3 with up to (3) Expansion units)  Output Power Factor Rating  O - 1 (Grid Code configurable)  Maximum Output Fault Current (1 s)  Maximum Short-Circuit Current Rating  10 kA  Load Start Capability  185 LRA  Solar to Battery to Home/Grid Efficiency  97.5% 5  Power Scalability  Up to 4 Powerwall 3 units supported  Energy Scalability  Up to 3 Expansion units (for a maximum total of 7 units)  Supported Islanding Devices  Gateway 3, Backup Switch, Backup Gateway 2  Connectivity  Wi-Fi (2.4 and 5 GHz), Ethernet, Cellular (LTE/4G°)  Hardware Interface  Dry contact relay, Rapid Shutdown (RSD) certified switch and 2-pin connector, RS-485 for meters  AC Metering  Revenue Grade (+/- 0.5%, ANSI C12.20)  Integrated arc fault circuit interrupter (AFCI), Isolation Monitor Interrupter (IMI), PV Rapid Shutdown (RSD) using Tesla Mobile App	Overcurrent Protection Device <sup>2</sup>	30 A	40 A	60 A	60 A	
(Powerwall 3 only)  Maximum Continuous Charge Current / Power (Powerwall 3 with up to (3) Expansion units)  Output Power Factor Rating  0 - 1 (Grid Code configurable)  Maximum Output Fault Current (1 s)  160 A  Maximum Short-Circuit Current Rating  10 kA  Load Start Capability  185 LRA  Solar to Battery to Home/Grid Efficiency  97.5% 5  Power Scalability  Up to 4 Powerwall 3 units supported  Energy Scalability  Up to 3 Expansion units (for a maximum total of 7 units)  Supported Islanding Devices  Gateway 3, Backup Switch, Backup Gateway 2  Connectivity  Wi-Fi (2.4 and 5 GHz), Ethernet, Cellular (LTE/4G 6)  Hardware Interface  Dry contact relay, Rapid Shutdown (RSD) certified switch and 2-pin connector, RS-485 for meters  AC Metering  Revenue Grade (+/- 0.5%, ANSI C12.20)  Protections  Customer Interface  Tesla Mobile App		15.4 kW <sup>3</sup>				
(Powerwall 3 with up to (3) Expansion units)  Output Power Factor Rating  0 - 1 (Grid Code configurable)  Maximum Output Fault Current (1 s)  160 A  Maximum Short-Circuit Current Rating  10 kA  Load Start Capability  185 LRA  Solar to Battery to Home/Grid Efficiency  89% 1/4  Solar to Home/Grid Efficiency  97.5% 5  Power Scalability  Up to 4 Powerwall 3 units supported  Energy Scalability  Up to 3 Expansion units (for a maximum total of 7 units)  Supported Islanding Devices  Gateway 3, Backup Switch, Backup Gateway 2  Connectivity  Wi-Fi (2.4 and 5 GHz), Ethernet, Cellular (LTE/4G 6)  Hardware Interface  Dry contact relay, Rapid Shutdown (RSD) certified switch and 2-pin connector, RS-485 for meters  AC Metering  Revenue Grade (+/- 0.5%, ANSI C12.20)  Protections  Integrated arc fault circuit interrupter (AFCI), Isolation Monitor Interrupter (IMI), PV Rapid Shutdown (RSD) using Tesla Mid-Circuit Interrupters  Customer Interface  Tesla Mobile App	· · · · · · · · · · · · · · · · · · ·	20.8 A AC / 5 kW				
Maximum Output Fault Current (1 s)  Maximum Short-Circuit Current Rating  10 kA  Load Start Capability  185 LRA  Solar to Battery to Home/Grid Efficiency  89% 14  Solar to Home/Grid Efficiency  97.5% 5  Power Scalability  Up to 4 Powerwall 3 units supported  Energy Scalability  Up to 3 Expansion units (for a maximum total of 7 units)  Supported Islanding Devices  Gateway 3, Backup Switch, Backup Gateway 2  Connectivity  Wi-Fi (2.4 and 5 GHz), Ethernet, Cellular (LTE/4G 6)  Hardware Interface  Dry contact relay, Rapid Shutdown (RSD) certified switch and 2-pin connector, RS-485 for meters  AC Metering  Revenue Grade (+/- 0.5%, ANSI C12.20)  Protections  Integrated arc fault circuit interrupter (AFCI), Isolation Monitor Interrupter (IMI), PV Rapid Shutdown (RSD) using Tesla Mid-Circuit Interrupters  Customer Interface  Tesla Mobile App		33.3 A AC / 8 kW				
Maximum Short-Circuit Current Rating  Load Start Capability  185 LRA  Solar to Battery to Home/Grid Efficiency  89% 1.4  Solar to Home/Grid Efficiency  97.5% 5  Power Scalability  Up to 4 Powerwall 3 units supported  Energy Scalability  Up to 3 Expansion units (for a maximum total of 7 units)  Supported Islanding Devices  Gateway 3, Backup Switch, Backup Gateway 2  Connectivity  Wi-Fi (2.4 and 5 GHz), Ethernet, Cellular (LTE/4G 6)  Hardware Interface  Dry contact relay, Rapid Shutdown (RSD) certified switch and 2-pin connector, RS-485 for meters  AC Metering  Revenue Grade (+/- 0.5%, ANSI C12.20)  Protections  Integrated arc fault circuit interrupter (AFCI), Isolation Monitor Interrupter (IMI), PV Rapid Shutdown (RSD) using Tesla Mid-Circuit Interrupters  Customer Interface  Tesla Mobile App	Output Power Factor Rating	0 - 1 (Grid Code configurable)				
Load Start Capability  185 LRA  Solar to Battery to Home/Grid Efficiency  89% 1.4  Solar to Home/Grid Efficiency  97.5% 5  Power Scalability  Up to 4 Powerwall 3 units supported  Energy Scalability  Up to 3 Expansion units (for a maximum total of 7 units)  Supported Islanding Devices  Gateway 3, Backup Switch, Backup Gateway 2  Connectivity  Wi-Fi (2.4 and 5 GHz), Ethernet, Cellular (LTE/4G 6)  Hardware Interface  Dry contact relay, Rapid Shutdown (RSD) certified switch and 2-pin connector, RS-485 for meters  AC Metering  Revenue Grade (+/- 0.5%, ANSI C12.20)  Protections  Integrated arc fault circuit interrupter (AFCI), Isolation Monitor Interrupter (IMI), PV Rapid Shutdown (RSD) using Tesla Mid-Circuit Interrupters  Customer Interface  Tesla Mobile App	Maximum Output Fault Current (1 s)	160 A				
Solar to Battery to Home/Grid Efficiency  97.5% 5  Power Scalability  Up to 4 Powerwall 3 units supported  Energy Scalability  Up to 3 Expansion units (for a maximum total of 7 units)  Supported Islanding Devices  Gateway 3, Backup Switch, Backup Gateway 2  Connectivity  Wi-Fi (2.4 and 5 GHz), Ethernet, Cellular (LTE/4G <sup>6</sup> )  Hardware Interface  Dry contact relay, Rapid Shutdown (RSD) certified switch and 2-pin connector, RS-485 for meters  AC Metering  Revenue Grade (+/- 0.5%, ANSI C12.20)  Protections  Integrated arc fault circuit interrupter (AFCI), Isolation Monitor Interrupter (IMI), PV Rapid Shutdown (RSD) using Tesla Mid-Circuit Interrupters  Customer Interface  Tesla Mobile App	Maximum Short-Circuit Current Rating	10 kA				
Solar to Home/Grid Efficiency  Power Scalability  Up to 4 Powerwall 3 units supported  Up to 3 Expansion units (for a maximum total of 7 units)  Supported Islanding Devices  Gateway 3, Backup Switch, Backup Gateway 2  Connectivity  Wi-Fi (2.4 and 5 GHz), Ethernet, Cellular (LTE/4G®)  Hardware Interface  Dry contact relay, Rapid Shutdown (RSD) certified switch and 2-pin connector, RS-485 for meters  AC Metering  Revenue Grade (+/- 0.5%, ANSI C12.20)  Protections  Integrated arc fault circuit interrupter (AFCI), Isolation Monitor Interrupter (IMI), PV Rapid Shutdown (RSD) using Tesla Mid-Circuit Interrupters  Customer Interface  Tesla Mobile App	Load Start Capability	185 LRA				
Power Scalability  Up to 4 Powerwall 3 units supported  Up to 3 Expansion units (for a maximum total of 7 units)  Supported Islanding Devices  Gateway 3, Backup Switch, Backup Gateway 2  Connectivity  Wi-Fi (2.4 and 5 GHz), Ethernet, Cellular (LTE/4G <sup>6</sup> )  Hardware Interface  Dry contact relay, Rapid Shutdown (RSD) certified switch and 2-pin connector, RS-485 for meters  AC Metering  Revenue Grade (+/- 0.5%, ANSI C12.20)  Protections  Integrated arc fault circuit interrupter (AFCI), Isolation Monitor Interrupter (IMI), PV Rapid Shutdown (RSD) using Tesla Mid-Circuit Interrupters  Customer Interface  Tesla Mobile App	Solar to Battery to Home/Grid Efficiency	89% 1,4				
Energy Scalability  Up to 3 Expansion units (for a maximum total of 7 units)  Supported Islanding Devices  Gateway 3, Backup Switch, Backup Gateway 2  Connectivity  Wi-Fi (2.4 and 5 GHz), Ethernet, Cellular (LTE/4G <sup>6</sup> )  Hardware Interface  Dry contact relay, Rapid Shutdown (RSD) certified switch and 2-pin connector, RS-485 for meters  AC Metering  Revenue Grade (+/- 0.5%, ANSI C12.20)  Protections  Integrated arc fault circuit interrupter (AFCI), Isolation Monitor Interrupter (IMI), PV Rapid Shutdown (RSD) using Tesla Mid-Circuit Interrupters  Customer Interface  Tesla Mobile App	Solar to Home/Grid Efficiency	97.5% <sup>5</sup>				
Supported Islanding Devices Gateway 3, Backup Switch, Backup Gateway 2 Wi-Fi (2.4 and 5 GHz), Ethernet, Cellular (LTE/4G <sup>6</sup> ) Hardware Interface Dry contact relay, Rapid Shutdown (RSD) certified switch and 2-pin connector, RS-485 for meters  AC Metering Revenue Grade (+/- 0.5%, ANSI C12.20) Protections Integrated arc fault circuit interrupter (AFCI), Isolation Monitor Interrupter (IMI), PV Rapid Shutdown (RSD) using Tesla Mid-Circuit Interrupters  Customer Interface Tesla Mobile App	Power Scalability	Up to 4 Pow	erwall 3 units s	upported		
Connectivity  Wi-Fi (2.4 and 5 GHz), Ethernet, Cellular (LTE/4G <sup>6</sup> )  Hardware Interface  Dry contact relay, Rapid Shutdown (RSD) certified switch and 2-pin connector, RS-485 for meters  AC Metering  Revenue Grade (+/- 0.5%, ANSI C12.20)  Protections  Integrated arc fault circuit interrupter (AFCI), Isolation Monitor Interrupter (IMI), PV Rapid Shutdown (RSD) using Tesla Mid-Circuit Interrupters  Customer Interface  Tesla Mobile App	Energy Scalability	Up to 3 Expa	ansion units (fo	r a maximum to	tal of 7 units)	
Hardware Interface  Dry contact relay, Rapid Shutdown (RSD) certified switch and 2-pin connector, RS-485 for meters  AC Metering  Revenue Grade (+/- 0.5%, ANSI C12.20)  Protections  Integrated arc fault circuit interrupter (AFCI), Isolation Monitor Interrupter (IMI), PV Rapid Shutdown (RSD) using Tesla Mid-Circuit Interrupters  Customer Interface  Tesla Mobile App	Supported Islanding Devices	Gateway 3, I	Backup Switch,	Backup Gatew	ay 2	
AC Metering  Revenue Grade (+/- 0.5%, ANSI C12.20)  Protections  Integrated arc fault circuit interrupter (AFCI), Isolation Monitor Interrupter (IMI), PV Rapid Shutdown (RSD) using Tesla Mid-Circuit Interrupters  Customer Interface  Tesla Mobile App	Connectivity	Wi-Fi (2.4 and 5 GHz), Ethernet, Cellular (LTE/4G <sup>6</sup> )				
Protections  Integrated arc fault circuit interrupter (AFCI), Isolation Monitor Interrupter (IMI), PV Rapid Shutdown (RSD) using Tesla Mid-Circuit Interrupters  Customer Interface  Tesla Mobile App	Hardware Interface					
Monitor Interrupter (IMI), PV Rapid Shutdown (RSD) using Tesla Mid-Circuit Interrupters  Customer Interface  Tesla Mobile App	AC Metering	· · · · · · · · · · · · · · · · · · ·				
	Protections	Monitor Interrupter (IMI), PV Rapid Shutdown (RSD) using				
Warranty 10 years	Customer Interface	Tesla Mobile	е Арр			
<u> </u>	Warranty	10 years				

 $<sup>^1</sup>$ Values provided for 25°C (77°F), at beginning of life. 3.3 kW charge/discharge power.

<sup>&</sup>lt;sup>2</sup>See <u>Powerwall 3 Installation Manual</u> for fuse requirements if using fuse for overcurrent protection.

<sup>&</sup>lt;sup>3</sup>15.4kW off-grid maximum continuous discharge power is only available if on-grid rating is 11.5 kW. If enabled, Powerwall 3 must be installed with an 80 A breaker and appropriately sized conductors.

<sup>&</sup>lt;sup>4</sup> Typical solar shifting use case.

<sup>&</sup>lt;sup>5</sup> Tested using CEC weighted efficiency methodology.

<sup>&</sup>lt;sup>6</sup>The customer is expected to provide internet connectivity for Powerwall 3; cellular should not be used as the primary mode of connectivity. Cellular connectivity subject to network operator service coverage and signal strength.

# **Powerwall 3 Technical Specifications**

# Solar Technical Specifications

Maximum Solar STC Input	20 kW
Withstand Voltage	600 V DC
PV DC Input Voltage Range	60 — 550 V DC
PV DC MPPT Voltage Range	60 — 480 V DC
MPPTs	6
Maximum Current per MPPT (I <sub>mp</sub> )	15 A <sup>7,8</sup>
Maximum Short Circuit Current per MPPT ( $I_{sc}$ )	19 A <sup>8</sup>

 $<sup>^{7}</sup>$  Only applicable to Powerwall 3 units with 15 A  $I_{MP}$  on the product label. Otherwise, Powerwall 3 has an  $I_{MP}$  of 13 A.

# **Environmental**Specifications

Operating Temperature	-20°C to 50°C (-4°F to 122°F) 9
Operating Humidity (RH)	Up to 100%, condensing
Storage Temperature	-20°C to 30°C (-4°F to 86°F), up to 95% RH, non- condensing, State of Energy (SOE): 25% initial
Maximum Elevation	3000 m (9843 ft)
Environment	Indoor and outdoor rated
Enclosure Rating	NEMA 3R
Ingress Rating	IP67 (Battery & Power Electronics) IP55 (Wiring Compartment)
Pollution Rating	PD3
Operating Noise @ 1 m	< 50 db(A) typical < 62 db(A) maximum

<sup>&</sup>lt;sup>9</sup> Performance may be de-rated at operating temperatures above 40°C (104°F).

# Compliance Information

Certifications	UL 1741, UL 9540, UL 9540A, UL 3741, UL 1741 PCS, UL 1741 SA, UL 1741 SB, UL 1973, UL 1699B, UL 1998, CSA C22.2 No. 0.8, CSA C22.2 No. 107.1, CSA C22.2 No. 330, CSA 22.3 No. 9, IEEE 1547, IEEE 1547A, IEEE 1547.1, CA Rule No.21
Grid Connection	United States and Canada
Emissions	FCC Part 15 Class B, ICES 003
Environmental	RoHS Directive 2011/65/EU
Seismic	AC156, IEEE 693-2005 (high)
Fire Testing	Meets the unit level performance criteria of UL 9540A


 $<sup>^8</sup>$  When PV strings are combined on the roof and the DC input current exceeds the MPPT rating, a jumper can be used to combine two MPPTs into a single input to intake DC current up to 30 A  $I_{\rm MP}$  / 38 A  $I_{\rm SC}$  (or 26 A  $I_{\rm MP}$  / 30 A  $I_{\rm SC}$  if Powerwall 3 is labeled with 13 A  $I_{\rm MP}$  / 15 A  $I_{\rm SC}$ ).

# **Powerwall 3 Technical Specifications**

# Mechanical Specifications

Dimensions	$1105 \times 609 \times 193 \text{ mm} (43.5 \times 24 \times 7.6 \text{ in})^{10}$
Total Weight of Installed Unit	132 kg (291.2 lb)
Weight of Powerwall 3	124 kg (272.5 lb)
Weight of Glass Front Cover	6.5 kg (14.5 lb)
Weight of Wall Bracket	1.9 kg (4.2 lb)
Mounting Options	Floor or wall mount

 $<sup>^{10}</sup>$  These dimensions include the glass front cover being installed on Powerwall 3.

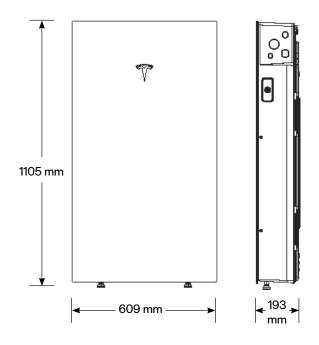

# **Powerwall 3 Expansion Technical Specifications**

# Battery Technical Specifications

Model Number	1807000-xx-y
Nominal Battery Energy	13.5 kWh
Voltage Range	52 - 92 V DC <sup>11</sup>

<sup>&</sup>lt;sup>11</sup> Powerwall 3 Expansion units are connected in parallel and are not field serviceable.

# **Environmental Specifications**

-20°C to 50°C (-4°F to 122°F) 12
Up to 100%, condensing
-20°C to 30°C (-4°F to 86°F), up to 95% RH, non-condensing, State of Energy (SOE): 25% initial
3000 m (9843 ft)
Indoor and outdoor rated
NEMA 3R
IP67
PD3


<sup>&</sup>lt;sup>12</sup> Performance may be de-rated at operating temperatures above 40°C (104°F).

# Compliance Information

Certifications

UL 1973, UL 9540

# Mechanical Specifications

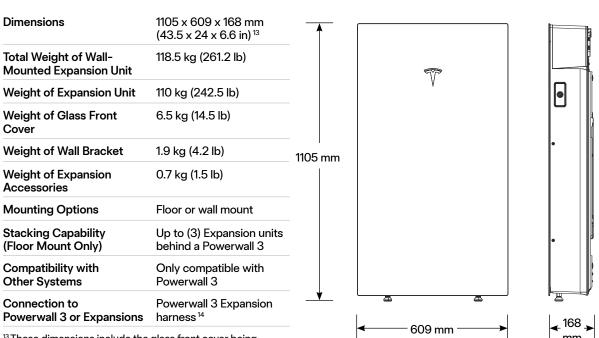

<sup>&</sup>lt;sup>13</sup> These dimensions include the glass front cover being installed on Powerwall 3 Expansion.

<sup>&</sup>lt;sup>14</sup> The Powerwall 3 Expansion harness is a listed component of the UL 9540 certification.

# Solar Shutdown Device Technical Specifications

\_

The Solar Shutdown Device is a Mid-Circuit Interrupter (MCI) and is integral to the rapid shutdown (RSD) function required for rooftop PV systems in accordance with Article 690 of the NEC. When paired with Powerwall 3, solar array shutdown is initiated by an External System Shutdown Switch or the On/Off Enable switch located on Powerwall 3. Systems not subject to rapid shutdown requirements must still install one or more MCIs for functional purposes; see the Powerwall 3 installation manual for details.

ΕI	ectrical
S	pecifications

Model	MCI-1	MCI-2	MCI-2 High Current
Nominal Input DC Current Rating (I <sub>MP</sub> )	13 A	13 A	15 A
Maximum Input Short Circuit Current (I <sub>SC</sub> )	19 A	17 A	19 A
Maximum System Voltage	600 V DC	1000 V DC <sup>15</sup>	1000 V DC 15
Maximum Disconnect Voltage 16	600 V DC	165 V DC	165 V DC

<sup>&</sup>lt;sup>15</sup> Maximum System Voltage is limited by Powerwall to 600 V DC.

# RSD Module Performance

Maximum Number of Devices per String	o o
Control	Power Line Excitation
Passive State	Normally Open
Maximum Power Consumption	7 W
Warranty	25 years

# **Environmental Specifications**

Enclosure Rating	NE	MA 4X / IP65
	(–22°F to 158°F)	(–22°F to 158°F)
Storage Temperature	–30°C to 70°C	–30°C to 70°C
Operating Temperature	-40°C to 50°C (-40°F to 122°F)	-45°C to 70°C (-49°F to 158°F)

# Mechanical Specifications

Electrical Connections	MC	4 Connector	
Housing		Plastic	
Dimensions	125 x 150 x 22 mm	173 x 45 x 22 mm	
	(5 x 6 x 1 in)	(6.8 x 1.8 x 1 in)	
/eight	350 g (0.77 lb)	120 g (0.26 lb)	
ounting Options	ZEP Home Run Clip	Wire Clip	
• ,	M4 Screw (#10)	·	
	M8 Bolt (5/16")		
	Nail / Wood screw		

# Compliance Information

Certifications	UL 1741 PVRSE, UL 3741, PVRSA (Photovoltaic Rapid Shutdown Array)
RSD Initiation Method	External System Shutdown Switch or Powerwall 3 Enable Switch

# UL 3741 PV Hazard Control (and PVRSA) Compatibility

See <u>UL 3741 Application Addendum</u>

<sup>&</sup>lt;sup>16</sup> Maximum Disconnect Voltage is the maximum voltage allowed across each MCI in the open position (Rapid Shutdown Initiated). An individual MCI-2 has a voltage rating of 165V but in combination (connected in the same string) their voltage ratings are additive.

# Gateway 3

Tesla Gateway 3 controls connection to the grid in a Powerwall system, automatically detecting outages and providing seamless transition to backup power. It provides energy monitoring that is used by Powerwall for solar self-consumption, time-based control, and backup operation.

# Performance Specifications

Model Number	1841000-x1-y
Nominal Grid Voltage	120/240 V AC
Grid Configuration	Split phase
Grid Frequency	60 Hz
Continuous Current Rating	200 A
Maximum Supply Short Circuit Current	22 kA with Square D or Eaton main breaker 25 kA with Eaton main breaker <sup>17</sup>
IEC Protective Class	Class I
Overvoltage Category	Category IV
<sup>17</sup> Only Eaton CSR or BWH m	nain breakers are 25 kA rated.

AC Meter	+/- 0.5%
Communication	CAN
User Interface	Tesla App
Backup Transition	Automatic disconnect for seamless backup
Overcurrent Protection Device	100–200 A Service entrance rated Eaton CSR, BWH, or BW, or Square D QOM breakers
Internal Panelboard	200 A 8-space/16 circuit breakers Eaton BR, Siemens QP, or Square D HOM breakers rated to 10–125A
Warranty	10 years

# **Environmental Specifications**


Operating Temperature	–20°C to 50°C (–4°F to 122°F)
Operating Humidity (RH)	Up to 100%, condensing
Maximum Elevation	3000 m (9843 ft)
Environment	Indoor and outdoor rated
Enclosure Type	NEMA 3R

# Compliance Information

Certifications	UL 67, UL 869A, UL 916, UL 1741 PCS, CSA 22.2 107.1, CSA 22.2 29
Emissions	FCC Part 15, Class B, ICES 003

# Mechanical Specifications

Dimensions	660 x 411 x 149 mm (26 x 16 x 6 in)		
Weight	16.3 kg (36 lb)		
Mounting options	Wall mount		



# **Backup Switch**

The Tesla Backup Switch controls connection to the grid in a Powerwall system, and can be easily installed behind the utility meter or in a standalone meter panel downstream of the utility meter.

The Backup Switch automatically detects grid outages, providing a seamless transition to backup power. It communicates directly with Powerwall, allowing home energy usage monitoring from any mobile device with the Tesla app.

# Performance Specifications

1624171-xx-y		
200 A, 120/240 V split phase		
22 kA with breaker <sup>18</sup>		
CAN		
+/- 0.5%		
21 years		
10 years		

<sup>&</sup>lt;sup>18</sup> Breaker maximum supply short circuit current rating must be equal to or greater than the available fault current.

# **Environmental Specifications**

Operating Temperature	-40°C to 50°C (-40°F to 122°F)
Storage Temperature	-40°C to 85°C (-40°F to 185°F)
Enclosure Rating	NEMA 3R
Pollution Rating	PD3


# Compliance Information


Safety Standards	USA: UL 414, UL 414 SB, UL 2735, UL 916, CA Prop 65
Emissions	FCC Part 15, Class B, ICES 003

# Mechanical Specifications


$176 \times 205 \times 74 \text{ mm} (6.9 \times 8.1 \times 2.9 \text{ in})$		
2.8 lb		
ANSI Type 2S, ringless or ring type		
Contactor manual override <sup>19</sup> Reset button		
1/2-inch NPT		


<sup>&</sup>lt;sup>19</sup> Manually overrides the contactor position during a service event.







# **Powerwall 3 Example System Configurations**

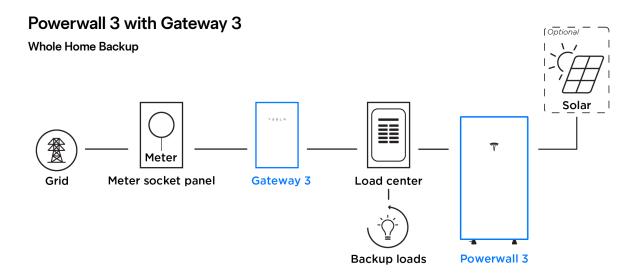

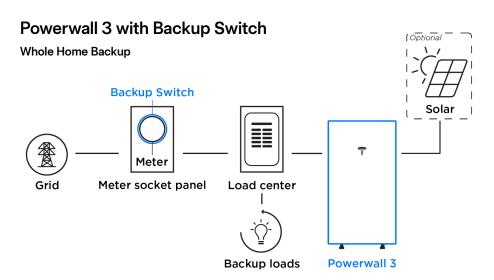

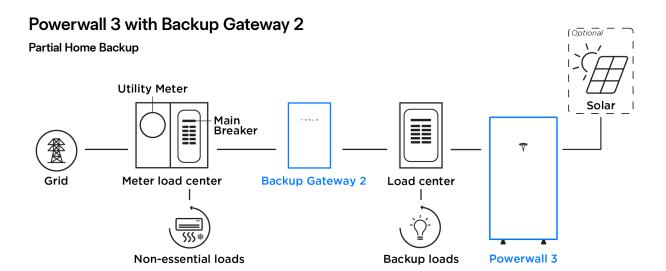


# Powerwall 3 Example System Configurations

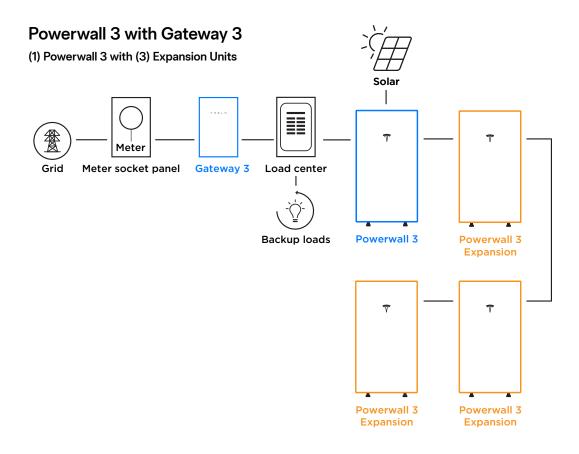

# Powerwall 3 with Backup Switch

Expansion

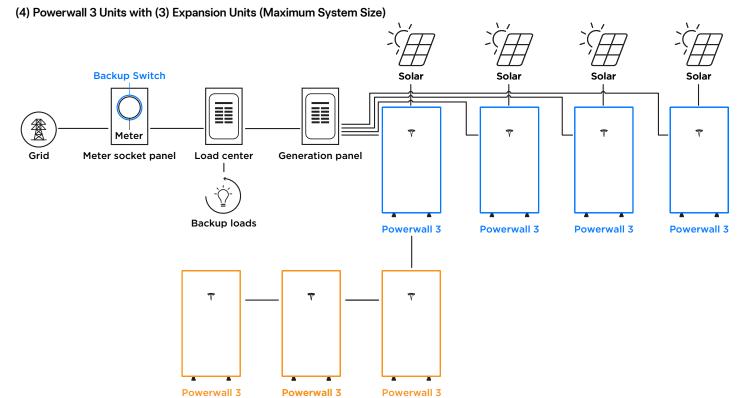

2024 Powerwall 3 Datasheet

Expansion

Expansion



# RAIL SYSTEM



# **Next-Level Solar Mounting**

A complete system for hassle-free rooftop installation, from watertight mounts to lifetime wire management.



# **Simplicity**

1/2"socket for everything. One clamp for mid or end. No tool splicing and bonding. Easy wire management.



# **Code Compliant**

UL 2703 listed LTR-AE-001-2012 listed Class A fire rating for any slope ASCE 7-16 PE Certified



# **Premium Aesthetics**

The narrowest panel gap available. Optional Hidden End Clamps and End Caps provide a flush look on the edge of the array.



# Watertight for Life

Secured on industry-leading Pegasus Mounts, for composite shingle and tile roofs. Backed by a 25-year warranty.



# RAIL SYSTEM









**Dovetail T-bolt** 

### **Pegasus Rail**

Available in 14' and 7' lengths for easy layout and shipping.

Open-channel design holds MC4 connectors, PV wire and trunk cables.

Black and Mill finish



# Pegasus Max Rail

Maximum-strength design. Meets specifications for high snow-load and hurricane zones. Black and Mill finish



### Splice and Max Splice

Installs by hand. Works over mounts.

Structurally connects and bonds rails automatically; UL2703 listed as reusable. Dovetail shape for extra strength.

Uses 1/2" socket.





Offers premium edge appearance.

Tucks away for reuse.





# 

N-S Bonding Jumper

### Multi-Clamp

Fits 30-40mm PV frames, as mid- or end-clamp.

Twist-locks into position; doesn't pinch wires in rail.

Bonds modules to rail; UL2703 listed as reusable



# Hidden End Clamp

Preinstalled pull-tab grips rail edge, allowing easy, one-hand installation.



# **Ground Lug**

Holds 6 or 8 AWG wire. Mounts on top or side of rail. Assembled on MLPE Mount. UL2703 listed as reusable.



UL2703 listed as reusable only with Pegasus Rail.







### **MLPE Mount**

Secures and bonds most micro-inverters and optimizers to rail.

Connectors and wires easily route underneath after installation.

UL2703 listed as reusable.

# Cable Grip

Secures four PV wires or two trunk cables. Stainless-steel backing provides durable grip.

Eliminates sagging wires.

# Wire Clip

Hand operable. Holds wires in channel. Won't slip.

### **End Cap and Max End Cap**

Fits flush to PV module and hides raw or angled cuts.

Hidden drain quickly clears water from rail.

### Certifications:

- UL 2703, Edition 1
- LTR-AE-001-2012
- ASCE 7-16 PE certified
- Class A fire rating for any slope roof



Quickly calculate the most efficient layout, spans and materials needed to suit your job. Visit the Pegasus Customer Portal. pegasussolar.com/portal

Patents pending. All rights reserved. ©2021 Pegasus Solar Inc.

LOAD		SPAN			
SNOW (PSF)	WIND (MPH)	32"	4′	6′	8′
	120				
0	160				
	190				
	140				
15	160				
	190				
30	160				
30	190				
45	190				
70	190				
110	190			PEGASUS RAIL	PEGASUS MAX RAIL

For reference only. Spans above are calculated using ASCE 7-16 for a Gable Roof, Exposure Category B, 7-20deg roof angle, 30ft mean roof height with non-exposed modules. For PE certified span tables, visit www.pegasussolar.com/spans.



# INSTAFLASH 2



# The Ultimate Comp Roof Attachment

Simple to use. Works for rafter or deck attach. No caulking, no ripped shingles, no mess. Pre-installed sealant acts as a chemical flashing and fills all gaps, voids, and butt joints for an instant, watertight seal.



# 25-Year Warranty

Manufactured with advanced materials and coatings to outlast the roof itself



# **Code Compliant**

Fully IBC/CBC code compliant Exceeds ASCE 7-22 standards UL2703 certified



# **Self-Healing**

Proprietary non-hardening sealant will flex and reseal over years of thermal expansion and contraction



# **Larger Spans**

Extra-large L-foot and proprietary screws result in larger spans between mounts



# **INSTA**FLASH® 2



Install screw through center hole, and drive into roof until InstaFlash2 pushes through cage and seats onto the roof.




If screw hits rafter, drive second screw in hole above. Ensure screws are embedded at least 2.5" into rafter. Installation complete.























SPECIFICATIONS	INSTAFLASH KITS				
	PIF2-B0	PIF2-BDT	PIF2-M0	PIF2-MDT	
Finish	Black		Mill		
Kit Contents	Black InstaFlash2	Black InstaFlash2, Dovetail T-bolt	Mill InstaFlash2	Mill InstaFlash2, Dovetail T-bolt	
Attachment Type	Rafter & Deck Attach				
Roof Fasteners	1/2" Socket Driven; PF-DRW85 (sold separately in boxes of 24)				
Roof Type	Sloped Roof: Composition Shingle, Rolled Asphalt   Flat Roof: Modified Bitumen Roof, Built-Up Roof				
Flashing Type	Factory Installed Non-Drying, Non-Skinning Butyl Based Chemical Flashing				
Installation Temperature	0° F to 170° F				
Cure Time	Instantly Waterproof; Non-Hardening				
Service Temperature	-40° F to 195° F				
Certifications	IBC, ASCE/SEI 7-16 & 7-22, UL2703				
Install Application	Most Railed Systems				
Kit Quantity	24				
Boxes Per Pallet	36				





SCAN FOR INSTALLATION VIDEO



SCAN FOR FREE TRIAL

 $See \ www.ps-ip.com\ for\ intellectual\ property\ details.\ All\ rights\ reserved.\ @2024\ Pegasus\ Solar\ Inc.$ 





UL50 Type 3R Enclosure • Stamped 1 8 gauge gal. steel • Powder coated finish • Weather tight

# **Enclosure Includes:**

- Dual ground lug
- · Universal DIN rail
- 1/2". 3/4" & 1" knockouts
- · Wire strain relief clip
- Complete hardware package



# INTRODUCED AT SOLAR POWER 2007





# **PV Roof-Mount Combiner/Enclosure**

# **Benefits**

- •The ability to prep the building is now possible
- Replaces several parts used today
- Provides professional looking install
- · Saves time on install
- Allows for easy access
- Guaranteed seal to roof
- Low profile design

For product information contact us at [866] 367-7782

www.commdeck.com



RSTC Enterprises, Inc 2219 Heimstead Road Eau Claire, WI 54703 1 (866) 367 - 7782





# SolaDeck Part # 780

# **Specifications:**

18 Gauge Steel Base (1) and Cover (2)
Pre Punched 7 holes in base (1) for roof deck
Pre Punched 4 holes in base (1) and cover (2) for match
Draw Process both parts
Powder Coated to withstand 1000 hours Salt Spray (Primer Gray)
High UV resistance
15" x 15" flashing dimension
Cavity dimension 8"W x 9" L x 2.5"D
Approx. 162 Cubic inch equipment cavity
Norloked steel base plate (3) to drawn base (2)
Three knockout locations .5", .75" and 1"
3" DIN rail installed
Grounding Lug- Installed (In Equipment Cavity)
Wire Strain Relief Clip –Installed (In Equipment Cavity)
Hardware pack withstands 500 hours Salt Spray

- 7 2" Trusshead Screws
- 4 .5" 8-32 thread cutting screws
- 4 #10 Bonded Seal washers
- 1 Foam closed Cell Seal

ETL Listed UL50 Type 3R

**Total Weight 6.9 pounds each** 

# Packaging:

Individually bagged and boxed
Box dimension 15.5"w x 16" L x 3" D
White Carton labeled with Cut out template
Print One Color - Black

Master Cartons of 6 Units each
Master Carton dimension 18.75"x16"x16.375"
Master Carton Weight – 42 pounds
18 Master Cartons per skid Approx 800 pounds with skid

# Eaton DG222URB

# Catalog Number: DG222URB

Eaton General duty non-fusible safety switch, single-throw, 60 A, NEMA 3R, Rainproof, Painted galvanized steel, Two-pole, Two-wire, 240 V  $\,$ 

# Photo is representative

General specifications

Product Name Catalog Number

Eaton general duty non-fusible safety DG222URB

switch

**UPC** 

782113144238

Product Length/Depth Product Height

7.38 in 14.38 in

Product Width Product Weight

8.69 in 9 lb

Warranty Compliances

Eaton Selling Policy 25-000, one (1) year NEC 230.62 (C) Compliant Barrier

from the date of installation of the

Product or eighteen (18) months from the Certifications

date of shipment of the Product,

whichever occurs first. Catalog Notes

WARNING! Switch is not approved for service entrance unless a neutral kit is

installed.



# default Taxonomy Attribute Label

Type

Non-fusible, single-throw

**Amperage Rating** 

60A

**Number Of Poles** 

Two-pole

**Product Category** 

General duty safety switch

Voltage rating

240V

Enclosure

NEMA 3R

**Enclosure material** 

Painted galvanized steel

Fuse configuration

Non-fusible

Number of wires

2

# Resources

### Catalogs

Eaton's Volume 2—Commercial Distribution

Multimedia

Double Up on Safety

Switching Devices Flex Center

Specifications and datasheets

Eaton Specification Sheet - DG222URB

Warranty guides

Selling Policy 25-000 - Distribution and Control Products and Services



Eaton Corporation plc Eaton House 30 Pembroke Road Dublin 4, Ireland Eaton.com

Reserved.

Eaton is a registered trademark.

All other trademarks are © 2024 Eaton. All Rights property of their respective owners.



Eaton.com/socialmedia