### **SCOPE OF WORK:**

TO INSTALL A ROOF MOUNTED SOLAR PHOTOVOLTAIC SYSTEM AT THE OWNER RESIDENCE LOCATED AT 7064 US 401 N, FUQUAY VARINA, NC 27526 THE POWER GENERATED BY THE PV SYSTEM WILL BE INTERCONNECTED WITH THE UTILITY GRID THROUGH THE EXISTING ELECTRICAL SERVICE EQUIPMENT.

THE PV SYSTEM DOES NOT INCLUDE STORAGE BATTERIES

01 TESLA 7.6 KW 1538000-XX-Y [240V] [SI1-SB] INVERTER

REQUIRE MODIFICATIONS IN CONSTRUCTION DETAILS.

	<u> </u>
EQUIPMENT SUMMARY	SYSTEM RATING
26 LONGI 405S LONGI LR5-54HPB-405M MODULES	10.530 KWDC
	7.600 KWAC
09 TESLA SOLAR SHUTDOWN DEVICE MCI-2 HIGH CURRENT	

GOVERNING CODES
2018 INTERNATIONAL FIRE CODE
2018 INTERNATIONAL BUILDING CODE
2018 INTERNATIONAL RESIDENTIAL CODE
2018 NORTH CAROLINA STATE BUILDING CODE
2017 NATIONAL ELECTRICAL CODE
AUTHORITY HAVING JURISDICTION (AHJ) : HARNETT COUNTY

SHEET INDEX			
PV-0	COVER PAGE		
PV-1	SITE PLAN		
PV-2	ROOF PLAN & MODULES		
PV-3	ATTACHMENT DETAIL		
PV-4	ELECTRICAL LINE DIAGRAM & CALCS.		
PV-5	ELECTRICAL PHOTOS		
PV-6	SPECIFICATIONS & CALCS.		
PV-7	LABLE & PLACARDS		
PV-8+	EQUIPMENT SPECIFICATIONS		

PROJECT SITE

PROJECT SITE

**HOUSE PHOTO** 

VICINITY MAP

7064 US 401 N,

Fuquay Varina, NC

27526, United States

# CAROLIN CONNECTION

**CAROLINA CONNECTIONS** 422 HUFFMAN MILL ROAD,

SUITE 105, BURLINGTON, NC 27215, UNITED STATES PHONE: (336) 585-1314

SYSTEM INFO.
(26) LONGI 405S LONGI
LR5-54HPB-405M
01) TESLA 7.6 KW 1538000-XX-\
[240V] [SI1-SB]

DC SYSTEM SIZE: 10.530 KWDC AC SYSTEM SIZE: 7.600 KWAC

REVISIONS
DESCRIPTION DATE REV

Signature with Seal

CARO

OHTO SESAL

OHT

STAMPED: 10/09/2025

PROJECT NAME & ADDRESS

SCALE: NTS

SCALE: NTS

W LEONARD SIBLEY
RESIDENCE
7064 US 401 N,
FUQUAY VARINA, NC 27526
PH.#: (919) 270-1119

DATE: 09/22/2025

SHEET NAME

COVER PAGE

SHEET SIZE

ANSI B 11" X 17"

PV-0

SHEET NUMBER

### WIRING AND CONDUIT NOTES:

- ALL CONDUIT SIZES AND TYPES, SHALL BE LISTED FOR ITS PURPOSE AND APPROVED FOR THE SITE APPLICATIONS.
- ALL PV CABLES AND HOME RUN WIRES BE #10AWG \*USE-2, PV WIRE, OR PROPRIETARY SOLAR CABLING SPECIFIED BY MFR, OR EQUIVALENT; ROUTED TO SOURCE CIRCUIT COMBINER BOXES AS REQUIRED.
- ALL CONDUCTORS AND OCPD SIZES AND TYPES SPECIFIED ACCORDING TO [NEC 690.8 (A)(1) & (B)(1)], [NEC 240] [NEC 690.7] FOR MULTIPLE CONDUCTORS.
- ALL PV DC CONDUCTORS IN CONDUIT EXPOSED TO SUNLIGHT SHALL BE DERATED ACCORDING TO [NEC TABLE 310.15 (B)(2)(C)] BLACK ONLY\*\*
- EXPOSED ROOF PV DC CONDUCTORS SHALL BE USE-2, 90°C RATED, WET AND UV RESISTANT, AND UL LISTED RATED FOR 600V, UV RATED SPIRAL WRAP SHALL BE USED TO PROTECT WIRE FROM SHARP EDGES.
- PHASE AND NEUTRAL CONDUCTORS SHALL BE DUAL RATED THHN/THWN-2 INSULATED, 90°C RATED, WET AND UV RESISTANT, RATED FOR 600V PER NEC 2008 OR 1000V PER NEC 2011.
- 4-WIRE DELTA CONNECTED SYSTEMS HAVE THE PHASE WITH THE HIGHER VOLTAGE TO GROUND MARKED ORANGE OR IDENTIFIED BY OTHER EFFECTIVE MEANS.
- ALL SOURCE CIRCUITS SHALL HAVE INDIVIDUAL SOURCE CIRCUIT PROTECTION.
- VOLTAGE DROP LIMITED TO 2%
- AC CONDUCTORS >4AWG COLOR CODED OR MARKED: PHASE A OR L1- BLACK, PHASE B OR L2- RED, PHASE C OR L3- BLUE, NEUTRAL- WHITE/GRAY.



# ARCHITECT HAS NOT BEEN RETAINED TO SUPERVISE ANY CONSTRUCTION OR INSTALLATION OF ANY FOLIDMENT AT SITE.

**GENERAL NOTES:** 

INSTALLATION OF ANY EQUIPMENT AT SITE.
 CONTRACTOR SHALL FURNISH ALL LABOR, MATERIAL, EQUIPMENT, TOOLS, OBTAINS ALL

THESE CONSTRUCTION DOCUMENTS HAVE BEEN BASED ON FIELD INSPECTIONS AND

OTHER INFORMATION AVAILABLE AT THE TIME. ACTUAL FIELD CONDITIONS MAY


- PERMITS, LICENSES AND PAY ALL REQUIRED FEES AND COMPLETE INSTALLATION.


  CONTRACTOR HAS THE FULL RESPONSIBILITY TO CHECK AND VERIFY ALL DIMENSIONS AND EXISTING CONDITIONS. ANY DISCREPANCIES SHALL BE REPORTED TO THE ENGINEER BEFORE PROCEEDING WITH THE WORK. ANY WORK STARTED BEFORE CONSULTATION AND ACCEPTANCE BY THE ENGINEER SHALL BE THE SOLE
- CONSULTATION AND ACCEPTANCE BY THE ENGINEER SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR AND SHALL BE SUBJECT TO CORRECTION BY THEM WITHOUT ADDITIONAL COMPENSATION.
- DAMAGE CAUSED TO THE EXISTING STRUCTURE, PIPES, DUCTS, WINDOWS, WALL, FLOORS, ETC. SHALL BE REPAIRED TO THE ORIGINAL CONDITION OR REPLACED BY THE CONTRACTOR AT NO ADDITIONAL COST.
- THE CONTRACTOR SHALL BE HELD RESPONSIBLE FOR THE PROPER INSTALLATION AND COMPLETION OF THE WORK WITH APPROVED MATERIALS.
- NO CHANGES ARE TO BE MADE WITHOUT THE CONSULTATION AND APPROVAL OF THE ARCHITECT
- CONTRACTOR SHALL OBTAIN BULDING PERMIT. NO WORK TO START UNLESS BUILDING PERMIT IS PROPERLY DISPLAYED.
- ALL WORKMANSHIP AND MATERIALS SHALL BE OF FIRST QUALITY AND IN COMPLIANCE WITH THE REQUIREMENTS OF THE NC BUILDING CODE, THE DEPARTMENT OF ENVIRONMENTAL PROTECTION AND ALL PERTINENT AGENCIES.
- IT IS ESSENTIAL THAT ALL WORK PROCEED WITH THE MAXIMUM COOPERATION OF ALL PARTIES AND WITH MINIMUM INTERFERENCE TO THE OCCUPANTS WITHIN THE BUILDING. THE OWNER'S DIRECTIONS IN THIS REGARD SHALL BE FULLY COMPLIED WITH.
- ALL EXPOSED PLUMBING, HVAC, ELECTRICAL DUCTWORK, PIPING AND CONDUITS ARE TO BE PAINTED BY GENERAL CONTRACTOR.
   THE CONTRACTOR SHALL PERFORM THE WORK IN STRICT CONFORMANCE WITH THE
- LOCAL LAWS, REGULATIONS AND THE NATIONAL ELECTRIC CODE.

  THE CONTRACTOR SHALL OBTAIN ALL PERMITS, APPROVALS, AFFIDAVITS,
- CERTIFICATIONS, ETC. AND PAY ALL FEES AS REQUIRED BY THE LOCAL AUTHORITIES.
- CONTRACTORS SHALL OBTAIN FIRE CERTIF. UPON COMPLETION OF WORK.

### **ELECTRICAL NOTES:**

- ALL EQUIPMENT TO BE LISTED BY UL OR OTHER NRTL, AND LABELED FOR ITS APPLICATION.
- ALL CONDUCTORS SHALL BE COPPER, RATED FOR 600 V AND 90 DEGREE C WET ENVIRONMENT.
- WIRING, CONDUIT, AND RACEWAYS MOUNTED ON ROOFTOPS SHALL BE ROUTED DIRECTLY TO, AND LOCATED AS CLOSE AS POSSIBLE TO THE NEAREST RIDGE, HIP, OR VALLEY.
- WORKING CLEARANCES AROUND ALL NEW AND EXISTING ELECTRICAL EQUIPMENT SHALL COMPLY WITH NEC 110.26.
- WHERE SIZES OF JUNCTION BOXES, RACEWAYS, AND CONDUITS ARE NOT SPECIFIED, THE CONTRACTOR SHALL SIZE THEM ACCORDINGLY.
- ALL WIRE TERMINATIONS SHALL BE APPROPRIATELY LABELED AND READILY VISIBLE.
- MODULE GROUNDING (UFO) FASTENER TO BE INSTALLED BETWEEN MODULE FRAME AND MODULE SUPPORT RAIL, PER THE (UFO) FASTENER MANUFACTURE'S INSTRUCTION.

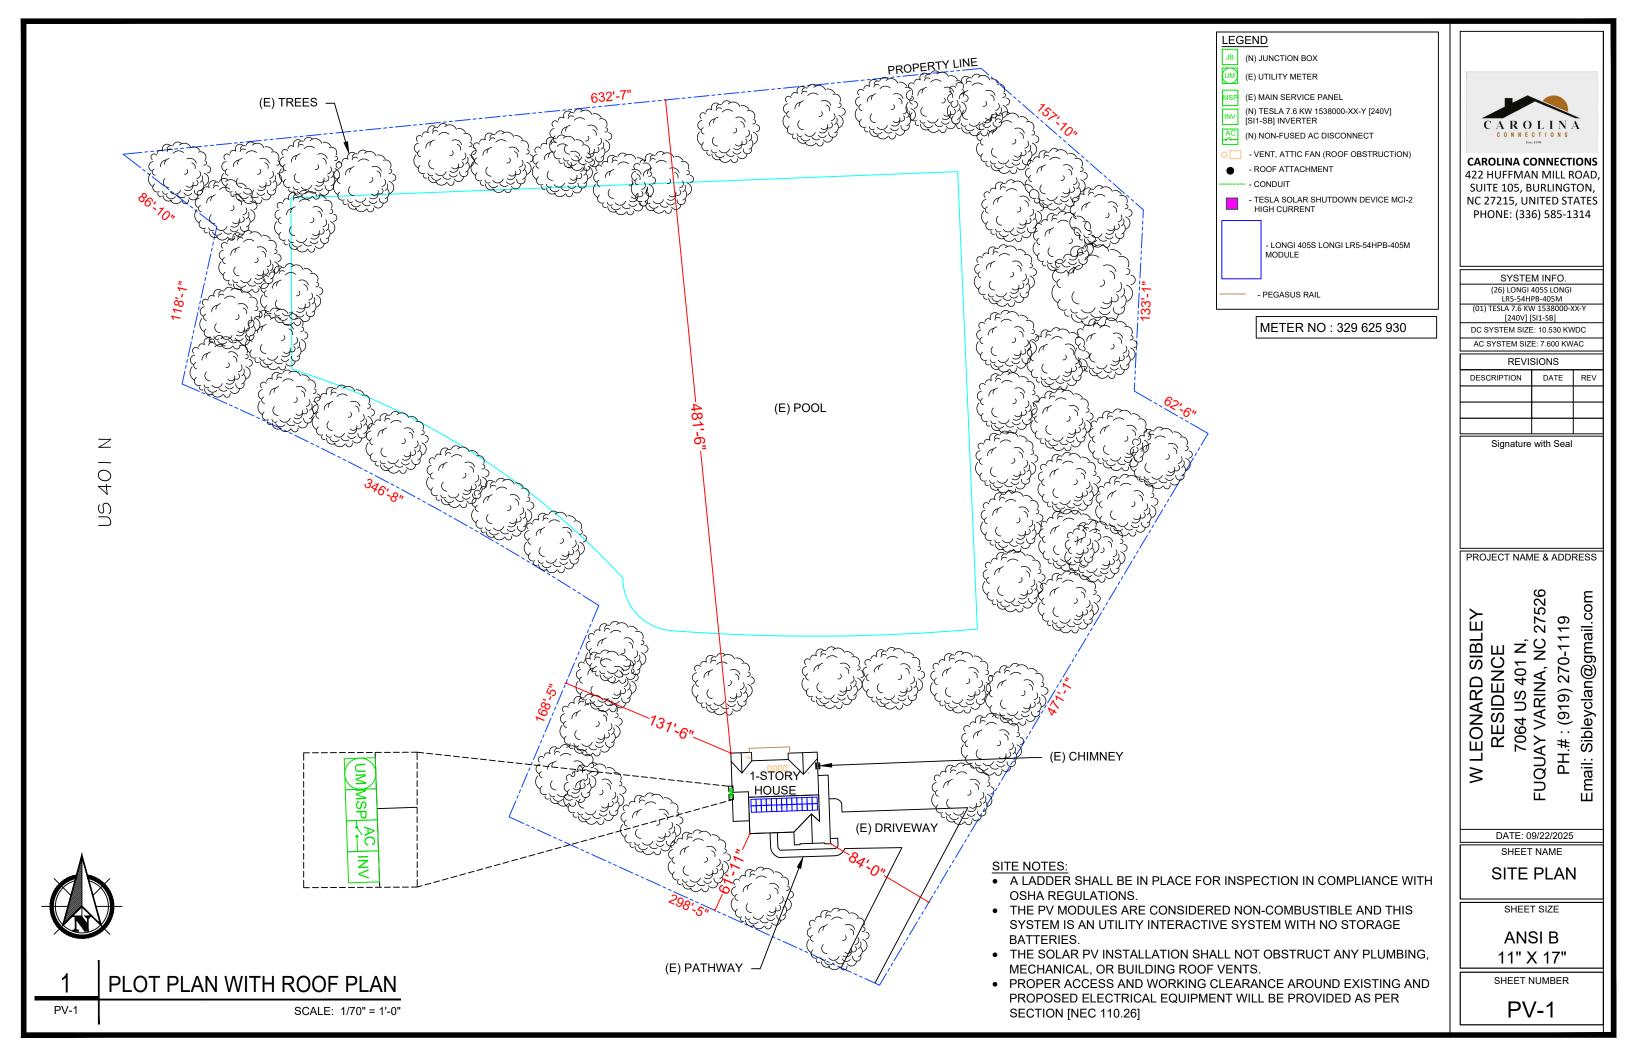

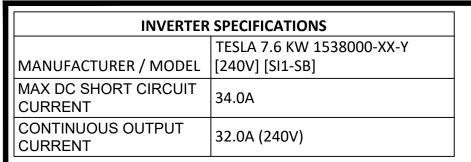


MODULE TYPE, DIMENSIONS & WEIGHT			
NUMBER OF MODULES:	26 MODULES		
MODULE TYPE:	LONGI 405S LONGI LR5-54HPB-405M		
MODULE WEIGHT:	45.85 LBS/20.8 KG		
MODULE DIMENSIONS:	67.79" x 44.64" = 21.04SF		
UNIT WEIGHT OF ARRAY:	2.18 PSF		

ROOF DESCRIPTION					
ROOF	ROOF TILT	AZIMUTH	TRUSS SIZE	TRUSS SPACING	ROOF MATERIA
#1	33°	178°	2" X 4"	24" O.C.	COMP. SHINGLE


ARRAY AREA & ROOF AREA CALC'S		
ROOF	# OF MODULES	ARRAY AREA (Sq. Ft.)
#1	26	461.59
(TOTAL ARRAY AREA/TOTAL ROOF AREA) X 100%		
(461.59/3994.05) X 100% = 11.56%		

DESIGN SPECIFICATION			
RISK CATEGORY:	II		
CONSTRUCTION:	SFD		
ZONING:	RESIDENTIAL		
SNOW LOAD (ASCE 7-10):	15 PSF		
EXPOSURE CATEGORY:	В		
WIND SPEED (ASCE 7-10):	116 MPH		

(E) BACK OF RESIDENCE

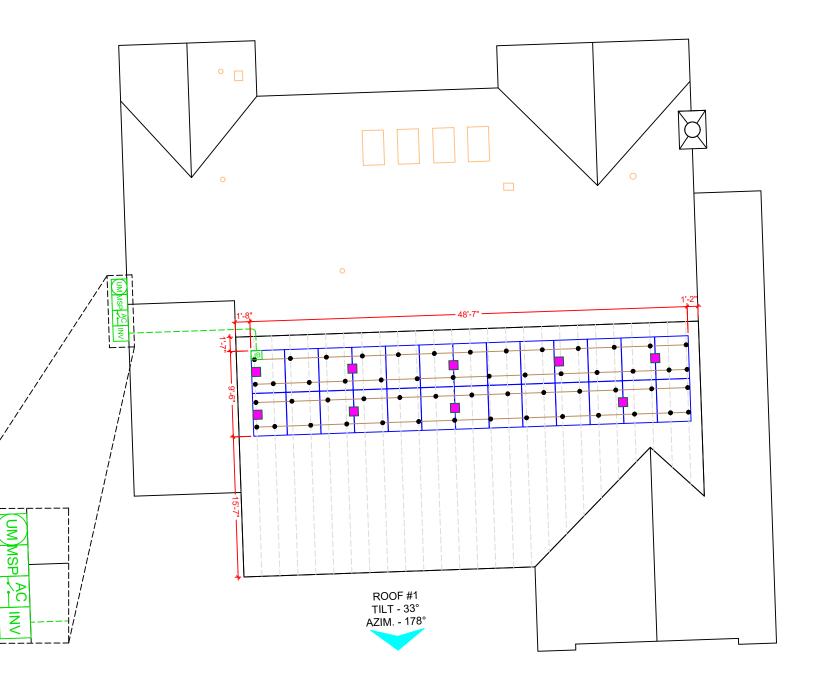

(E) FRONT OF RESIDENCE US 401 N



PANEL HEIGHT OFF ROOF

6"

CAROLINA
CONNECTIONS
CAROLINA CONNECTIONS

CAROLINA CONNECTIONS
422 HUFFMAN MILL ROAD,
SUITE 105, BURLINGTON,
NC 27215, UNITED STATES

PHONE: (336) 585-1314

SYSTEM INFO. (26) LONGI 4055 LONGI LR5-54HPB-405M (01) TESLA 7.6 KW 1538000-XX-[240V] [SI1-5B]

DC SYSTEM SIZE: 10.530 KWDC

REVISIONS

DESCRIPTION DATE RE

SEAL OSCIPE SEAL O

PROJECT NAME & ADDRESS

©

W LEONARD SIBLEY
RESIDENCE
7064 US 401 N,
FUQUAY VARINA, NC 27526
PH.#: (919) 270-1119
Email: Sibleyclan@gmail.com

DATE: 09/22/2025

ROOF PLAN &

MODULES SHEET SIZE

ANSI B

11" X 17"
SHEET NUMBER


PV-2

ROOF PLAN & MODULES

PV-2

SCALE: 3/32" = 1'-0"

METER NO: 329 625 930

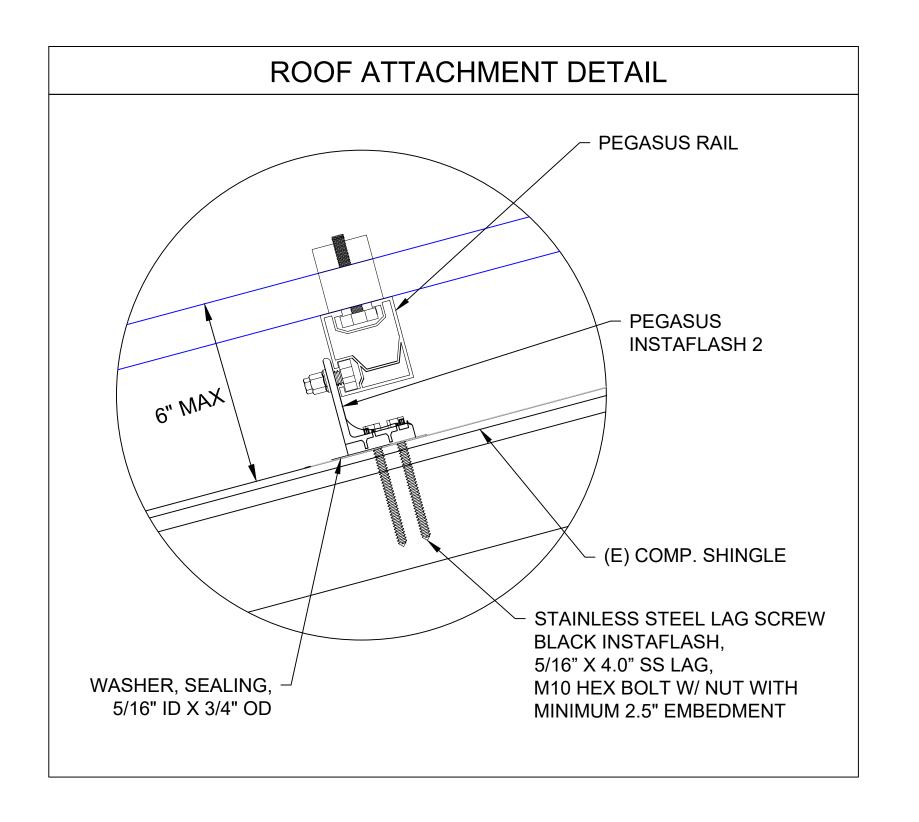



CAROLINA CONNECTIONS
422 HUFFMAN MILL ROAD,
SUITE 105, BURLINGTON,
NC 27215, UNITED STATES
PHONE: (336) 585-1314

SYSTEM INFO.
(26) LONGI 4055 LONGI
LR5-54HPB-405M
(01) TESLA 7.6 KW 1538000-XX-Y
[240V] [S11-SB]
DC SYSTEM SIZE: 10.530 KWDC
AC SYSTEM SIZE: 7.600 KWAC

DESCRIPTION DATE REV

10/8/2025

PROJECT NAME & ADDRESS

W LEONARD SIBLEY
RESIDENCE
7064 US 401 N,
FUQUAY VARINA, NC 27526
PH.#: (919) 270-1119
Email: Sibleyclan@gmail.com

DATE: 09/22/2025

SHEET NAME


ATTACHMENT

DETAIL

SHEET SIZE

ANSI B 11" X 17"

SHEET NUMBER

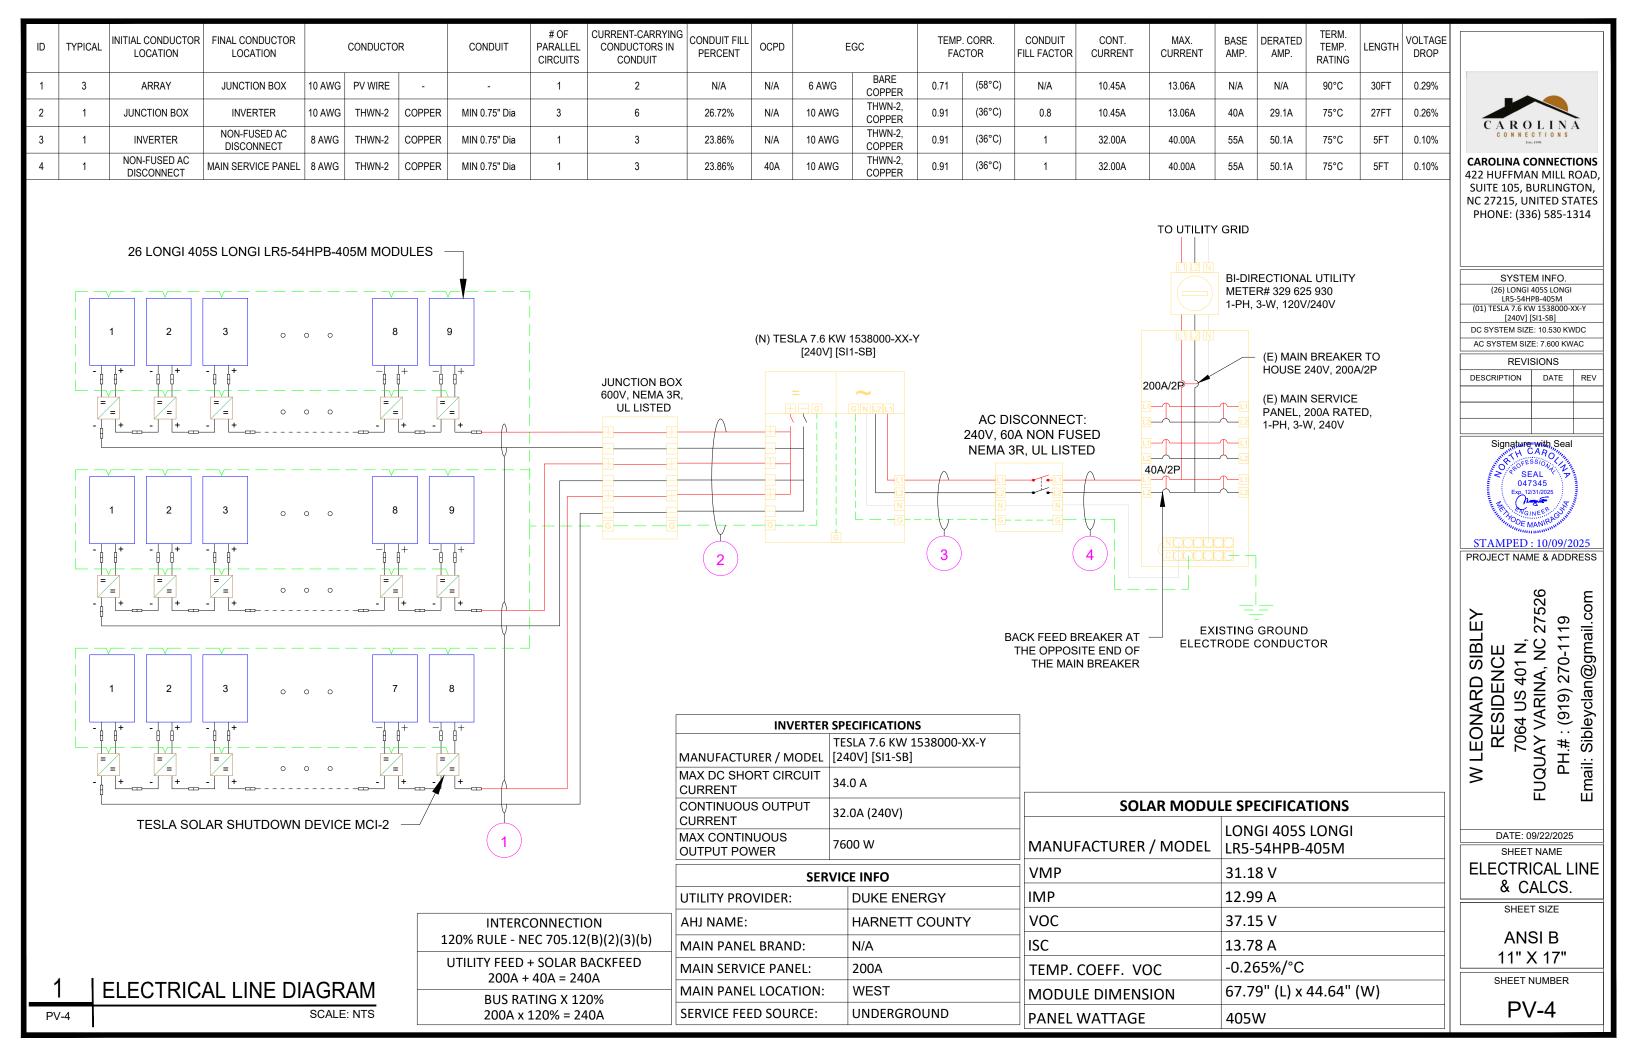





CAROLINA CONNECTIONS
422 HUFFMAN MILL ROAD,
SUITE 105, BURLINGTON,
NC 27215, UNITED STATES
PHONE: (336) 585-1314

SYSTEM INFO.

(26) LONGI 405S LONGI LR5-54HPB-405M (01) TESLA 7.6 KW 1538000-XX-Y [240V] [S11-SB] DC SYSTEM SIZE: 10.530 KWDC

AC SYSTEM SIZE: 7.600 KWAC

REVISIONS

DESCRIPTION	DATE	REV

SEAL 047345

### STAMPED: 10/09/2025

PROJECT NAME & ADDRESS

7064 US 401 N, FUQUAY VARINA, NC 27526 Email: Sibleyclan@gmail.com PH.#: (919) 270-1119

DATE: 09/22/2025

SHEET NAME ELECTRICAL PHOTOS

SHEET SIZE

ANSI B 11" X 17"

SHEET NUMBER

SOLAR MODULE SPECIFICATIONS			
MANUFACTURER / MODEL	LONGI 405S LONGI LR5-54HPB-405M		
VMP	31.18 V		
IMP	12.99 A		
VOC	37.15 V		
ISC	13.78 A		
TEMP. COEFF. VOC	-0.265%/°C		
MODULE DIMENSION	67.79" (L) x 44.64" (W)		
PANEL WATTAGE	405W		

INVERTER SPECIFICATIONS			
MANUFACTURER / MODEL	TESLA 7.6 KW 1538000-XX-Y [240V] [SI1-SB]		
MAX DC SHORT CIRCUIT CURRENT	34.0 A		
CONTINUOUS OUTPUT CURRENT	32.0A (240V)		

AMBIENT TEMPERATURE SPECS			
RECORD LOW TEMP	-10°C		
AMBIENT TEMP (HIGH TEMP 2%)	36°C		
CONDUIT HEIGHT	7/8"		
ROOF TOP TEMP	90°C		
CONDUCTOR TEMPERATURE RATE	58°C		
MODULE TEMPERATURE COEFFICIENT OF VOC	-0.265%/C		

	NUMBER OF CURRENT
PERCENT OF VALUES	CARRYING CONDUCTORS
	IN EMT
0.80	4-6
0.70	7-9
0.50	10-20



CAROLINA CONNECTIONS
422 HUFFMAN MILL ROAD,
SUITE 105, BURLINGTON,
NC 27215, UNITED STATES
PHONE: (336) 585-1314

SYSTEM INFO. (26) LONGI 405S LONGI LR5-54HPB-405M (01) TESLA 7.6 KW 1538000-XX-Y [240V] [SI1-5B]

DC SYSTEM SIZE: 10.530 KWDC

AC SYSTEM SIZE: 7.600 KWAC

REVISIONS DESCRIPTION DATE

o47345

STAMPED: 10/09/2025

PROJECT NAME & ADDRESS

W LEONARD SIBLEY
RESIDENCE
7064 US 401 N,
FUQUAY VARINA, NC 27526
PH.#: (919) 270-1119
Email: Sibleyclan@gmail.com

DATE: 09/22/2025

SHEET NAME **SPECIFICATIONS** & CALC.

SHEET SIZE

ANSI B 11" X 17"

SHEET NUMBER

# **WARNING**

### **ELECTRIC SHOCK HAZARD**

TERMINALS ON BOTH LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION

LABEL LOCATION:

MAIN SERVICE PANEL/AC DISCONNECT/AC COMBINER (PER CODE: NEC 2017 690.13(B))

2

**WARNING: PHOTOVOLTAIC POWER SOURCE** 

LABEL LOCATION:

EVERY 10' AND ON CONDUIT BODIES WHEN EXPOSED (PER CODE: NEC2017 690.31(G)(3)(4))

3

PHOTOVOLTAIC SYSTEM AC DISCONNECT RATED AC OUTPUT CURRENT 32.00 AMPS NOMINAL OPERATING AC VOLTAGE 240 VOLTS

MAIN SERVICE PANEL/AC DISCONNECT

NEC2017, 690,53

4

RAPID SHUTDOWN SWITCH **FOR SOLAR PV SYSTEM** 

LABEL LOCATION: AT OR WITHIN 3' OF THE AC/DC COMBINER SWITCH PER CODE: NEC 690.58(C)(3)

5



**DUAL POWER SOURCE SECOND SOURCE IS PHOTOVOLTAIC SYSTEM** 


LABEL LOCATION: MAIN SERVICE PANEL/AC DISCONNECT/AC COMBINER/REVENUE METER 2017 NEC 705.12(B)(3)

### ADHESIVE FASTENED SIGNS

- ANSI Z535.4-2011 PRODUCT SAFETY SIGNS AND LABELS, PROVIDES GUIDELINES FOR SUITABLE FONT SIZES, WORDS COLORS, SYMBOLS, AND LOCATION REQUIREMENTS FOR LABELS. NEC 110.21(B)(1).
- THE LABEL SHALL BE OF SUFFICIENT DURABILITY TO WITHSTAND THE ENVIRONMENT INVOLVED. NEC 110.21(B)(3).
- ADHESIVE FASTENED SIGNS MAY BE ACCEPTABLE IF PROPERLY ADHERED. VINYL SIGNS SHALL BE WEATHER RESISTANT.

SOLAR PV SYSTEM EQUIPPED WITH RAPID SHUTDOWN

URN RAPID SHUTDOWN SWITCH TO THE "OFF" POSITION TO HUT DOWN PV SYSTEM AND REDUCE SHOCK HAZARD IN THE ARRAY



MAIN SERVICE PANEL IF MSD IS OUTSIDE PLACE IT THERE / IF MSD IS INSIDE PLACE ON THE AC DISCONNECT PER CODE: NEC 690.56(C)(1)

7

6

**PHOTOVOLTAIC SYSTEM UTILITY DISCONNECT SWITCH** 

LABEL LOCATION: 2017 NEC 690.56(C)(3)

8

**PV SOLAR BREAKER** 


DO NOT RELOCATE THIS **OVERCURRENT DEVICE** 

LABEL LOCATION: MAIN SERVICE PANEL 2017 NEC 705.12(B)(2)(3)(B)



# **CAUTION**

POWER TO THIS BUILDING IS ALSO SUPPLIED FROM THE FOLLOWING SOURCES WITH DISCONNECTS LOCATED AS SHOWN:

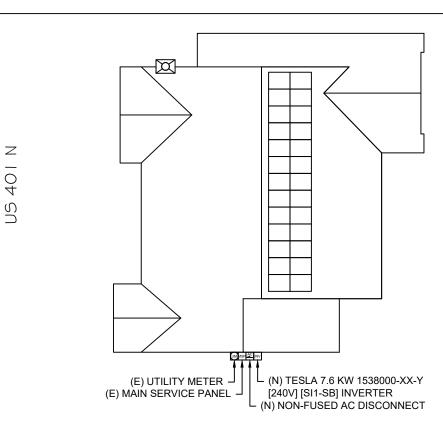



**SECTIONNEUR PRINCIPALE** 

SERVICIO DE **DESCONEXION** 

LABEL LOCATION: AC DISCONNECT 2017 NEC 230.66

**CAROLINA CONNECTIONS** 422 HUFFMAN MILL ROAD,

SUITE 105, BURLINGTON, NC 27215, UNITED STATES PHONE: (336) 585-1314

> SYSTEM INFO. (26) LONGI 405S LONGI

(01) TESLA 7.6 KW 1538000-XX

[240V] [SI1-SB] DC SYSTEM SIZE: 10.530 KWDC

AC SYSTEM SIZE: 7.600 KWAC

REVISIONS DESCRIPTION DATE

047345

STAMPED: 10/09/2025

PROJECT NAME & ADDRESS

27526 Sibleyclan@gmail.

PH.#: (919) 270-1119 FUQUAY VARINA, NC RESIDENC 7064 US 401

**LEONARD SIBLEY** 

≥

DATE: 09/22/2025

Email:

SHEET NAME SIGNAGE

SHEET SIZE

ANSI B 11" X 17"

SHEET NUMBER





# LR5-54HPB 400~420M

21.5% MAX MODULE EFFICIENCY

0~3%

<2% FIRST YEAR POWER DEGRADATION

0.55% YEAR 2-25 POWER DEGRADATION **HALF-CELL** 

Lower operating temperature

### **Additional Value**

**Mechanical Parameters** 

Cell Orientation

Junction Box

Connector Type


Output Cable Glass

Frame

Weight

Dimension

Packaging



108 (6×18)

IP68

MC4

4mm²,  $\pm$ 1200mm, length can be customized

single glass, 3.2mm coated tempered glass Anodized aluminum alloy frame

20.8kg

1722×1134×30mm

36pcs per pallet / 216pcs per 20' GP


per 40' HC

936pcs

864pcs(only for USA)







C	1400 1150			
				F 9
1134	¢		1093	
		0	0	- PA
Tolerance: Length: ±2mm Width: ±2mm	4.5	S 30 30 A-A	25 B-B	

<b>Electrical Characteristics</b>	STC:AM1	5 1000W/r	n² 25°C	NOCT: AM	1.5 800W/r	m² 20°C 1m/s	Test un	certainty for Pmax	:: ±3%	
Module Type	LR5-54H	IPB-400M	LR5-54H	IPB-405M	LR5-54H	IPB-410M	LR5-54H	HPB-415M	LR5-54HI	PB-420M
Testing Condition	STC	NOCT	STC	NOCT	STC	NOCT	STC	NOCT	STC	NOCT
Maximum Power (Pmax/W)	400	299.0	405	302.7	410	306.5	415	310.2	420	313.9
Open Circuit Voltage (Voc/V)	36.90	34.70	37.15	34.93	37.40	35.17	37.65	35.40	37.89	35.63
Short Circuit Current (Isc/A)	13.72	11.09	13.78	11.14	13.84	11.19	13.91	11.24	13.97	11.30
Voltage at Maximum Power (Vmp/V)	30.94	28.74	31.18	28.96	31.42	29.19	31.66	29.41	31.90	29.63
Current at Maximum Power (Imp/A)	12.93	10.40	12.99	10.45	13.05	10.50	13.11	10.55	13.17	10.59
Module Efficiency(%)	2	0.5	20	0.7	2	1.0	2	1.3	2.	L.5

Operating Parameters		
Operational Temperature	-40°C ~ +85°C	
Power Output Tolerance	0~3%	
Maximum System Voltage	DC1000V (IEC/UL)	
Maximum Series Fuse Rating	25A	
Nominal Operating Cell Temperature	45±2℃	
Protection Class	Class II	
Fire Rating	UL type 1 or 2 IEC Class C	

Mechanical Loading	
Front Side Maximum Static Loading	5400Pa
Rear Side Maximum Static Loading	2400Pa
Hailstone Test	25mm Hailstone at the speed of 23m/s

<b>Temperature Ratings</b> (STC)	
Temperature Coefficient of Isc	+0.050%/°C
Temperature Coefficient of Voc	-0.265%/°C
Temperature Coefficient of Pmax	-0.340%/°C

LONG

Specifications included in this datasheet are subject to change without notice. LONGi reserves the right of final interpretation. (20231207V18) DG



**CAROLINA CONNECTIONS** 422 HUFFMAN MILL ROAD, SUITE 105, BURLINGTON, NC 27215, UNITED STATES PHONE: (336) 585-1314

SYSTEM INFO. (26) LONGI 405S LONGI LR5-54HPB-405M (01) TESLA 7.6 KW 1538000-XX-

[240V] [SI1-SB] DC SYSTEM SIZE: 10.530 KWDC AC SYSTEM SIZE: 7.600 KWAC

REVISIONS DESCRIPTION DATE

Signature with Seal

PROJECT NAME & ADDRESS

LEONARD SIBLEY PH.#: (919) 270-1119 7064 US 401 N, FUQUAY VARINA, NC RESIDENCE

> DATE: 09/22/2025 SHEET NAME

**EQUIPMENT SPECIFICATION** 

SHEET SIZE

ANSI B 11" X 17"

SHEET NUMBER

# **Tesla Solar Inverter Technical Specifications**

**Electrical Specifications:** Output (AC)

1538000-xx-y Model Number

Output (AC)1 3.8 kW 5.7 kW 5 kW 7,600 W **Nominal Power** 3,800 W 5,000 W 5,700 W 6,000 VA Maximum Apparent Power 7,680 VA 3.840 VA 5,040 VA **Maximum Continuous Current** 16 A 21 A 24 A 32 A **Breaker (Overcurrent Protection)** 20 A 30 A 30 A 40 A

**Nominal Power Factor** 1 - 0.9 (leading / lagging

THD (at Nominal Power)

**Electrical Specifications:** Input (DC)

1-2-1-2 Input Connectors per MPPT 600 VDC Maximum Input Voltage DC Input Voltage Range 60 - 550 VDC DC MPPT Voltage Range 60 - 480 VDC1 13 A<sup>2</sup> Maximum Current per MPPT (I<sub>MP</sub>)

Maximum Short Circuit Current per

MPPT (Isc)

<sup>1</sup>Maximum current.

<sup>2</sup>Where the DC input current exceeds an MPPT rating, jumpers can be used to allow a single MPPT to

17 A<sup>2</sup>

intake additional DC current up to 26 A I<sub>MP</sub> / 34 A I<sub>SC</sub>.

Performance **Specifications**  Peak Efficiency 98.6% at 240 V **CEC Efficiency** 98.0% at 240 V

Allowable DC/AC Ratio

Tesla Mobile App **Customer Interface** 

Wi-Fi (2.4 GHz, 802.11 b/g/n), Internet Connectivity Ethernet, Cellular (LTE/4G)3 Revenue Grade Meter Revenue Accurate (+/- 0.5%)

**AC Remote Metering Support** Wi-Fi (2.4 GHz, 802.11 b/g/n), RS-485

Integrated arc fault circuit **Protections** 

interrupter (AFCI), Rapid Shutdown

60 Hz, 240 V Split Phase Supported Grid Types

12.5 years Warranty


<sup>3</sup>Cellular connectivity subject to network operator service coverage and signal strength.

# **Tesla Solar Inverter Technical Specifications**

**Mechanical Specifications** 

Dimensions

660 mm x 411 mm x 158 mm (26 in x 16 in x 6 in)



Weight 52 lb4

**Mounting Options** Wall mount (bracket)

<sup>4</sup>Door and bracket can be removed for a mounting weight of 37 lb.

**Environmental Specifications** 

**Operating Temperature** -30°C to 45°C (-22°F to 113°F)5

Operating Humidity (RH) Up to 100%, condensing

-30°C to 70°C (-22°F to 158°F) Storage Temperature

**Maximum Elevation** 3000 m (9843 ft)

**Environment** Indoor and outdoor rated

Type 3R **Enclosure Rating** 

Ingress Rating IP55 (Wiring compartment)

**Pollution Rating** PD2 for power electronics and terminal wiring compartment, PD3 for all other components

Operating Noise @ 1 m < 40 db(A) nominal, < 50 db(A) maximum

<sup>5</sup>Performance may be de-rated to 6.2 kW at 240 V when operating at temperatures

greater than 45°C.

**Grid Certifications** 

UL 1741, UL 1741 SA, UL 1741 SB, UL 1741 PCS,

IEEE 1547-2018, IEEE 1547.1

UL 1741 PVRSS, UL 1699B, UL 1998 (US), UL 3741 Safety Certifications **Emissions** 

EN 61000-6-3 (Residential), FCC 47CFR15.109 (a)

**CAROLINA CONNECTIONS** 422 HUFFMAN MILL ROAD, SUITE 105, BURLINGTON, NC 27215, UNITED STATES PHONE: (336) 585-1314

SYSTEM INFO. (26) LONGI 405S LONGI (01) TESLA 7.6 KW 1538000-XX-[240V] [SI1-SB]

DC SYSTEM SIZE: 10.530 KWDC AC SYSTEM SIZE: 7.600 KWAC

REVISIONS DESCRIPTION DATE

Signature with Seal

PROJECT NAME & ADDRESS

27526 PH.#: (919) 270-1119 7064 US 401 N, FUQUAY VARINA, NC RESIDENC

LEONARD SIBLEY

≥

DATE: 09/22/2025

Email:

SHEET NAME **EQUIPMENT SPECIFICATION** 

SHEET SIZE

ANSI B 11" X 17"

SHEET NUMBER

PV-9

**Compliance Information** 

### **Solar Shutdown Device Technical Specifications**

The Solar Shutdown Device is a Mid-Circuit Interrupter (MCI) and is part of the PV system rapid shutdown (RSD) function in accordance with Article 690 of the applicable NEC. When paired with Tesla Solar Inverter, solar array shutdown is initiated by any loss of AC power.

Electrical Specifications	Model	MCI-1	MCI-2	MCI-2 High Current
opeomedations.	Nominal Input DC Current Rating ( $I_{MP}$ )	13 A	13 A	15 A
	Maximum Input Short Circuit Current ( $I_{sc}$ )	19 A	17 A	19 A
	Maximum System Voltage (PVHCS)	600 V DC	1000 V DC®	1000 V DC 6
	Maximum Disconnect Voltage <sup>7</sup>	600 V DC	165 V DC	165 V DC
	<sup>6</sup> Maximum System Voltage is limited by Tesla Solar Inverter	to 600 V DC.		
	<sup>7</sup> Maximum Disconnect Voltage is the maximum voltage allov MCI-2 has a voltage rating of 165V but in combination (cor			
RSD Module	Maximum Number of Devices per String		5	
Performance	Control	Р	ower Line Excitation	1
	Passive State		Normally Open	
	Maximum Power Consumption		7 W	
	Warranty		25 years	
Environmental	Operating Temperature	-40°C to 50°C (-40°F to 122°F)		to 70°C to 158°F)
Specifications	Storage Temperature	−30°C to 70°C (−22°F to 158°F)		to 70°C to 158°F)
	Enclosure Rating	NEMA 4X / IP65	NEMA 4	4X / IP65
Mechanical	Electrical Connections	MC4 Connector	MC4 C	onnector
Specifications	Housing	Plastic	Pla	astic
·	Dimensions	125 x 150 x 22 mm (5 x 6 x 1 in)		5 x 22 mm l.8 x 1 in)
	Weight	350 g (0.77 lb)	120 g (	(0.26 lb)
	Mounting Options	ZEP Home Run Clip M4 Screw (#10) M8 Bolt (5/16") Nail / Wood screw	Wir	e Clip
Compliance Information	Certifications		1741 PVRSE, UL 374 tovoltaic Rapid Shut	

UL 3741 PV Hazard Control (and PVRSA) Compatibility

RSD Initiation Method

See UL 3741 Application Addendum

PV System AC Breaker or Switch

Tesla Solar Inverter and Solar Shutdown Device Datasheet

4 T ≡ ⊑ L □ T

TEPV-DS-0023-22

# PV HAZARD CONTROL SYSTEM | GENERIC PV ARRAY

UL 3741 REPORT DATE 4-06-22 Tesla Inverter Based PVHCS, Consisting of Tesla Inverters, Tesla MCI and other PV RAPID SHUTDOWN ARRAY listed components to create the system

WARNING: To reduce the risk of injury, read all instructions.

### PV HAZARD CONTROL EQUIPMENT AND COMPONENTS

Function	Manufacturer	Model No.	Firmware Versions	Certification Standard	
Inverter or Powerwall+	Tesla	7.6 kW: 1538000¹ 3.8 kW: 1534000¹ 7.6 kW: 1850000¹	V4, CEA4F802 V4, FF7BE4E1 V4, CEA4F802	UL 1741, UL 1998, PVRSS/PVRSE	
Mid Circuit Interrupter (MCI)	Tesla	MCI-1, MCI-2	N/A	UL 1741 PVRSE	
PV Modules	The PVHC PV mod and Class I).	dules must be listed by a NRTL to UL 170	3 and/or UL 61730-1 and UL 6	1730-2 (excluding Class 0	
PV Mounting System	Listed by NR7     The non-certification	system must comply with one of the follow FL to UL 2703 and rated for use with the s fied combinations of mounting and PV mo the NEC and other applicable installation	specific PV modules noted about		
PV Connectors	Staubli type P     Staubli type P     Staubli Brance	onnectors may be used to connect to the V-KST4/6II-UR or type PV-KST4-EVO2 (V-KBT4/6II-UR or PV-KBT4-EVO2 (femath Socket PV-AZB4 and Branch Plug PV-Fvaluated by an NRTL for intermatability w	male), le), AZS4,		
PVHCS Initiator: (PV Inverter)	Dedicated PV system AC circuit breaker or AC disconnect switch, labeled per NEC 690.12 requirements.				
PVHCS Initiator: (Powerwall+)	Emergency stop de Device" or "Emerge	evice (NISD)- Listed "Emergency Stop Bu ency Stop Unit".	itton" or "Emergency Stop	UL 508 or UL 60947 Parts 1, 5-1 and 5-5.	

<sup>&</sup>lt;sup>1</sup> Applies to variations of this part number with suffix of two numbers and one letter.

Note: PVHCS installation requirements may reduce the effective equipment and component ratings below the individual equipment and component PVRSE ratings in order to achieve PVHCS shock hazard reduction requirements.

PVHCS INSTALLATION REQUIREMENTS				
Max System Voltage	600 Vpc			
PVHCS Maximum Circuit Voltage (Array Internal Voltage After Actuation)	165 Vpc (cold weather open circuit)			

### OTHER INSTALLATION INSTRUCTIONS

- 1. An MCI must be connected to one end of each series string or mounting plane sub-array string.
- 2. MCIs shall be installed between series connected module combinations such that the PVHC Maximum Circuit Voltage after actuation is no greater than 165V under any circumstances. The installation location coldest anticipated operating ambient temperature shall be used to calculate the PV maximum voltage in accordance with NEC 690.7.
  - 3. Verification that the MCIs are installed in accordance with 1) and 2) shall be documented for inspection, by voltage measurement logs and/or as-built string layout diagrams.
  - 4. For PV Inverter: The PVHCS initiator (AC breaker or switch) shall be sized and installed in accordance with NEC requirements. The specific part shall be identified on the as-built system drawings.
  - 5. For Powerwall+: The PVHCS emergency stop initiator shall have the following minimum ratings: Outdoor (Type 3R or higher), 12V, 1A, and shall be installed in accordance with NEC requirements. The specific part shall be identified on the as-built system drawings. Refer to the Powerwall+ installation manual for further details.



CAROLINA CONNECTIONS
422 HUFFMAN MILL ROAD,
SUITE 105, BURLINGTON,
NC 27215, UNITED STATES
PHONE: (336) 585-1314

SYSTEM INFO.
(26) LONGI 405S LONGI
LR5-54HPB-405M
(01) TESLA 7.6 KW 1538000-XX-Y
[240V] [SI1-SB]

DC SYSTEM SIZE: 10.530 KWDC

AC SYSTEM SIZE: 7.600 KWAC

REVISIONS						
DESCRIPTION	DATE	REV				

Signature with Seal

PROJECT NAME & ADDRESS

W LEONARD SIBLEY
RESIDENCE
7064 US 401 N,
FUQUAY VARINA, NC 27526
PH.#: (919) 270-1119

DATE: 09/22/2025

SHEET NAME
EQUIPMENT
SPECIFICATION

SHEET SIZE

ANSI B 11" X 17"

SHEET NUMBER







Open rail channel holds and protects wires. Clamps won't pinch wires after tightening.

# **Bonding Structural Splice**

Connect rails instantly, without tools, interference or limitations.

# **Next-Level Solar Mounting**

A complete system for hassle-free rooftop installation, from watertight mounts to lifetime wire management.



1/2"socket for everything. One clamp for mid or end. No tool splicing and bonding. Easy wire management.

### **Code Compliant**

UL 2703 listed LTR-AE-001-2012 listed Class A fire rating for any slope ASCE 7-16 PE Certified



### **Premium Aesthetics**

The narrowest panel gap Clamps and End Caps provide a flush look on the edge of the array.



Secured on industry-leading Pegasus Mounts, for composite shingle and tile roofs Backed by a 25-year warranty.

# RAIL SYSTEM



Pegasus Rail

Available in 14' and 7' lengths for easy

Open-channel design holds MC4

Black and Mill finish

connectors. PV wire and trunk cables



Pegasus Max Rail

Maximum-strength design.

Black and Mill finish

Meets specifications for high

snow-load and hurricane zones.

Splice and Max Splice

Structurally connects and bonds rails

automatically; UL2703 listed as reusable

Installs by hand.

Works over mounts.



### Dovetail T-bolt

Dovetail shape for extra strength. Uses 1/2" socket.





### Hidden End Clamp

Fits 30-40mm PV frames, as mid- or Twist-locks into position; doesn't pinch

Multi-Clamp

Bonds modules to rail; UL2703 listed

MLPE Mount

Secures and bonds most micro-inverters

Connectors and wires easily route

Offers premium edge appearance. Preinstalled pull-tab grips rail edge, allowing easy, one-hand installation Tucks away for reuse.

Cable Grip

Secures four PV wires or two trunk cables.

Stainless-steel backing provides

Eliminates sagging wires.

durable grip.

Holds 6 or 8 AWG wire. Mounts on top or side of rail. Assembled on MLPE Mount. UL2703 listed as reusable.



Hand operable

Won't slip.

Holds wires in channel

### N-S Bonding Jumper

Installs by hand, eliminates row-to-row

Fits flush to PV module and hides

Hidden drain quickly clears

UL2703 listed as reusable only with Pegasus Rail.



raw or angled cuts.



End Cap and Max End Cap

### Certifications:

• UL 2703, Edition 1

UL2703 listed as reusable.

and optimizers to rail.


- LTR-AE-001-2012
- ASCE 7-16 PE certified
- Class A fire rating for any slope roof



### **FREE** PEGASUS SOLAR **Design Tool**

Quickly calculate the most efficient layout, spans and materials needed to suit your job. Visit the Pegasus Customer Portal. pegasussolar.com/portal

Patents pending. All rights reserved. ©2021 Pegasus Solar Inc.

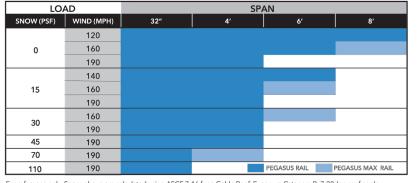

For reference only. Spans above are calculated using ASCE 7-16 for a Gable Roof, Exposure Category B, 7-20deg roof angle, 30ft mean roof height with non-exposed modules. For PE certified span tables, visit www.pegasussolar.com/spans.

Pegasus Solar Inc | 506 West Ohio Avenue, Richmond, CA 94804 | T: 510.210.3797 | www.pegasussolar.com

**CAROLINA CONNECTIONS** 422 HUFFMAN MILL ROAD,

SUITE 105, BURLINGTON, NC 27215, UNITED STATES PHONE: (336) 585-1314

SYSTEM INFO.

(26) LONGI 405S LONGI LR5-54HPB-405M (01) TESLA 7.6 KW 1538000-XX-

[240V] [SI1-SB]

DC SYSTEM SIZE: 10.530 KWDC

AC SYSTEM SIZE: 7.600 KWAC **REVISIONS** 

DESCRIPTION	DATE	REV

Signature with Seal

PROJECT NAME & ADDRESS

27526 PH.#: (919) 270-1119 7064 US 401 N, FUQUAY VARINA, NC RESIDENC

LEONARD SIBLEY

DATE: 09/22/2025

SHEET NAME

**EQUIPMENT SPECIFICATION** 

SHEET SIZE

**ANSI B** 11" X 17"

SHEET NUMBER

**PV-11** 



available. Optional Hidden End





Pegasus Solar Inc | 506 West Ohio Avenue, Richmond, CA 94804 | T: 510.210.3797 | www.pegasussolar.com



# INSTAFLASH 2



# The Ultimate Comp Roof Attachment

Simple to use. Works for rafter or deck attach. No caulking, no ripped shingles, no mess. Pre-installed sealant acts as a chemical flashing and fills all gaps, voids, and butt joints for an instant, watertight seal



### 25-Year Warranty

Manufactured with advanced materials and coatings to outlast the roof itself



### **Code Compliant**

Fully IBC/CBC code compliant Exceeds ASCE 7-22 standards UL2703 certified



### **Self-Healing**

Proprietary non-hardening

# PEGASUS

or right screw holes

3.7in

**SPECIFICATIONS** 

Kit Contents

Attachment Type

Roof Fasteners

Roof Type

Flashing Type

Installation

Temperature Cure Time

Service Temperature

Certifications

Install Application

Kit Quantity

Boxes Per Pallet

PIF2-B0

Black InstaFlash2

See www.ps-ip.com for intellectual property details. All rights reserved. ©2024 Pegasus Solar Inc.

# **INSTA**FLASH 2

Irive second screw n hole above.

Ensure screws are embedded at leas

PIF2-MDT

Mill InstaFlash2,

Dovetail T-bolt

Mill

2.5" into rafter.





.5" into rafter

PIF2-BDT


Black InstaFlash2,

Dovetail T-bolt

Black







PIF2-M0

Mill InstaFlash2



PROJECT NAME & ADDRESS

LEONARD SIBLEY

≥



SCAN FOR INSTALLATION VIDEO



**SCAN FOR** 

### **Larger Spans**

Extra-large L-foot and larger spans between mounts

Pegasus | 506 West Ohio Avenue, Richmond, CA 94804 | www.pegasussolar.com

Pegasus | 506 West Ohio Avenue, Richmond, CA 94804 | www.pegasussolar.com

Rafter & Deck Attach

1/2" Socket Driven; PF-DRW85 (sold separately in boxes of 24)

Sloped Roof: Composition Shingle, Rolled Asphalt | Flat Roof: Modified Bitumen Roof, Built-Up Roof

Factory Installed Non-Drying, Non-Skinning Butyl Based Chemical Flashing

0° F to 170° F

Instantly Waterproof; Non-Hardening

-40° F to 195° F

IBC, ASCE/SEI 7-16 & 7-22, UL2703

Most Railed Systems

**CAROLINA CONNECTIONS** 422 HUFFMAN MILL ROAD,

SUITE 105, BURLINGTON, NC 27215, UNITED STATES PHONE: (336) 585-1314

> SYSTEM INFO. (26) LONGI 405S LONGI

LR5-54HPB-405M (01) TESLA 7.6 KW 1538000-XX-[240V] [SI1-SB]

DC SYSTEM SIZE: 10.530 KWDC AC SYSTEM SIZE: 7.600 KWAC

**REVISIONS** DESCRIPTION DATE

Signature with Seal

27526 PH.#: (919) 270-1119 7064 US 401 N, FUQUAY VARINA, NC RESIDENC

Sibleyclan@gmail.

DATE: 09/22/2025

SHEET NAME **EQUIPMENT** 

SHEET SIZE

**SPECIFICATION** 

ANSI B 11" X 17"

SHEET NUMBER