



Fire Marshal Division

1005 Edwards Brother Drive

Lillington, NC 2756

910-893-7580

Reviewed For Code Compliance By:

D. Banks Wallace

Chief Deputy Fire Marshal

10/02/2018 3:15:42 PM

Application for Tent/Canopy Permit

Application# FMFW1810-0001 Date: 9 / 28 / 18

Applicant: Campbell Universtiy Inc.

Billing Address: 255 Dr. McKoy Rd

City Buies Creek State NC Zip 27506

Contact Phone # 910-814-7331

Location of Tent/Canopy: 69 Don phelps Cir

City Lillington State NC Zip 27546

Set-up Date 10 / 5 / 18 Completion Date 10 / 6 / 18

This application must be completed and returned to Central Permitting, prior to the issuance of the permit. A site inspection will be conducted to verify compliance. Please allow (7) working days for processing. There will be a permit fee assessed for the tent(s). Permit fees shall be paid after reviewed has been completed. The following items are required to be submitted with this application:

- 1 Site plan showing location of tent/canopy on property and distance from buildings.
- 2 Number of tents/canopies including dimensions of each and whether the tent will be equipped with enclosed sides.
- 3 Proposed use of each tent/canopy.
- 4 Flame resistant certificate for each tent/canopy.


Applicant Signature

10/1/18
Date

To: Harnett County Fire Marshall

From: Jason S. Wangelin
Assistant Director Facilities Management
Campbell University, Inc.


On October 6, 2018 we are planning to set up a large tent to accommodate approximately 200 people to have a seated picnic for Bob Barker Day at the Football Game. This tent will not have any cooking under the tent, but will have buffet service of prepared food served under the tent.

Sincerely:

Jason S. Wangelin


Harnett GIS

NOT FOR LEGAL USE

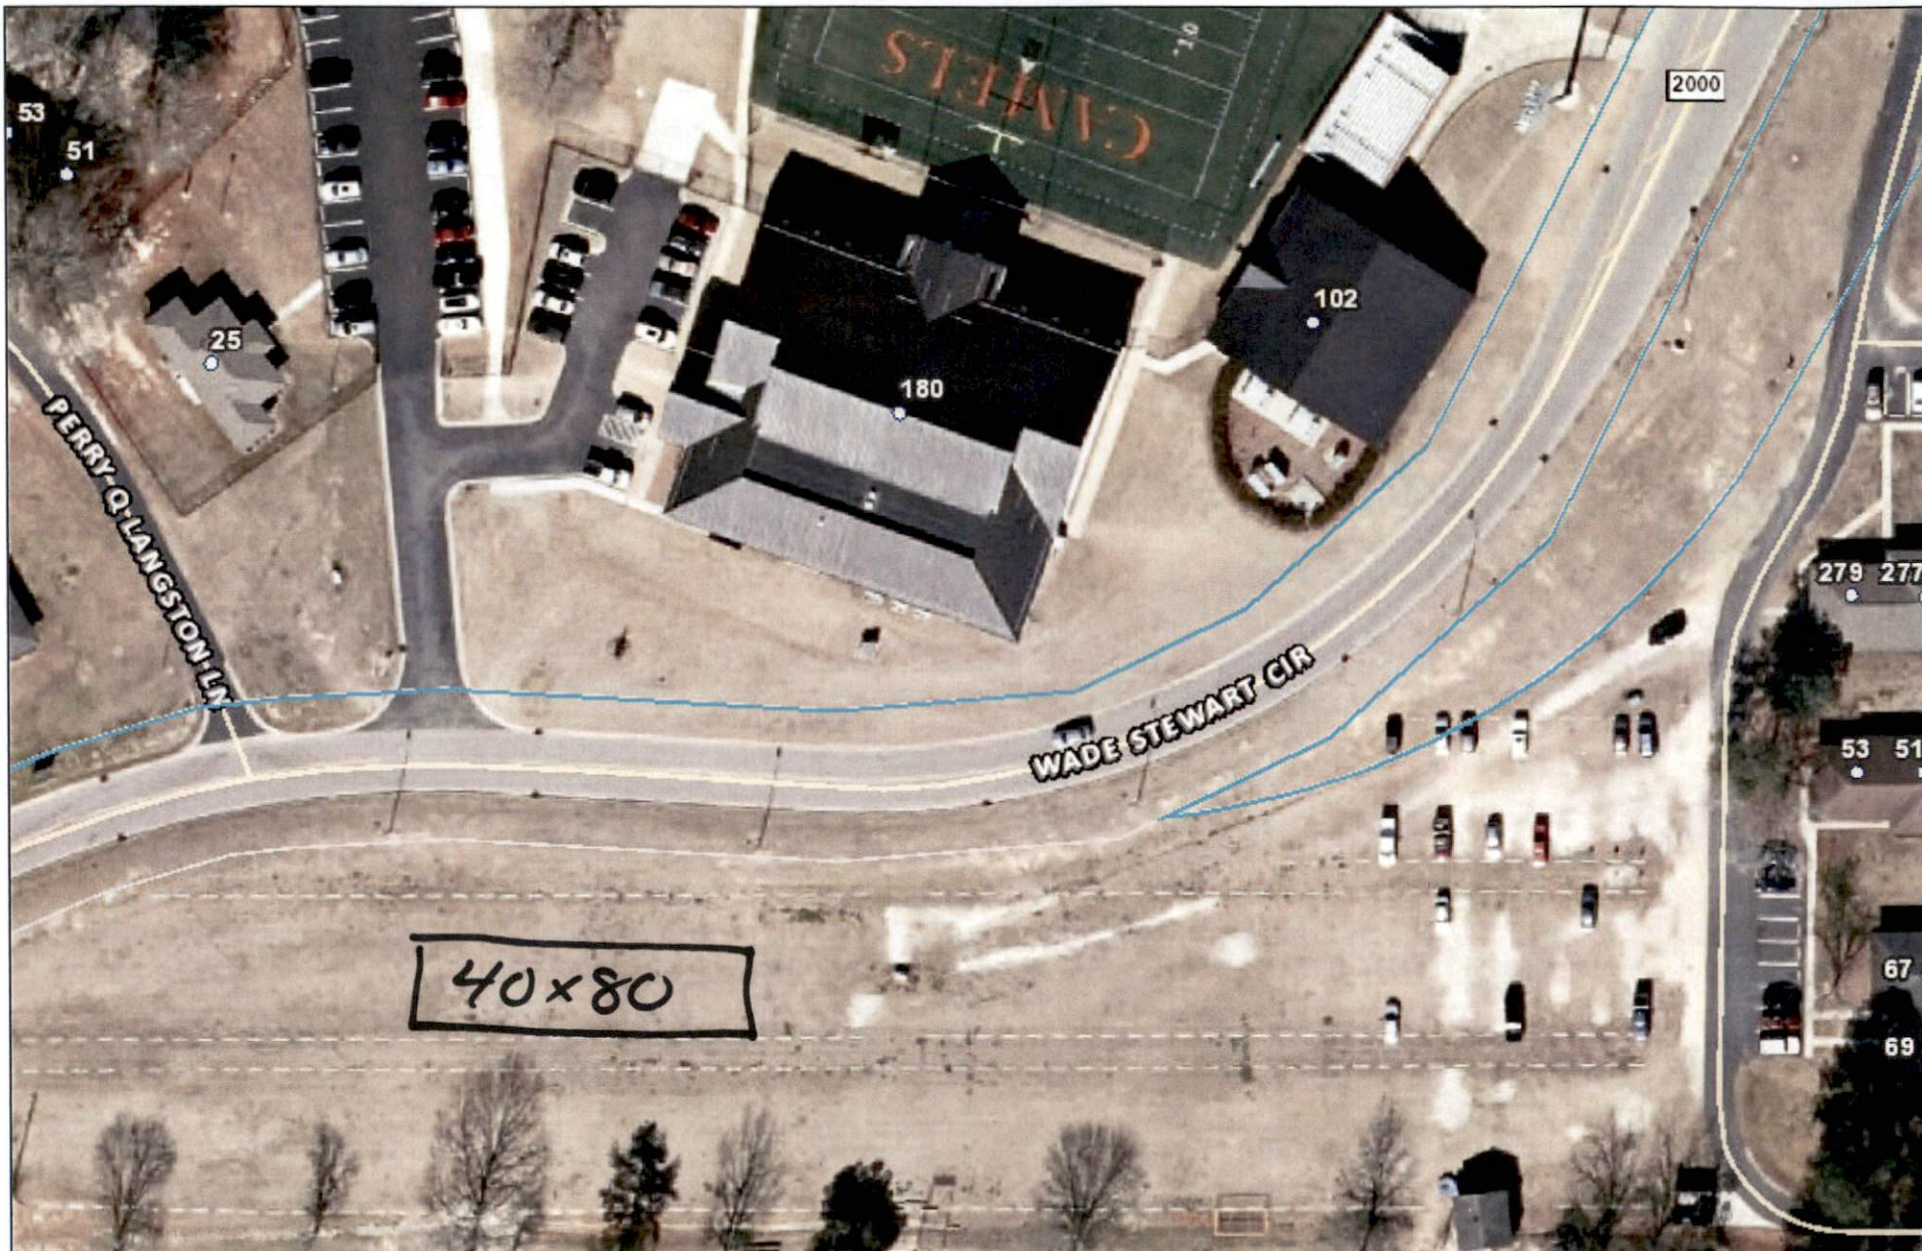


Harnett
 COUNTY
 NORTH CAROLINA
 GIS/E-911 Addressing
 October 1, 2018

- | | | | |
|-------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------|
|  Recycle Center |  City Limits |  NC |  Parcels |
|  Landfills |  Address Numbers |  US | |
|  Surrounding County Boundaries |  Airport |  Roads | |
|  Federal Property | MajorRoads |  Mile_Markers | |
| |  Interstate |  Railroad | |

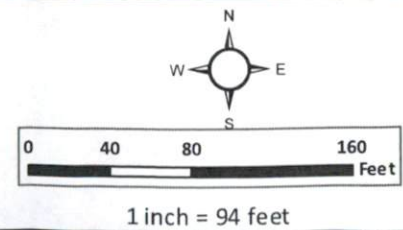

08 x 6 1/2



Fire Marshal Division

October 2, 2018

Jason Wangelin
Campbell University
PO Box 535
Buies Creek, NC 27506

**Re: Campbell University Tent
Barker Lane Stadium (180 Wade Stewart Circle)
Lillington, NC 27546**

Application Number FMFW1810-0001

Mr. Wangelin,

Thank you for submitting the plans for the tent. The plans have been carefully reviewed by a qualified code enforcement official to examine for compliance with the North Carolina Fire Prevention Code and all other fire protection regulatory documents. There are some items that were found during the plan review process that need to be addressed before a final inspection of the new facility can be given. These items are outlined and described below.

- **2404.12 Fire Extinguishers.**
 - 2A-10B: C fire extinguisher shall be placed at tents/canopies with a travel distance not to exceed 100' from any fire extinguisher.
- **2403.12.5.1 Arrangement of aisles.**
 - The arrangement of aisles shall be subject to the approval of the fire code official and shall be maintained clear at all times during occupancy.
- **2403.12.6 Exit Signs**
 - Exits shall be clearly marked. Exit signs shall be installed at required exit doorways and where otherwise necessary to indicate clearly the direction of egress when the exit serves an occupant load of 50 or more.



- **2404.6 Smoking**

- Smoking shall not be allowed under tents/canopies. "NO SMOKING" signs shall be conspicuously posted under the tent.

Thank you again for submitting the plans for the tent. Please review the plans and adhere to any notes and alterations that were made in addition to the original drawings. These remarks are for the plans that were submitted and its original intent. These remarks do not apply if the original intent changes or what was submitted on the above date changes. If you have any questions, please do not hesitate to call this office.

Sincerely,



D. Banks Wallace
Chief Deputy Fire Marshal