



October 8, 2018

Mike Park
1223 E. Cashwell Street
Wadesboro, N.C.

RE: Angier Sweepstakes
149-A Logan Court
Angier, NC 27501

Application Number 2018-00026

Mr. Park,

Thank you for submitting the plans for the up fit. The plans have been carefully reviewed by a qualified code enforcement official to examine for full compliance with the North Carolina Fire Prevention Code and all other fire protection regulatory documents. There are some items that were found during the plan review process that need to be addressed before a final inspection of the new facility can be given. These items are outlined and described below.

- **906.1 Fire Extinguishers**
 - A portable fire extinguisher shall be provided within a 30-foot (9144 mm) travel distance of commercial-type cooking equipment. Cooking equipment involving vegetable or animal oils and fats shall be protected by a Class K rated portable extinguisher.

- **1006.1 Emergency Lighting**
 - All emergency lighting, provided prior to up fit, shall be in proper operating condition at time of final inspection.
 - Any changes made in illumination requirements, due to equipment placement or storage arrangements shall be addressed before final inspection.
 - The means of egress, including the exit discharge, shall be illuminated at all time the building space is served by the means of egress is occupied.
 - Means of egress consist of three separate and distinct parts: the exit access, the exit and the exit discharge.
 - The means of egress illumination shall not be less than 1 foot-candle at the walking surface.



- **506.1 Knox Box**
 - Keys for front entrance door shall be provided to be placed in the existing box installed on the premises.
- **1017.2 Aisles in Groups B and M**
 - The minimum clear aisle width shall be determined by Section 1005.1 for the occupant load served, but shall not be less than 36 inches (914mm).
- **1008.1.10 Panic Hardware**
 - Panic hardware is required on assembly occupancies with an occupant load of 50 or more. The calculated occupancy capacity from the plans submitted is 218 occupants, this requires panic hardware on all required exit doors.
- **102.3 Change of use or occupancy**
 - Occupancy has changed use from previous business occupancy, need to contact the building inspector for any building code requirements.

Note: Please schedule all fire inspections through the Fire Marshal's Office (910) 893-0743.

Thank you again for submitting the plans for the up fit. Please review the plans and adhere to any notes and alterations that were made in addition to the original drawings. These remarks are for the plans that were submitted and its original intent. These remarks do not apply if the original intent changes or what was submitted on the above date changes. If you have any questions, please do not hesitate to call this office

Again, thank you and we look forward to working with you during the construction period!

Sincerely,

Roger Sullivan
Deputy Fire Marshal



Plan Review, Inspection, and Permit Fees

Application Number

2018-00026

\$100.00	<input type="checkbox"/>	DRB Major Sub Division Prelim Site Plans	\$	-
\$200.00	<input type="checkbox"/>	Explosive Material (90 Days)	\$	-
\$100.00	<input type="checkbox"/>	Explosive Materials (72 Hours)	\$	-
\$100.00	<input type="checkbox"/>	Fireworks Public Display	\$	-
\$50.00	<input checked="" type="checkbox"/>	Final Inspection	\$	50.00
\$35.00 + \$2.00 per device	<input type="checkbox"/>	Fire Alarm Testing	\$	-
\$35.00 + \$2.00 per nozzle	<input type="checkbox"/>	Fixed Fire Suppression	\$	-
\$75.00	<input type="checkbox"/>	Insecticide Fog/Fumigation	\$	-
\$100.00	<input type="checkbox"/>	Pipe Test/UST/AGST	\$	-
\$50.00	<input checked="" type="checkbox"/>	Plans up to 5000 sq ft	\$	50.00
\$100.00	<input type="checkbox"/>	Plans 5001 sq ft to 10,000 sq ft	\$	-
\$150.00	<input type="checkbox"/>	Plans 10,001 sq ft to 25,000 sq ft	\$	-
\$250.00	<input type="checkbox"/>	Plans 25,001 sq ft and over	\$	-
\$35.00 + 2.00 per head	<input type="checkbox"/>	Sprinkler Certification Test	\$	-
\$50.00	<input type="checkbox"/>	Standpipe Testing	\$	-
\$50.00	<input type="checkbox"/>	Special Assembly (ie. amusement buildings, carnivals, fairs)	\$	-
\$75.00	<input type="checkbox"/>	Tents/Canopies/Air Supported Structure	\$	-
\$100.00	<input type="checkbox"/>	Tank Installation (charge for each tank)	\$	-
\$100.00	<input type="checkbox"/>	Tank Removal (charge for each tank)	\$	-
		Total Devices/Heads	\$	-
		Total Cost	\$	100.00

Code Enforcement Official

10/8/2018



Harnett
COUNTY
NORTH CAROLINA



Emergency Services Department
www.harnettnc.com

Fire Marshal Division
P.O. Box 370
Lillington, NC 27546
910-893-7580

Application for Plan Review

Application # _____

Date Received: _____ Received By: _____

Name of Project: Angler Sweepstakes

Physical Address of Project: 149-A Logan Court

Plans Submitted By: Angler NC NC

Project Phone: Gi Do Son

Contact Person/Address: (910) 262-9317

Contact Phone: Milce Park, 1223 E Caswell St, Nokesboro, NC

Contact Person/Address: _____

Contact Phone: (678) 772-1216 ()

Contractor's Name/Info: Mike Park

Contractor's Phone: _____

Contractor's Phone: (678) 772-1216

- Plans that are submitted will be reviewed as quickly as possible with an average time of review between 7-10 working days.
- Status checks may be conducted on plan reviews by visiting the website <http://hweb.harnett.org/Click2Gov/PP/Index.jsp> or by calling the Harnett County Central Permitting Office (910-893-7525 ext 2), or the Harnett County Fire Marshal's Office (910-893-7580).
- Approved plans must be picked up from the Central Permitting Office and all fees paid before any required inspections can be conducted.



TOWN OF ANGIER
LAND USE PERMIT

55 NORTH BROAD ST. WEST ANGIER, NC 27501-0278
Phone: 919-639-2071 FAX: 919-639-6130

DATE ISSUED: 10/03/2018

PERMIT #: 2018-00026

LOCATION:

149-A LOGAN COURT

DISTRICT
GC

TAX MAP PARCEL#
040683 0116 03

OWNER:

ANGIER SWEEPSTAKES

LOT
ZONING DISTRICT
GC

CONTRACTOR:

TOTAL VALUATION
\$0

SUBCONTRACTOR ID#NAME

SUBCONTRACTOR TYPE

TYPE CONSTRUCTION: LAND USE

OCCUPANCY GROUP: COMMERCIAL

FEE CODE

LAND USE COMMERCIAL

FEE
35.00

TOTAL PAID:

35.00 **PAID IN-FULL**

TOTAL AMOUNT:

35.00

REMARKS:

LAND USE PERMIT FOR ZONING COMPLIANCE
SWEEPSTAKES STYLE ELECTRONIC GAMING BUSINESS PERMITTED PER SECTION 4.8.4 OF
THE ANGIER UNIFIED DEVELOPMENT ORDINANCE.
ALL ELECTRONIC GAMING DEVICES MUST COMPLY WITH NORTH CAROLINA GENERAL
STATUTES INCLUDING G.S. 14-306.1A

(SIGNATURE OF CONTRACTOR/OWNER)


Steve Johnson
(ISSUED BY)

(DATE)

10/3/18
(DATE)

Floor Plan (Angler Skills Game)

48-A-1 Logans Court Angler, NC 27501

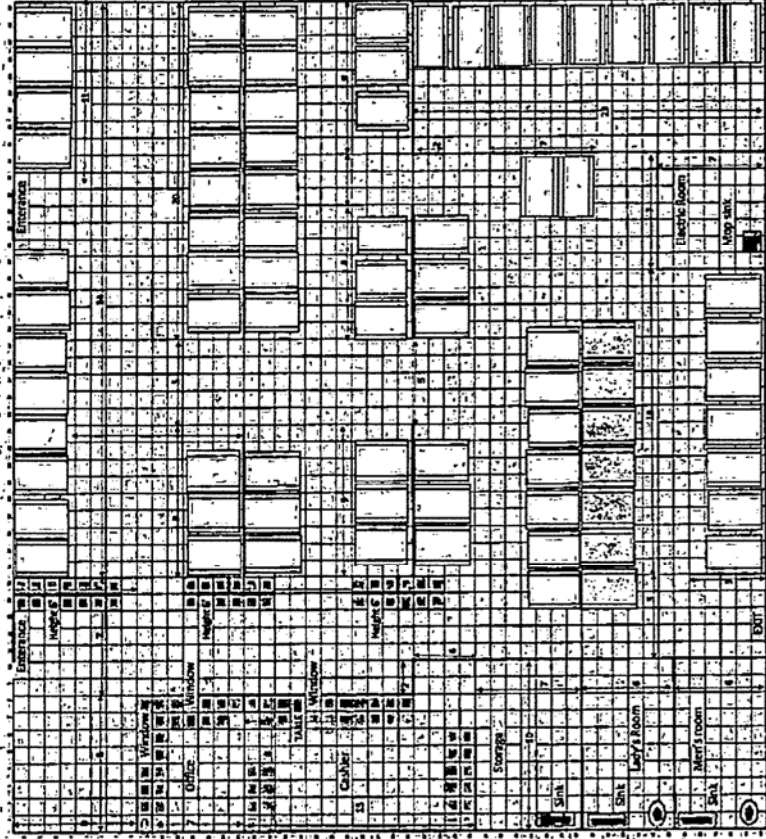

Actual Size is 49 X 49 feet

1 cell is 3X1 feet
Desk & Chair
(2 2/3 feet)