



### Fire Marshal Division

P.O. Box 370  
Lillington, NC 27546  
910-893-7580

## Application for Plan Review

Application # FMFW1812-0005

Date Received: 12/17/18 Received By: [Signature]

Name of Project: PJ's Truck Bodies

Physical Address of Project: 1560 George Perry Lee Rd  
Dunn NC 28334

Plans Submitted By: Robert Whitley

Project Phone: ( )- -

Contact Person/Address: Jeremy Parrish

Contact Phone: 919-894-8495 ( )- -


Contractor's Name/Info: Pye Barker Fire & Safety  
710 Porter Rd Rocky Mount, NC 27803

Contractor's Phone: 252-985-4545



- **Plans that are submitted will be reviewed as quickly as possible with an average time of review between 7-10 working days.**
- **Status checks may be conducted on plan reviews by visiting the website <http://hteweb.harnett.org/Click2GovBP/Index.jsp> or by calling the Harnett County Central Permitting Office (910-893-4759), or the Harnett County Fire Marshal's Office (910-893-7580).**
- **Approved plans must be picked up from the Central Permitting Office and all fees paid before any required inspections can be conducted.**

# Pyro Chem U.L. 1254 AUTO SPRAY PAINT BOOTH FIRE SUPPRESSION SYSTEM

EXHAUST FAN & INCOMING AIR MUST SHUT DOWN ON DISCHARGE OF THE FIRE SUPPRESSION SYSTEM.  
THE BUILDING FIRE ALARM MUST BE CONNECTED IF BUILDING IS EQUIPPED WITH A FIRE ALARM SYSTEM.  
HEATED BOOTHS GAS SUPPLY MUST SHUT DOWN ON DISCHARGE OF THE FIRE SYSTEM.

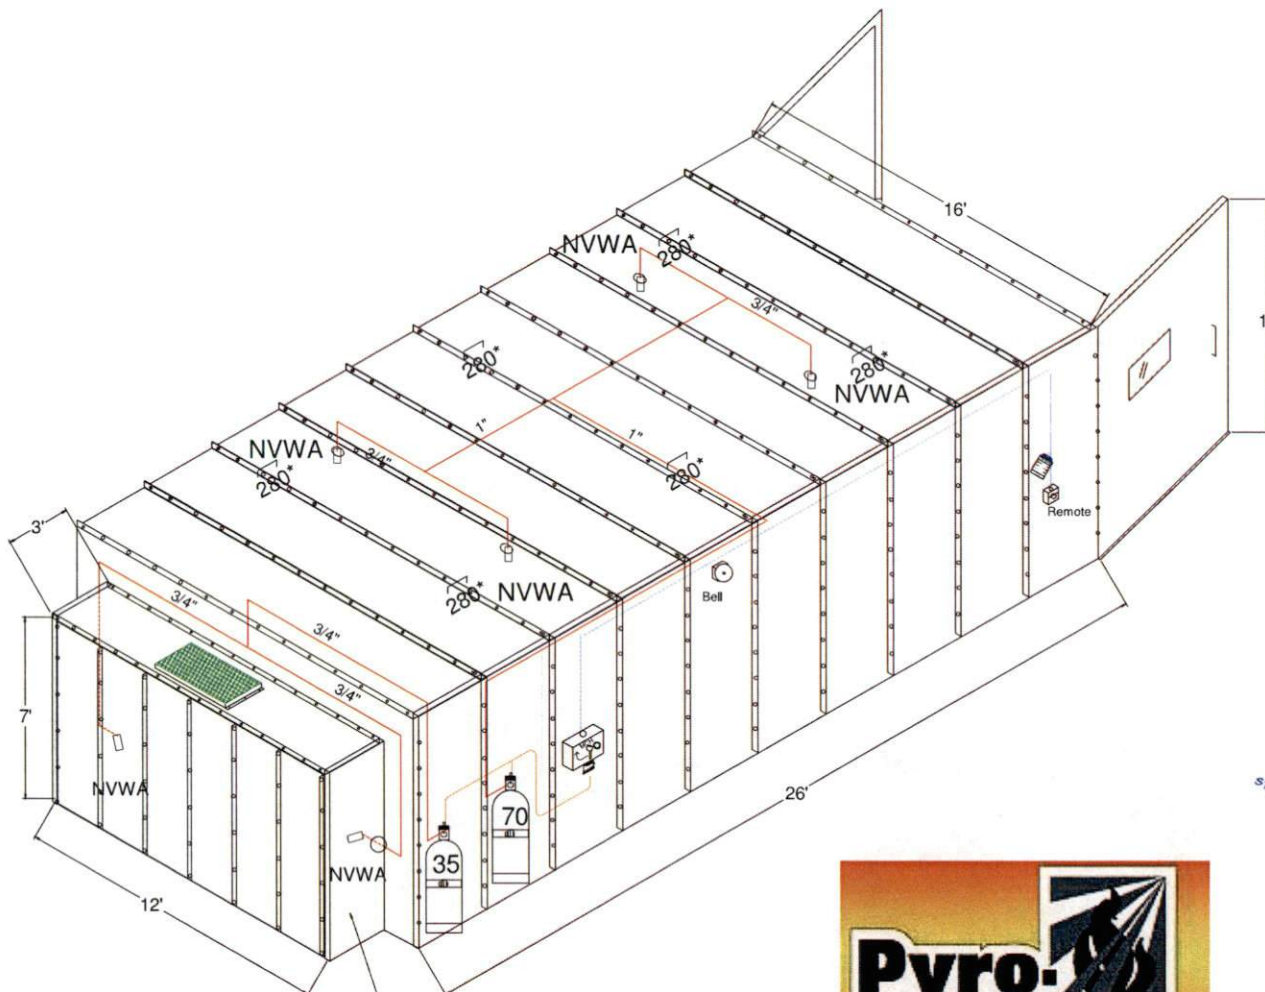

Recirculation Plenum  
No Exhaust Duct

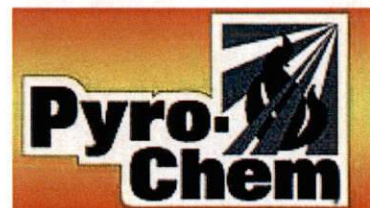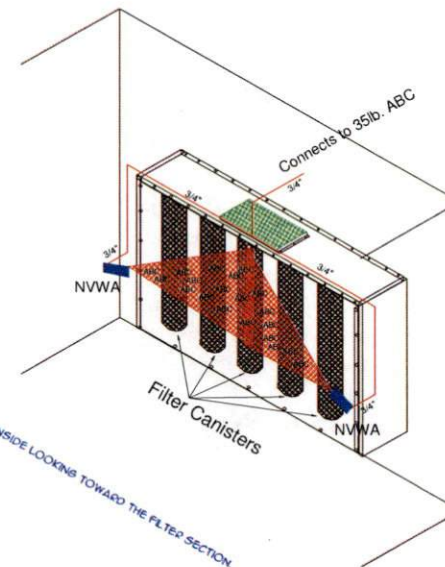

## PERMIT APPLICATION DRAWING

Date: 12/13/18



Pye Barker Fire & Safety  
710 Porter Road  
Rocky Mount, NC 27803

PJ's Truck Bodies  
1560 George Perry Lee Road  
Dunn, NC 28334