



Fire Marshal Division

P.O. Box 370
Lillington, NC 27546
910-893-7580

Reviewed For Code Compliance By:
D. Banks Wallace
Chief Deputy Fire Marshal
05/16/2019 9:29:51 AM

Application for Plan Review

Application # FMFW1905-0004

Date Received: 5/3/19 Received By: [Signature]

Name of Project: LAFAYETTE ELEMENTARY SCHOOL

Physical Address of Project: 108 LAFAYETTE SCHOOL RD.
KIPLING NC 27543

Plans Submitted By: BFPE INTERNATIONAL

Project Phone: (919) 552-4353

Contact Person/Address: KEVIN DECILLES

For Payment: → Cyndy Gilchrist cgilchrist@bfpe.com

Contact Phone: (919) 550-2699

Contractor's Name/Info: BFPE INTERNATIONAL
115 BESTWOOD DR. CLAYTON, NC 27520


Contractor's Phone: (919) 550-2699

Plans that are submitted will be reviewed as quickly as possible with an average time of review between 7-10 working days.

Status checks may be conducted on plan reviews by visiting the website <http://htweb.harnett.org/Click2GovBP/Index.jsp> or by calling the Harnett County Central Permitting Office (910-893-4759), or the Harnett County Fire Marshal's Office (910-893-7580).


Approved plans must be picked up from the Central Permitting Office and all fees paid before any required inspections can be conducted.

- * PULL STATION IN AISLE OF EGRESS
- * APPLIANCES ELECTRIC W/ SHUT OFF
- * MICRO SWITCH FOR SHUT DOWNS & ALARM
- * DETECTOR TEMP FIELD DETERMINED




ANSUL R-102
3.0 GALLON
UL 300
6 FLOW POINTS

SIDE B

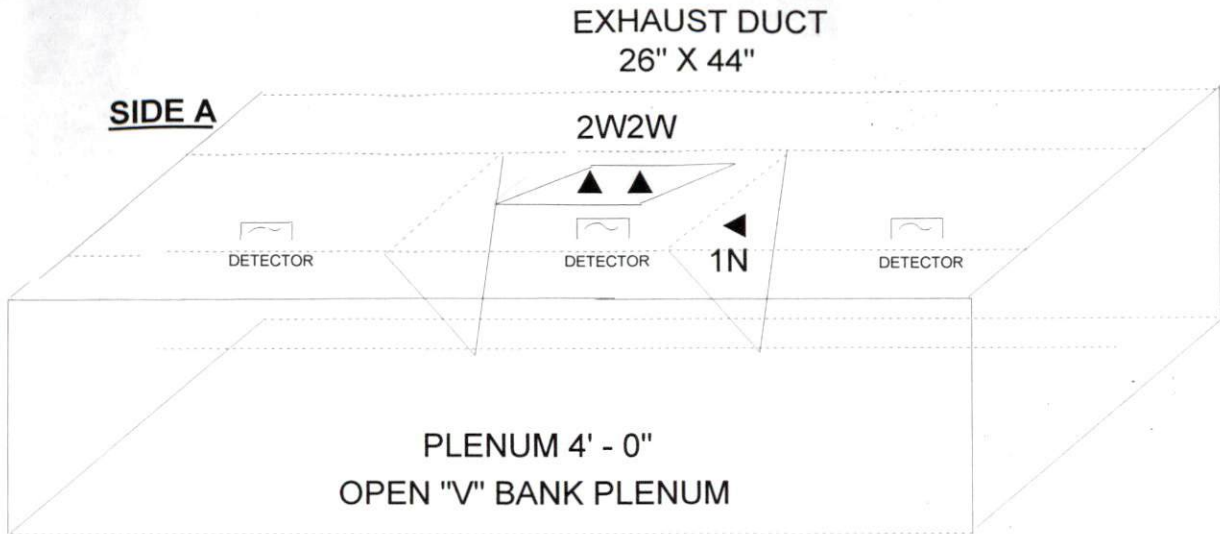

SIDE A



STEAM KETTLE



PROOFER



STEAMER




STEAMER

1N
▼

SIDE B



PROOFER



FLAT TOP RANGE
12" X 24"



CONV OVEN


LAFAYETTE ELEMENTARY SCHOOL
108 LAFAYETTE SCHOOL RD.
KIPLING, NC 27543

BFPE INTERNATIONAL NOT TO SCALE
115 BESTWOOD DRIVE 4/29/19
CLAYTON, NC 27520 BY: KFD *KFD*
PH: 919-550-2699 FAX: 919-550-0719

- * PUL' STATION IN AISLE OF EGRESS
- * APPLIANCES ELECTRIC W/ SHUT OFF
- * MICRO SWITCH FOR SHUT DOWNS & ALARM
- * DETECTOR TEMP FIELD DETERMINED




ANSUL R-102
3.0 GALLON
UL 300
6 FLOW POINTS

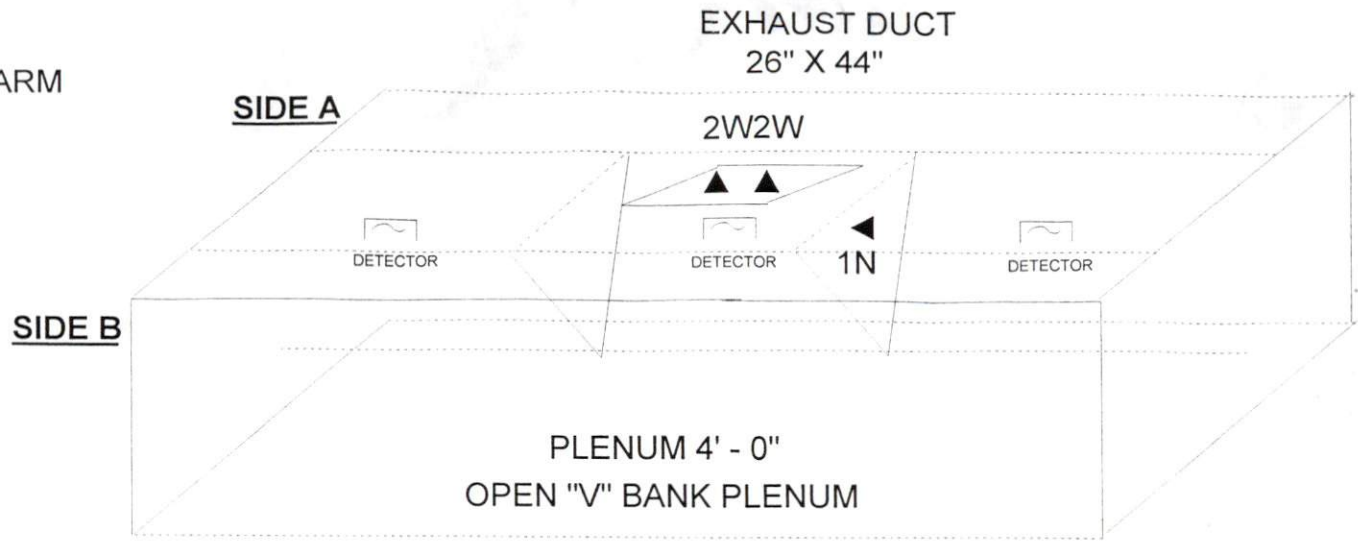

LAFAYETTE ELEMENTARY SCHOOL
108 LAFAYETTE SCHOOL RD.
KIPLING, NC 27543

SIDE A



STEAM KETTLE



PROOFER



STEAMER



STEAMER


1N




SIDE B



PROOFER



FLAT TOP RANGE
12" X 24"



CONV OVEN


COPY

BFPE INTERNATIONAL NOT TO SCALE
115 BESTWOOD DRIVE 4/29/19
CLAYTON, NC 27520 BY: KFD *KFD*
PH: 919-550-2699 FAX: 919-550-0719

- * PULL STATION IN AISLE OF EGRESS
- * APPLIANCES ELECTRIC W/ SHUT OFF
- * MICRO SWITCH FOR SHUT DOWNS & ALARM
- * DETECTOR TEMP FIELD DETERMINED




ANSUL R-102
3.0 GALLON
UL 300
6 FLOW POINTS

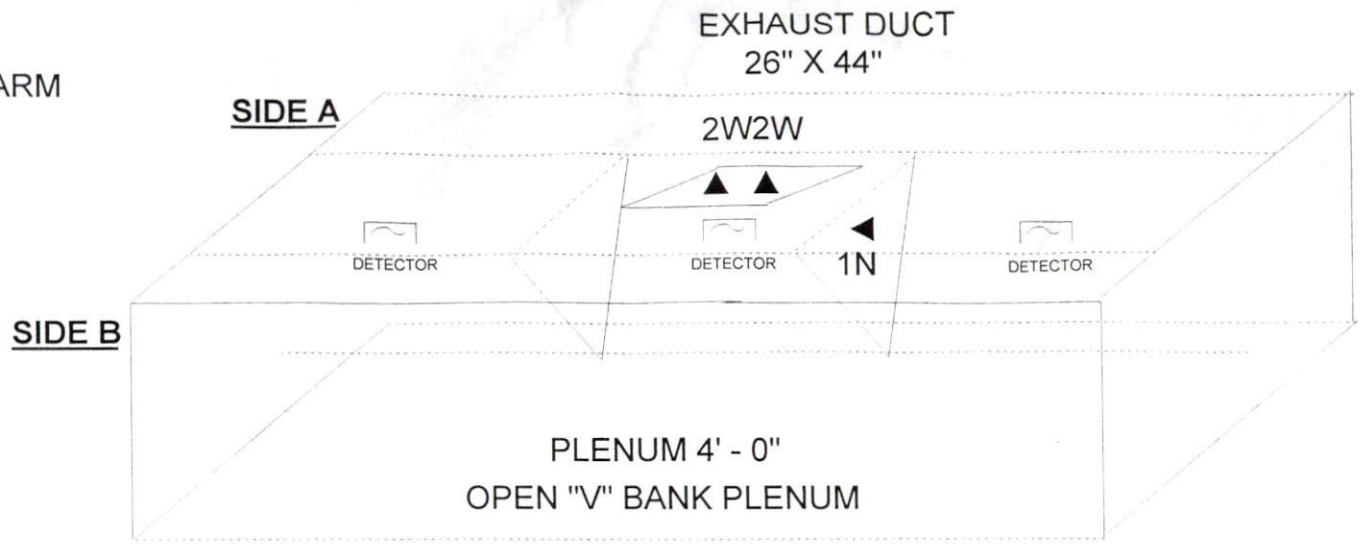


LAFAYETTE ELEMENTARY SCHOOL
108 LAFAYETTE SCHOOL RD.
KIPLING, NC 27543

SIDE A

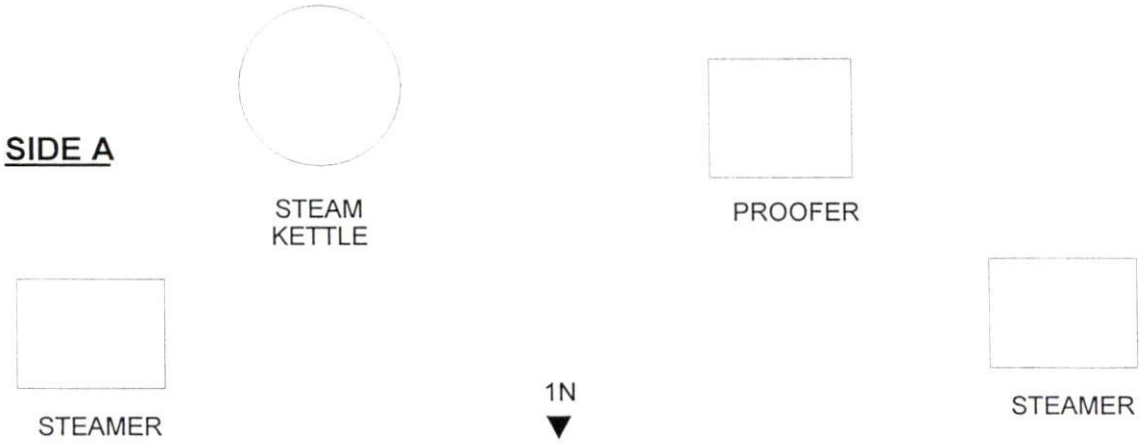

SIDE B

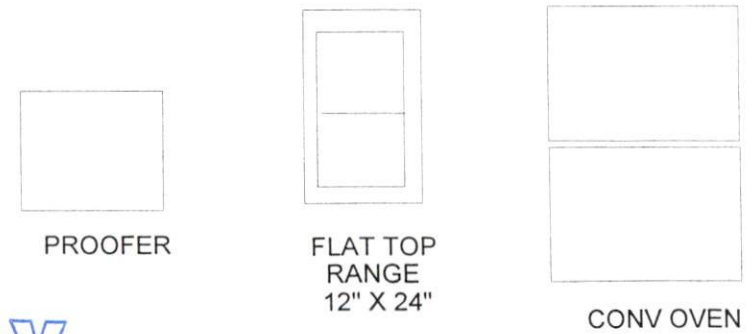

BFPE INTERNATIONAL NOT TO SCALE
115 BESTWOOD DRIVE 4/29/19
CLAYTON, NC 27520 BY: KFD *KFD*
PH: 919-550-2699 FAX: 919-550-0719

COPY



LETTER OF TRANSMITTAL

May 2, 2019

To:

Harnett County Building Inspections
108 E. Front Street
Lillington, NC 27546

Attention: Plans Review and Permits

RE:

Lafayette Elementary School
108 Lafayette School Road
Kipling, N.C. 27543

Re: Kitchen Fire Suppression

We are sending you: Attached Via: UPS Hand Delivered
 Drawings Prints Plans Permit Application

<u>Copies</u>	<u>Description</u>
3	Shop Drawing of Kitchen fire suppression system
1	Application for Plan Review

For Approval For your use As requested Resubmitted for approval

COMMENTS: *****

Please call Cyndy Gilchrist 919-550-2699 for our credit card number for payment of fees as discussed with Ms. Jennifer Brock . Please notify us when approved and work can begin. Our scope of work consists of installation of fire suppression system only. Please forward permit to us. We will notify you when ready for test.

Copy to: File & Installation Dept.

Signed: 

BFPE International
Kevin F. DeCilles