

UL 300 HOOD FIRE SUPPRESSION SYSTEM

PULL STATION DETAIL - 1/2" CONDUIT STRAIGHT UP TO ABOVE CEILING LINE, NO OFFSETS OR BEND - 4" STANDARD ELECTRICAL OCTAGON BOX 42"-48" ABOVE FINISHED FLOOR OR IN ACCORDANCE WITH LOCAL CODE Code requires location between 10' and 20' on a normal path of egress NOTE: HEIGHT OF PULL STATION SHOULD BE DETERMINED IN ACCORDANCE WITH AUTHORITY HAVING JURISDICTION.

FIRE SYSTEM OPERATION

- 1. Kitchen hood shall be constructed and installed per NFPA 96.
- 2. Hood Electrical Control Panel and Fire Control System shall shut down kitchen hood make up air fan upon activation of fire extinguishing system. Kitchen hood exhaust fan shall continue to operate or power on upon activation. The hood electrical panel and fire system will provide interlock for automatic operation of fire suppression system with:
 - a. Mechanical gas valve (installed by mechanical/plumbing contractor, if gas used)
 - b. Hood supply and exhaust fan (wiring by elec)
 - c. Remote manual pull station (by hood fire system distr)
- d. Fire alarm system notification (if Bldg Fire Alarm present, by Fire alarm Contractor)
- . See Hood details for drawings
- 3. All exposed piping with fire suppression system shall be covered with a a chrome sleeve. 4. Mechanical contractor shall install conduit in wall for manual pull station. Pull Station shall be
- located at or near a means of egress from the cooking area.
- 5. Fire suppression system shall be in accordance with UL 300.

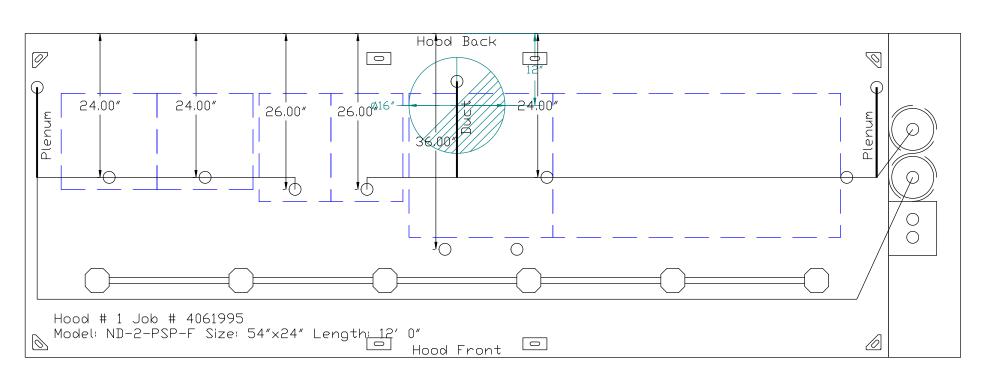

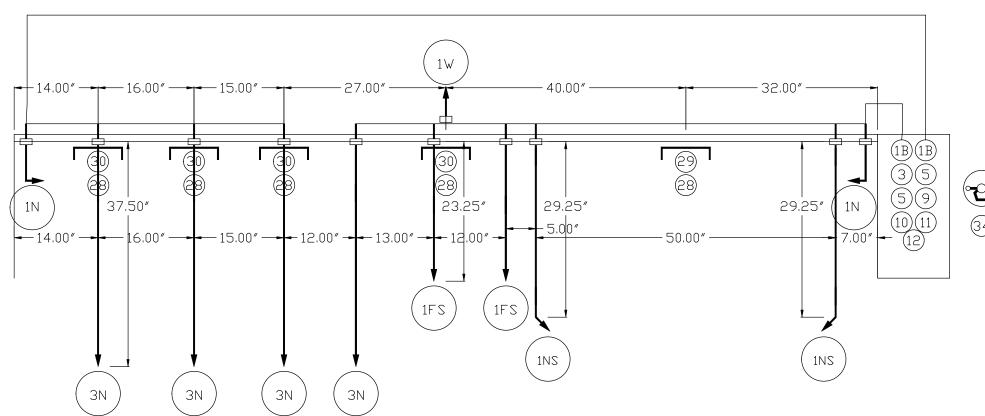


All Fire System Piping will be 3/8" schedule 40 black iron.


NC FIRE CODE 904.11.2

System Interconnection:


The Actuation of the fire extinguishing system shall automatically shut down the fuel or

electrical power supply to the cooking equipment. The Fuel and electrical supply reset shall be manual.



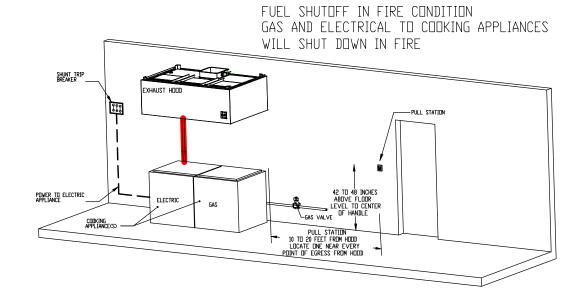

CAPTIVE-AIRE HOODS ARE BUILT IN COMPLIANCE WITH:

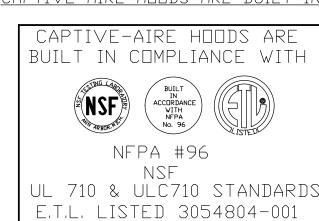

FOR QUESTIONS CONTACT: JOE WYLIE

NORTH CAROLINA REGIONAL OFFICE PHONE: (919) 825-3566 EMAIL: REG36@CAPTIVEAIRE.COM FAX: (919) 227-5917

- FIELD PIPE DROPS AS SHOWN

SLEEVING, ELBOWS, TEES, AND NOZZLES SUPPLIED BY CAS

- RELOCATE NOZZLES IF FLOW PATTERN IS BLOCKED BY SHELVING, SALAMANDERS, ETC.

- MAXIMUM 9 ELBOWS IN SUPPLY LINE. - MINIMUM 72 INCHES OF AGENT LINE FROM TANK TO FIRST NOZZLE. - IF APPLICABLE, PRE-PIPED CHARBROILER DROPS ARE SHIPPED LOOSE. - FACTORY PIPING EXTENDS A MAXIMUM OF 6" ABOVE THE TOP OF THE HOOD.

- APPLIANCE DIMENSIONS LISTED REPRESENT THE COOKING SURFACE SIZE, NOT THE OVERALL APPLIANCE SIZE.

- THIS FIRE SYSTEM COMPLIES WITH U.L. 300 REQUIREMENTS

Job #: 4061995

Job Name: HARNETT CROSS FOOD MART

System Size: ANSUL-3.0/3.0 Total FP required: 19 Hood # 1 12' 0.00" Long \times 54" Wide \times 24" High

Riser # 1 Size: 16" Dia.

<u>LEGEND - FIRE CABINET ANSUL SYSTEM</u>

1.5 GALLON TANK 3 GALLON TANK MEM AUTOMAN RELEASE DEM REGULATED RELEASE DEM REGULATED ACTUATOR

CARTRIDGE (101-20)

TEST LINK

HOSE ASSEMBLY DUCT NOZZLE (430913)

NOZZLE ASSEMBLY (419338) NOZZLE ASSEMBLY (419340) NOZZLE ASSEMBLY (419339)

NOZZLE ASSEMBLY (419342) NOZZLE ASSEMBLY (419341) DETECTOR BRACKET

HIGH TEMP FUSIBLE LINK MGV MECHANICAL GAS VALVE ELECTRICAL GAS VALVE

SWIVEL ADAPTOR

Hood # 1 Metal Blow-Off Caps included.

ANSULEX LIQUID AGENT (3 GAL.) ANSULEX LIQUID AGENT (1.5 GAL.) CARTRIDGE (101-10) CARTRIDGE (101-30) CARTRIDGE (LT-A-101-30) DOUBLE TANK CARTRIDGE DOUBLE MICROSWITCH

DUCT NOZZLE (419337) NOZZLE ASSEMBLY (419336) NOZZLE ASSEMBLY (419333) NOZZLE ASSEMBLY (419335) NOZZLE ASSEMBLY (419334)

NOZZLE ASSEMBLY (419343)

LOW TEMP FUSIBLE LINK

REMOTE MANUAL PULL STATION

Reviewed For Code Compliance By: D. Banks Wallace **Chief Deputy Fire Marshal**

02/03/2020 11:04:50 AM

REVISIONS

DATE: 11/11/19

DWG.#: REG36

DRAWN BY: jwylie36 **SCALE:**

3/4" = 1'-0" **MASTER DRAWING**

SHEET NO.