



Amerex Pre-Engineered Fire Suppression System

Wet Chemical - Kitchen System


Installation Location:

Johnston County Mart
2525 Johnston County Road
Angier, NC 27501

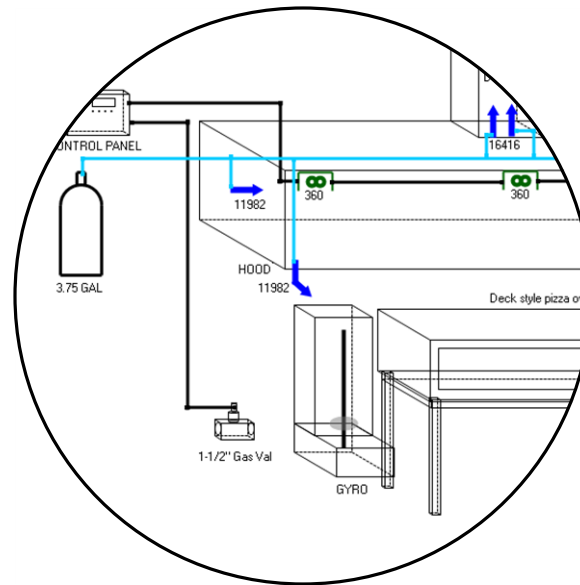

All American Fire Protection
159 S Main St
Spring Lake, NC 28390-3901
910-496-0600
msmith@allamericanfireusa.com

Amerex Pre-Engineered Fire Suppression System

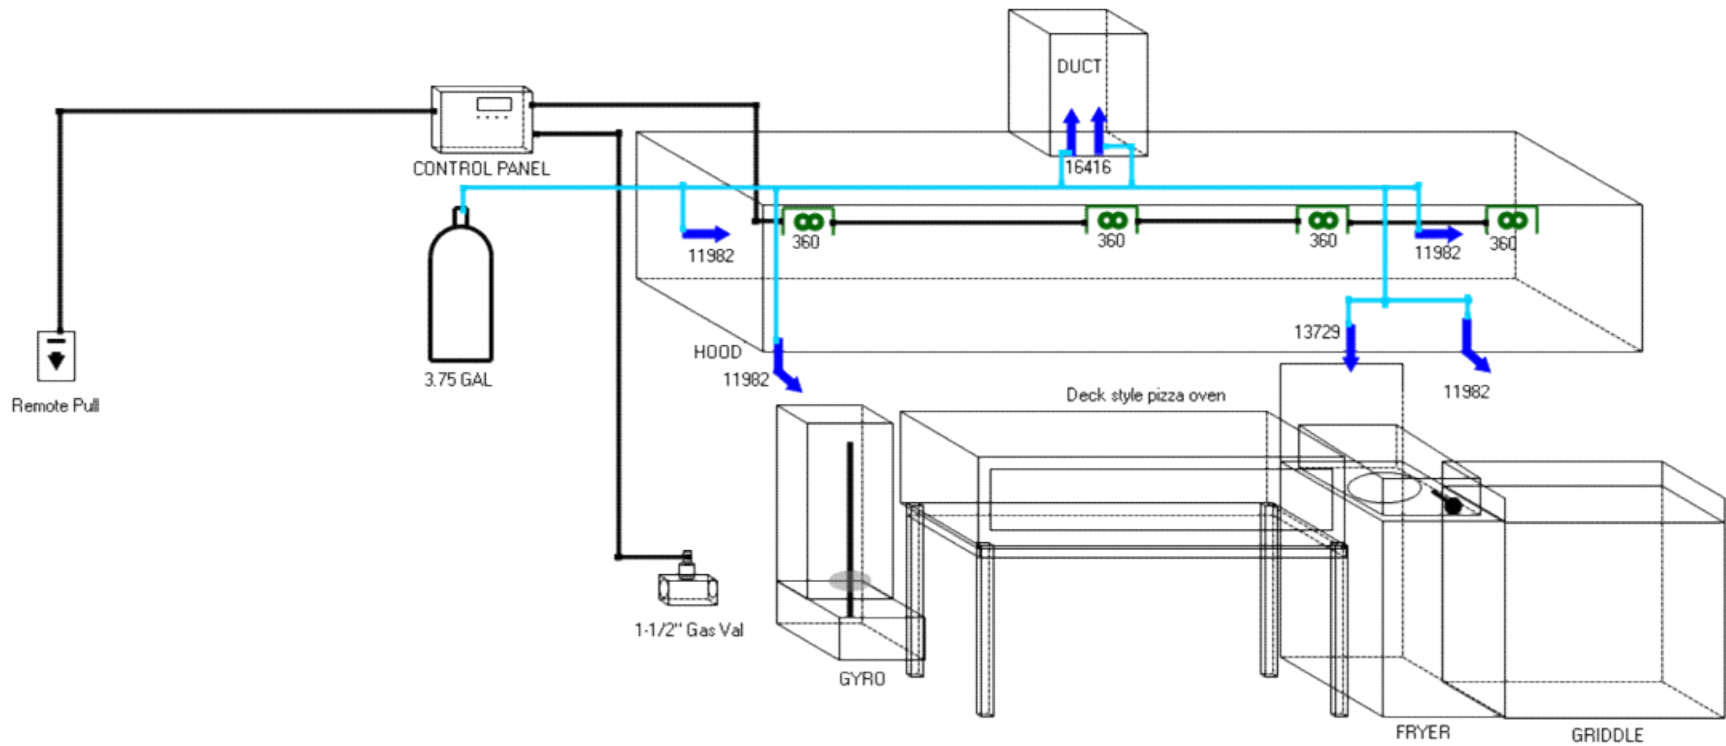

Total System Flow Points = 11 : Flow Points Used = 8



Designed & Installed by:
 All American Fire Protection
 159 S Main St
 Spring Lake, NC 28390-3901
 910-496-0600

For:
 Johnston County Mart
 2525 Johnston County Road
 Angier, NC 27501

Designer:
 Job: UL300 fire system upgrade
 Date: 8/15/2023

Amerex Pre-Engineered Fire Suppression System

Notes

- UL300 upgrade of existing hood system. New system is an Amerex KP375 using 3/8" black steel piping, automatic gas shutoff valve, remote manual release mounted in path of egress, fusible metal links, microswitch for supply air and electric shutdown. System has an 11 flow point capacity, and this application uses 8. Single 3.75 gallon tank supplies coverage to hood, duct and all appliances.

Hood - 12'L x 4"W

Duct - 16" x 16"

Equipment - Upright gyro broiler, 60" deck style pizza oven, 16" round pressure fryer, 36" x 22" griddle.

**Upright broiler is not listed in Amerex manual, as they do not require coverage. We have chosen to protect it as a radiant broiler.



Designed & Installed by:
All American Fire Protection
159 S Main St
Spring Lake, NC 28390-3901

For:
Johnston County Mart
2525 Johnston County Road
Angier, NC 27501