
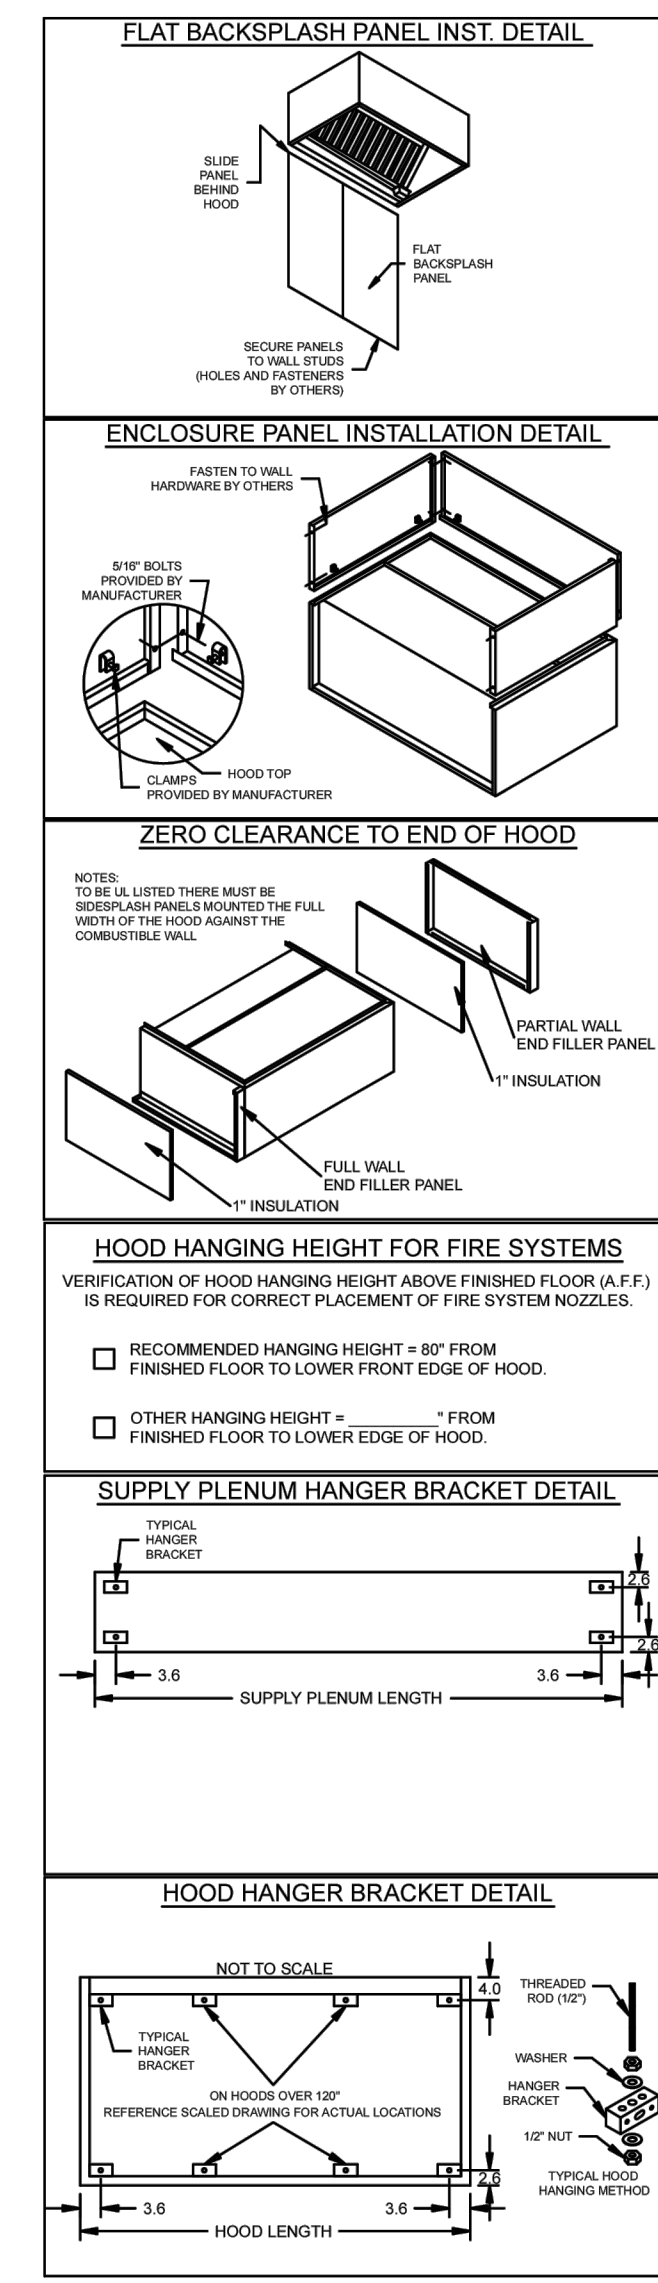
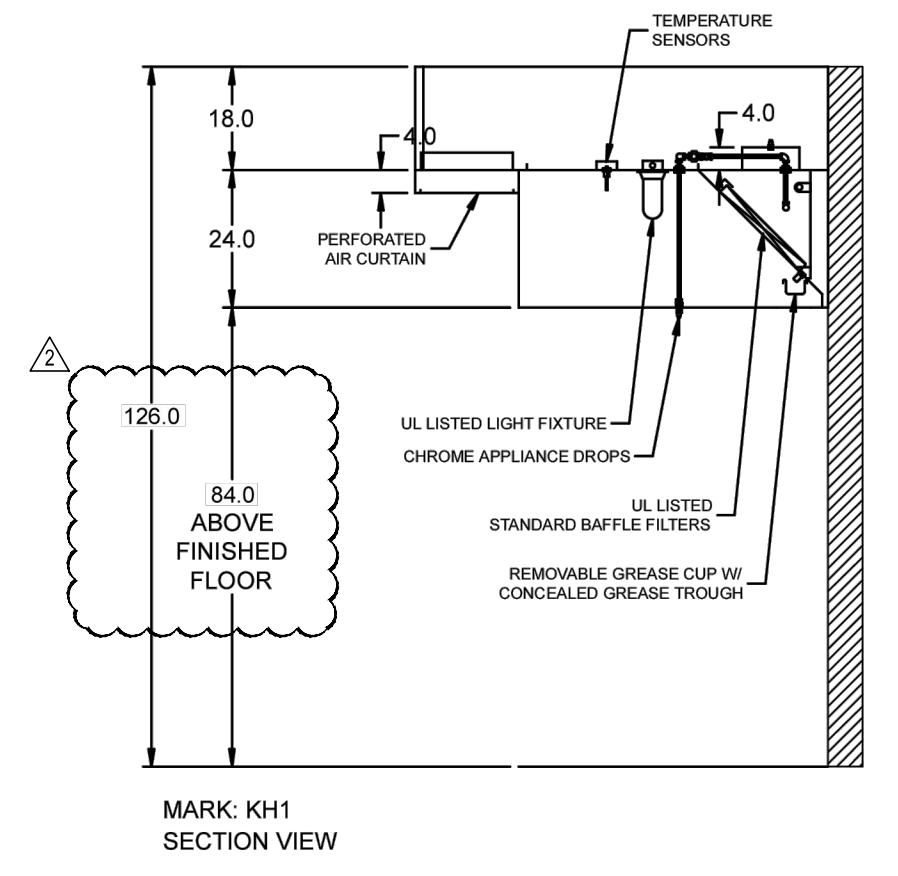
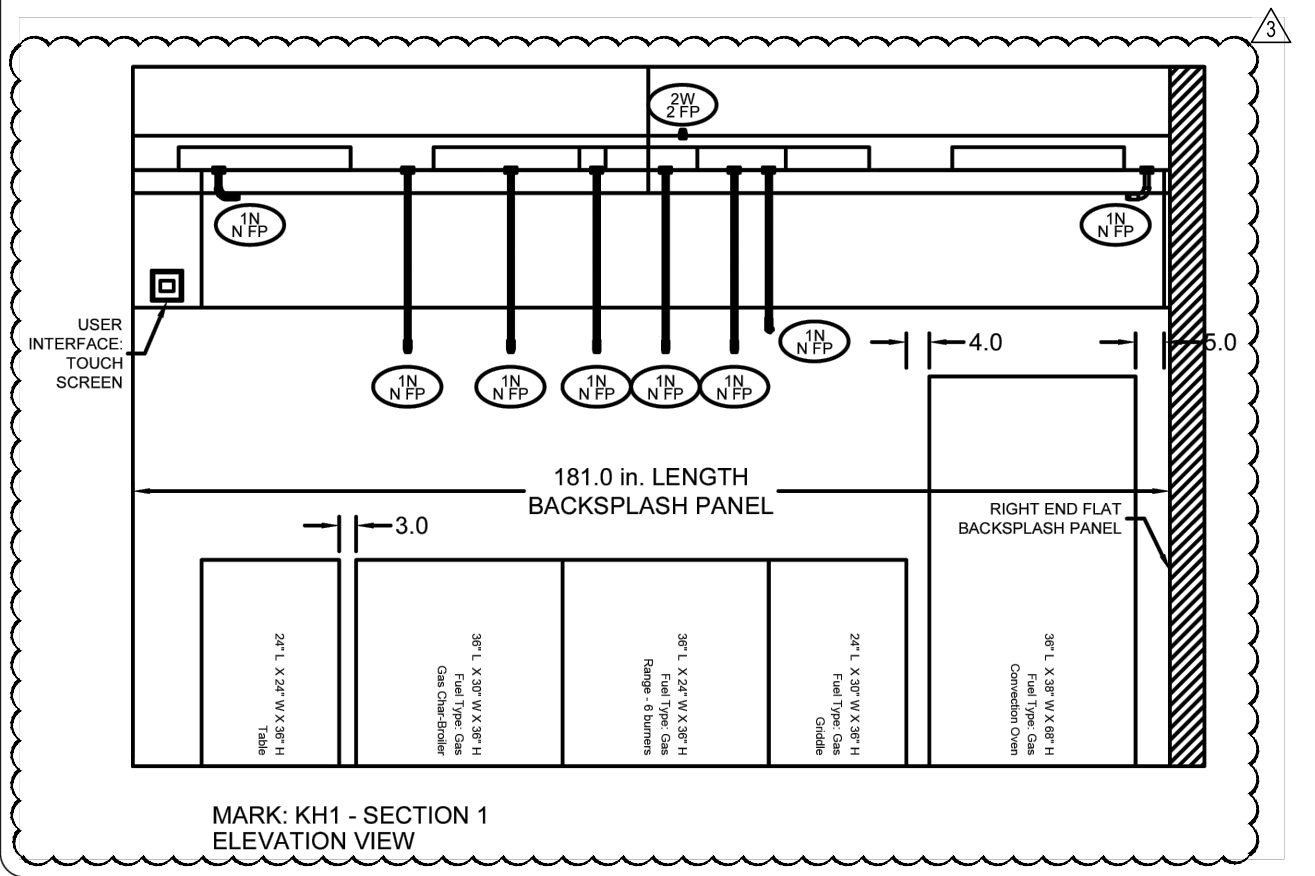


HOOD INFORMATION															
HOOD NO.	MARK	MODEL	HOOD DIMENSIONS (IN.)			HOOD CONSTR.	COOKING LOAD / DUTY RATING	TOTAL CFM	EXHAUST COLLAR(S)			SECTION LOCATION			
			LENGTH	WIDTH	HEIGHT				WIDTH	LENGTH	DIA.		CFM	S.P.	
1	KH1	XBEW-168-S	168	54	24	430 SS WHERE EXPOSED	HEAVY	4000	10	36	4000	0.515	3200	394 22	SINGLE

HOOD INFORMATION															
HOOD NO.	MARK	LIGHTING DETAILS				GREASE FILTRATION DETAILS				UTILITY CABINET(S)					
		FIXTURE TYPE	BULB / LAMP INFO	QTY	FOOT CANDLES	TYPE / MODEL	MATERIAL	QTY	SIZE (IN.)	LOCATION	FIRE SYSTEM	TYPE	SIZE	MODEL	INTERFACE
1	KH1	INCANDESCENT (LOBE)	100W A19 (BULBS NOT INCL.)	8	53.81	BAFFLE	STAINLESS STEEL	2	8 1/2	20	LEFT	ANSUL R102	3	XKC	TOUCHSCREEN

SUPPLY PLENUM INFORMATION																		
HOOD NO.	MARK	POS.	TYPE	SIZE (IN.)			INSULATED	DAMPER(S)	LED LIGHT(S) SUPPLIED	QTY	TOTAL CFM	COLLARS						
				L	W	H						TOTAL S.P.	TYPE	MOUNTING	QTY	W	L	DIA.
1	KH1	FRONT	ASP	90.5	18	4	NO	YES	NO	1600	0.01	MUA	FACTORY	2	16	30	800	240
1	KH1	FRONT	ASP	90.5	18	4	NO	YES	NO	1600	0.01	MUA	FACTORY	2	16	30	800	240

HOOD OPTIONS
 UL 710 LISTED W/O EXHAUST FIRE DAMPER - UL #R25625
 BACK INTEGRAL AIR SPACE - 3 IN WIDE
 RIGHT NON-INTEGRAL AIR SPACE - 1 IN THICK - ZERO CLEARANCE
 18 IN HIGH CEILING ENCLOSURES - FRONT LEFT - FIELD INSTALLED
 FACTORY MOUNTED EXHAUST COLLAR(S)
 BACKSPASH 80.00 IN HIGH 181.00 IN LONG
 RIGHT SIDESPASH 80.00 IN HIGH 54.00 IN LONG
 PERFORMANCE ENHANCING LIP (PEL) TECHNOLOGY
 STANDING SEAM CONSTRUCTION FOR SUPERIOR STRENGTH

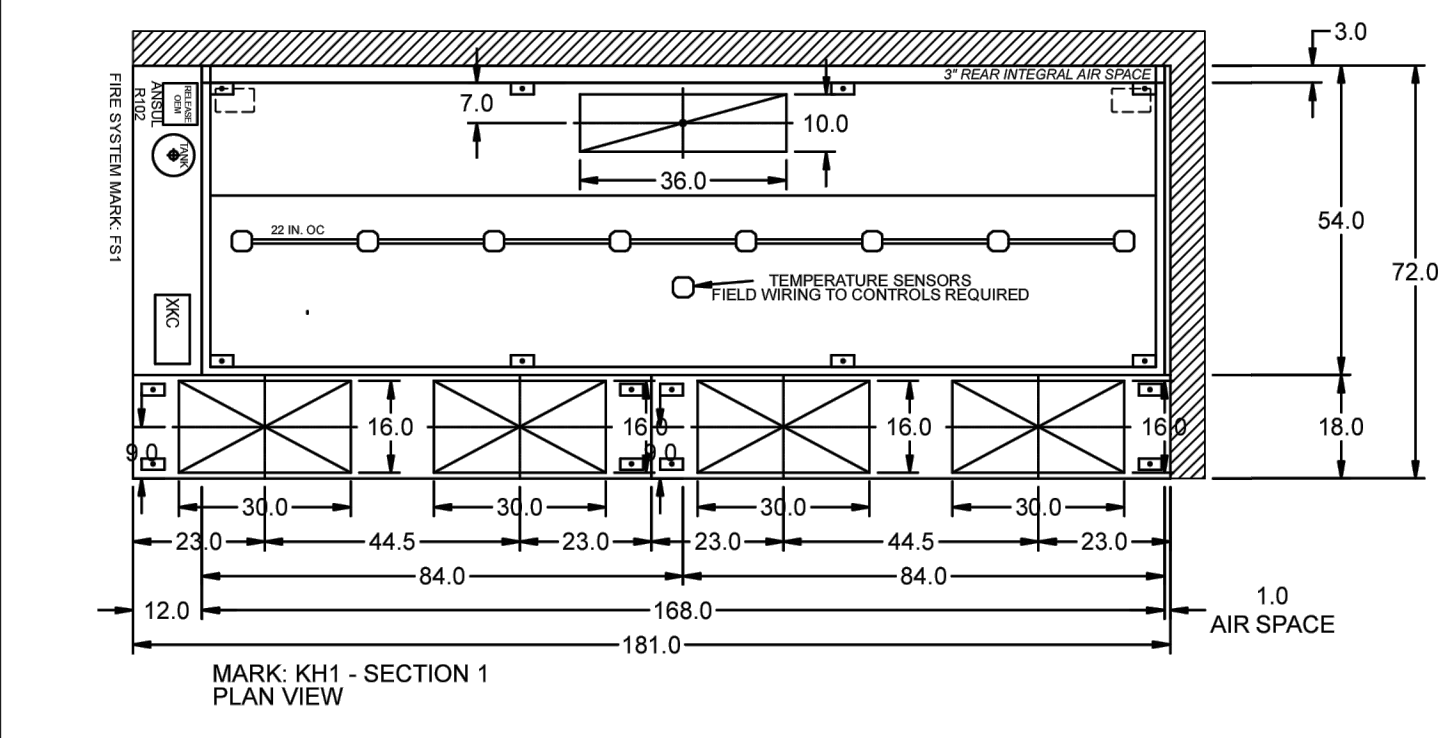

PROJECT: 02232023
 MARK: KH1
 HARVEY JOHN'S STEAKHOUSE
 ACCUREX COASTAL CAROLINAS
 MIKE NOMAK
 MIKE.NOMAK@ACCUREX.COM
 (910)556-7429
ACCUREX

Scope Note:
 The Kitchen Equipment Supplier shall furnish the kitchen hoods, hood exhaust and supply fans, Ansul system, and controls. The mechanical contractor shall be responsible for installing all equipment and providing all connecting ductwork.

1 Kitchen Hood Details
 Scale: None