

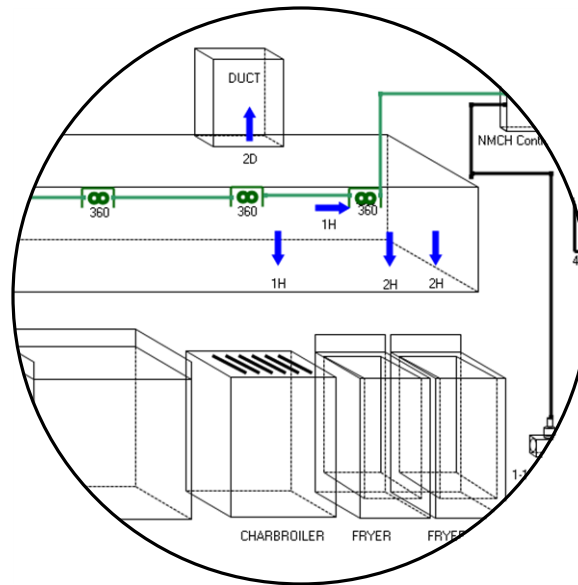


# Pyro-Chem Pre-Engineered Fire Suppression System

Wet Chemical - Kitchen System


Installation Location:

Lost Paddle  
100 South Main Street  
Lillington, NC 27546



All American Fire Protection  
159 S Main St  
Spring Lake, NC 28390-3901  
910-496-0600  
msmith@allamericanfireusa.com

# Pyro-Chem Pre-Engineered Fire Suppression System

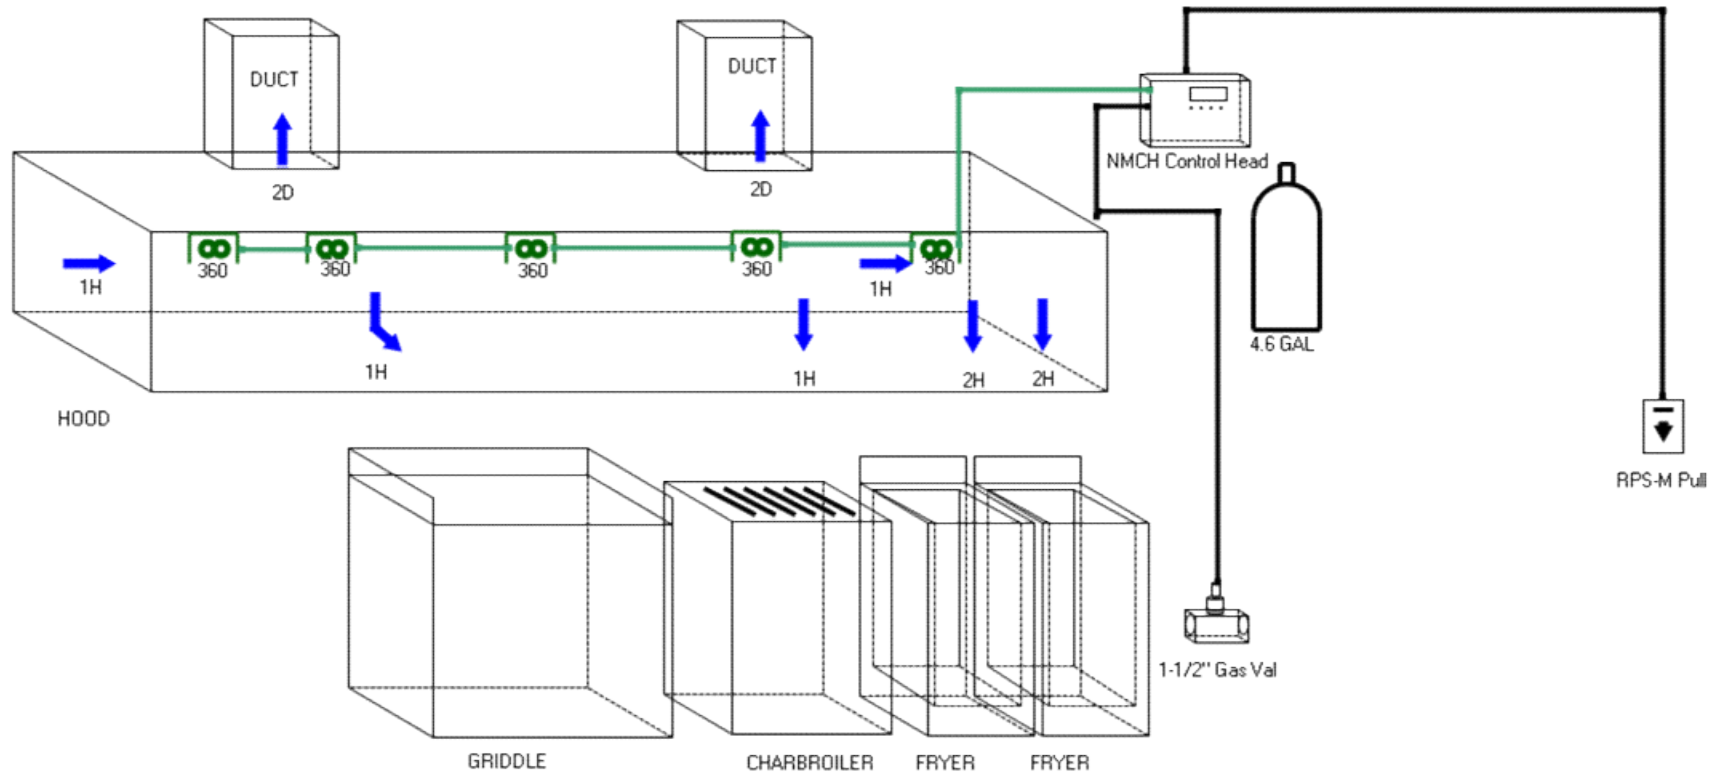

Total System Flow Points = 15 : Flow Points Used = 12



Designed & Installed by:  
 All American Fire Protection  
 159 S Main St  
 Spring Lake, NC 28390-3901  
 910-496-0600

For:  
 Lost Paddle  
 100 South Main Street  
 Lillington, NC 27546

Designer:

Job: Adjust piping for proper coverage

Date: 9/19/2023

# Pyro-Chem Pre-Engineered Fire Suppression System

## Notes

- Adjust piping for new equipment coverage.

System is a Pyrochem PCL460 using 3/8" black steel piping, fusible metal links, automatic gas shutoff valve, remote manual release, microswitch for supply air shutdown. System has a 15 flow point capacity, and this application uses 12.

Hood - 12'L x 4"W

Ducts- 2 @ 8" x 14"

Equipment - 36" x 22" griddle, 24" x 22" chargrill, 2 fryers @ 14" x 24"



Designed & Installed by:  
All American Fire Protection  
159 S Main St  
Spring Lake, NC 28390-3901

For:  
Lost Paddle  
100 South Main Street  
Lillington, NC 27546