

Anderson Creek the Lodge - 322 Falls Creek Dr

GENERAL NOTES:

INSTALLATION PER IFC-2018, NFPA 96, 17A, AND UL 300 STANDARDS AND PER MANUFACTURERS' INSTRUCTIONS/RECOMMENDATIONS DESIGN BASED ON SECTION IV OF ANSUL R-102 INSTALLATION MANUAL

ALL PIPE AND FITTINGS ARE 3/8" SCHEDULE 40 BLACK IRON & CHROME PIPING CONFIGURATIONS & LIMITATIONS ARE TOO LENGTHY TO LIST PIPING SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S REQUIREMENTS SEE CHAPTER 4 - DISTRIBUTION PIPING REQUIREMENTS

ACTUATION & EXPELLENT HOSES, PIPING OR TUBING SHALL BE INSTALLED IN ACCORDANCE WITH CHAPTER 5:"INSTALLING THE ACTUATION & EXPELLANT GAS LINES"

DETECTION LINE LIMITATIONS SHALL BE INSTALLED IN ACCORDANCE WITH ANSUL'S TECHNICAL MANUAL CHAPTER 4 - SYSTEM DESIGN
SCISSOR STYLE DETECTORS SHALL BE USED WITHOUT OFF-SET CONDUIT.
MAXIMUM # OF DETECTORS IS 15. MAXIMUM NUMBER OF CORNER PULLEYS IS 20 WITH A MAXIMUM OF 150' OF 1/2" EMT
FUSIBLE LINK INSTALLATION SHALL CONFORM TO MANUFACTURER'S INSTRUCTIONS APPLIANCES WITH A CONTINUOUS COOKING SURFACE UP TO 48" X 48" SHALL BE PROTECTED WITH A SINGLE DETECTOR
APPLIANCES EXCEEDING 48" X 48" SHALL BE PROTECTED BY MULTIPLE DETECTORS

REMOTE MANUAL PULL STATION(S) SHALL BE INSTALLED ON A PATH OF EGRESS OR EXIT AND IN ACCORDANCE WITH ANSUL TECHNICAL MANUAL CHAPTER 4 - SYSTEM DESIGN
MAXIMUM NUMBER OF 20 CORNER PULLEYS, 150 FEET OF 1/2" EMT AND (1) TEE PULLEY

MECHANICAL GAS VALVE CONNECTIONS SHALL BE MADE IN ACCORDANCE WITH CODE REQUIREMENTS & CHAPTER 4 - SYSTEM DESIGN OF THE ANSUL R-102 MANUAL
A MAXIMUM OF 20 CORNER PULLEYS, 150 FEET OF 1/2" EMT AND (1) TEE PULLEY

ELECTRIC GAS VALVES SHALL BE CONNECTED USING A RESET RELAY
RESET RELAY & ELECTRICAL PORTION OF VALVE INSTALLATION SHALL BE BY A QUALIFIED ELECTRICIAN
CONFORMANCE WITH NFPA #70 IS THE RESPONSIBILITY OF THE INSTALLING CONTRACTOR NOT FIRE PROTECTION

CONNECTION TO FIRE ALARM CONTROL PANEL TO BE MADE BY OTHERS WHEN APPLICABLE
ELECTRICAL DISCONNECTS TO BE PERFORMED BY QUALIFIED ELECTRICIAN, WHEN APPLICABLE
GAS VALVE TO BE INSTALLED BY A QUALIFIED PLUMBER WHEN APPLICABLE
CONFORMANCE TO APPLICABLE NFPA CODES FOR ALARM, ELECTRICAL & PLUMBING WORK IS THE RESPONSIBILITY OF THE INSTALLING CONTRACTOR & IS NOT THE RESPONSIBILITY OF FIRE PROTECTION

CONDITION AND ACCEPTABILITY OF THE EXHAUST HOOD & DUCT IS THE RESPONSIBILITY OF THE OWNER/OPERATOR

APPLIANCES SHOWN ON PLANS ARE REPRESENTATIONAL ONLY - ACTUAL APPLIANCES MAY APPEAR DIFFERENT THAN SHOWN ON PLANS

GENERAL SEQUENCE OF OPERATION - NOT PROJECT SPECIFIC

UPON ACTIVATION OF A FUSIBLE LINK OR REMOTE MANUAL PULL STATION AN ANSUL R-102 WET CHEMICAL FIRE SYSTEM MAY RESULT IN THE FOLLOWING SEQUENCE OF OPERATION:

WET CHEMICAL SHALL DISCHARGE ONTO PROTECTED APPLIANCES & INTO DUCT & PLENUM AREAS OF HOOD
SIMULTANEOUSLY, IF CONNECTED, A FIRE ALARM SYSTEM SHALL BE ACTIVATED OR A HORN/STROBE SHALL ACTIVATE (PRECISE OPERATIONS OF FIRE ALARM SYSTEM / CONTROL PANEL ARE NOT THE RESPONSIBILITY OF THE SUPPRESSION SYSTEM CONTRACTOR AND ARE NOT LISTED ON THESE PLANS)
SIMULTANEOUSLY, ALL GAS APPLIANCES LOCATED UNDER THE HOOD SHALL SHUTDOWN VIA MECHANICAL OR ELECTRICAL GAS VALVE
SIMULTANEOUSLY, ALL ELECTRICAL EQUIPMENT, PROTECTED OR UNPROTECTED, UNDER THE HOOD SHALL SHUTDOWN
SIMULTANEOUSLY, HOOD LIGHTS, AS PERMITTED BY CODE MAY REMAIN ON OR MAY SHUTDOWN
SIMULTANEOUSLY, INTERNAL MAKE-UP AIR SHALL SHUTDOWN
SIMULTANEOUSLY, EXTERNAL MAKE-UP AIR MAY REMAIN ON OR MAY SHUTDOWN
SIMULTANEOUSLY, EXHAUST FAN MAY OR MAY NOT CONTINUE TO OPERATE (IF THE EXHAUST FAN IS OFF AT THE TIME OF DISCHARGE, THE FAN MAY OR MAY NOT TURN ON)

I.D. DESCRIPTION

- K1** USED R102 CONTROL HEAD CONTAINS (1) CARTRIDGE, (1) SET OF MICROSWITCHES
- K2** CYLINDER #1&2 - (2) R102 3 GALLON TANK 22 FLOW POINTS AVAIL. 14 USED
- K3** HOOD #1: USED TYPE I EXHAUST HOOD: 12'-0" X 78" W/ A SINGLE BANK OF BAFFLED FILTERS CONTAINS (2) EXHAUST DUCTS: 14" X 14"
- K4** USED MECHANICAL GAS VALVE LOCATED ABOVE THE CEILING
- K5** USED REMOTE MANUAL PULL STATION LOCATED 48" A.F.F. ON PATH OF EGRESS OR EXIT

N1

N2

N3

2W NOZZLE: DUCT PROTECTION

NOZZLE ID: 2W-X FLOW POINTS: 2
MAXIMUM PERIMETER: 100"
MAXIMUM DIAMETER: 32"
LOCATION: CENTERED W/IN PERIMETER
HEIGHT: 2" TO 8" ABOVE DUCT COLLAR

1N NOZZLE: PLENUM PROTECTION

NOZZLE ID: 1N-X FLOW POINTS: 1
LOCATION: 2 TO 4 IN. FROM FILTER FACE & CENTERED BETWEEN FILTER HEIGHT
NOZZLE AIM: HORIZONTAL DOWN LENGTH
POSITIONED: 0 TO 6 IN. FROM END OF HOOD TO THE TIP OF THE NOZZLE.

1N NOZZLE: RANGE

NOZZLE ID: 1N-X
LOCATION: 10" FROM BURNER CENTER
MAXIMUM HEIGHT: 40"
MINIMUM HEIGHT: 30"
MAX. COVERAGE: 384 SQ. IN. // LONGEST SIDE: 32"

N4

N5

N6

1N NOZZLE: GRIDDLE COVERAGE

NOZZLE ID: 1N-X FLOW POINTS: 1
LOCATION: PERIMETER 0"-2" - AIM CENTER
HEIGHT: 40" TO 35"
MAX. COVERAGE: 1080 SQ. IN. // 36" LONGEST SIDE


1N NOZZLE: GAS RADIANT BROILER COVERAGE

NOZZLE ID: 1N-X
LOCATION: ANYWHERE ALONG OR WITHIN
HEIGHT: 40" TO 15"
MAX. COVERAGE: 864 SQ. IN. // LONGEST SIDE 36"

3N NOZZLE: FRYER COVERAGE

NOZZLE ID: 3N-X FLOW POINTS: 3
LOCATION: FRONT 1/2 OF FRYPOT - PERIMETER-AIM CENTER
NOZZLE HEIGHT: 35" TO 25"
MAX. COVERAGE: 18" X 18" FRYPOT (18" X 27 3/4" OVERALL)

I.D. NOZZLE DESCRIPTION

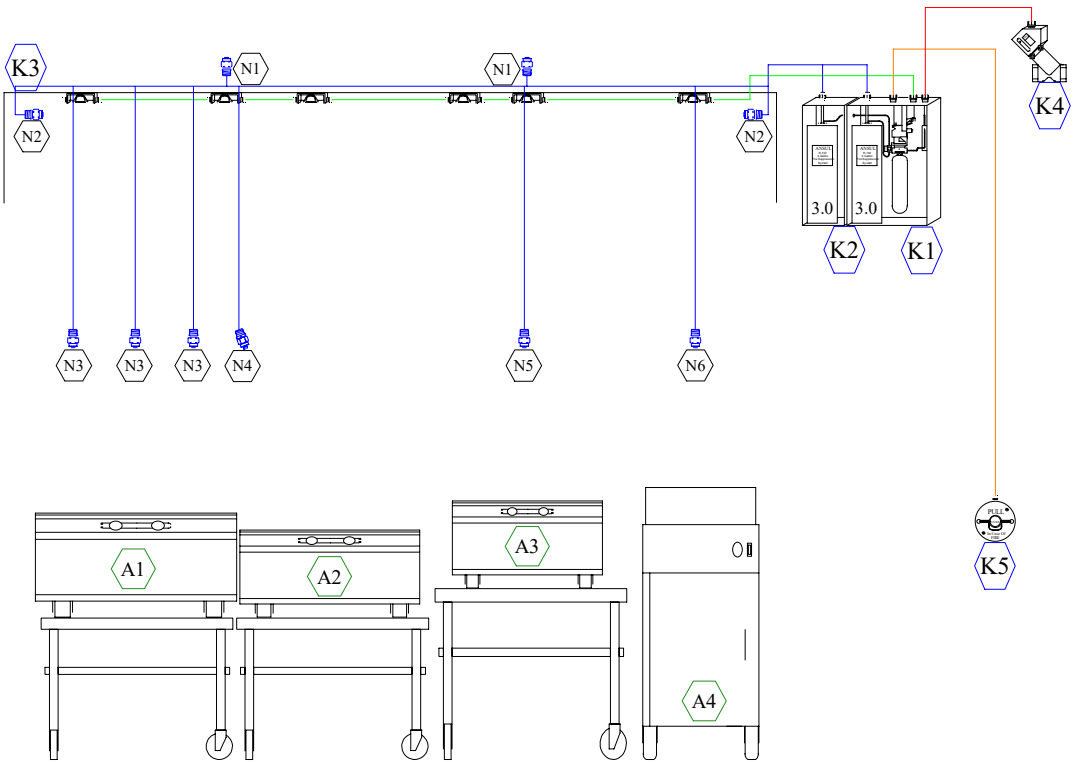

I.D. APPLIANCE DESCRIPTION

- A1** 6 BURNER RANGE 36" X 24"
- A2** GRIDDLE 36" X 22"
- A3** CHARBROILER 36" X 22"
- A4** FRYER 15" X 25"

PROJECT NAME & ADDRESS:

Anderson Creek the Lodge

322 Falls Creek Dr
Spring Lake, NC 28390

ANSUL MANUAL #:	418087-12	NOTES:	
DRAWING #:	1 OF 1		
SCALE:	NTS	DATE:	2/1/24
DRAWN BY:	JCA		

FIRE PROTECTION

1048 Bragg Blvd, Fayetteville, NC 28301
Phone: 910-486-6270