
## **Protex Pre-Engineered Fire Suppression System**


Wet Chemical - Kitchen System



## **Installation Location:**


Baptist Grove Church 6140 Christian Light Road Fuquay Varina, NC 27526

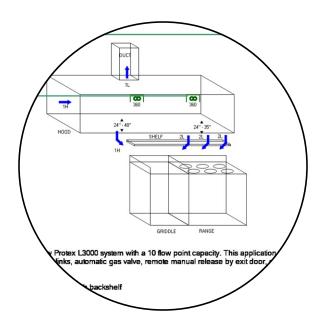



All American Fire Protection 159 S Main St Spring Lake, NC 28390-3901 910-496-0600 msmith@allamericanfireusa.com

## Protex Pre-Engineered Fire Suppression System

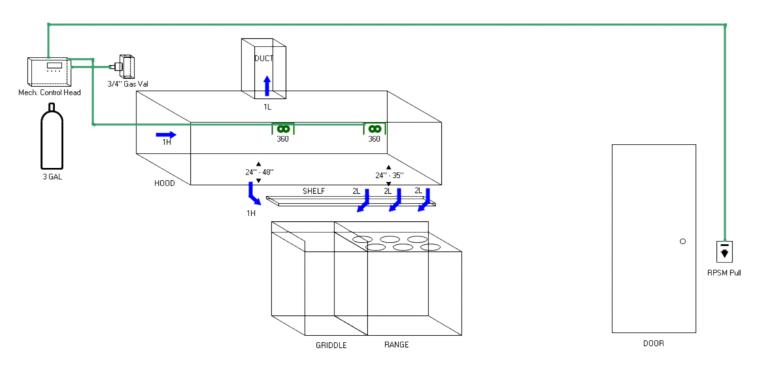

Existing fire system is being replaced with a new Protex L3000 system with a 10 flow point capacity. This application uses 9 flows. System uses 3/8" black steel piping, fusible metal links, automatic gas valve, remote manual release by exit door, switches for supply air shutdown. Hood - 8'L x 4'W

Duct - 12" x 12"

Equipment - 24" x 30" griddle, 36" x 24" 6 burner stove with backshelf

Total System Flow Points = 10 : Flow Points Used = 9



Designed & Installed by: All American Fire Protection 159 S Main St Spring Lake, NC 28390-3901 910-496-0600 For: Baptist Grove Church 6140 Christian Light Road Fuquay Varina, NC 27526 Job: UL300 fire system upgrade

Designer:

Date: 4/17/2024

Protex Pre-Engineered Fire Suppression System		
	Notes	
POINTS THE SET OF THE	Designed & Installed by: All American Fire Protection 159 S Main St Spring Lake, NC 28390-3901	For: Baptist Grove Church 6140 Christian Light Road Fuquay Varina, NC 27526

FlashPoints - www.flash-soft.com