



- * DETECTORS FIELD DETERMINED
- * PULL STATION IN AISLE OF EGRESS
- * GAS APPLIANCES W/ SHUT-OFF
- * MICRO SWITCH FOR SHUT DOWNS & ALARM




ANSUL R-102
 3 GALLON
 UL 300
 5 FLOW POINTS

NEW BREED BAPTIST CHURCH
 3900 US 401 NORTH
 FUQUAY VARINA, NC 27526

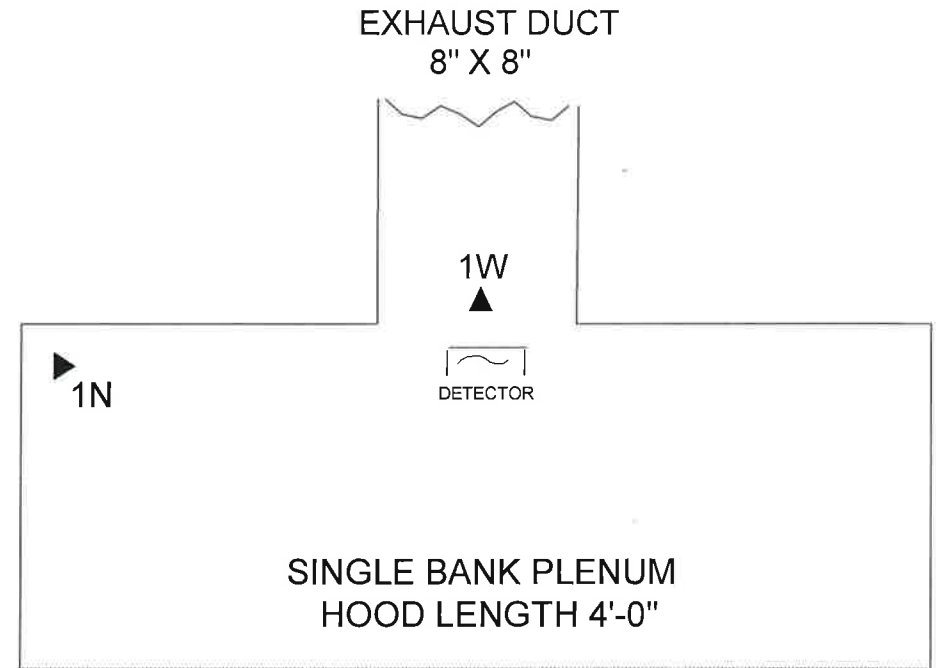

40"-50" 30"-40"
 245 1N
 ▼ ▼

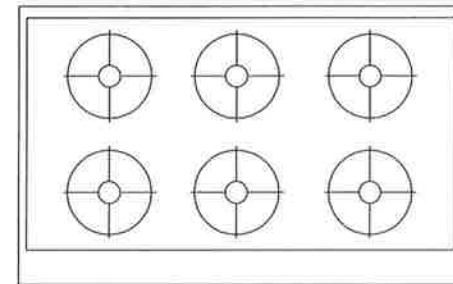

6 EYE RANGE
 36" X 24"

BFPE INTERNATIONAL	NOT TO SCALE
115 BESTWOOD DRIVE	5/1/24
CLAYTON, NC 27520	BY: KFD <i>[Signature]</i>
PH: 919-550-2699	FAX: 919-550-0719

WORK SCOPE: REPLACE OUTDATED SYSTEM WITH UL-300 SYSTEM