


- * DETECTORS FIELD DETERMINED
- * PULL STATION IN AISLE OF EGRESS
- * GAS APPLIANCES W/ SHUT-OFF
- * MICRO SWITCH FOR SHUT DOWNS & ALARM



Reviewed for Fire Code Compliance
 Harnett COUNTY NORTH CAROLINA Roger Sullivan
 05/02/2024 3:33:21 PM



ANSUL R-102
 3 GALLON
 UL 300
 5 FLOW POINTS

NEW BREED BAPTIST CHURCH
 3900 US 401 NORTH
 FUQUAY VARINA, NC 27526

BFPE INTERNATIONAL NOT TO SCALE
 115 BESTWOOD DRIVE 5/1/24
 CLAYTON, NC 27520 BY: KFD *[Signature]*
 PH: 919-550-2699 FAX: 919-550-0719

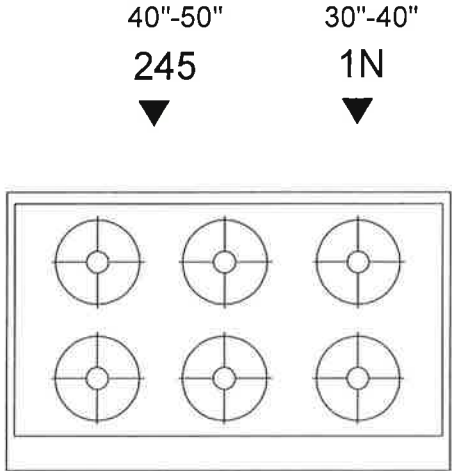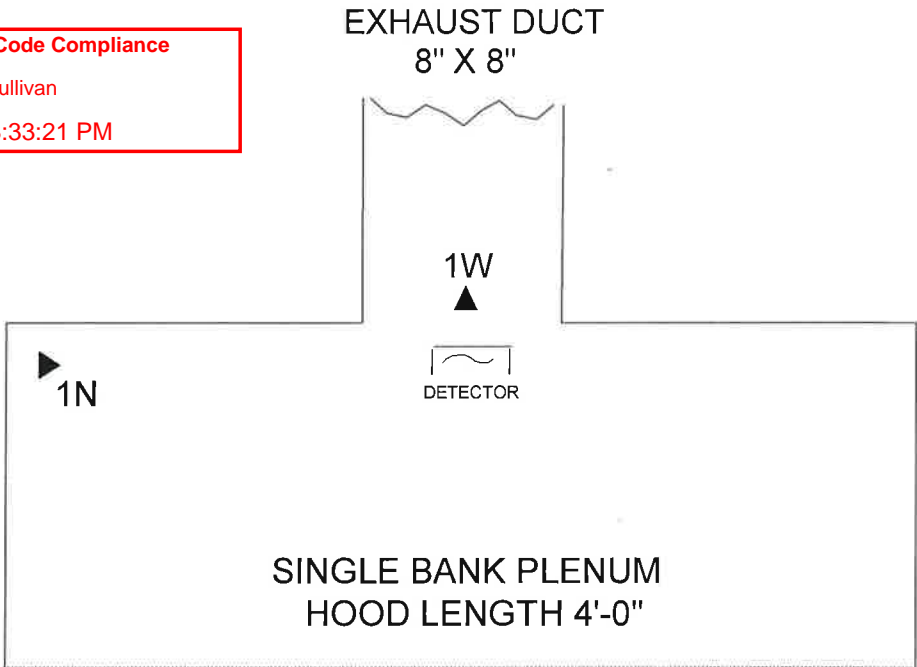

6 EYE RANGE
 36" X 24"

WORK SCOPE: REPLACE OUTDATED SYSTEM WITH UL-300 SYSTEM