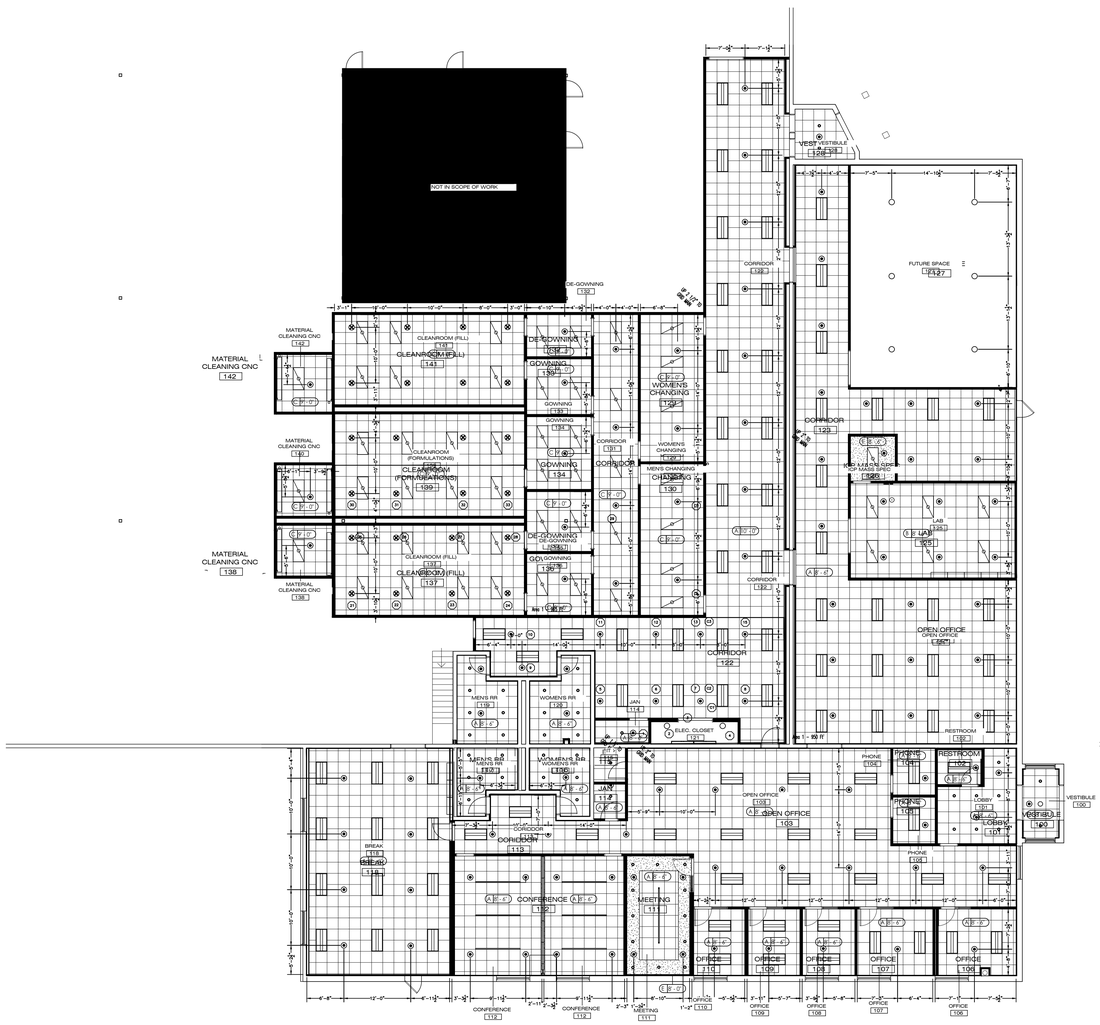

WORK AREA CEILING PLAN

SCALE: 3/32" = 1'-0"

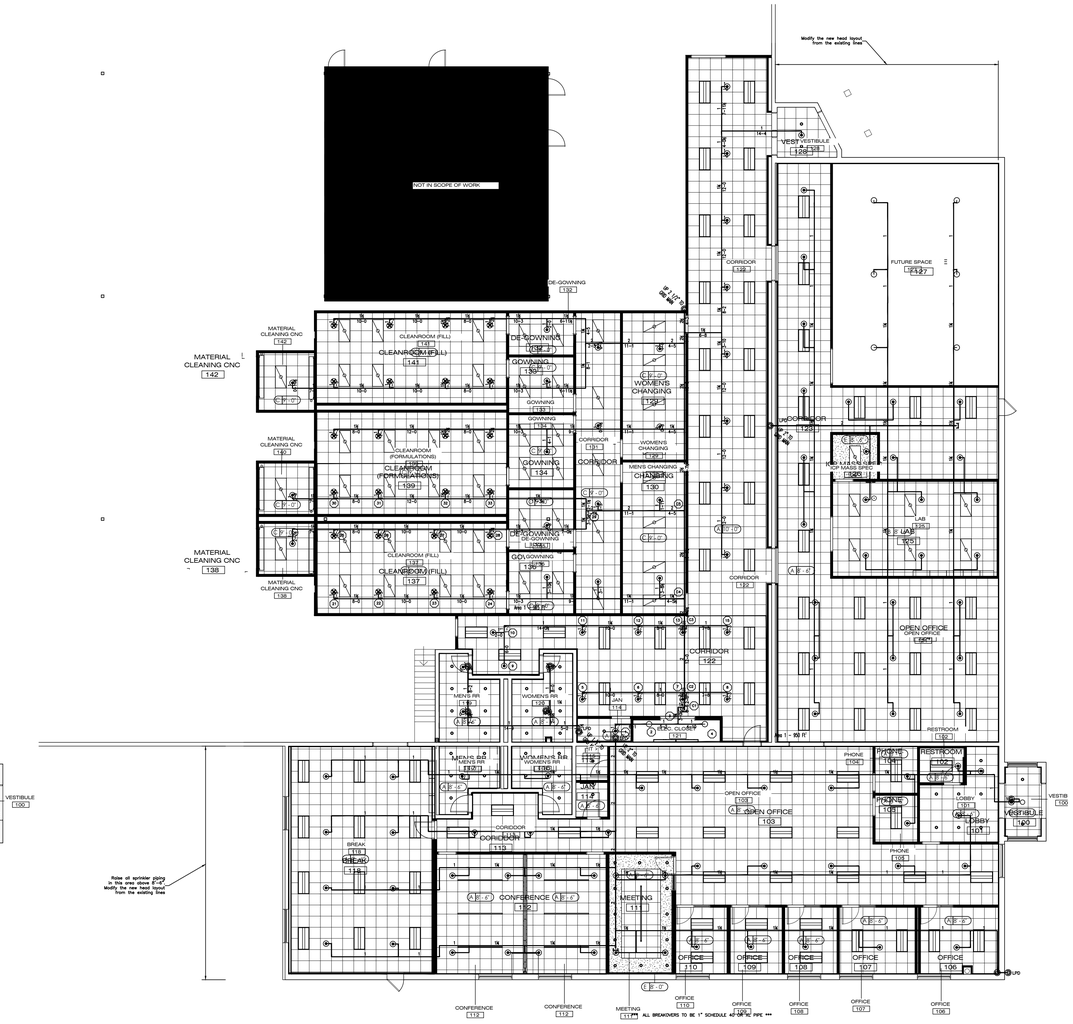

WORK AREA PIPING PLAN

SCALE: 3/32" = 1'-0"

Sprinkler Head Schedule

Symbol	Count	Thread	K-Factor	Description	Model
⊕	116	1/2"	5.6	QR CHROME RECESSED PENDENT	TYCO TY-3231
○	6	1/2"	5.6	QR BRASS UPRIGHT	TYCO TY-3131
⊗	24	1/2"	5.6	QR CLEAN ROOM PENDENT	TYCO TY-3531
146 = Total Number of Heads This Floor					

FIRE SPRINKLERS LEGEND:

- Hydraulic Reference Points
- (FT-IN) FT-IN Elev. Above Finished Floor
- (FT-IN) FT-IN Ceiling Height
- Denotes Hanger Location
- Rise up or down
- Rigid Coupling
- Flexible Coupling
- LPD Low Point Drain
- HG Head Guard

ILC Dover Interior Addition and Renovation

900 Edwards Brothers Drive
Lillington,NC

Owner
ILC Dover LP
One Moonwalker Road
Frederica, DE 19946

ARCHITECT
Redline Design Group
925 Tuckaseegee Road
Suite 110
Charlotte, NC 28208
704-377-2990

Job Site Contact
Gilbane Building Company
150 Fayetteville Street, Suite 1100
Raleigh, NC 27601
Attn: Mark Cicio; 919-802-7279m

Authority Having Jurisdiction
Harnett County Fire Marshall

Fire Protection Contact
ABL Fire Protection, LLC
Design: Petch Lawson
300 Hoke Street, Raleigh,
North Carolina 27601
(919) xxx-xxxx

Fire Protection, LLC

ABL FIRE PROTECTION, LLC
300 HOKE STREET, RALEIGH
NORTH CAROLINA 27601
Phone: (919) 835-2225
Fax: (919) 835-2210

Contractor Seal

Arthur K. Lamson, Jr. N.I.C.E.T. Level III #20462 FS

I certify that to the best of my knowledge this plan, prepared under my supervision, is in accordance with applicable NFPA standards, current building codes.

This drawing and the information hereon is the property of ABL Fire Protection, LLC and may not be reproduced, altered or used in any form without consent from ABL Fire Protection, LLC.

DRAWN BY	RDM
DATE	12/18/24
SCALE	⅛" = 1'-0" UNO
SPRINKLERS ON JOBS	146
CONTRACT NO.	????

	DESCRIPTION	REV	DATE	BY
1	SUBMITTAL DRAWING		12/18/24	AL

SHEET TITLE
WORK AREA PIPING PLAN & CEILING PLAN

SHEET NUMBER
FP2