

Existing Private Hydrant  
 Flow Test Date- 12-16-24  
 Static Pressure- 93 PSI  
 Residual Pressure- 53PSI  
 Flow Rate- 1234 GPM

Reviewed for Fire Code Compliance  
 Harnett County Fire Marshal  
 Leslie Jackson  
 01/13/2025 8:05:30 AM

**ILC Dover**  
 Interior Addition  
 and Renovation  
 900 Edwards Brothers Drive  
 Lillington, NC

**Owner**  
 ILC Dover LP  
 One Moonwalker Road  
 Fredericka, DE 19946

**ARCHITECT**  
 Redline Design Group  
 925 Tuckaseegee Road  
 Suite 110  
 Charlotte, NC 28208  
 704-377-2990


**Job Site Contact**  
 Gilbane Building Company  
 150 Fayetteville Street, Suite 1100  
 Raleigh, NC 27601  
 Attn: Mark Clox; 919-802-7279m

**Authority Having Jurisdiction**  
 Harnett County Fire Marshal


**Fire Protection Contact**  
 ABL Fire Protection, LLC  
 Design: Petch Lawson  
 300 Hoke Street, Raleigh,  
 North Carolina 27601  
 (919) xxx-xxxx

### GENERAL NOTES


1. THIS RENOVATION HAS BEEN DESIGNED PER NFPA-13. PIPING AND HANGERS SHALL BE INSTALLED IN A STRAIGHT AND WORKMANLIKE MANNER IN ACCORDANCE WITH THE LATEST EDITION OF NFPA 13.
2. ALL NEW PIPE UP TO 1 1/2" SHALL BE SCHEDULE 40 PIPE WITH THREADED FITTINGS. PIPING 2" AND LARGER SHALL BE SCHEDULE 10 BLACK STEEL WITH ROLLED GROOVE FITTING.
3. ALL NEW PIPING WILL BE PROPERLY TESTED. PRESSURE TEST SHALL BE STATIC WATER AT TEST PRESSURE OF 200 PSIG FOR 2 HOURS DURATION WITHOUT LEAK FROM ANY JOINT OR SEGMENT OF THE PIPING SYSTEM FROM ANY EQUIPMENT OR DEVICE.
4. FLUSH, TEST, AND INSPECT SPRINKLER PIPING SYSTEMS IN ACCORDANCE WITH NFPA 13. REPLACE PIPING SYSTEM COMPONENTS WHICH DO NOT PASS THE TEST PROCEDURES SPECIFIED, AND RETEST REPAIRED PORTION OF THE SYSTEM.

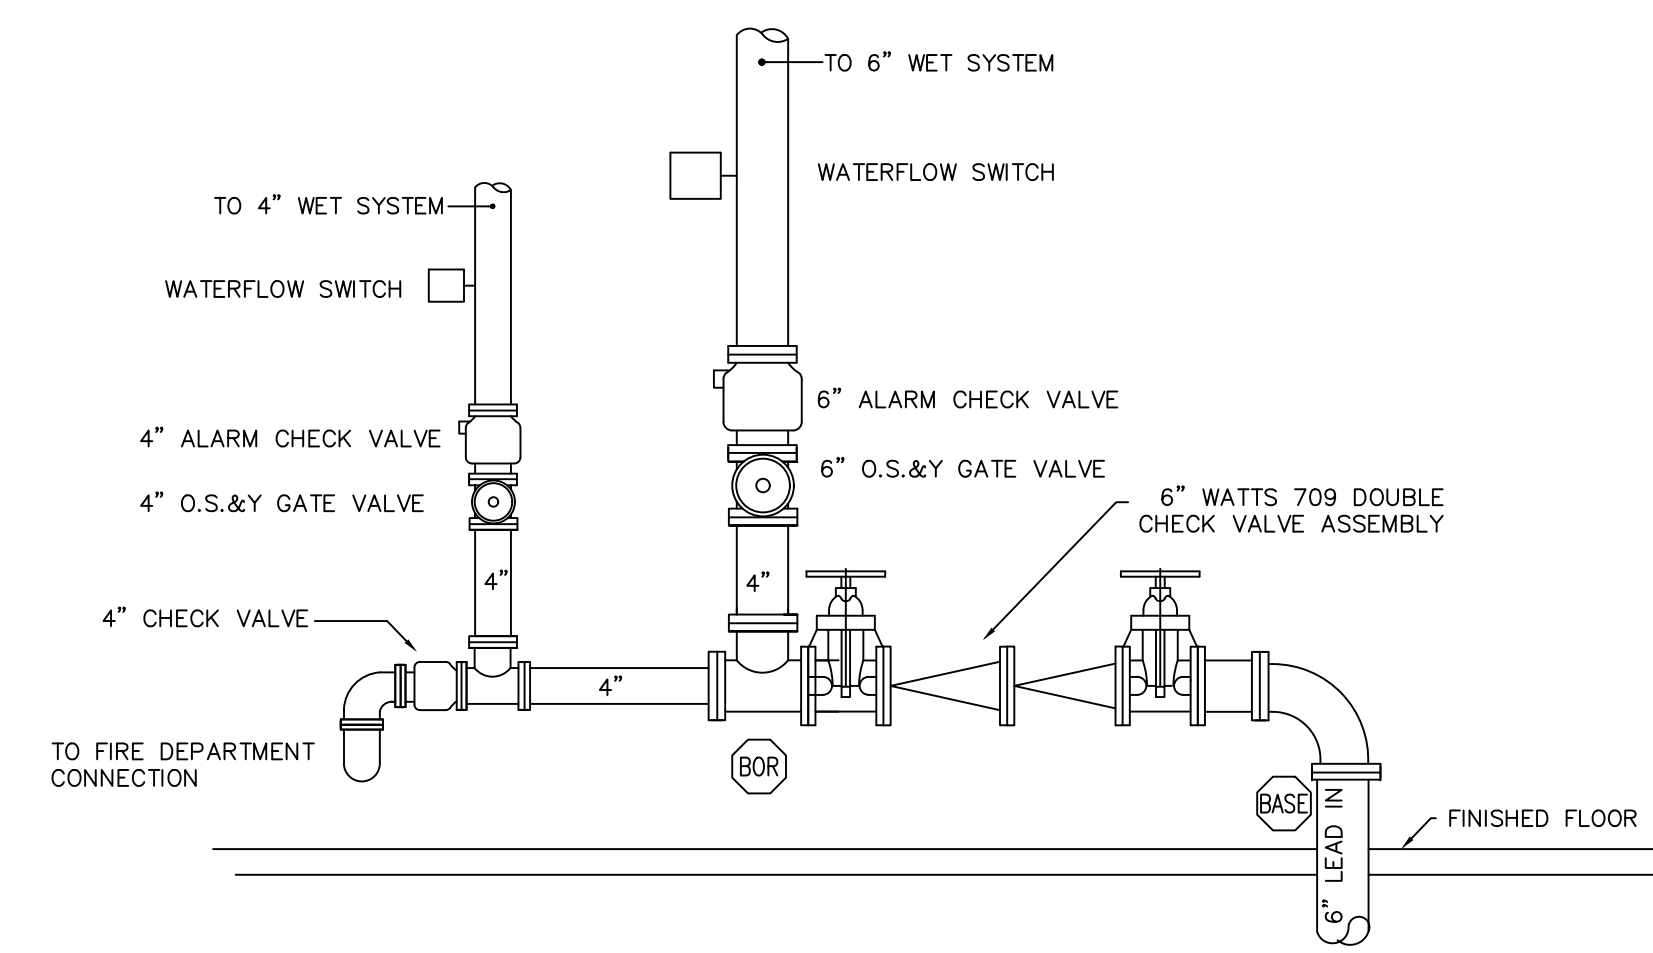


**RISER DETAIL- EXISTING**  
 SCALE: 1/2" = 1'-0"

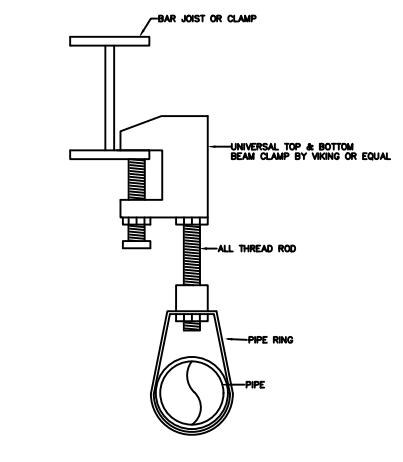

**HANGER DETAIL**

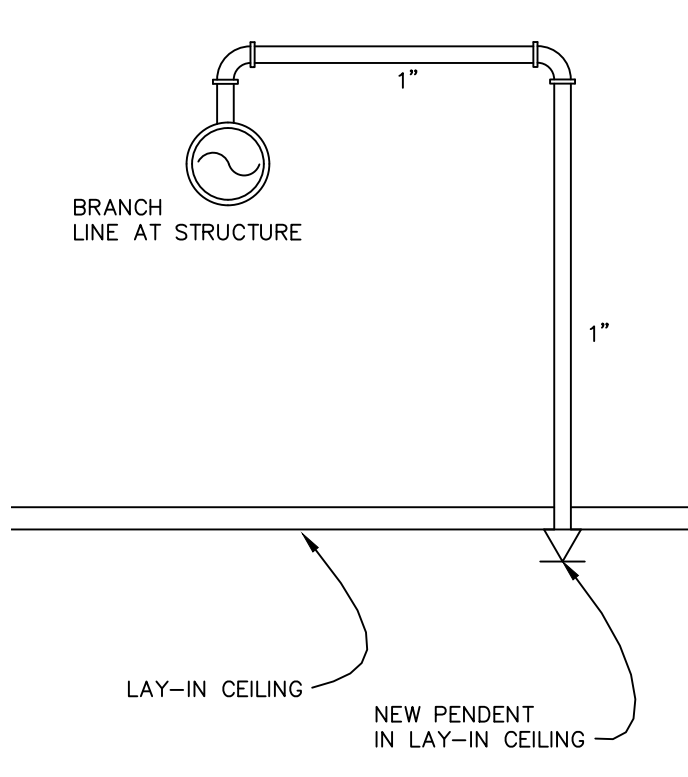

**ARM-OVER DETAIL**

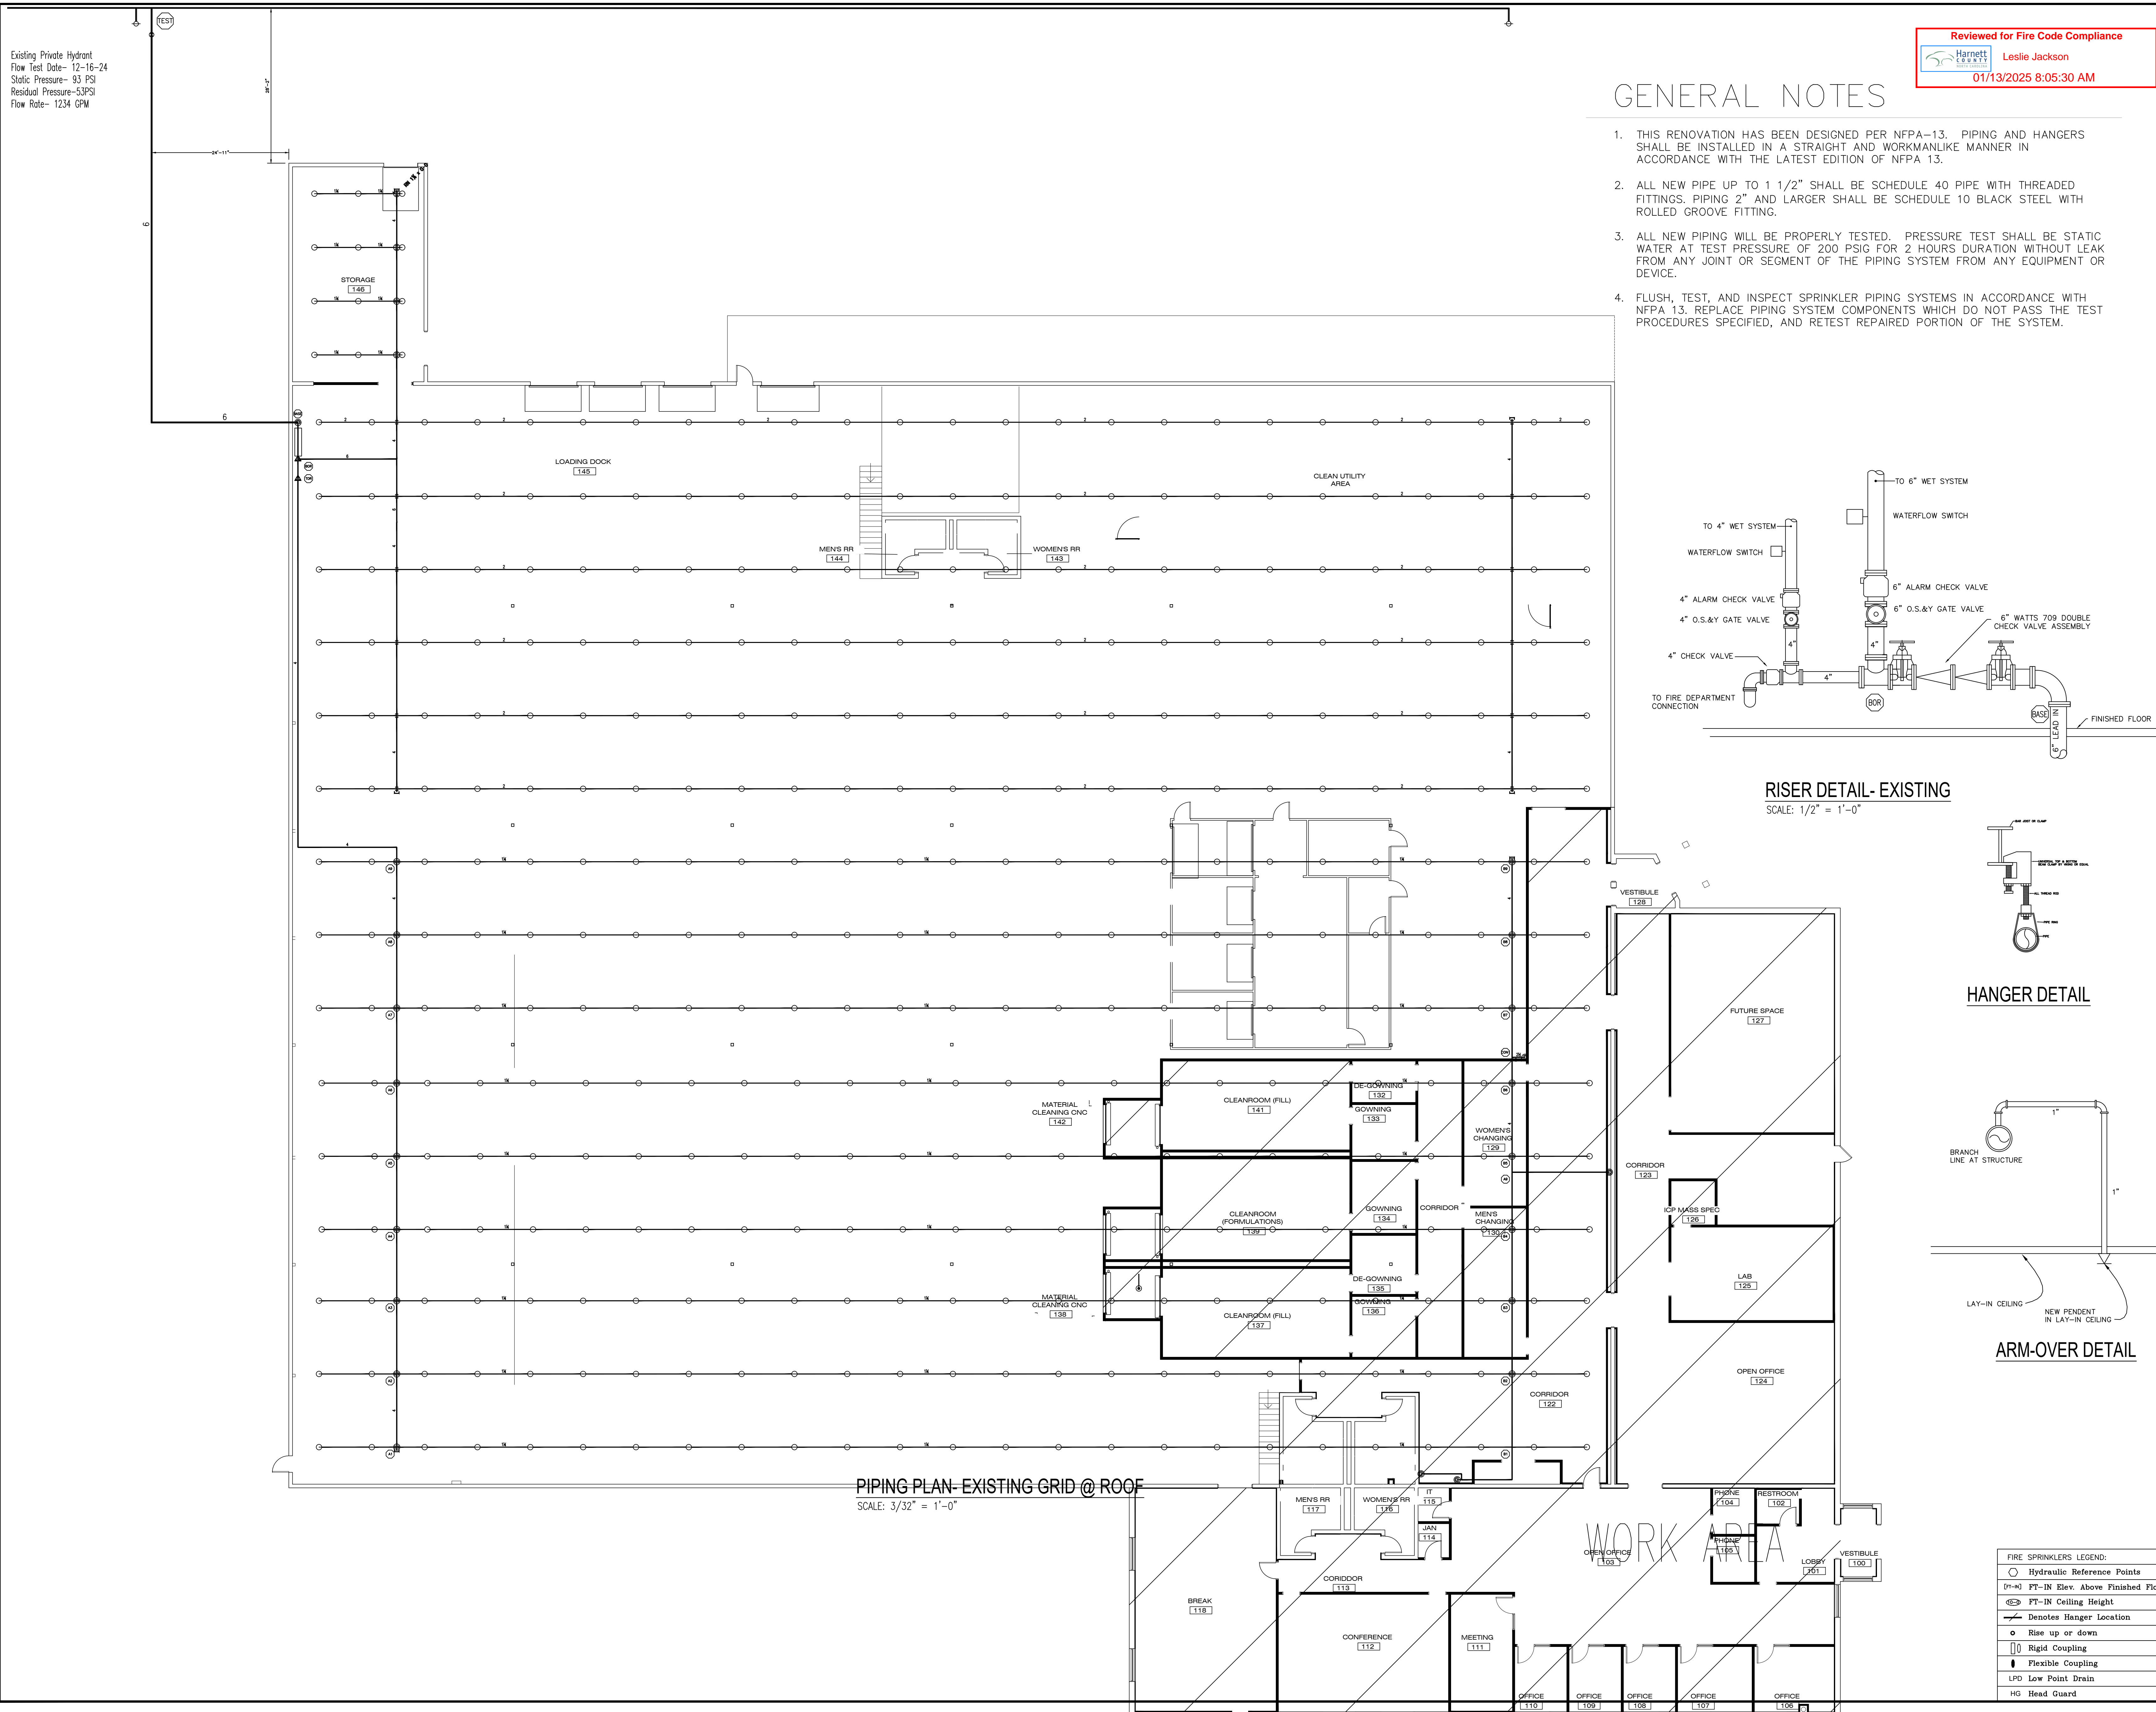

**PIPING PLAN- EXISTING GRID @ ROOF**  
 SCALE: 3/32" = 1'-0"

WORK AREA

**FIRE SPRINKLERS LEGEND:**

- Hydraulic Reference Points
- PT-IN FT-IN Elev. Above Finished Floor
- PT-IN FT-IN Ceiling Height
- Denotes Hanger Location
- Rise up or down
- Rigid Coupling
- Flexible Coupling
- LPD Low Point Drain
- HG Head Guard

DRAWN BY	RDM
DATE	12/18/24
SCALE	3/32" = 1'-0" UNO
SPRINKLERS ON JOBS	146
CONTRACT NO.	????

DESCRIPTION	REV DATE	BY
1 SUBMITTAL DRAWING	12/18/24	AL

SISHEET TITLE  
**FIRE PROTECTION EXISTING PIPING PLAN**

SHEET NUMBER  
**FP1**



**ABL FIRE PROTECTION, LLC**  
 300 HOKE STREET, RALEIGH  
 NORTH CAROLINA 27601  
 Phone: (919) 835-2225  
 Fax: (919) 835-2210

Contractor Seal  
*Arthur K. Lamson, Jr.*  
 Arthur K. Lamson, Jr. N.I.C.E.T. Level III #20462 FS

I certify that to the best of my knowledge this plan, prepared under my supervision, is in accordance with applicable NFPA standards, current building codes.

This drawing and the information hereon is the property of ABL Fire Protection, LLC and may not be reproduced, altered or used in any form without consent from ABL Fire Protection, LLC.

**ILC Dover  
Interior Addition  
and Renovation**

900 Edwards Brothers Drive  
Lillington, NC

**Owner**  
ILC Dover LP  
One Moonwalker Road  
Frederica, DE 19546

**ARCHITECT**  
Redline Design Group  
925 Tuckaseegee Road  
Suite 110  
Charlotte, NC 28208  
704-377-2990

**Job Site Contact**  
Gilbane Building Company  
150 Fayetteville Street, Suite 1100  
Raleigh, NC 27601  
Attn: Mark Goto 919-802-7279m

**Authority Having Jurisdiction**  
Harnett County Fire Marshal

**Fire Protection Contact**  
ABL Fire Protection, LLC  
Design: Patch Lawson  
300 Hoke Street, Raleigh,  
North Carolina 27601  
(919) xxx-xxxx



**ABL FIRE PROTECTION, LLC**  
300 HOKE STREET, RALEIGH  
NORTH CAROLINA 27601  
Phone: (919) 835-2225  
Fax: (919) 835-2210

Contractor Seal  
*Arthur K. Lamson, Jr.*

Arthur K. Lamson, Jr. N.I.C.E.T. Level III #20462 FS  
I certify that to the best of my knowledge this plan, prepared under my supervision, is in accordance with applicable NFPA standards, current building codes.

This drawing and the information herein is the property of ABL Fire Protection, LLC and may not be reproduced, altered or used in any form without consent from ABL Fire Protection, LLC.


DRAWN BY	RDM
DATE	12/18/24
SCALE	3/32" = 1'-0" UNO
SPRINKLERS ON JOBS	146
CONTRACT NO.	????

DESCRIPTION	REV	DATE	BY
1 SUBMITTAL DRAWING		12/18/24	AL

**WORK AREA  
PIPING PLAN &  
CEILING PLAN**


SHEET NUMBER

**FP2**

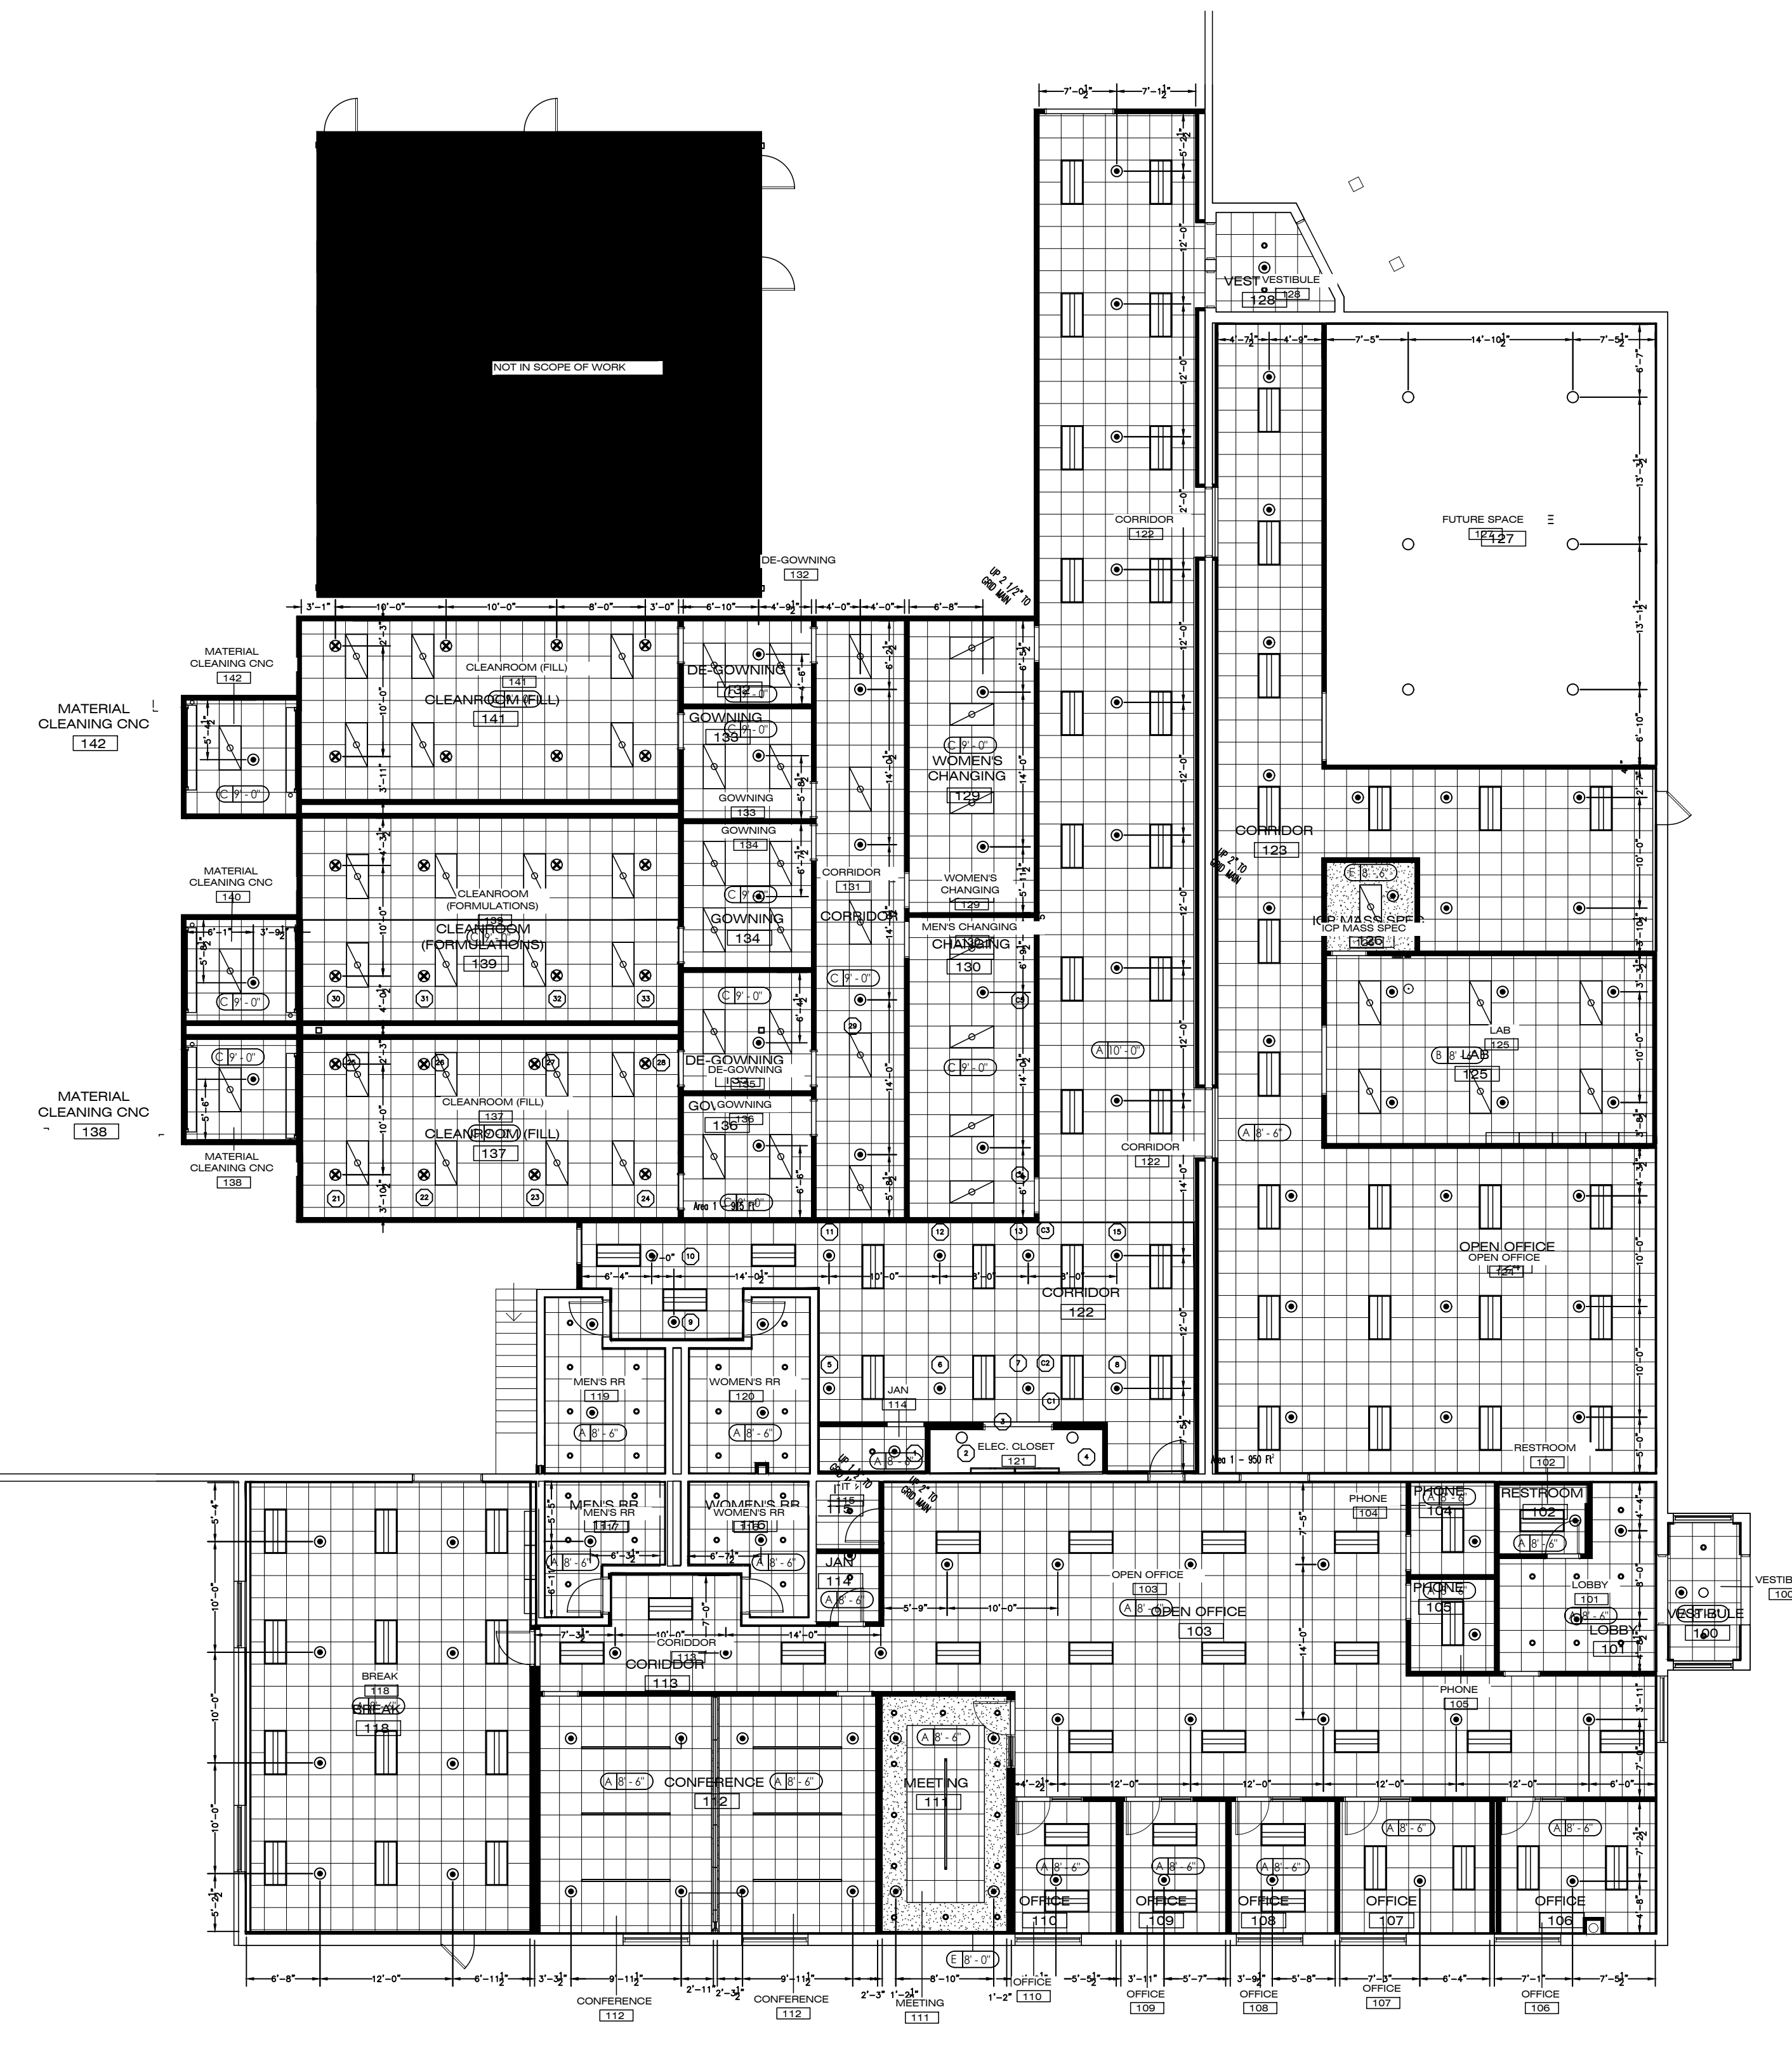

**WORK AREA CEILING PLAN**  
SCALE: 3/32" = 1'-0"

Notes of sprinker piping in this area shall be 1" above the new floor level from the existing floor.

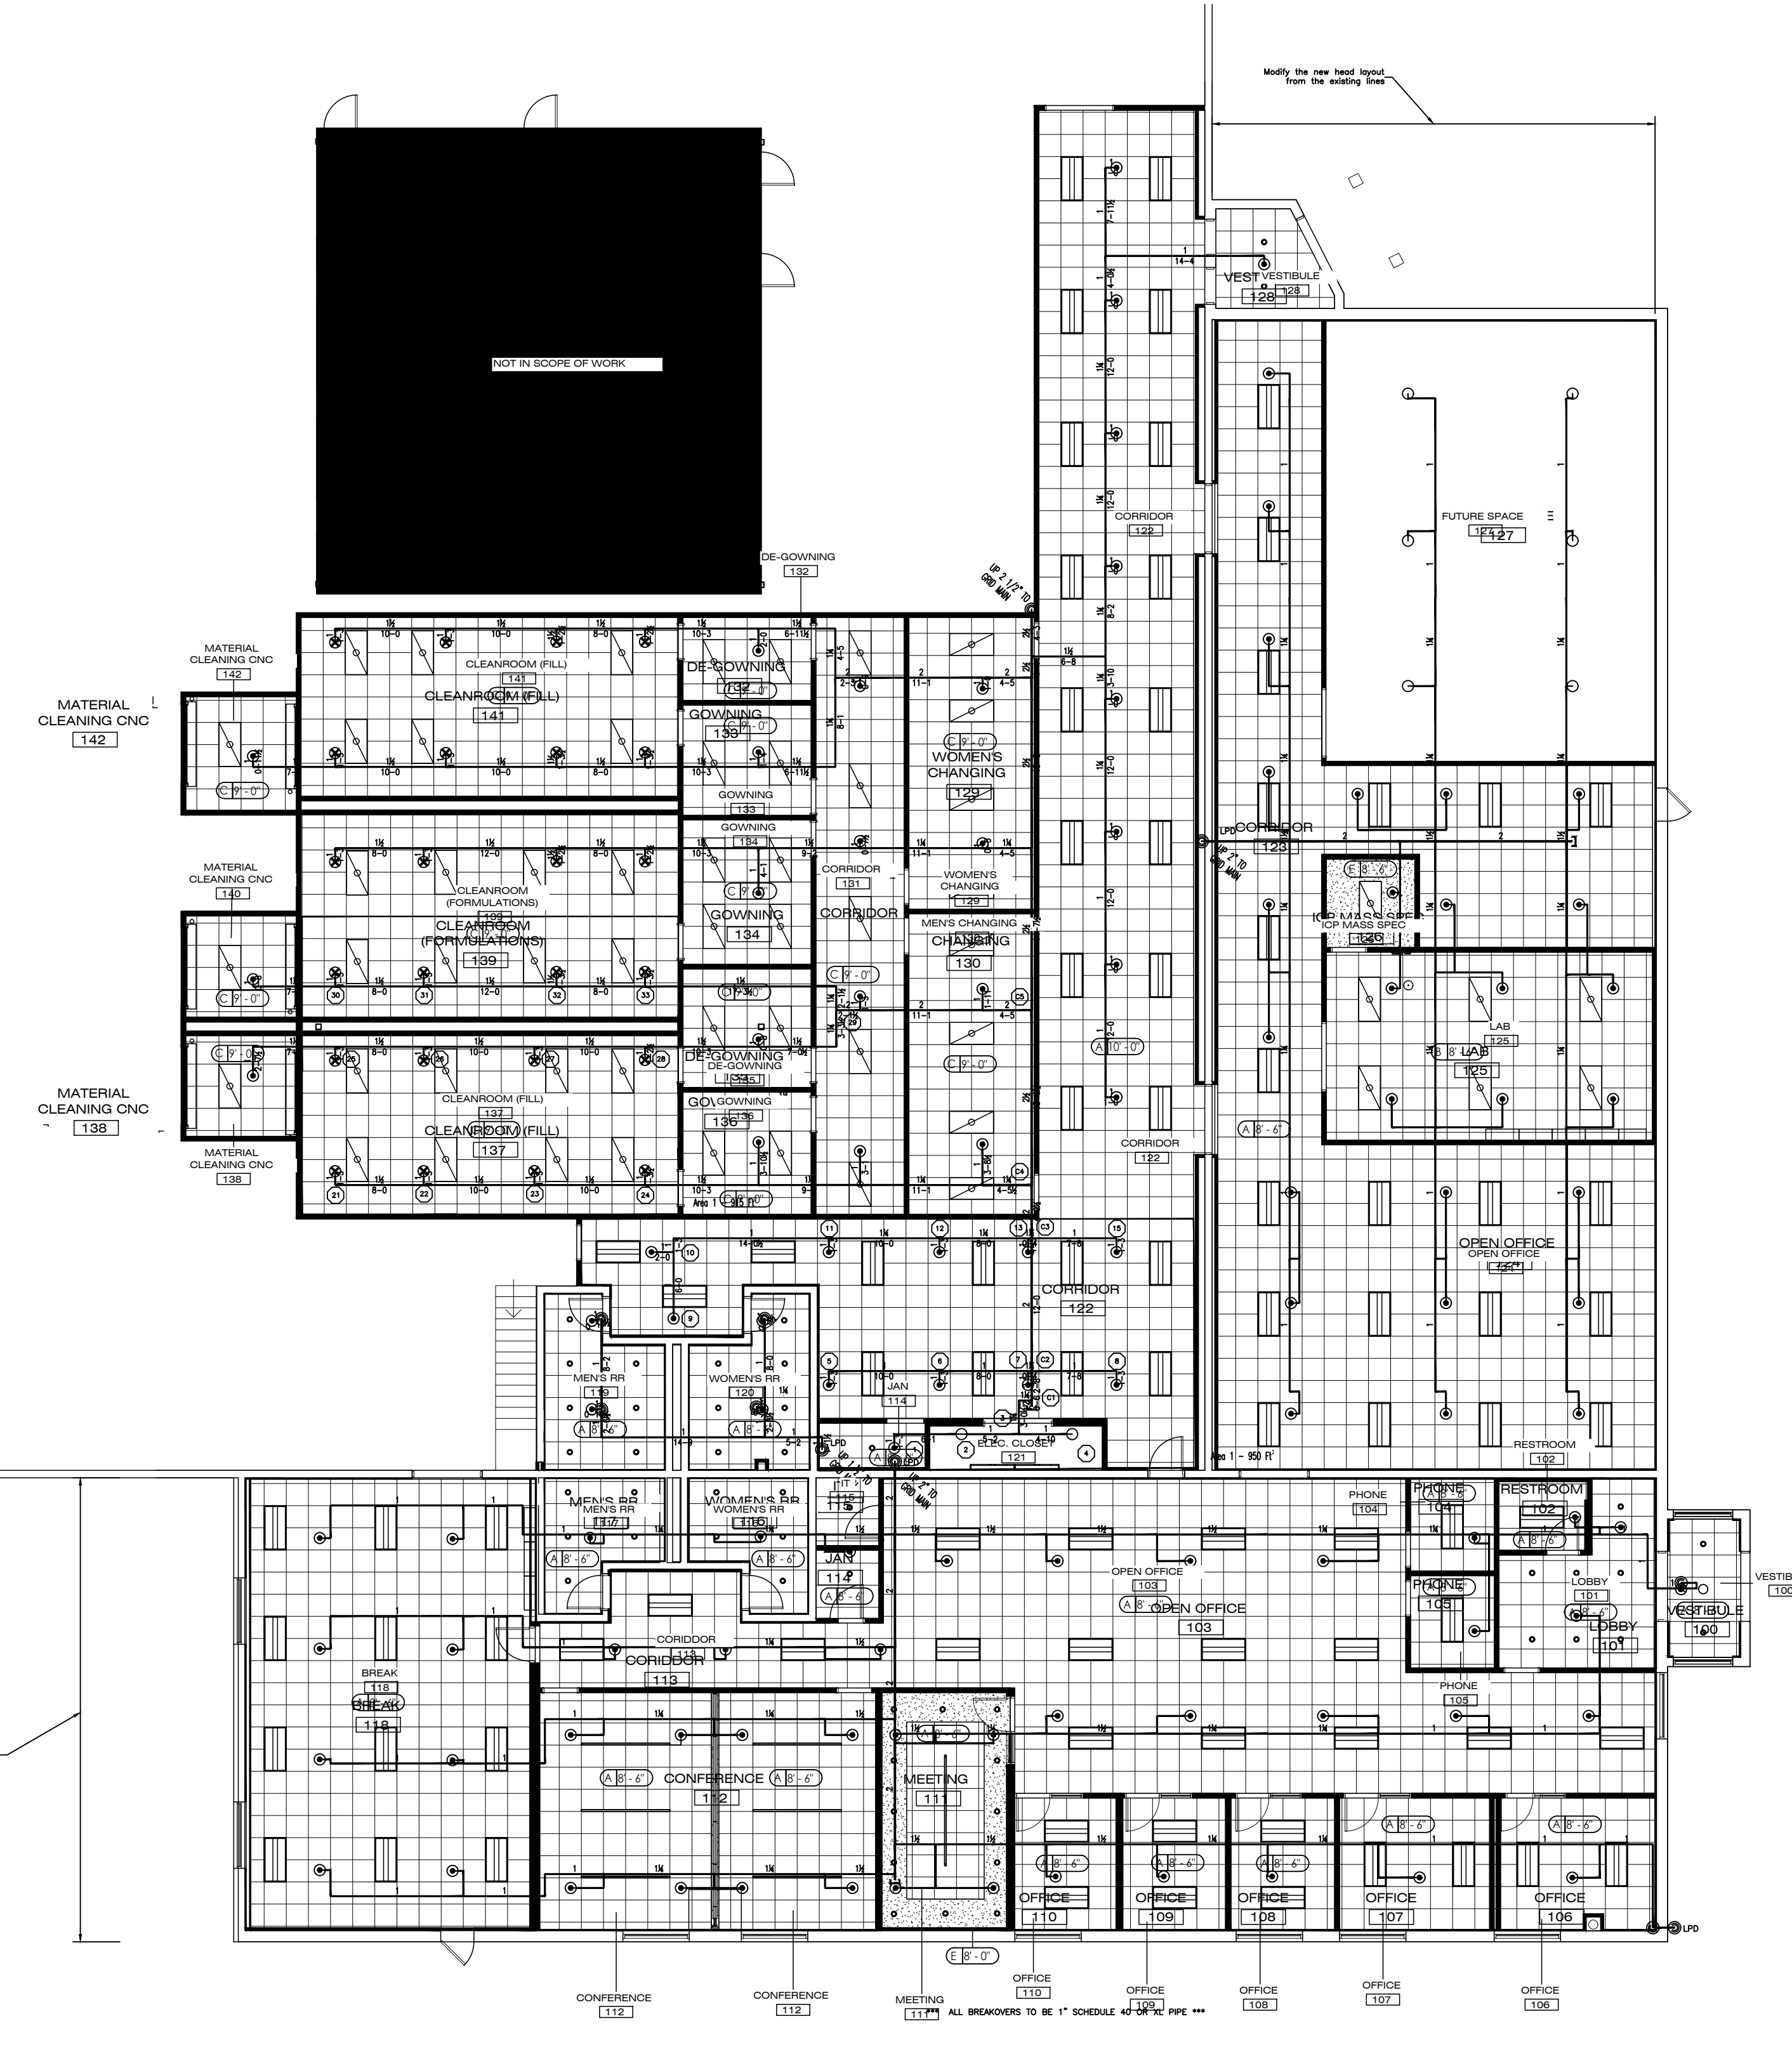

**WORK AREA PIPING PLAN**  
SCALE: 3/32" = 1'-0"

**Sprinkler Head Schedule**

Symbol	Count	Thread	K-Factor	Description	Model
⊙	116	1/2"	5.6	DR CHROME RECESSED PENDENT OR BRACE UPRIGHT	TYCO TY-3231
⊙	6	1/2"	5.6	DR CLEAN ROOM PENDENT	TYCO TY-3131
⊙	24	1/2"	5.6	DR CLEAN ROOM PENDENT	TYCO TY-3531

146 = Total Number of Heads This Floor

- FIRE SPRINKLERS LEGEND:**
- Hydraulic Reference Points
  - ⊙ FT-IN Elev. Above Finished Floor
  - ⊙ FT-IN Ceiling Height
  - Denotes Hanger Location
  - Rise up or down
  - Rigid Coupling
  - ◐ Flexible Coupling
  - LPD Low Point Drain
  - HG Head Guard



## Hydraulic Calculations by HydraCALC

ABL Fire Protection  
300 Hoke Street  
Raleigh, NC 27601  
919-291-7460

Job Name : ILC Dover- Interior Renovation and Addition  
Drawing :  
Location : Lillington, NC  
Remote Area : 1  
Contract :  
Data File : ILC Dover Calcs.WXF

---

**HYDRAULIC CALCULATIONS**  
**for**

**JOB NAME** ILC Dover  
**Location** Lillington, NC  
**Drawing #**  
**Contract #**  
**Date**

**DESIGN**

**Remote area #** 1  
**Remote area location** Corridor  
**Occupancy classification** Light Hazard  
**Density** .10 - Gpm/SqFt  
**Area of application** 900 - SqFt  
**Coverage/sprinkler** 130 - SqFt  
**Type of sprinkler calculated** Quick Response Pendent  
**# Sprinklers calculated** 12  
**In-rack demand** - GPM  
**Hose streams** 100 - GPM  
**Total water required (including hose streams)** 362.743 - GPM @ 70574 - Psi  
**Type of system**  
**Volume of system (dry or pre-action)** - Gal

**WATER SUPPLY INFORMATION**

**Test date** 12-16-24  
**Location** Closest Private Hydrant  
**Source of info** Andrew King Engineering

**CONTRACTOR INFO** ABL Fire Protection  
**Address** 300 Hoke St.; Raleigh. NC 27601  
**Phone #** 919-291-7460  
**Name of designer** Art Lamson  
**Authority having jurisdiction** Harnett County  
**NOTES:**

text1(35) - invisible

# Water Supply Curve

ABL Fire Protection  
ILC Dover- Interior Renovation and Addition


Page 2  
Date 12/18/24

## City Water Supply:

C1 - Static Pressure : 93  
C2 - Residual Pressure: 53  
C2 - Residual Flow : 1234

## Demand:

D1 - Elevation : 6.063  
D2 - System Flow : 262.743  
D2 - System Pressure : 70.574  
Hose ( Demand ) : 100  
D3 - System Demand : 362.743  
Safety Margin : 18.273

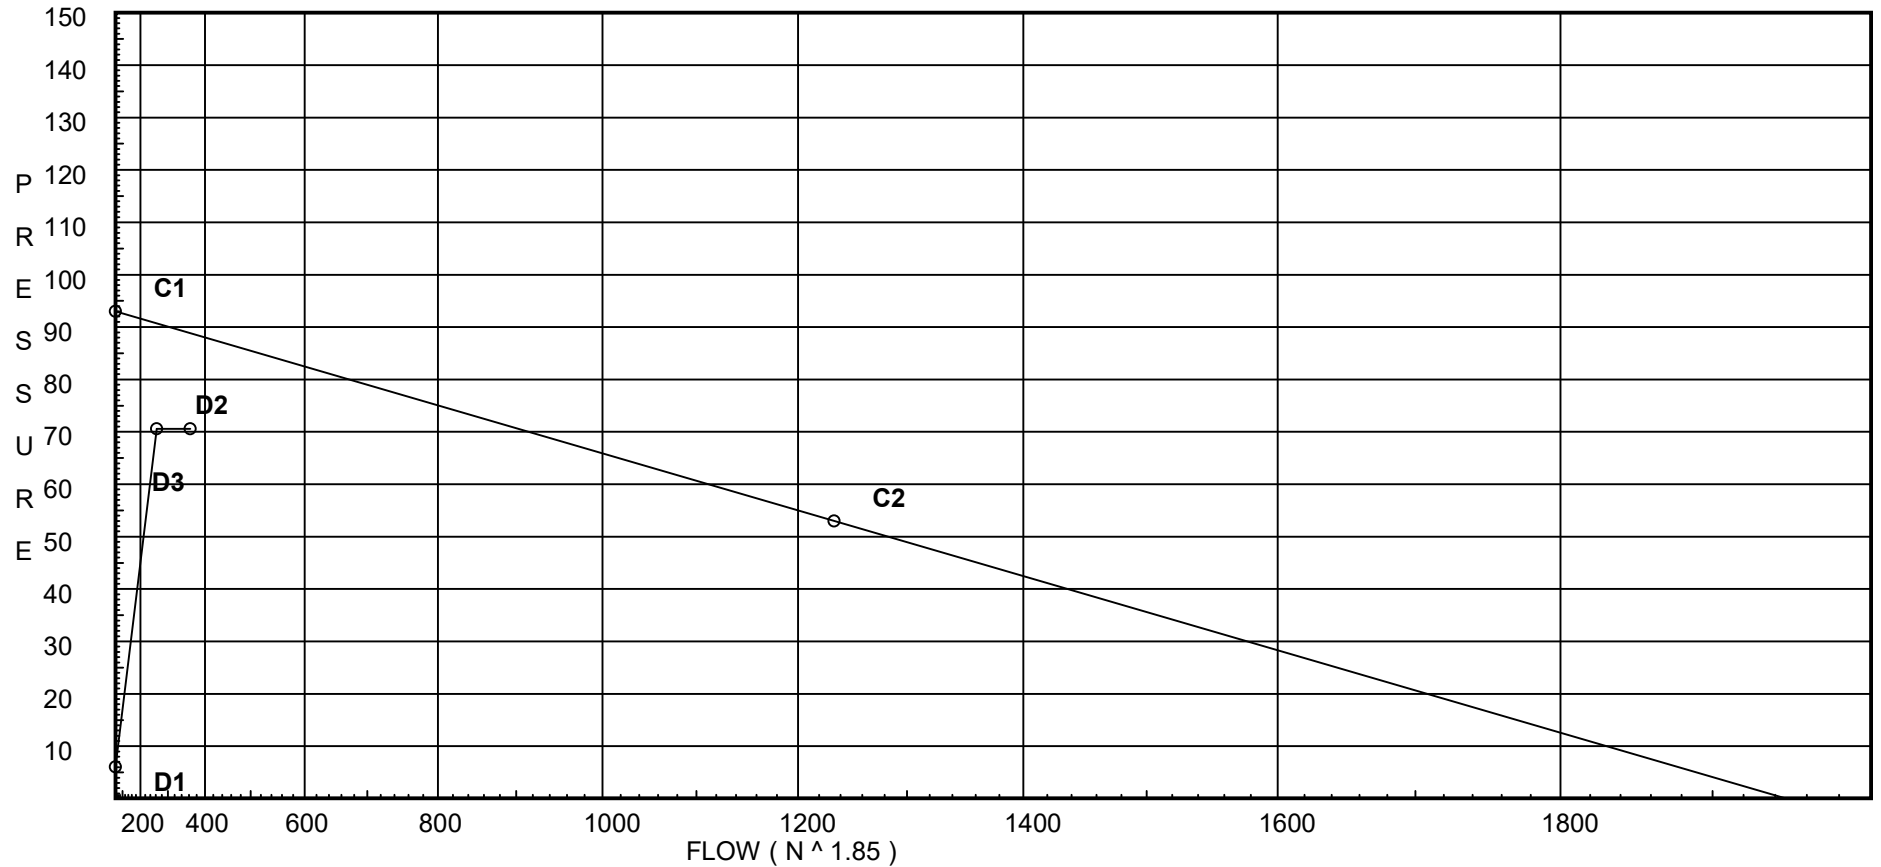

# Fittings Used Summary

ABL Fire Protection  
 ILC Dover- Interior Renovation and Addition

Page 3  
 Date 12/18/24

## Fitting Legend

Abbrev.	Name	1/2	3/4	1	1 1/4	1 1/2	2	2 1/2	3	3 1/2	4	5	6	8	10	12	14	16	18	20	24	
A	Alarm Rel E1 & E3							7.7	21.5		17		27	29								
E	NFPA 13 90' Standard Elbow	1	2	2	3	4	5	6	7	8	10	12	14	18	22	27	35	40	45	50	61	
G	NFPA 13 Gate Valve	0	0	0	0	0	1	1	1	1	2	2	3	4	5	6	7	8	10	11	13	
T	NFPA 13 90' Flow thru Tee	3	4	5	6	8	10	12	15	17	20	25	30	35	50	60	71	81	91	101	121	
Zwc	Watts 709	Fitting generates a Fixed Loss Based on Flow																				

## Units Summary

Diameter Units           Inches  
 Length Units            Feet  
 Flow Units                US Gallons per Minute  
 Pressure Units           Pounds per Square Inch

Note: Fitting Legend provides equivalent pipe lengths for fittings types of various diameters. Equivalent lengths shown are standard for actual diameters of Sched 40 pipe and CFactors of 120 except as noted with \*. The fittings marked with a \* show equivalent lengths values supplied by manufacturers based on specific pipe diameters and CFactors and they require no adjustment. All values for fittings not marked with a \* will be adjusted in the calculation for CFactors of other than 120 and diameters other than Sched 40 per NFPA.

# Flow Summary - NFPA

ABL Fire Protection  
 ILC Dover- Interior Renovation and Addition

Page 4  
 Date 12/18/24

## SUPPLY ANALYSIS

<i>Node at Source</i>	<i>Static Pressure</i>	<i>Residual Pressure</i>	<i>Flow</i>	<i>Available Pressure</i>	<i>Total Demand</i>	<i>Required Pressure</i>
TEST	93.0	53	1234.0	88.847	362.74	70.574

## NODE ANALYSIS

<i>Node Tag</i>	<i>Elevation</i>	<i>Node Type</i>	<i>Pressure at Node</i>	<i>Discharge at Node</i>	<i>Notes</i>
S2	9.0	5.6	7.0	14.82	0.1 130
S5	9.0	5.6	7.0	14.82	0.1 130
1	10.0	4.4	14.48	16.74	K=K @ EQ1
2	10.0	4.4	15.42	17.27	K=K @ EQ1
3	10.0	4.4	18.98	19.16	K=K @ EQ1
4	10.0	4.4	17.84	18.58	K=K @ EQ1
5	10.0	4.35	17.9	18.41	K=K @ EQ2
6	10.0	4.35	19.02	18.98	K=K @ EQ2
7	10.0	4.35	22.33	20.57	K=K @ EQ2
8	10.0	4.35	22.22	20.51	K=K @ EQ2
9	9.0	5.6	11.0	18.57	0.1 130
10	10.0	4.35	11.59	14.82	K=K @ EQ2
11	10.0	4.35	17.38	18.15	K=K @ EQ2
12	10.0	4.35	19.35	19.15	K=K @ EQ2
13	10.0	4.35	22.18	20.5	K=K @ EQ2
14	10.0	4.35	24.03	21.34	K=K @ EQ2
C1	10.0		23.8		
C2	10.0		23.92		
C3	10.0		25.87		
C4	10.0		28.15		
C5	10.0		30.86		
A1	19.0		53.94		
A2	19.0		53.94		
A3	19.0		53.96		
A4	19.0		53.99		
A5	19.0		54.03		
A6	19.0		54.11		
A7	19.0		54.21		
A8	19.0		54.35		
A9	19.0		54.53		
TOR	2.0		62.11		
BOR	2.0		63.29		
BASE	0.0		68.06	100.0	
TEST	-4.0		70.57		
B1	19.0		38.29		
B2	19.0		38.29		
B3	19.0		38.28		
B4	19.0		38.25		
B5	19.0		38.2		
B6	19.0		38.13		
CON1	19.0		38.09		
B7	19.0		38.11		

# Flow Summary - NFPA

ABL Fire Protection  
ILC Dover- Interior Renovation and Addition

Page 5  
Date 12/18/24

---

## *NODE ANALYSIS (cont.)*

<i><b>Node Tag</b></i>	<i><b>Elevation</b></i>	<i><b>Node Type</b></i>	<i><b>Pressure at Node</b></i>	<i><b>Discharge at Node</b></i>	<i><b>Notes</b></i>
B8	19.0		38.12		



# Final Calculations : Hazen-Williams

ABL Fire Protection  
ILC Dover- Interior Renovation and Addition

Page 6  
Date 12/18/24

Node1 to Node2	Elev1 Elev2	K Fact	Qa Qt	Nom Act	Fitting or Equiv Len	Pipe Ftngs Total	CFact Pf/Ft	Pt Pe Pf	*****	Notes	*****
S2 to EQ1	9 0	5.60	14.82 14.82	1 1.049	T 5.0	1.000 5.000 6.000	120 0.0747	7.000 3.898 0.448		Vel = 5.50	
EQ1			0.0 14.82					11.346		K Factor = 4.40	
S5 to EQ2	9 0	5.60	14.82 14.82	1 1.049	E T 5.0	2.250 7.000 9.250	120 0.0747	7.000 3.898 0.691		Vel = 5.50	
EQ2			0.0 14.82					11.589		K Factor = 4.35	
1 to 2	10 10	4.4	16.74 16.74	1 1.049		10.000 10.000	120 0.0936	14.481 0.0 0.936		K = K @ EQ1 Vel = 6.21	
2 to 3	10 10	4.4	17.27 34.01	1 1.049	T 5.0	5.250 5.000 10.250	120 0.3475	15.417 0.0 3.562		K = K @ EQ1 Vel = 12.63	
3 to C1	10 10	4.4	37.74 71.75	1.25 1.38	E T 6.0	4.250 9.000 13.250	120 0.3637	18.979 0.0 4.819		K = K @ EQ1 Vel = 15.39	
C1			0.0 71.75					23.798		K Factor = 14.71	
4 to 3	10 10	4.4	18.58 18.58	1 1.049	T 5.0	5.000 5.000 10.000	120 0.1136	17.843 0.0 1.136		K = K @ EQ1 Vel = 6.90	
3			0.0 18.58					18.979		K Factor = 4.26	
5 to 6	10 10	4.35	18.41 18.41	1 1.049		10.000 10.000	120 0.1117	17.899 0.0 1.117		K = K @ EQ2 Vel = 6.83	
6 to 7	10 10	4.35	18.98 37.39	1 1.049		8.000 8.000	120 0.4141	19.016 0.0 3.313		K = K @ EQ2 Vel = 13.88	
7 to C2	10 10	4.35	20.57 57.96	1.25 1.38	T 6.0	0.500 6.000 6.500	120 0.2451	22.329 0.0 1.593		K = K @ EQ2 Vel = 12.43	
C2			0.0 57.96					23.922		K Factor = 11.85	
8 to C2	10 10	4.35	20.51 20.51	1 1.049	T 5.0	7.500 5.000 12.500	120 0.1364	22.217 0.0 1.705		K = K @ EQ2 Vel = 7.61	
C2			0.0 20.51					23.922		K Factor = 4.19	
9 to 10	9 10	5.60	18.57 18.57	1 1.049	E 2.0	7.000 2.000 9.000	120 0.1134	11.001 -0.433 1.021		Vel = 6.89	
10 to 11	10 10	4.35	14.82 33.39	1 1.049	E 2.0	15.250 2.000 17.250	120 0.3359	11.589 0.0 5.794		K = K @ EQ2 Vel = 12.40	

# Final Calculations : Hazen-Williams

ABL Fire Protection  
ILC Dover- Interior Renovation and Addition

Page 7  
Date 12/18/24

Node1 to Node2	Elev1 Elev2	K Fact	Qa Qt	Nom Act	Fitting or Eqiv	Len	Pipe Ftngs Total	CFact Pf/Ft	Pt Pe Pf	*****	Notes	*****
11 to 12	10 10	4.35	18.15	1.25			10.000	120	17.383 0.0		K = K @ EQ2	
			51.54	1.38			10.000	0.1971	1.971		Vel = 11.06	
12 to 13	10 10	4.35	19.14	1.25			8.000	120	19.354 0.0		K = K @ EQ2	
			70.68	1.38			8.000	0.3538	2.830		Vel = 15.16	
13 to C3	10 10	4.35	20.50	1.25	T	6.0	0.500 6.000 6.500	120	22.184 0.0 3.683		K = K @ EQ2	
			91.18	1.38				0.5666			Vel = 19.56	
C3			0.0 91.18						25.867		K Factor = 17.93	
14 to C3	10 10	4.35	21.34	1	T	5.0	7.500 5.000 12.500	120	24.034 0.0 1.833		K = K @ EQ2	
			21.34	1.049				0.1466			Vel = 7.92	
C3			0.0 21.34						25.867		K Factor = 4.20	
C1 to C2	10 10		71.75	2			3.000	120	23.798 0.0			
			71.75	2.157			3.000	0.0413	0.124		Vel = 6.30	
C2 to C3	10 10		78.47	2			12.000	120	23.922 0.0			
			150.22	2.157			12.000	0.1621	1.945		Vel = 13.19	
C3 to C4	10 10		112.52	2			5.000	120	25.867 0.0			
			262.74	2.157			5.000	0.4560	2.280		Vel = 23.07	
C4 to C5	10 10		0.0	2.5			15.750	120	28.147 0.0			
			262.74	2.635			15.750	0.1720	2.709		Vel = 15.46	
C5 to CON1	10 19		0.0	2.5	E T	8.237 16.474	40.000 24.711 64.711	120	30.856 -3.898 11.132		Vel = 15.46	
CON1			0.0 262.74						38.090		K Factor = 42.57	
A1 to A2	19 19		28.92	4			13.330	120	53.940 0.0			
			28.92	4.26			13.330	0.0003	0.004		Vel = 0.65	
A2 to A3	19 19		28.94	4			13.330	120	53.944 0.0			
			57.86	4.26			13.330	0.0010	0.013		Vel = 1.30	
A3 to A4	19 19		28.95	4			13.330	120	53.957 0.0			
			86.81	4.26			13.330	0.0021	0.028		Vel = 1.95	
A4 to A5	19 19		29.02	4			13.330	120	53.985 0.0			
			115.83	4.26			13.330	0.0037	0.049		Vel = 2.61	
A5 to A6	19 19		29.11	4			13.330	120	54.034 0.0			
			144.94	4.26			13.330	0.0056	0.074		Vel = 3.26	

# Final Calculations : Hazen-Williams

ABL Fire Protection  
ILC Dover- Interior Renovation and Addition

Page 8  
Date 12/18/24

Node1 to Node2	Elev1 Elev2	K Fact	Qa Qt	Nom Act	Fitting or Equiv Len	Pipe Ftngs Total	CFact Pf/Ft	Pt Pe Pf	*****	Notes	*****
A6 to A7	19 19		29.26 174.2	4 4.26		13.330 13.330	120 0.0077	54.108 0.0 0.103			Vel = 3.92
A7 to A8	19 19		29.38 203.58	4 4.26		13.330 13.330	120 0.0104	54.211 0.0 0.138			Vel = 4.58
A8 to A9	19 19		29.49 233.07	4 4.26		13.330 13.330	120 0.0133	54.349 0.0 0.177			Vel = 5.25
A9 to TOR	19 2		29.67 262.74	4 4.26		13.330 13.330	120 0.0165	54.526 7.363 0.220			Vel = 5.91
TOR to BOR	2 2		0.0 262.74	4 4.26	A G T	22.384 2.633 26.334	20.000 51.351 71.351	120 0.0 1.183			Vel = 5.91
BOR to BASE	2 0		0.0 262.74	6 6.357	Zwc E	0.0 17.603	6.000 17.603	120 4.714		** Fixed Loss = 3.848	Vel = 2.66
BASE to TEST	0 -4	H100	100.00 362.74	6 6.16	3E T G	60.252 43.037 4.304	100.000 107.593 207.593	140 1.732 0.780			Vel = 3.91
TEST			0.0 362.74					70.574			K Factor = 43.18
B1 to B2	19 19		-28.92 -28.92	4 4.26		13.330 13.330	120 -0.0003	38.295 0.0 -0.004			Vel = 0.65
B2 to B3	19 19		-28.94 -57.86	4 4.26		13.330 13.330	120 -0.0011	38.291 0.0 -0.014			Vel = 1.30
B3 to B4	19 19		-28.95 -86.81	4 4.26		13.330 13.330	120 -0.0021	38.277 0.0 -0.028			Vel = 1.95
B4 to B5	19 19		-29.02 -115.83	4 4.26		13.330 13.330	120 -0.0037	38.249 0.0 -0.049			Vel = 2.61
B5 to B6	19 19		-29.11 -144.94	4 4.26		13.330 13.330	120 -0.0055	38.200 0.0 -0.073			Vel = 3.26
B6 to CON1	19 19		-29.26 -174.2	4 4.26		4.750 4.750	120 -0.0078	38.127 0.0 -0.037			Vel = 3.92
CON1 to B7	19 19		262.75 88.55	4 4.26		8.580 8.580	120 0.0022	38.090 0.0 0.019			Vel = 1.99
B7 to B8	19 19		-29.38 59.17	4 4.26		13.330 13.330	120 0.0011	38.109 0.0 0.014			Vel = 1.33
B8 to B9	19 0		-29.50 29.67	4 4.26		13.330 13.330	120 0.0003	38.123 8.229 0.004			Vel = 0.67

# Final Calculations : Hazen-Williams

ABL Fire Protection  
 ILC Dover- Interior Renovation and Addition

Page 9  
 Date 12/18/24

Node1 to Node2	Elev1 Elev2	K Fact	Qa Qt	Nom Act	Fitting or Eqiv	Len	Pipe Ftngs Total	CFact Pf/Ft	Pt Pe Pf	*****	Notes	*****
B9			0.0 29.67						46.356		K Factor = 4.36	
A1 to B1	19 19		-28.92 -28.92	1.25 1.38	4T	24.0	207.000 24.000 231.000	120 -0.0677	53.940 0.0 -15.645		Vel = 6.20	
B1			0.0 -28.92						38.295		K Factor = -4.67	
A2 to B2	19 19		-28.93 -28.93	1.25 1.38	4T	24.0	207.000 24.000 231.000	120 -0.0678	53.944 0.0 -15.653		Vel = 6.21	
B2			0.0 -28.93						38.291		K Factor = -4.68	
A3 to B3	19 19		-28.96 -28.96	1.25 1.38	4T	24.0	207.000 24.000 231.000	120 -0.0679	53.957 0.0 -15.680		Vel = 6.21	
B3			0.0 -28.96						38.277		K Factor = -4.68	
A4 to B4	19 19		-29.02 -29.02	1.25 1.38	4T	24.0	207.000 24.000 231.000	120 -0.0681	53.985 0.0 -15.736		Vel = 6.22	
B4			0.0 -29.02						38.249		K Factor = -4.69	
A5 to B5	19 19		-29.11 -29.11	1.25 1.38	4T	24.0	207.000 24.000 231.000	120 -0.0685	54.034 0.0 -15.834		Vel = 6.24	
B5			0.0 -29.11						38.200		K Factor = -4.71	
A6 to B6	19 19		-29.26 -29.26	1.25 1.38	4T	24.0	207.000 24.000 231.000	120 -0.0692	54.108 0.0 -15.981		Vel = 6.28	
B6			0.0 -29.26						38.127		K Factor = -4.74	
A7 to B7	19 19		-29.38 -29.38	1.25 1.38	4T	24.0	207.000 24.000 231.000	120 -0.0697	54.211 0.0 -16.102		Vel = 6.30	
B7			0.0 -29.38						38.109		K Factor = -4.76	
A8 to B8	19 19		-29.50 -29.5	1.25 1.38	4T	24.0	207.000 24.000 231.000	120 -0.0702	54.349 0.0 -16.226		Vel = 6.33	
B8			0.0 -29.50						38.123		K Factor = -4.78	
A9 to B9	19 0		-29.67 -29.67	1.25 1.38	4T	24.0	207.000 24.000 231.000	120 -0.0710	54.526 8.229 -16.399		Vel = 6.36	
B9			0.0 -29.67						46.356		K Factor = -4.36	

# Final Calculations : Hazen-Williams

ABL Fire Protection  
ILC Dover- Interior Renovation and Addition

Page 10  
Date 12/18/24

---

Node1	Elev1	K	Qa	Nom	Fitting		Pipe	CFact	Pt			
to					or		Ftngs		Pe	*****	Notes	*****
Node2	Elev2	Fact	Qt	Act	Equiv	Len	Total	Pf/Ft	Pf			

---



## Hydraulic Calculations by HydraCALC

ABL Fire Protection  
300 Hoke Street  
Raleigh, NC 27601  
919-291-7460

Job Name : ILC Dover- Clean Rooms  
Drawing :  
Location : Lillington, NC  
Remote Area : 2  
Contract :  
Data File : ILC Dover Calcs- Clean Rooms.WXF

---

**HYDRAULIC CALCULATIONS**  
*for*

**JOB NAME** ILC Dover  
**Location** Lillington, NC  
**Drawing #**  
**Contract #**  
**Date**

**DESIGN**

**Remote area #** 2  
**Remote area location** Clean Rooms  
**Occupancy classification** Ordinary Hazard  
**Density** .10 - Gpm/SqFt  
**Area of application** 900 - SqFt  
**Coverage/sprinkler** 130 - SqFt  
**Type of sprinkler calculated** Quick Response Pendent  
**# Sprinklers calculated** 12  
**In-rack demand** - GPM  
**Hose streams** 100 - GPM  
**Total water required (including hose streams)** 493.918 - GPM @ 68.41 - Psi  
**Type of system**  
**Volume of system (dry or pre-action)** - Gal

**WATER SUPPLY INFORMATION**

**Test date** 12-16-24  
**Location** Closest Private Hydrant  
**Source of info** Andrew King Engineering

**CONTRACTOR INFO** ABL Fire Protection

**Address** 300 Hoke St.; Raleigh. NC 27601

**Phone #** 919-291-7460

**Name of designer** Art Lamson

**Authority having jurisdiction** Harnett County

**NOTES:**

text1(35) - invisible


# Water Supply Curve

ABL Fire Protection  
ILC Dover- Clean Rooms

Page 2  
Date 12/18/24

City Water Supply:  
C1 - Static Pressure : 93  
C2 - Residual Pressure: 53  
C2 - Residual Flow : 1234

Demand:  
D1 - Elevation : 6.063  
D2 - System Flow : 243.918  
D2 - System Pressure : 68.410  
Hose ( Demand ) : 250  
D3 - System Demand : 493.918  
Safety Margin : 17.239

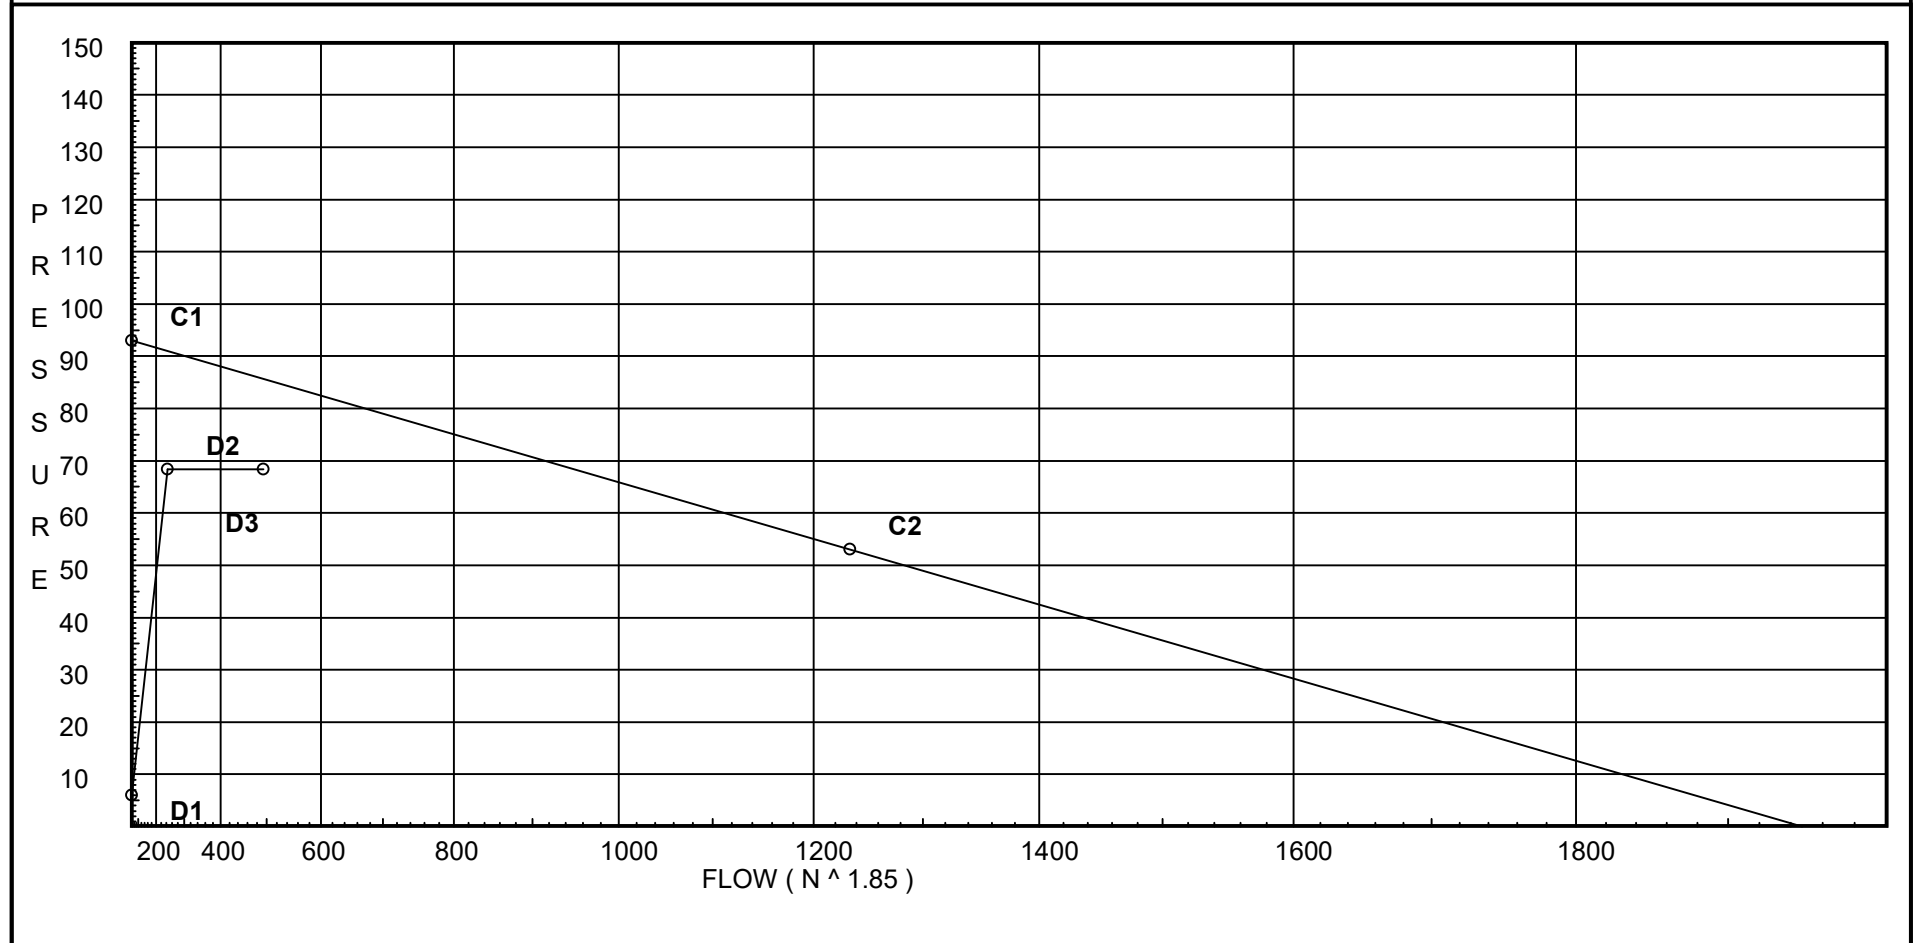



# Fittings Used Summary

ABL Fire Protection  
ILC Dover- Clean Rooms

Page 3  
Date 12/18/24

## Fitting Legend

Abbrev.	Name	1/2	3/4	1	1 1/4	1 1/2	2	2 1/2	3	3 1/2	4	5	6	8	10	12	14	16	18	20	24	
A	Alarm Rel E1 & E3							7.7	21.5		17		27	29								
E	NFPA 13 90' Standard Elbow	1	2	2	3	4	5	6	7	8	10	12	14	18	22	27	35	40	45	50	61	
G	NFPA 13 Gate Valve	0	0	0	0	0	1	1	1	1	2	2	3	4	5	6	7	8	10	11	13	
T	NFPA 13 90' Flow thru Tee	3	4	5	6	8	10	12	15	17	20	25	30	35	50	60	71	81	91	101	121	
Zwc	Watts 709	Fitting generates a Fixed Loss Based on Flow																				

## Units Summary

Diameter Units           Inches  
Length Units             Feet  
Flow Units                US Gallons per Minute  
Pressure Units           Pounds per Square Inch

Note: Fitting Legend provides equivalent pipe lengths for fittings types of various diameters. Equivalent lengths shown are standard for actual diameters of Sched 40 pipe and CFactors of 120 except as noted with \*. The fittings marked with a \* show equivalent lengths values supplied by manufacturers based on specific pipe diameters and CFactors and they require no adjustment. All values for fittings not marked with a \* will be adjusted in the calculation for CFactors of other than 120 and diameters other than Sched 40 per NFPA.

# Flow Summary - NFPA

ABL Fire Protection  
ILC Dover- Clean Rooms

Page 4  
Date 12/18/24

## SUPPLY ANALYSIS

<i>Node at Source</i>	<i>Static Pressure</i>	<i>Residual Pressure</i>	<i>Flow</i>	<i>Available Pressure</i>	<i>Total Demand</i>	<i>Required Pressure</i>
TEST	93.0	53	1234.0	85.648	493.92	68.41

## NODE ANALYSIS

<i>Node Tag</i>	<i>Elevation</i>	<i>Node Type</i>	<i>Pressure at Node</i>	<i>Discharge at Node</i>	<i>Notes</i>
S2	9.0	5.6	12.13	19.5	0.15 130
S5	9.0	5.6	12.13	19.5	0.15 130
21	10.0	4.71	19.46	20.76	K=K @ EQ2
22	10.0	4.71	19.6	20.83	K=K @ EQ2
23	10.0	4.71	20.23	21.16	K=K @ EQ2
24	10.0	4.71	21.57	21.85	K=K @ EQ2
25	10.0	4.71	17.17	19.5	K=K @ EQ2
26	10.0	4.71	17.3	19.57	K=K @ EQ2
27	10.0	4.71	17.85	19.88	K=K @ EQ2
28	10.0	4.71	19.05	20.54	K=K @ EQ2
29	10.0		25.69		
30	10.0	4.71	17.32	19.58	K=K @ EQ2
31	10.0	4.71	17.44	19.65	K=K @ EQ2
32	10.0	4.71	18.0	19.97	K=K @ EQ2
33	10.0	4.71	19.2	20.62	K=K @ EQ2
C1	10.0		31.58		
C2	10.0		31.58		
C3	10.0		31.58		
C4	10.0		31.58		
C5	10.0		31.91		
A1	19.0		51.53		
A2	19.0		51.53		
A3	19.0		51.54		
A4	19.0		51.57		
A5	19.0		51.61		
A6	19.0		51.68		
A7	19.0		51.77		
A8	19.0		51.89		
A9	19.0		52.04		
TOR	2.0		59.59		
BOR	2.0		60.63		
BASE	0.0		65.3	250.0	
TEST	-4.0		68.41		
B1	19.0		37.89		
B2	19.0		37.89		
B3	19.0		37.88		
B4	19.0		37.85		
B5	19.0		37.81		
B6	19.0		37.75		
CON1	19.0		37.72		

# Flow Summary - NFPA

ABL Fire Protection  
ILC Dover- Clean Rooms

Page 5  
Date 12/18/24

---

## *NODE ANALYSIS (cont.)*

<i>Node Tag</i>	<i>Elevation</i>	<i>Node Type</i>	<i>Pressure at Node</i>	<i>Discharge at Node</i>	<i>Notes</i>
B7	19.0		37.73		
B8	19.0		37.74		

# Final Calculations : Hazen-Williams

ABL Fire Protection  
ILC Dover- Clean Rooms

Page 6  
Date 12/18/24

Node1 to Node2	Elev1 Elev2	K Fact	Qa Qt	Nom Act	Fitting or Eqiv	Len	Pipe Ftngs Total	CFact Pf/Ft	Pt Pe Pf	*****	Notes	*****
S2 to EQ1	9 0	5.60	19.50 19.5	1 1.049	T	5.0	1.000 5.000 6.000	120 0.1242	12.125 3.898 0.745		Vel = 7.24	
EQ1			0.0 19.50						16.768		K Factor = 4.76	
S5 to EQ2	9 0	5.60	19.50 19.5	1 1.049	E T	2.0 5.0	2.250 7.000 9.250	120 0.1242	12.125 3.898 1.149		Vel = 7.24	
EQ2			0.0 19.50						17.172		K Factor = 4.71	
21 to 22	10 10	4.71	20.76 20.76	1.5 1.61			8.000 8.000	120 0.0174	19.461 0.0 0.139		K = K @ EQ2 Vel = 3.27	
22 to 23	10 10	4.71	20.83 41.59	1.5 1.61			10.000 10.000	120 0.0626	19.600 0.0 0.626		K = K @ EQ2 Vel = 6.55	
23 to 24	10 10	4.71	21.17 62.76	1.5 1.61			10.000 10.000	120 0.1340	20.226 0.0 1.340		K = K @ EQ2 Vel = 9.89	
24 to C4	10 10	4.71	21.85 84.61	1.5 1.61	T	8.0	35.000 8.000 43.000	120 0.2329	21.566 0.0 10.013		K = K @ EQ2 Vel = 13.33	
C4			0.0 84.61						31.579		K Factor = 15.06	
25 to 26	10 10	4.71	19.50 19.5	1.5 1.61			8.000 8.000	120 0.0154	17.172 0.0 0.123		K = K @ EQ2 Vel = 3.07	
26 to 27	10 10	4.71	19.57 39.07	1.5 1.61			10.000 10.000	120 0.0558	17.295 0.0 0.558		K = K @ EQ2 Vel = 6.16	
27 to 28	10 10	4.71	19.88 58.95	1.5 1.61			10.000 10.000	120 0.1193	17.853 0.0 1.193		K = K @ EQ2 Vel = 9.29	
28 to 29	10 10	4.71	20.54 79.49	1.5 1.61	E T	4.0 8.0	20.000 12.000 32.000	120 0.2075	19.046 0.0 6.640		K = K @ EQ2 Vel = 12.53	
29 to C5	10 10		79.82 159.31	2 2.067	T	10.0	18.000 10.000 28.000	120 0.2224	25.686 0.0 6.226		Vel = 15.23	
C5			0.0 159.31						31.912		K Factor = 28.20	
30 to 31	10 10	4.71	19.58 19.58	1.5 1.61			8.000 8.000	120 0.0156	17.315 0.0 0.125		K = K @ EQ2 Vel = 3.09	
31 to 32	10 10	4.71	19.65 39.23	1.5 1.61			10.000 10.000	120 0.0562	17.440 0.0 0.562		K = K @ EQ2 Vel = 6.18	

# Final Calculations : Hazen-Williams

ABL Fire Protection  
ILC Dover- Clean Rooms

Page 7  
Date 12/18/24

Node1 to Node2	Elev1 Elev2	K Fact	Qa Qt	Nom Act	Fitting or Eqiv	Len	Pipe Ftngs Total	CFact Pf/Ft	Pt Pe Pf	*****	Notes	*****
32 to 33	10 10	4.71	19.97 59.2	1.5 1.61			10.000 10.000	120 0.1202	18.002 0.0 1.202		K = K @ EQ2	
33 to 29	10 10	4.71	20.62 79.82	1.5 1.61	E T	4.0 8.0	19.000 12.000 31.000	120 0.2091	19.204 0.0 6.482		K = K @ EQ2	
29			0.0 79.82						25.686		K Factor = 15.75	
C1 to C2	10 10		0.0 0.0	2 2.157			3.000 3.000	120 0	31.579 0.0 0.0		Vel = 0	
C2 to C3	10 10		0.0 0.0	2 2.157			12.000 12.000	120 0	31.579 0.0 0.0		Vel = 0	
C3 to C4	10 10		0.0 0.0	2 2.157			5.000 5.000	120 0	31.579 0.0 0.0		Vel = 0	
C4 to C5	10 10		84.61 84.61	2.5 2.635			15.750 15.750	120 0.0211	31.579 0.0 0.333		Vel = 4.98	
C5 to CON1	10 19		159.31 243.92	2.5 2.635	E T	8.237 16.474	40.000 24.711 64.711	120 0.1499	31.912 -3.898 9.702		Vel = 14.35	
CON1			0.0 243.92						37.716		K Factor = 39.72	
A1 to A2	19 19		26.85 26.85	4 4.26			13.330 13.330	120 0.0002	51.529 0.0 0.003		Vel = 0.60	
A2 to A3	19 19		26.86 53.71	4 4.26			13.330 13.330	120 0.0009	51.532 0.0 0.012		Vel = 1.21	
A3 to A4	19 19		26.88 80.59	4 4.26			13.330 13.330	120 0.0019	51.544 0.0 0.025		Vel = 1.81	
A4 to A5	19 19		26.94 107.53	4 4.26			13.330 13.330	120 0.0032	51.569 0.0 0.042		Vel = 2.42	
A5 to A6	19 19		27.03 134.56	4 4.26			13.330 13.330	120 0.0048	51.611 0.0 0.064		Vel = 3.03	
A6 to A7	19 19		27.16 161.72	4 4.26			13.330 13.330	120 0.0068	51.675 0.0 0.090		Vel = 3.64	
A7 to A8	19 19		27.27 188.99	4 4.26			13.330 13.330	120 0.0090	51.765 0.0 0.120		Vel = 4.25	

# Final Calculations : Hazen-Williams

ABL Fire Protection  
ILC Dover- Clean Rooms

Page 8  
Date 12/18/24

Node1 to Node2	Elev1 Elev2	K Fact	Qa Qt	Nom Act	Fitting or Eqiv	Len	Pipe Ftngs Total	CFact Pf/Ft	Pt Pe Pf	*****	Notes	*****
A8 to A9	19 19		27.39 216.38	4 4.26			13.330 13.330	120 0.0116	51.885 0.0 0.155			Vel = 4.87
A9 to TOR	19 2		27.54 243.92	4 4.26			13.330 13.330	120 0.0144	52.040 7.363 0.192			Vel = 5.49
TOR to BOR	2 2		0.0 243.92	4 4.26	A G T	22.384 2.633 26.334	20.000 51.351 71.351	120 0.0144	59.595 0.0 1.031			Vel = 5.49
BOR to BASE	2 0		0.0 243.92	6 6.357	Zwc E	0.0 17.603	6.000 17.603 23.603	120 0.0021	60.626 4.622 0.049		** Fixed Loss = 3.756	Vel = 2.47
BASE to TEST	0 -4	H250	250.00 493.92	6 6.16	3E T G	60.252 43.037 4.304	100.000 107.593 207.593	140 0.0067	65.297 1.732 1.381			Vel = 5.32
TEST			0.0 493.92						68.410			K Factor = 59.72
B1 to B2	19 19		-26.85 -26.85	4 4.26			13.330 13.330	120 -0.0002	37.894 0.0 -0.003			Vel = 0.60
B2 to B3	19 19		-26.86 -53.71	4 4.26			13.330 13.330	120 -0.0009	37.891 0.0 -0.012			Vel = 1.21
B3 to B4	19 19		-26.88 -80.59	4 4.26			13.330 13.330	120 -0.0019	37.879 0.0 -0.025			Vel = 1.81
B4 to B5	19 19		-26.94 -107.53	4 4.26			13.330 13.330	120 -0.0032	37.854 0.0 -0.042			Vel = 2.42
B5 to B6	19 19		-27.03 -134.56	4 4.26			13.330 13.330	120 -0.0048	37.812 0.0 -0.064			Vel = 3.03
B6 to CON1	19 19		-27.16 -161.72	4 4.26			4.750 4.750	120 -0.0067	37.748 0.0 -0.032			Vel = 3.64
CON1 to B7	19 19		243.92 82.2	4 4.26			8.580 8.580	120 0.0019	37.716 0.0 0.016			Vel = 1.85
B7 to B8	19 19		-27.27 54.93	4 4.26			13.330 13.330	120 0.0010	37.732 0.0 0.013			Vel = 1.24
B8 to B9	19 0		-27.39 27.54	4 4.26			13.330 13.330	120 0.0002	37.745 8.229 0.003			Vel = 0.62
B9			0.0 27.54						45.977			K Factor = 4.06
A1 to B1	19 19		-26.85 -26.85	1.25 1.38	4T	24.0	207.000 24.000 231.000	120 -0.0590	51.529 0.0 -13.635			Vel = 5.76

# Final Calculations : Hazen-Williams

ABL Fire Protection  
ILC Dover- Clean Rooms

Page 9  
Date 12/18/24

Node1 to Node2	Elev1 Elev2	K Fact	Qa Qt	Nom Act	Fitting or Eqiv	Len	Pipe Ftngs Total	CFact Pf/Ft	Pt Pe Pf	*****	Notes	*****
B1			0.0 -26.85						37.894		K Factor = -4.36	
A2 to B2	19 19		-26.86 -26.86	1.25 1.38	4T	24.0	207.000 24.000 231.000	120 -0.0591	51.532 0.0 -13.641		Vel = 5.76	
B2			0.0 -26.86						37.891		K Factor = -4.36	
A3 to B3	19 19		-26.88 -26.88	1.25 1.38	4T	24.0	207.000 24.000 231.000	120 -0.0592	51.544 0.0 -13.665		Vel = 5.77	
B3			0.0 -26.88						37.879		K Factor = -4.37	
A4 to B4	19 19		-26.94 -26.94	1.25 1.38	4T	24.0	207.000 24.000 231.000	120 -0.0594	51.569 0.0 -13.715		Vel = 5.78	
B4			0.0 -26.94						37.854		K Factor = -4.38	
A5 to B5	19 19		-27.03 -27.03	1.25 1.38	4T	24.0	207.000 24.000 231.000	120 -0.0597	51.611 0.0 -13.799		Vel = 5.80	
B5			0.0 -27.03						37.812		K Factor = -4.40	
A6 to B6	19 19		-27.16 -27.16	1.25 1.38	4T	24.0	207.000 24.000 231.000	120 -0.0603	51.675 0.0 -13.927		Vel = 5.83	
B6			0.0 -27.16						37.748		K Factor = -4.42	
A7 to B7	19 19		-27.27 -27.27	1.25 1.38	4T	24.0	207.000 24.000 231.000	120 -0.0607	51.765 0.0 -14.033		Vel = 5.85	
B7			0.0 -27.27						37.732		K Factor = -4.44	
A8 to B8	19 19		-27.39 -27.39	1.25 1.38	4T	24.0	207.000 24.000 231.000	120 -0.0612	51.885 0.0 -14.140		Vel = 5.88	
B8			0.0 -27.39						37.745		K Factor = -4.46	
A9 to B9	19 0		-27.54 -27.54	1.25 1.38	4T	24.0	207.000 24.000 231.000	120 -0.0619	52.040 8.229 -14.292		Vel = 5.91	
B9			0.0 -27.54						45.977		K Factor = -4.06	