
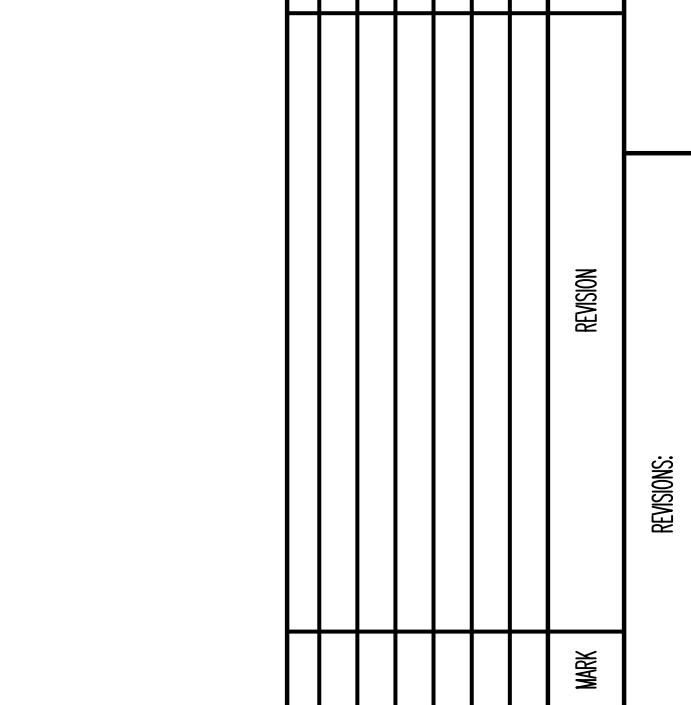
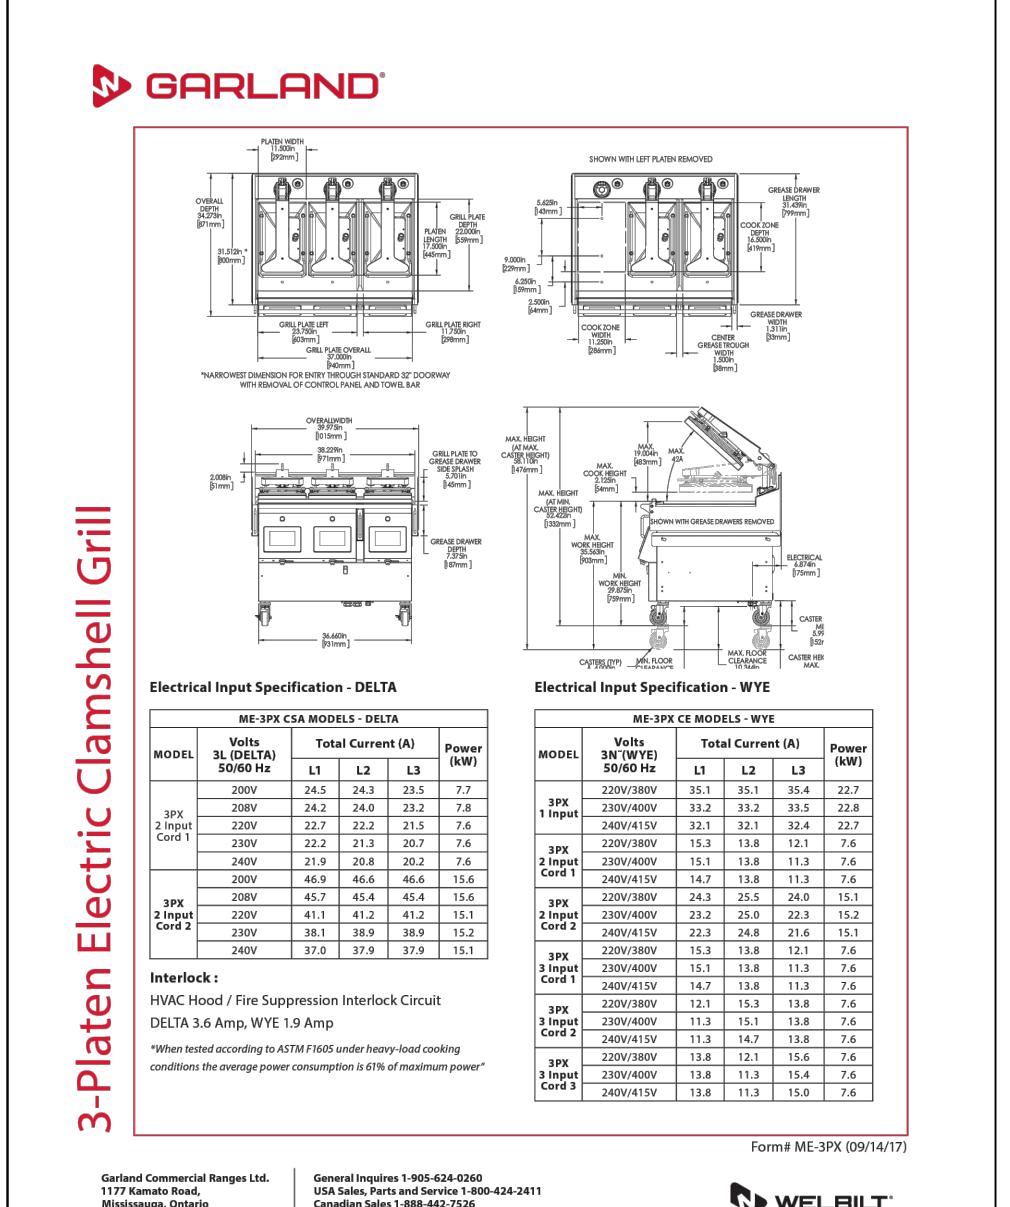
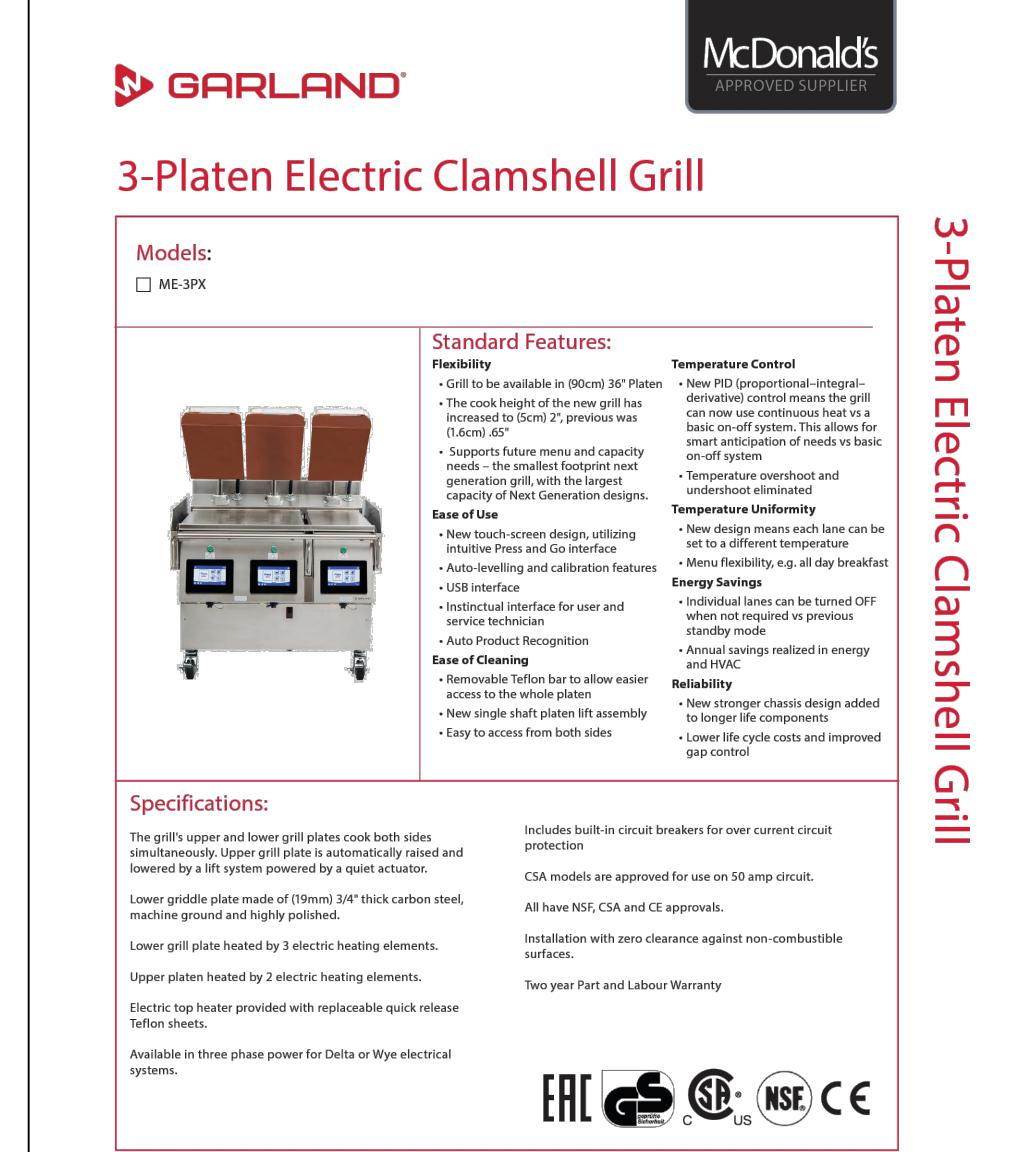
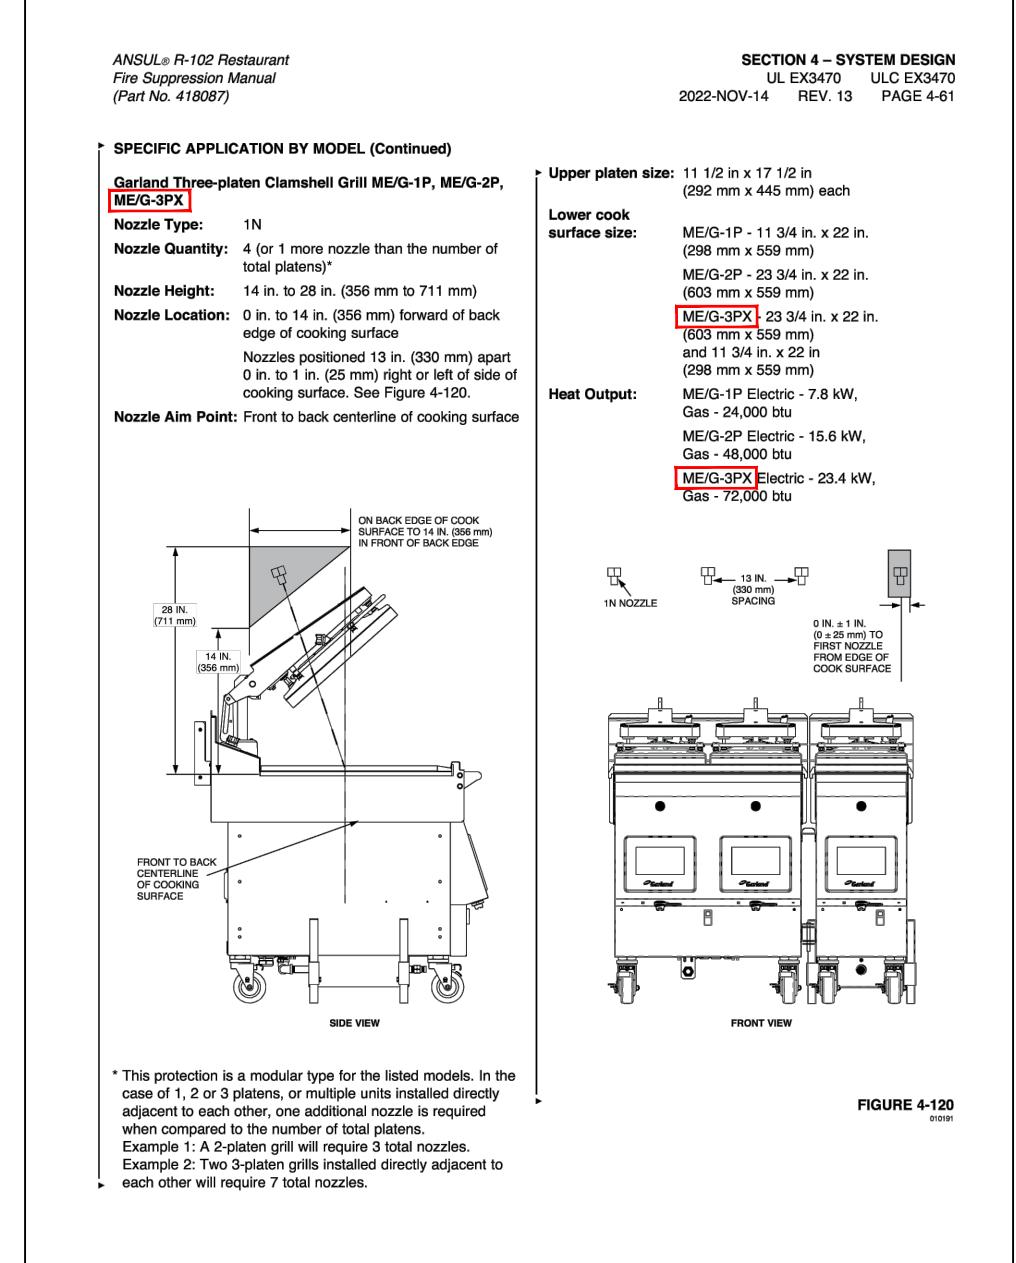
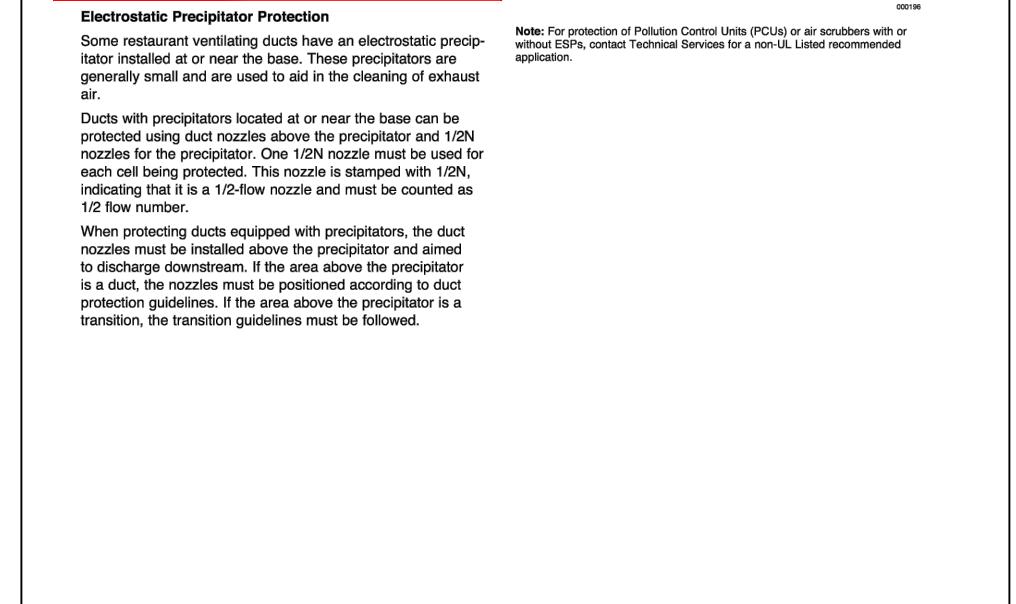


ANSUL R-102 DETAILS


- * DETECTOR TEMP PER ANSUL MANUAL PAGE 3-11 REV 11, 4-71 TO 4-72 REV 11
- * ALL PIPING 3/8" SCH. 40 BLACK STEEL PER ANSUL MANUAL PAGE 4-67 TO 4-69, REV 11
- * ALL FITTINGS 3/8" BLACK STEEL PER ANSUL MANUAL PAGE 4-67 TO 4-69, REV 11
- * PULL STATION IN AISLE OF EGRESS. SEE SHEET K1.0 FOR EXACT LOCATION.
- * PULL STATIONS AND HOODS TO BE LABELED WITH CORRESPONDING LABELS.
- * ELECTRIC APPLIANCES WITH AUTOMATIC SHUT-OFF
- * MICRO SWITCH FOR SHUT DOWNS AND/OR ALARM TIE IN

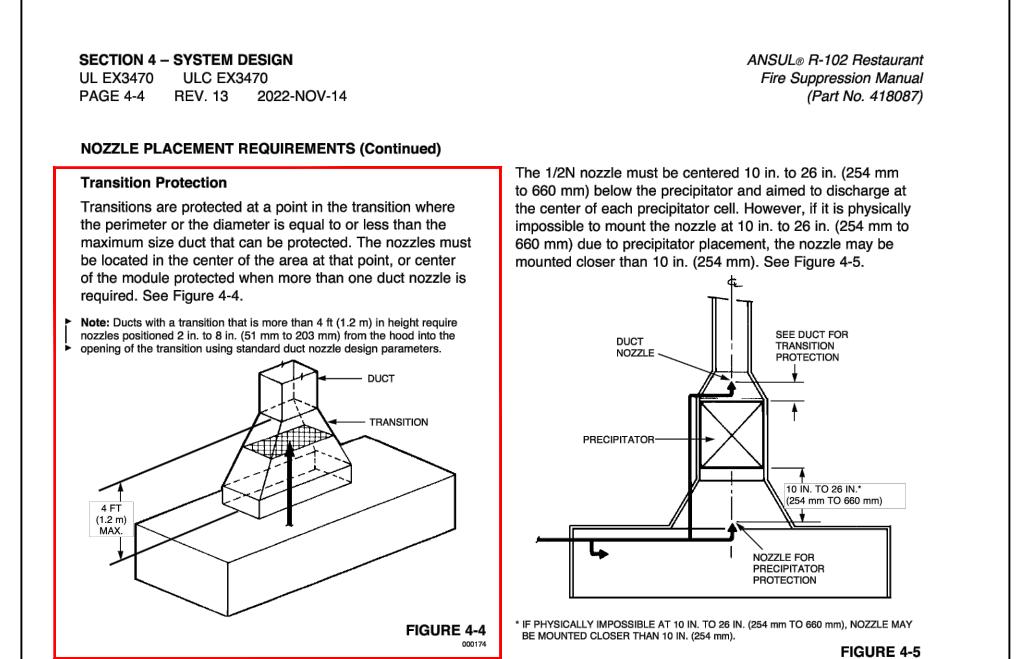

Seal

Pre-engineered
Fire System
Seal Not
Required

SHOP DRAWINGS

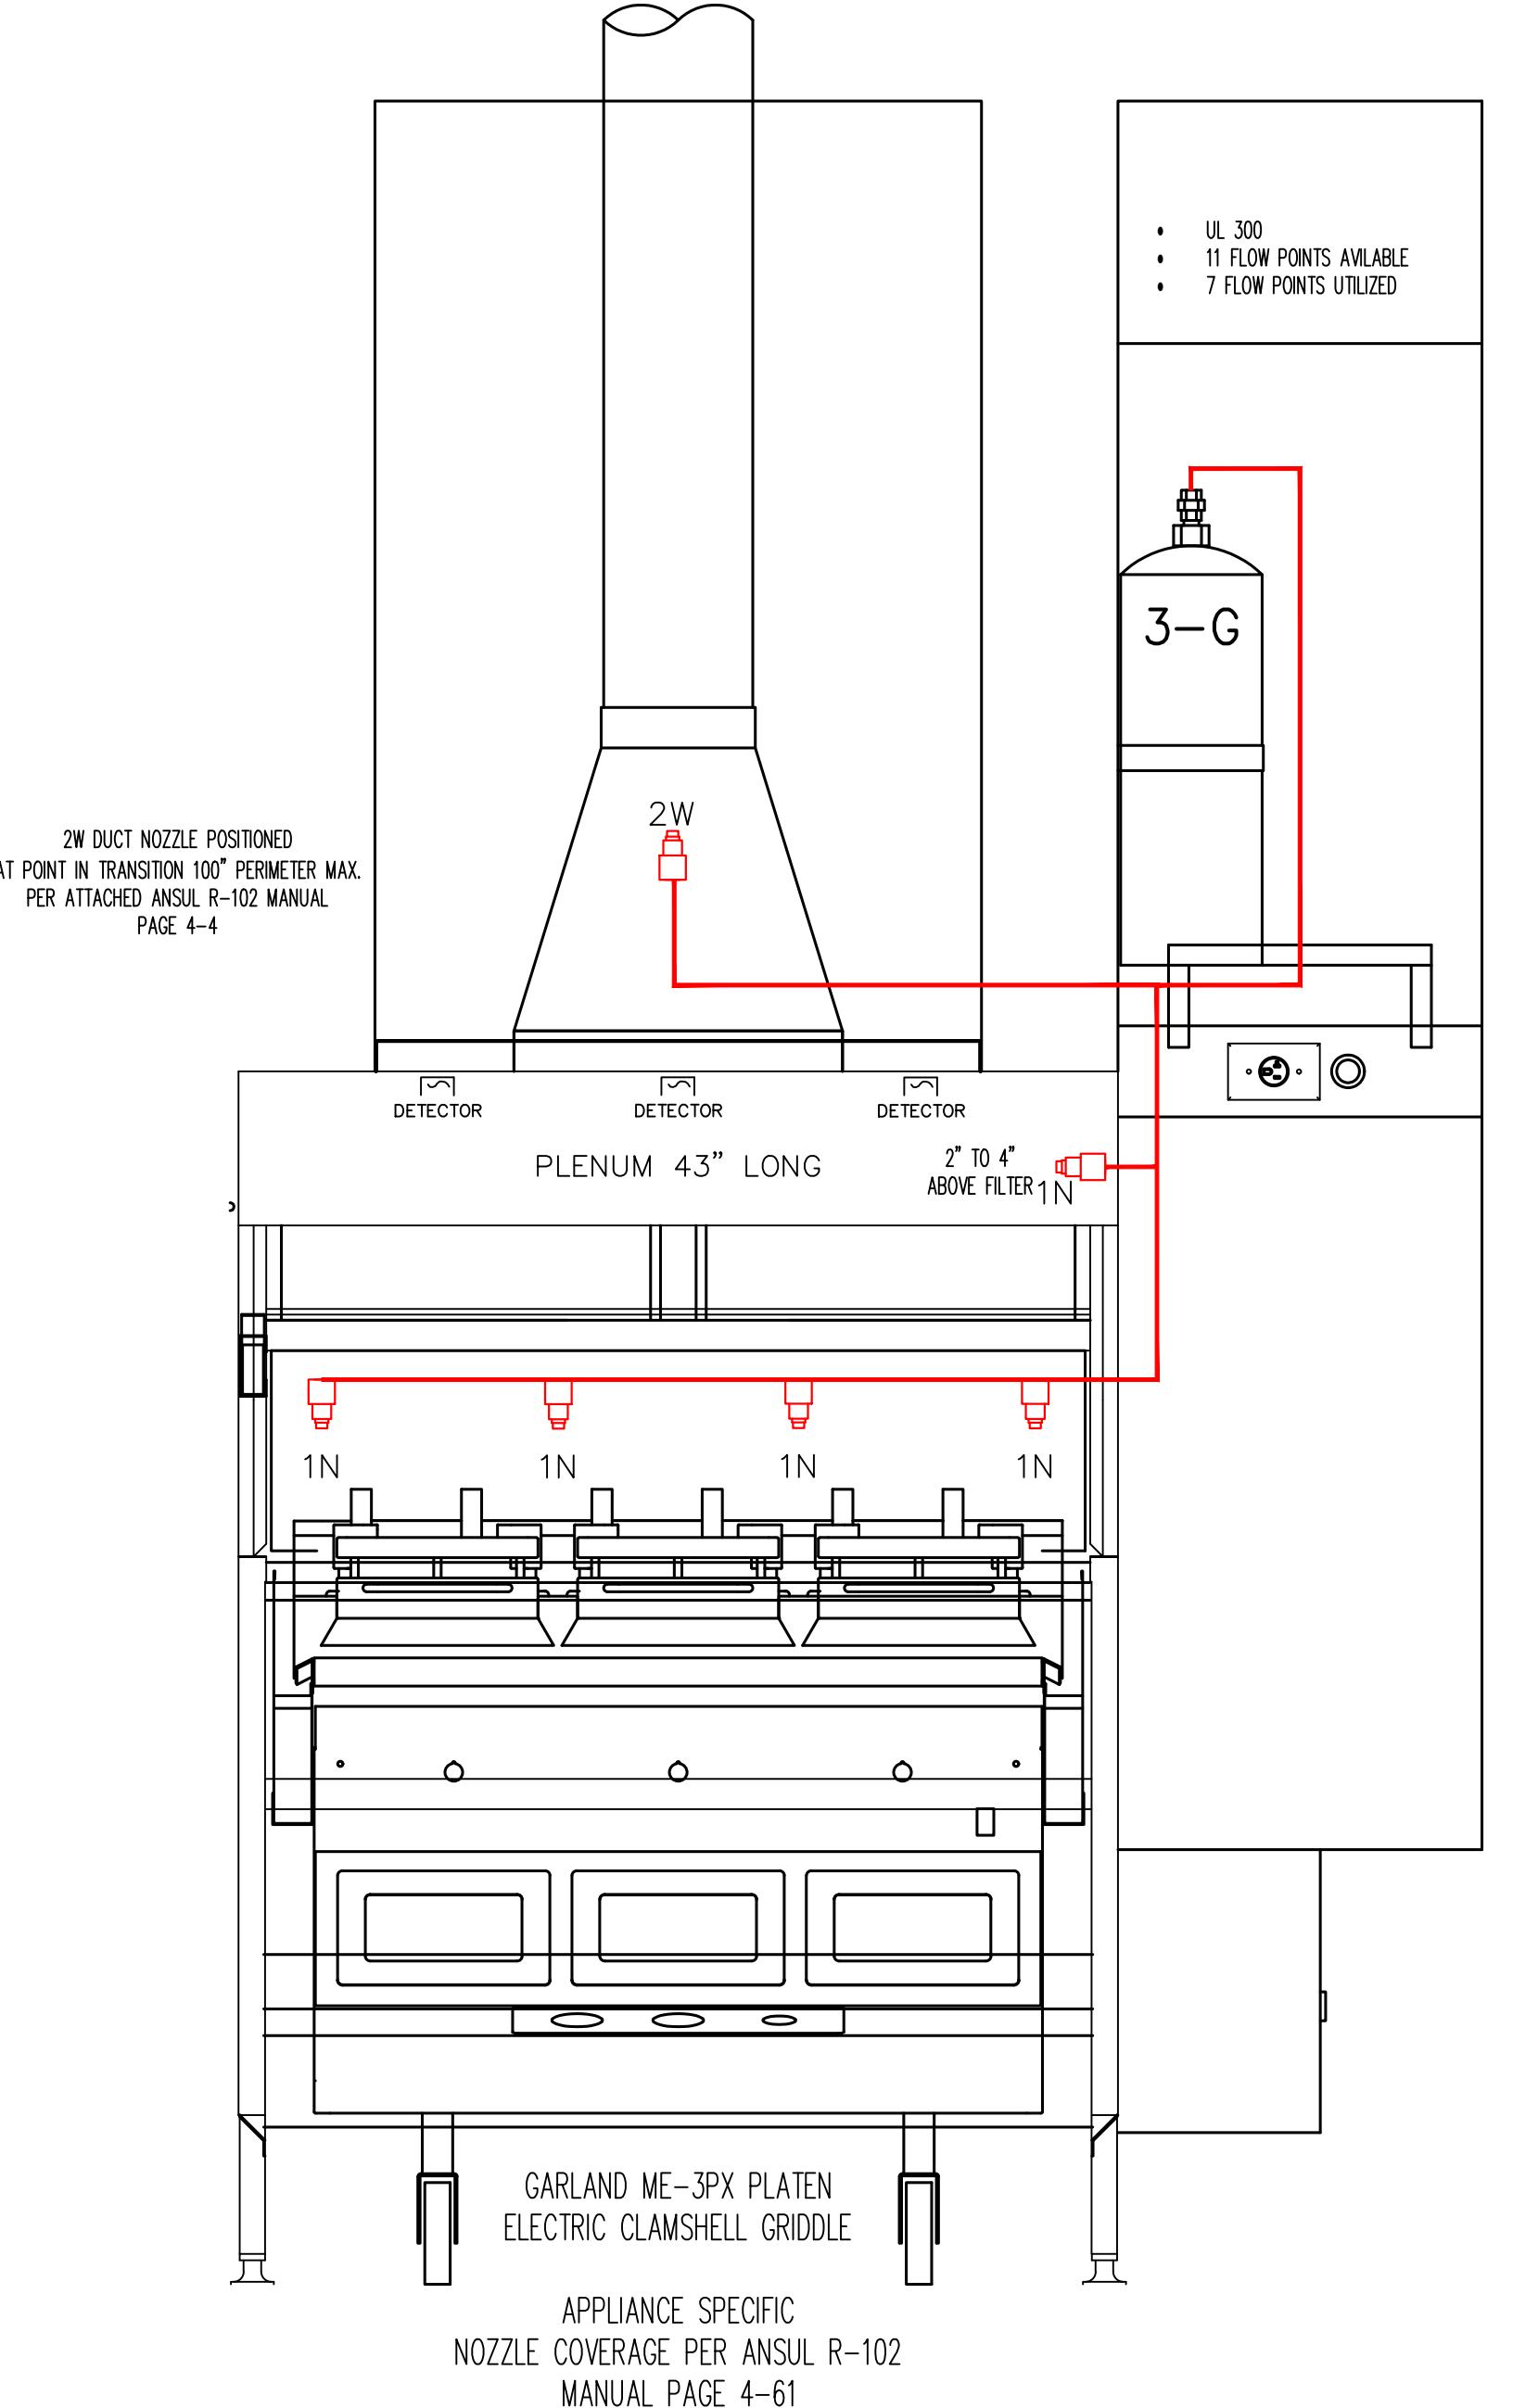

2 DUCT NOZZLE POSITIONED
AT POINT IN TRANSITION 100° PERIMETER MAX.
PER ATTACHED ANSUL R-102 MANUAL
PAGE 4-4

4

McDonald's #10721
102 West Cornelius Hornett Blvd
Lilington, NC 27546



DRAWN BY: MWE
CHECKED BY:
SCALE: N.T.S.
SHEET NO. 2 OF 4 SHEETS
DATE: NOVEMBER 6, 2025
PROJECT NO: N/A

Sheet Contents:
Ansul R-102 Fire System
Griddle Station

DRAWING NO.:

FS200