

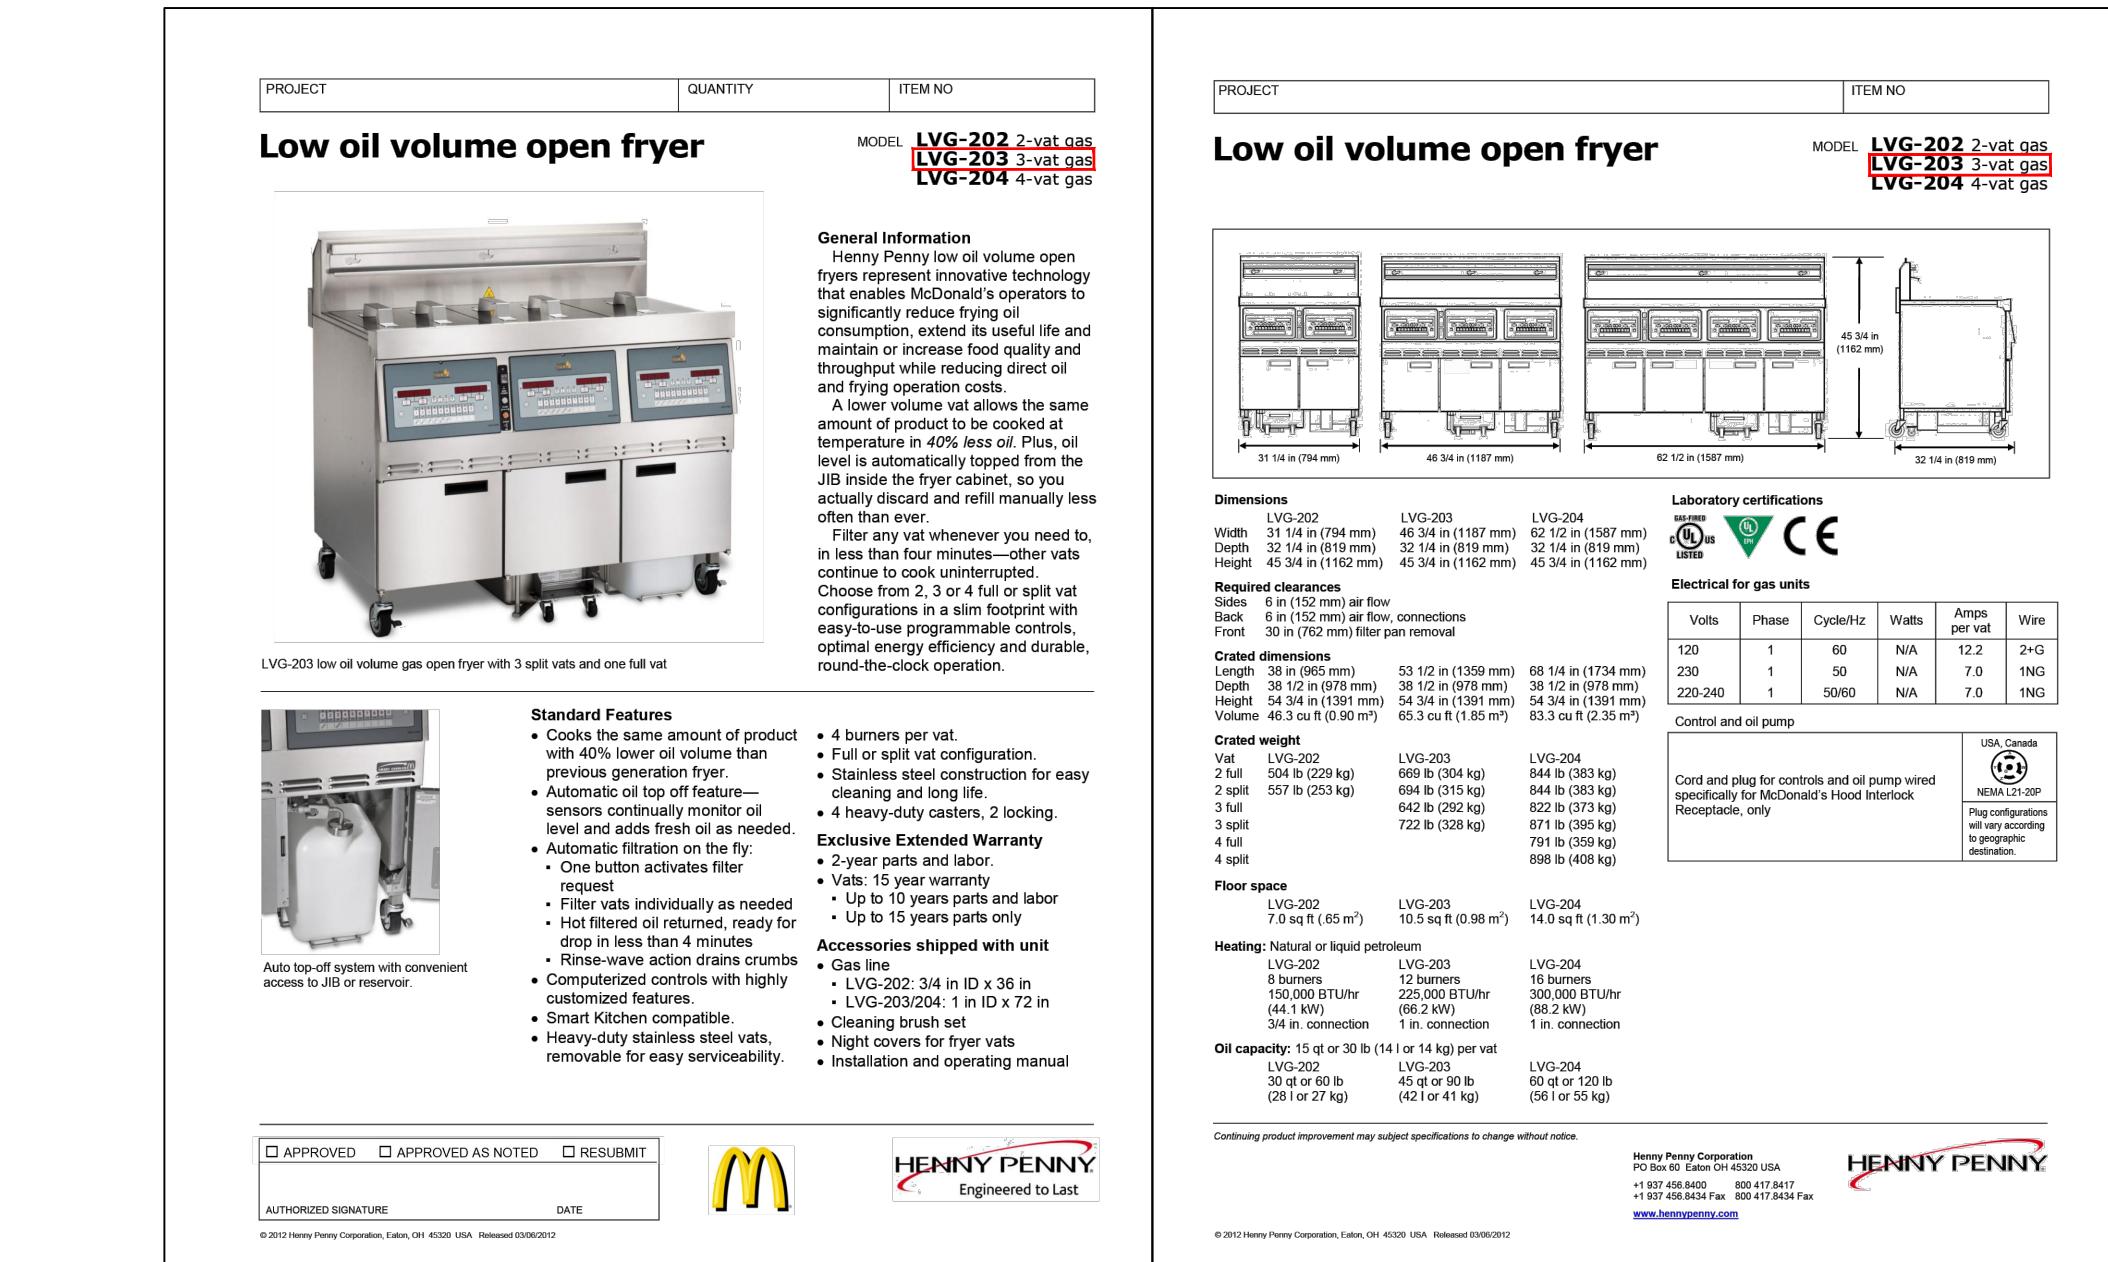
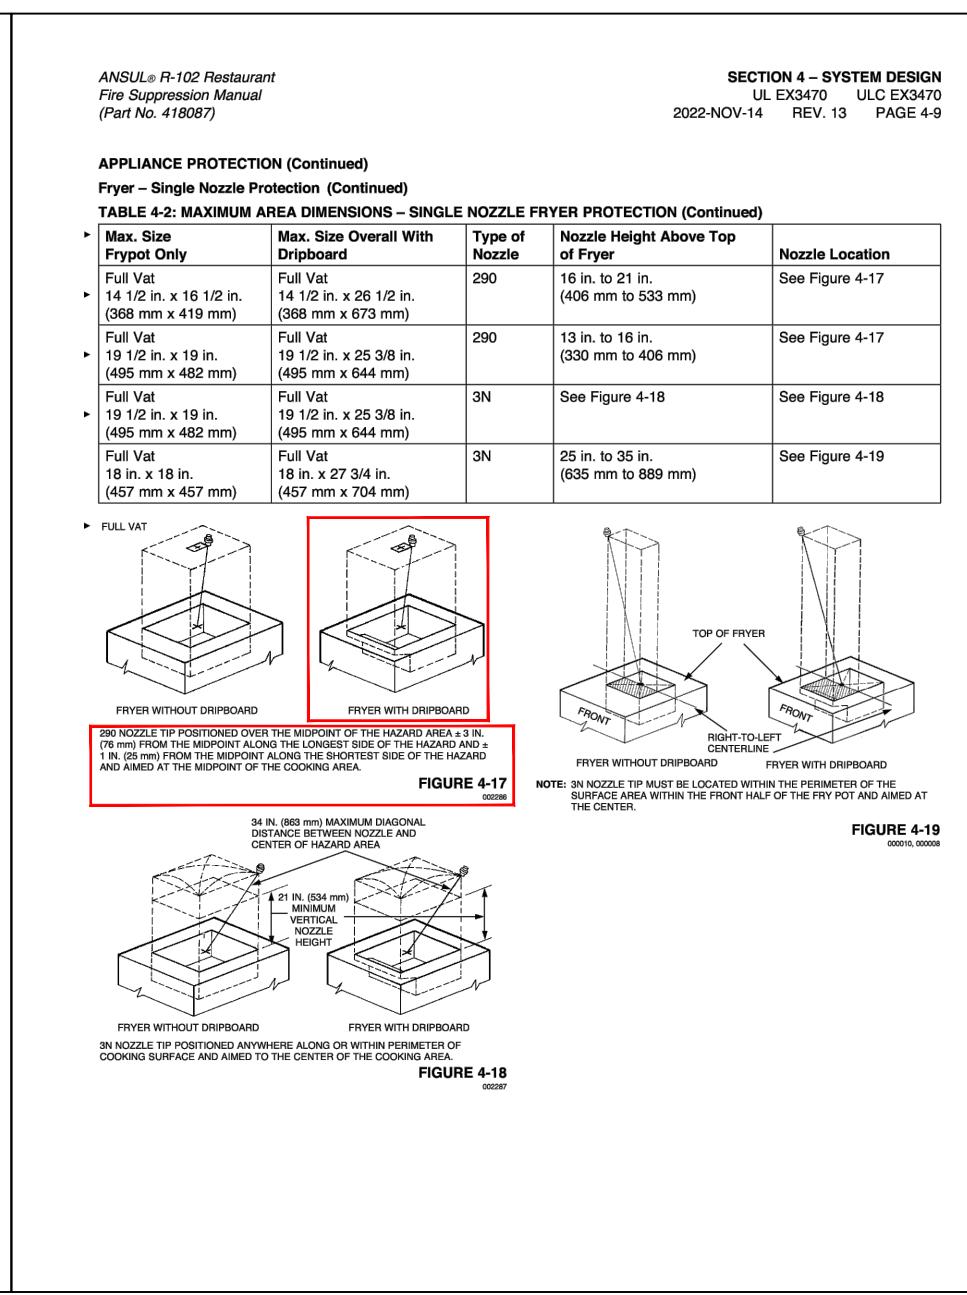
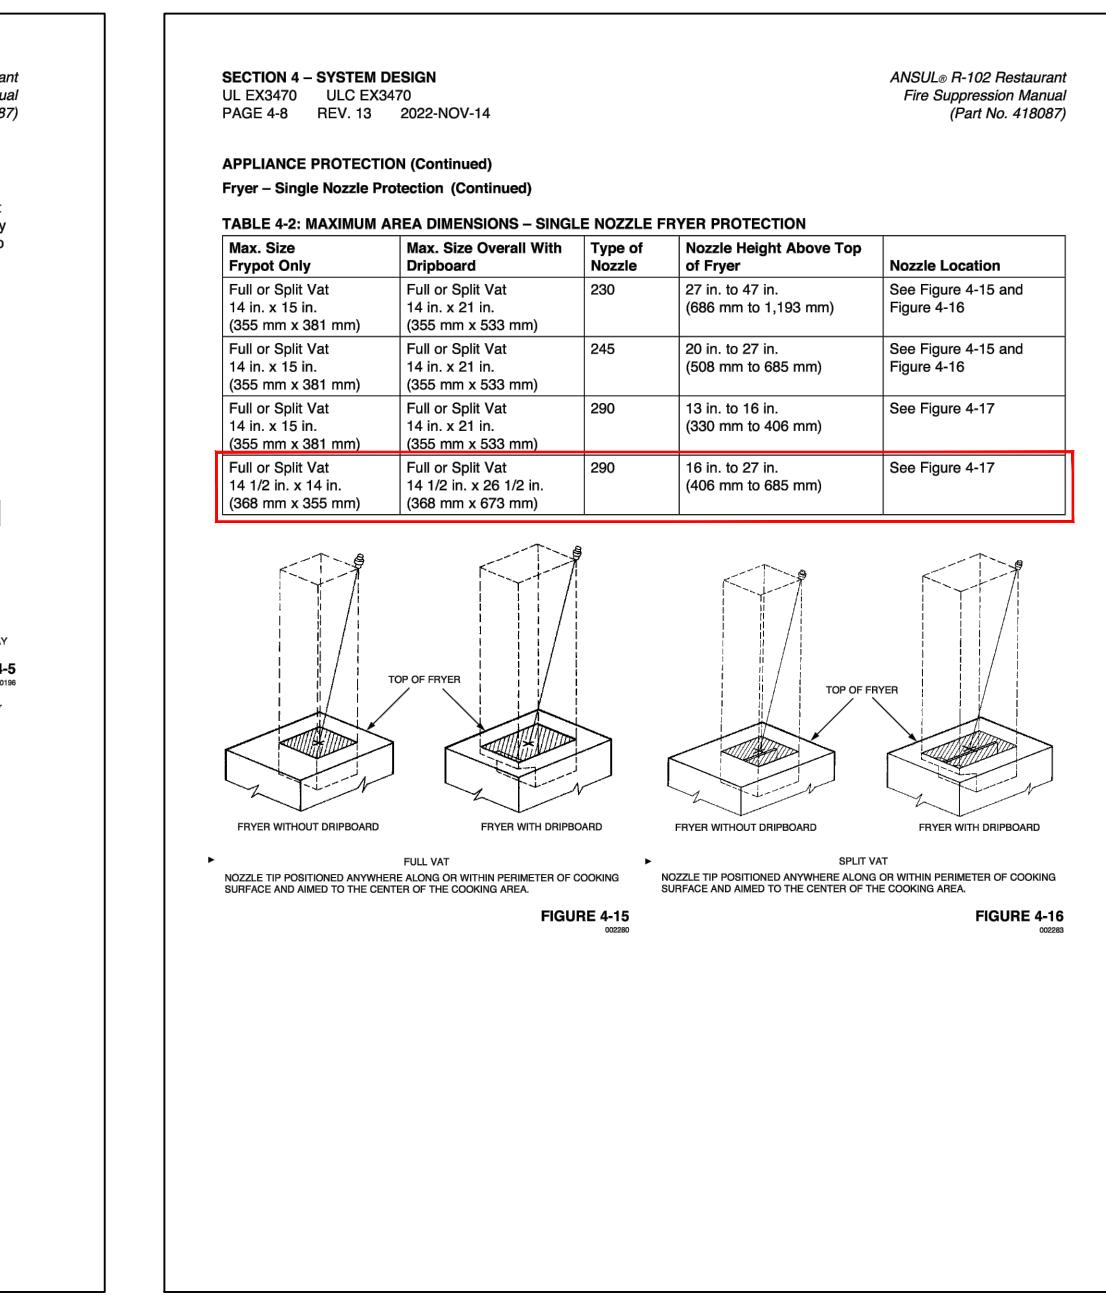


# ANSUL R-102 DETAILS

- \* DETECTOR TEMP PER ANSUL MANUAL PAGE 3-11 REV 11, 4-71 TO 4-72 REV 11
- \* ALL PIPING 3/8" SCH. 40 BLACK STEEL PER ANSUL MANUAL PAGE 4-67 TO 4-69, REV 11
- \* ALL FITTINGS 3/8" 150# BLACK STEEL PER ANSUL MANUAL PAGE 4-67 TO 4-69, REV 11
- \* PULL STATION IN AISLE OF EGRESS. SEE SHEET K1.0 FOR EXACT LOCATION.
- \* PULL STATIONS AND HOODS TO BE LABELED WITH CORRESPONDING LABELS.
- \* GAS APPLIANCES WITH AUTOMATIC SHUT-OFF
- \* MICRO SWITCH FOR SHUT DOWNS AND/OR ALARM TIE IN

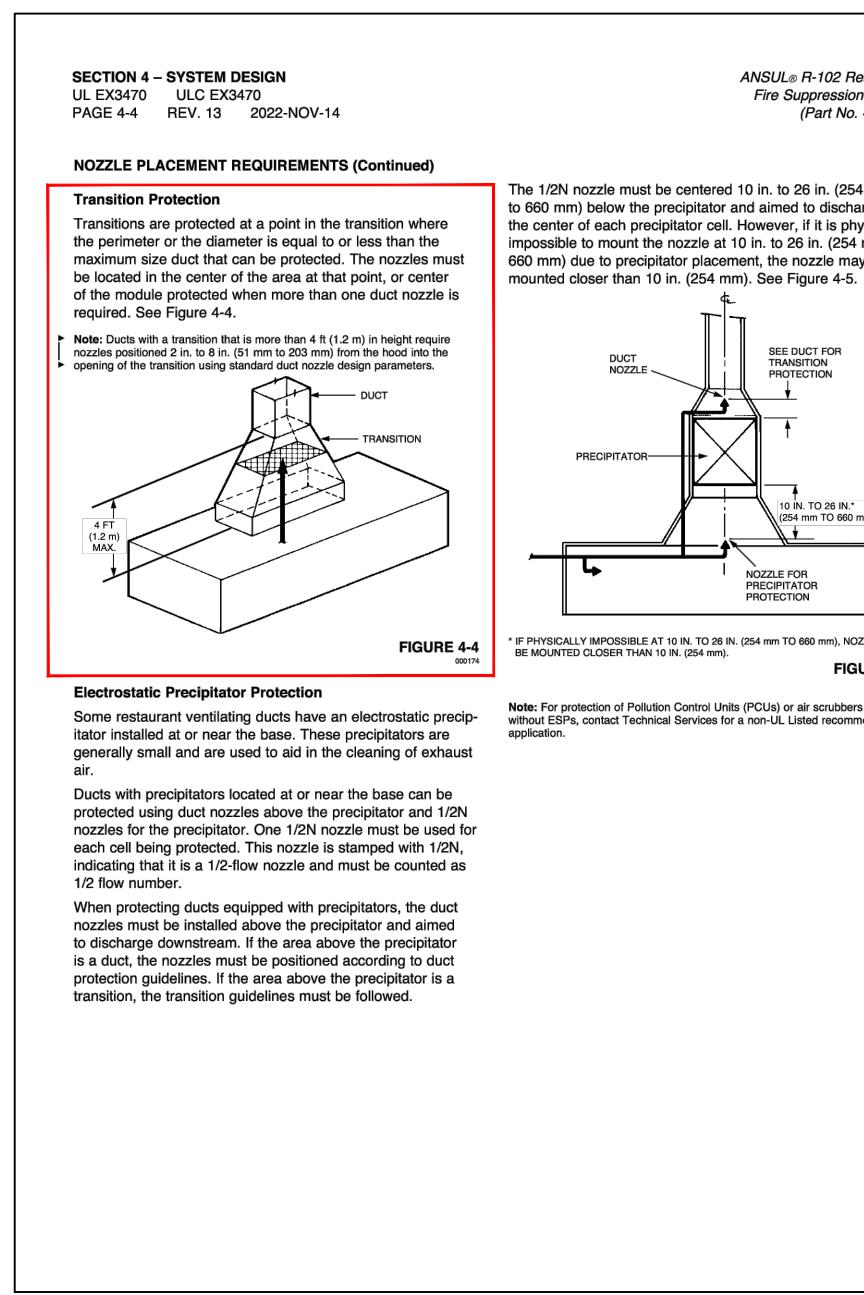

McDonald's #10721  
102 West Cornelius Harnett Blvd  
Lillington, NC 27546

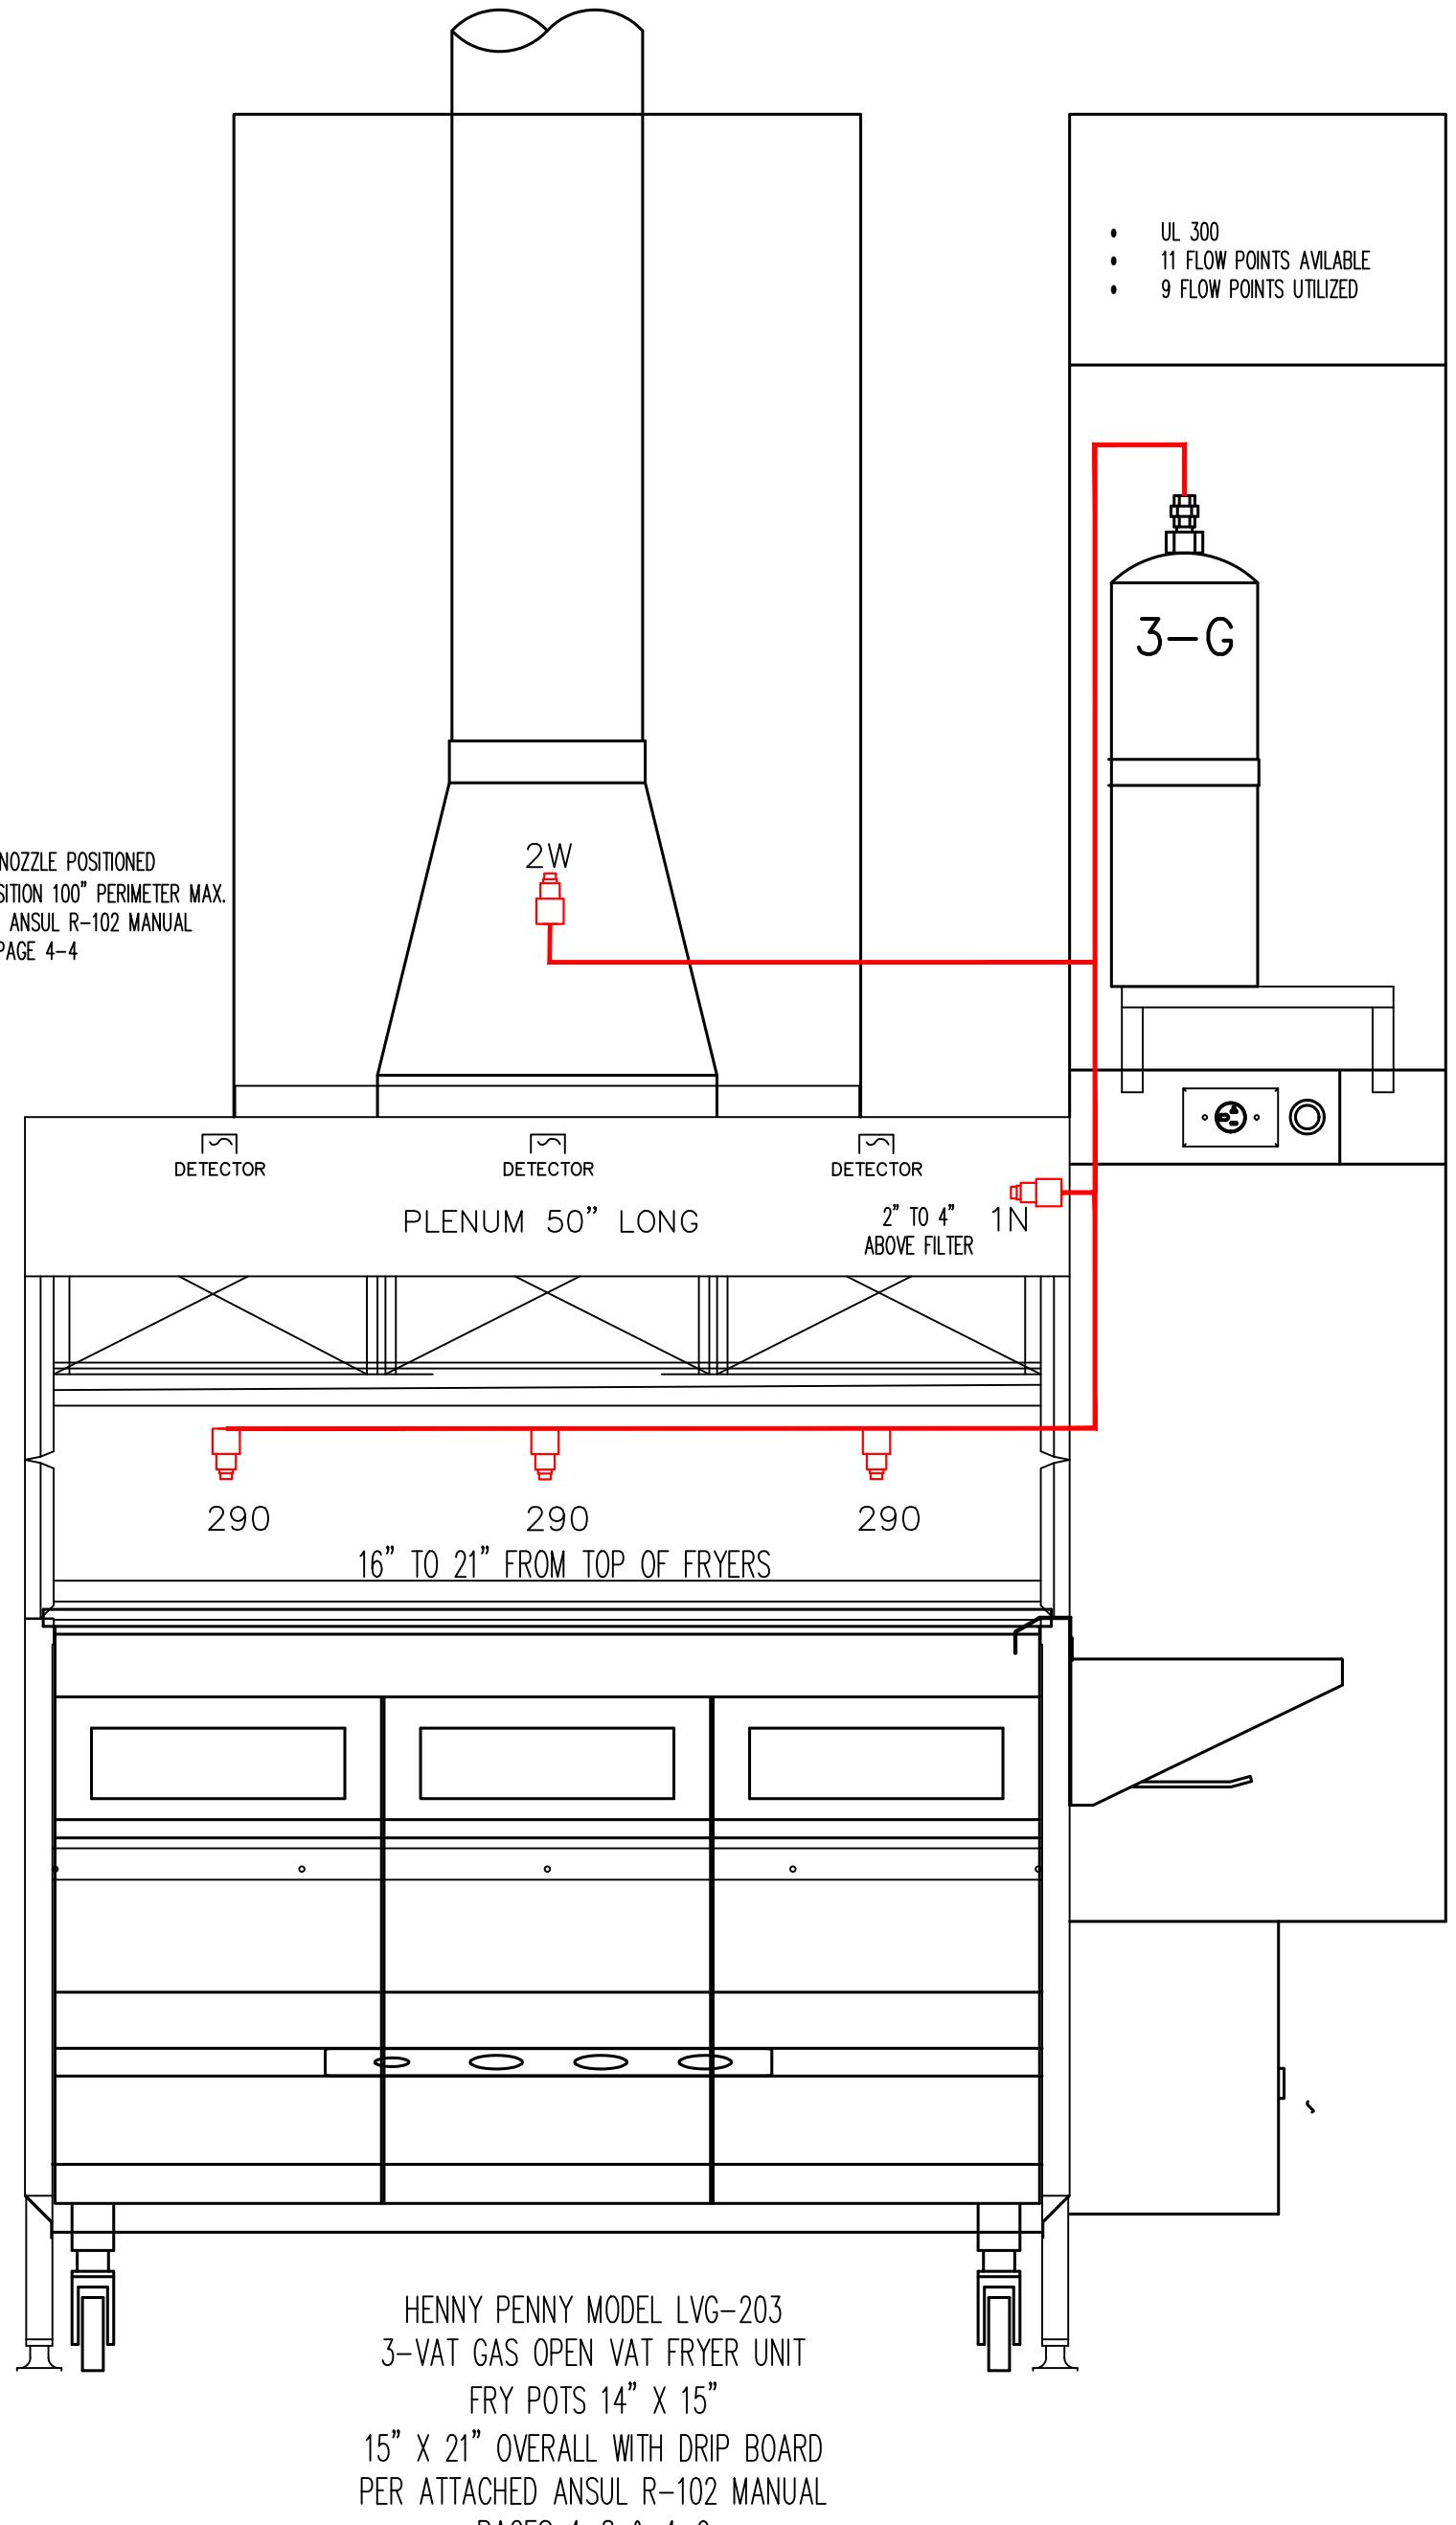

Sheet Contents:  
Ansul R-102 Fire System  
Fryer Station  
DRAWING NO.: FS300

NOTICE - THIS DRAWING, DATA AND DESIGNS THEREON SHALL NOT BE DUPLICATED, USED, OR DISCLOSED TO OTHERS FOR PROCUREMENT OR OTHER PURPOSES, EXCEPT AS OTHERWISE AUTHORIZED BY CONTRACT, WITHOUT WRITTEN PERMISSION OF BFPE INTERNATIONAL.

DATE: BY: REVISION: WORK: Seal: Seal: Pre-engineered Fire System Seal Not Required