



## Fire Marshal Division

P.O. Box 370  
Lillington, NC 27546  
910-893-7580

Reviewed for Fire Code Compliance



Leslie Jackson

06/13/2025 2:48:25 PM

# Application for Plan Review

Permit Type: \_\_\_\_\_

Date Received: \_\_\_\_\_ Received By: \_\_\_\_\_

Name of Project: \_\_\_\_\_

Physical Address of Project: \_\_\_\_\_

Plans Submitted By: \_\_\_\_\_

Project Phone: (\_\_\_\_\_) - \_\_\_\_ - \_\_\_\_

Contact Person/Address: \_\_\_\_\_

\_\_\_\_\_

Contact Phone: (\_\_\_\_\_) - \_\_\_\_ - \_\_\_\_ (\_\_\_\_\_) - \_\_\_\_ - \_\_\_\_

Contractor's Name/Info: \_\_\_\_\_

\_\_\_\_\_

Contractor's Phone: (\_\_\_\_\_) - \_\_\_\_ - \_\_\_\_

Contact Email: \_\_\_\_\_



- **Plans that are submitted will be reviewed as quickly as possible with an average time of review between 7-10 working days.**
- **Status checks may be conducted on plan reviews by visiting the website <http://hteweb.harnett.org/Click2GovBP/Index.jsp> or by calling the Harnett County Central Permitting Office (910-893-7525 : Opt. 2), or the Harnett County Fire Marshal's Office (910-893-7580).**
- **Approved plans must be picked up from the Central Permitting Office and all fees paid before any required inspections can be conducted.**

# Buckeye Pre-Engineered Fire Suppression System

Wet Chemical - Kitchen System


## Installation Location:

Pharaoh's  
54 Melody Lane  
Cameron, NC 28326

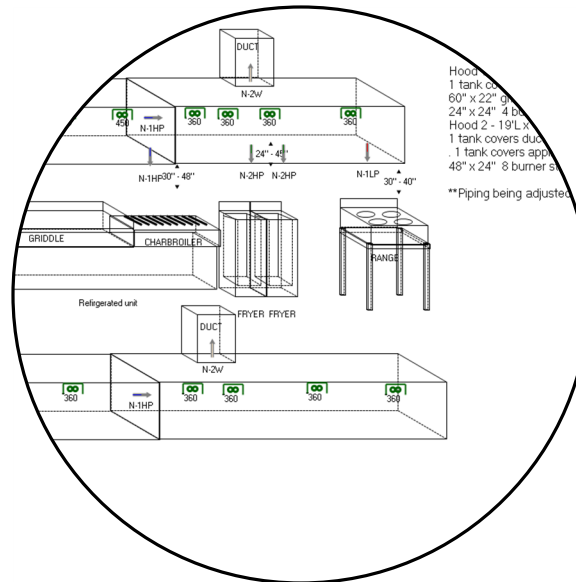

All American Fire Protection  
159 S Main St  
Spring Lake, NC 28390-3901  
910-496-0600  
[msmith@allamericanfireusa.com](mailto:msmith@allamericanfireusa.com)

# Buckeye Pre-Engineered Fire Suppression System

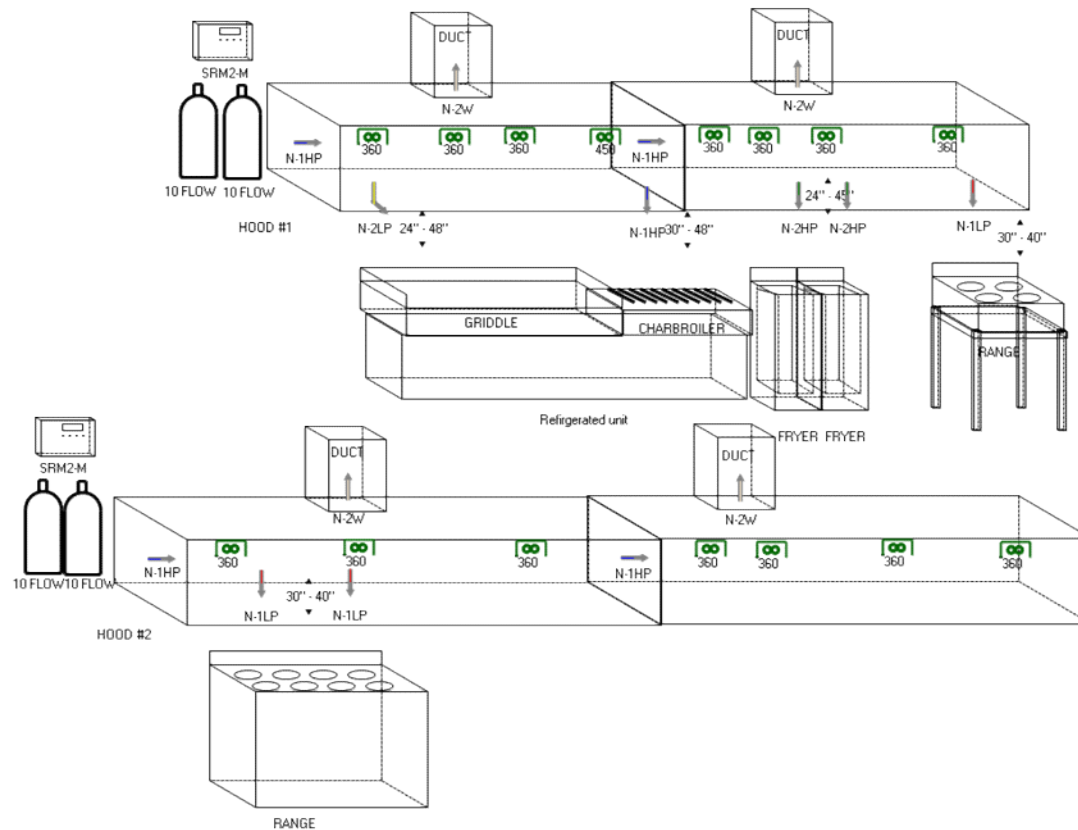

Hood 1 - 16'L x 4'W. 2 ducts @ 16" x 16". Buckeye BFR-10/10 fire system.  
 1 tank covers appliances using 8 flows. 1 tank covers plenum and ducts using 6 flows.  
 60" x 22" griddle, 36" x 22" radiant chargrill, Double vat fryer (vats 13" x 16" each)  
 24" x 24" 4 burner stove.  
 Hood 2 - 19'L x 4'W. 2 ducts @ 16" x 16". Buckeye BFR- 10/10 fire system.  
 1 tank covers ducts/plenum using 6 flows.  
 1 tank covers appliances using 2 flows.  
 48" x 24" 8 burner stove.

\*\*Piping being adjusted for proper coverage of new appliances.

Total System Flow Points = 40 : Flow Points Used = 22



Designed & Installed by:  
 All American Fire Protection  
 159 S Main St  
 Spring Lake, NC 28390-3901  
 910-496-0600

For:  
 Pharaoh's  
 54 Melody Lane  
 Cameron, NC 28326

Job: Adjust coverage for new appliances

Designer: MS

Date: 6/12/2025

# Buckeye Pre-Engineered Fire Suppression System

## Notes

- Coverage being adjusted for new appliances.



Designed & Installed by:  
All American Fire Protection  
159 S Main St  
Spring Lake, NC 28390-3901

For:  
Pharaoh's  
54 Melody Lane  
Cameron, NC 28326