

Abby Empanadas - 8018 Elliott Bridge Road, Spring Lake, NC 28390

GENERAL NOTES:

INSTALLATION PER IFC-2018, NFPA 96, 17A, AND UL 300 STANDARDS
AND PER MANUFACTURERS' INSTRUCTIONS/RECOMMENDATIONS
DESIGN BASED ON SECTION IV OF PYROCHEM INSTALLATION MANUAL

ALL PIPE AND FITTINGS ARE 3/8" SCHEDULE 40 BLACK IRON & CHROME
PIPING CONFIGURATIONS & LIMITATIONS ARE TOO LENGTHY TO LIST
PIPING SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S
REQUIREMENTS SEE CHAPTER 4 - DISTRIBUTION PIPING REQUIREMENTS

ACTUATION & EXPELLENT HOSES, PIPING OR TUBING SHALL BE INSTALLED IN
ACCORDANCE WITH CHAPTER 5:"INSTALLING THE ACTUATION & EXPELLANT GAS LINES"

DETECTION LINE LIMITATIONS SHALL BE INSTALLED IN ACCORDANCE WITH
PYROCHEMS TECHNICAL MANUAL CHAPTER 4 - SYSTEM DESIGN
SCISSOR STYLE DETECTORS SHALL BE USED WITHOUT OFF-SET CONDUIT.
MAXIMUM # OF DETECTORS IS 15. MAXIMUM NUMBER OF CORNER PULLEYS IS 20
WITH A MAXIMUM OF 150' OF 1/2" EMT
FUSIBLE LINK INSTALLATION SHALL CONFORM TO MANUFACTURER'S INSTRUCTIONS
APPLIANCES WITH A CONTINUOUS COOKING SURFACE UP TO 48" X 48" SHALL BE
PROTECTED WITH A SINGLE DETECTOR
APPLIANCES EXCEEDING 48" X 48" SHALL BE PROTECTED BY MULTIPLE DETECTORS

REMOTE MANUAL PULL STATION(S) SHALL BE INSTALLED ON A PATH OF EGRESS OR EXIT
AND IN ACCORDANCE WITH PYROCHEM TECHNICAL MANUAL CHAPTER 4 - SYSTEM DESIGN
MAXIMUM NUMBER OF 20 CORNER PULLEYS, 150 FEET OF 1/2" EMT AND (1) TEE PULLEY

MECHANICAL GAS VALVE CONNECTIONS SHALL BE MADE IN ACCORDANCE WITH
CODE REQUIREMENTS & CHAPTER 4 - SYSTEM DESIGN OF THE PYROCHEM MANUAL
A MAXIMUM OF 20 CORNER PULLEYS, 150 FEET OF 1/2" EMT AND (1) TEE PULLEY

ELECTRIC GAS VALVES SHALL BE CONNECTED USING A RESET RELAY
RESET RELAY & ELECTRICAL PORTION OF VALVE INSTALLATION SHALL
BE BY A QUALIFIED ELECTRICIAN
CONFORMANCE WITH NFPA #70 IS THE RESPONSIBILITY OF THE
INSTALLING CONTRACTOR NOT FIRE PROTECTION

CONNECTION TO FIRE ALARM CONTROL PANEL TO BE MADE BY OTHERS WHEN APPLICABLE
ELECTRICAL DISCONNECTS TO BE PERFORMED BY QUALIFIED ELECTRICIAN, WHEN APPLICABLE
GAS VALVE TO BE INSTALLED BY A QUALIFIED PLUMBER WHEN APPLICABLE
CONFORMANCE TO APPLICABLE NFPA CODES FOR ALARM, ELECTRICAL & PLUMBING WORK
IS THE RESPONSIBILITY OF THE INSTALLING CONTRACTOR & IS NOT THE RESPONSIBILITY OF FIRE PROTECTION

CONDITION AND ACCEPTABILITY OF THE EXHAUST HOOD & DUCT IS THE RESPONSIBILITY
OF THE OWNER/OPERATOR

APPLIANCES SHOWN ON PLANS ARE REPRESENTATIONAL ONLY - ACTUAL APPLIANCES
MAY APPEAR DIFFERENT THAN SHOWN ON PLANS

GENERAL SEQUENCE OF OPERATION - NOT PROJECT SPECIFIC

UPON ACTIVATION OF A FUSIBLE LINK OR REMOTE MANUAL PULL STATION A PYROCHEM
WET CHEMICAL FIRE SYSTEM MAY RESULT IN THE FOLLOWING SEQUENCE OF OPERATION:

WET CHEMICAL SHALL DISCHARGE ONTO PROTECTED APPLIANCES & INTO DUCT & PLENUM AREAS OF HOOD
SIMULTANEOUSLY, IF CONNECTED, A FIRE ALARM SYSTEM SHALL BE ACTIVATED OR A HORN/STROBE SHALL ACTIVATE
(PRECISE OPERATIONS OF FIRE ALARM SYSTEM / CONTROL PANEL ARE NOT THE RESPONSIBILITY OF THE
SUPPRESSION SYSTEM CONTRACTOR AND ARE NOT LISTED ON THESE PLANS)
SIMULTANEOUSLY, ALL GAS APPLIANCES LOCATED UNDER THE HOOD SHALL SHUTDOWN VIA MECHANICAL OR
ELECTRICAL GAS VALVE
SIMULTANEOUSLY, ALL ELECTRICAL EQUIPMENT, PROTECTED OR UNPROTECTED, UNDER THE HOOD SHALL SHUTDOWN
SIMULTANEOUSLY, HOOD LIGHTS, AS PERMITTED BY CODE MAY REMAIN ON OR MAY SHUTDOWN
SIMULTANEOUSLY, INTERNAL MAKE-UP AIR SHALL SHUTDOWN
SIMULTANEOUSLY, EXTERNAL MAKE-UP AIR MAY REMAIN ON OR MAY SHUTDOWN
SIMULTANEOUSLY, EXHAUST FAN MAY OR MAY NOT CONTINUE TO OPERATE
(IF THE EXHAUST FAN IS OFF AT THE TIME OF DISCHARGE, THE FAN MAY OR MAY NOT TURN ON)

I.D. DESCRIPTION

K1 USED PYROCHEM CONTROL HEAD
CONTAINS (1) CARTRIDGE,
(1) SET OF MICROSWITCHES

K2 CYLINDER #1 - (1) PCL460 4.6 GALLON TANK 15 FLOW POINTS AVAIL. 13 USED

K3 HOOD #1: NEW TYPE I EXHAUST HOOD: 12'-0" X 54"
W/ A SINGLE BANK OF BAFFLED FILTERS
CONTAINS (2) EXHAUST DUCTS: 12" X 14"

K4 NEW MECHANICAL GAS VALVE LOCATED BELOW THE CEILING

K5 USED REMOTE MANUAL PULL STATION
LOCATED 48" A.F.F. ON PATH OF EGRESS OR EXIT

PYROCHEM MANUAL #	#18087-12	NOTES:
DRAWING #:	1 OF 1	
SCALE:	NTS	DATE:
DRAWN BY:	JCA	9/9/25

PROJECT NAME & ADDRESS:

Abby Empanadas

8018 Elliott Bridge Road
Spring Lake, NC 28390

I.D. NOZZLE DESCRIPTION

2D: EXHAUST DUCT PROTECTION - UP TO 100"

NOZZLE ID: 2D FLOW POINTS: 2
NOZZLE HEIGHT: 0" TO 6"
LOCATION: CENTER LINE OF AREA - AIM INTO OPENING
COVERAGE: 100" PERIMETER WITH 37 3/8" MAX DIAGONAL
ROUND DUCT MAXIMUM 31 7/8" DIAMETER

1H: PLENUM PROTECTION

NOZZLE ID: 1H FLOW POINTS: 1
NOZZLE HEIGHT: 1/3 WAY DOWN VERTICAL
LOCATION: 2" FROM BACK EDGE OF FILTER
WITHIN 6" OF END OF PLENUM
COVERAGE: LENGTH 10' X-0" WIDTH 4'-0"

1H: SMALL RANGE PROTECTION

NOZZLE ID: 1H FLOW POINTS: 1
NOZZLE HEIGHT: 40" TO 50"
LOCATION: CENTERLINE AIMED AS PER CHART PAGE 3-5
COVERAGE: MAXIMUM AREA: 336 SQ. IN., LONGEST SIDE 28"

1L: UPRIGHT / SALAMANDER BROILER PROTECTION

NOZZLE ID: 1L FLOW POINTS: 1
NOZZLE HEIGHT: 13" TO 24"
LOCATION: ABOVE GRATE, FRONT EDGE
AIM BACK OPPOSITE CORNER
COVERAGE: MAXIMUM AREA: 1064SQ. IN., LONGEST SIDE 36"

2L: LARGE BURNER RANGE PROTECTION


NOZZLE ID: 2L FLOW POINTS: 2
NOZZLE HEIGHT: 34" TO 48"
LOCATION: CENTER OF HAZARD OR SEE CHART
COVERAGE: MAXIMUM AREA: 784 SQ. IN., LONGEST SIDE 28"

I.D. APPLIANCE DESCRIPTION

A1 4 BURNER RANGE 24" X 24"

A2 6 BURNER RANGE 36" X 24"

A3 CHAINBROILER 30" X 20"

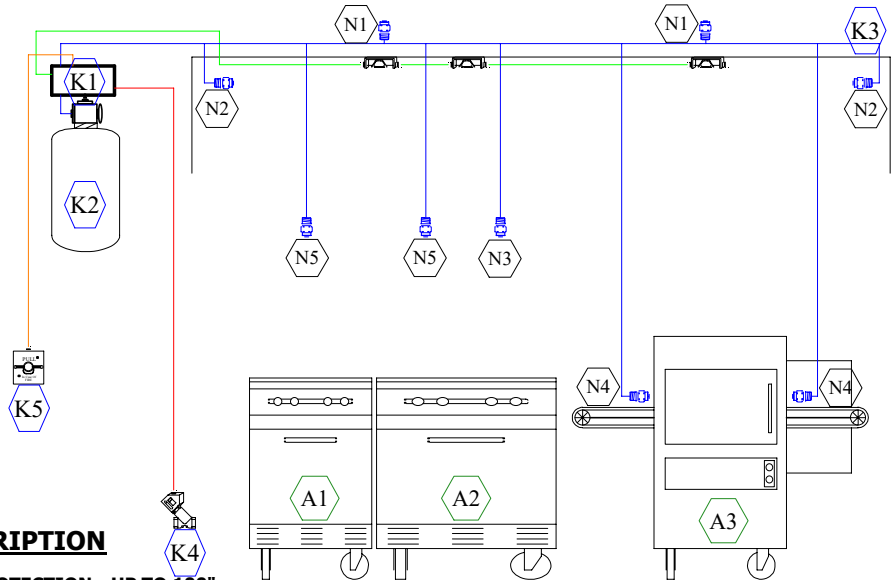

FIRE PROTECTION
1048 Bragg Blvd, Fayetteville, NC 28301
Phone: 910-486-6270



Fire Marshal Division

P.O. Box 370
Lillington, NC 27546
910-893-7580

Application for Plan Review

Permit Type: Hood Suppression upgrade

Date Received: _____ Received By: _____

Name of Project: Abby's Empanada's

Physical Address of Project: 8018 Elliott Bridge Rd. Spring Lake, NC 28390

Plans Submitted By: Justin Adams / Fire Protection

Project Phone: (910) - 486 - 6270

Contact Person/Address: Justin Adams 1048 Bragg blvd
Fayetteville, NC 28301

Contact Phone: (910) - 486 - 6270 (775) - 733 - 6530

Contractor's Name/Info: Fire Protection 1048 Bragg blvd
Fayetteville, NC 28301

Contractor's Phone: (910) - 486 - 6270

Contact Email: FireProtection@firepro.biz

- Plans that are submitted will be reviewed as quickly as possible with an average time of review between 7-10 working days.
- Status checks may be conducted on plan reviews by visiting the website <http://hteweb.harnett.org/Click2GovBP/Index.jsp> or by calling the Harnett County Central Permitting Office (910-893-7525 : Opt. 2), or the Harnett County Fire Marshal's Office (910-893-7580).
- Approved plans must be picked up from the Central Permitting Office and all fees paid before any required inspections can be conducted.