

IMPROVEMENT PERMIT

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) Edna P. Yarbrough☒ New Installation☒ Septic TankProperty Location: SR# 421 N☐ Repairs☒ Nitrification LineJust Before Lee Co Line RdSubdivision Lani YarbroughLot # 2 B

Tax ID # _____

Quadrant # _____

Number of Bedrooms Proposed: 3 1/2 4 (28x70) Lot Size: 1.00 ACBasement with Plumbing: ☐Garage: ☐meat onsiteWater Supply: ☐ Well ☒ Public☐ CommunityDo not Drive or park on Septic systemDistance From Well: 50 ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: ☒ Conventional☐ Other _____

Size of tank:

Septic Tank: 1000 gallons

Pump Tank: _____ gallons

Subsurface
Drainage FieldNo. of
ditches 4

exact length

of each ditch 75 ft.

width of

ditches 3 ft.

depth of

ditches 18 in.

French Drain Required: _____ Linear feet


Date: 5-10-2000

This permit is subject to revocation if site plans or intended use change.

Signed: Jon L. AM

Environmental Health Specialist

Maintain
All set Backs
Follow contours
STUB out
Plumbing
Shallow

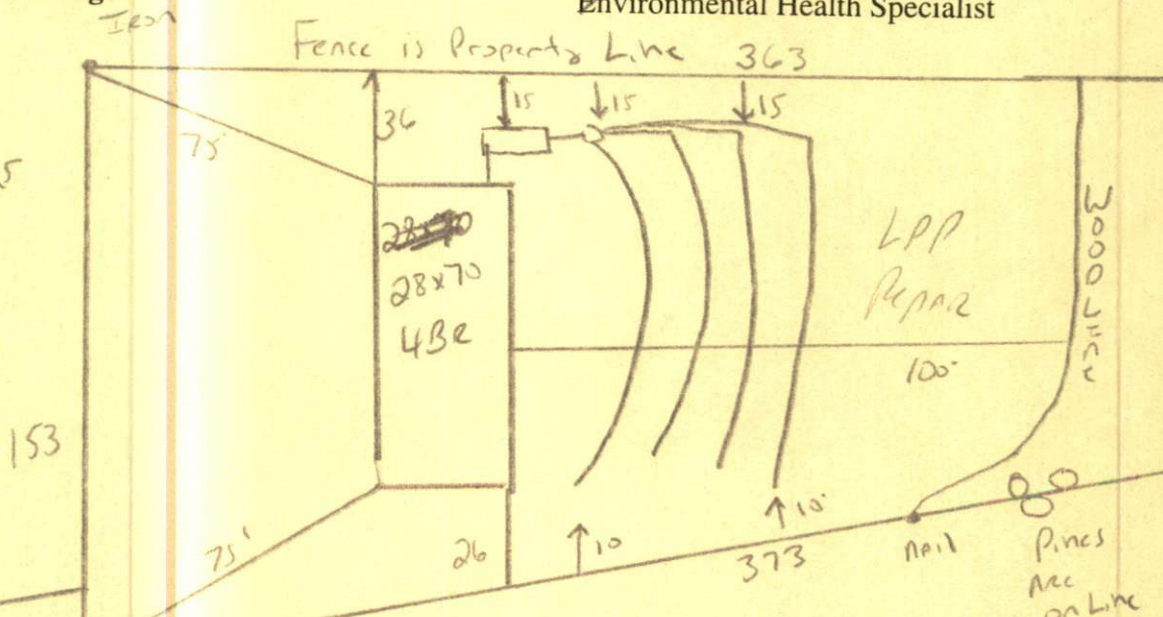

HARNETT COUNTY HEALTH DEPARTMENT
AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Health Department Improvement Permit # 17835. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. This authorization will be invalid if ownership, site plans, or intended use change.

Owner or Authorized Agent Edna Yarbrough

Name: _____ Telephone # 919-258-5580

Address: 66 Brookside Ave Bridgeport CT 06606

Property Location: SR # 421 Road Name _____

New Installation ☒ Repair ☐ Septic Tank ☒ Nitrification Lines ☒

Subdivision Louis Yarbrough Lot # 2B

Number of Bedrooms Proposed: 4(28x70) Lot size: 1.00 AC

Basement ☐ With Plumbing ☐ Without Plumbing ☐

Water Supply: Well ☐ Public ☒ Minimum Well Setback: _____ ft.

Type of System: Conventional ☒ Other ☐

Tank Volume: Septic Tank 1000 gallons Pump Chamber _____ gallons

Nitrification Field Specifications

Number of fields 1 Number of Lines per Field 4 Length of lines 75

Width of ditches 3 ft. Depth of ditches 18 inches

French Drain: Linear feet required _____ Depth of gravel _____

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the improvement permit and that a valid operations permit has been issued.

Authorized Agent for Harnett County Health Department

Name: [Signature] Date: 5-10-2000