

00-40000605

IMPROVEMENT PERM

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) Scott & Denise Tart New Installation Septic Tank
Property Location: SR# 2026 Repairs Nitrification Line

Subdivision Cowan Lot # 3

Tax ID # _____ Quadrant # _____

Number of Bedrooms Proposed: TWO Lot Size: _____

Basement with Plumbing: Garage:

Water Supply: Well Public Community

Distance From Well: 50 ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: Conventional Other _____

Size of tank: Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface Drainage Field No. of ditches 2 exact length of each ditch 50 ft. width of ditches 3 ft. depth of ditches 30 in.

French Drain Required: _____ Linear feet


Date: 27th June 2000 *IP-adding line*

This permit is subject to revocation if site plans or intended use change.

Signed: Vernon B. Dalg
Environmental Health Specialist

1-24-05

(730)

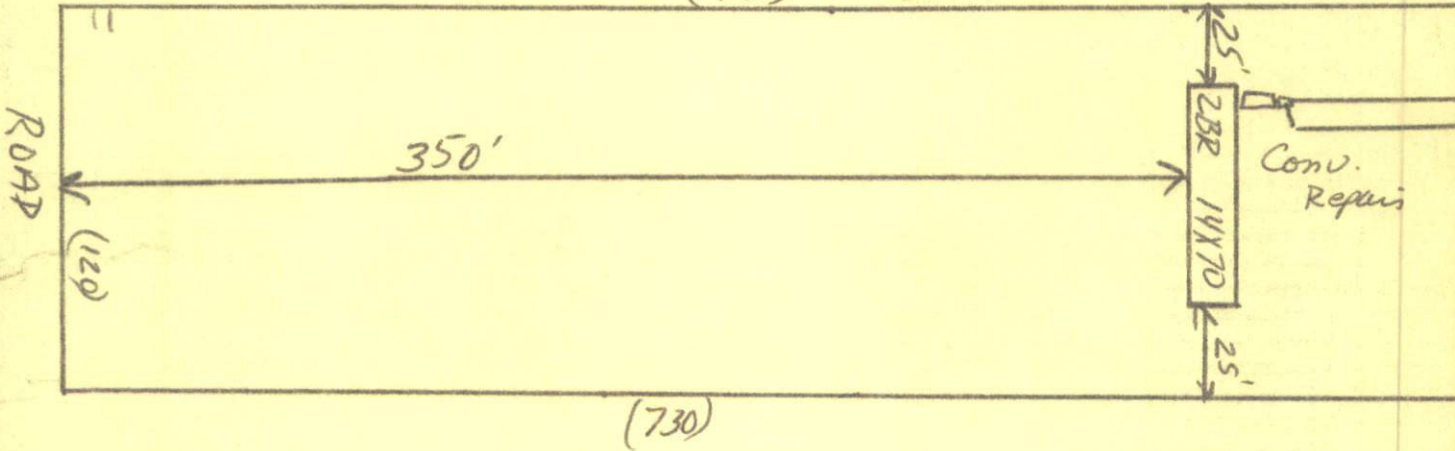

HARNETT COUNTY HEALTH DEPARTMENT
AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Health Department Improvement Permit # 17301. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. This authorization will be invalid if ownership, site plans, or intended use change.

Owner or Authorized Agent _____

Name: Scott & Denise Tart Telephone # 893-4483

Address: 30 Lwart Dr Lillington, NC

Property Location: SR# 2026 Road Name Byrd Mill

New Installation Repair _____ Septic Tank Nitrification Lines

Subdivision Cowan Lot # 3

Number of Bedrooms Proposed: Two Lot size: _____

Basement _____ With Plumbing _____ Without Plumbing _____

Water Supply: Well Public _____ Minimum Well Setback: 50 ft.

Type of System: Conventional Other _____

Tank Volume: Septic Tank 1000 gallons Pump Chamber _____ gallons

Nitrification Field Specifications

Number of fields 1 Number of Lines per Field 2 Length of lines 50 feet

Width of ditches 3 ft. Depth of ditches 30 inches

French Drain: Linear feet required _____ Depth of gravel _____

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the improvement permit and that a valid operations permit has been issued.

Authorized Agent for Harnett County Health Department

Name: Vernest R. Dohp Date: 27 June 2000