

Release Permit # 13461

HARNETT COUNTY HEALTH DEPARTMENT

No 16609

IMPROVEMENT PERMIT

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) Willis B. Harvey Prop Inc  New Installation  Septic Tank
Property Location: SR# 1257  Repairs  Nitrification Line

Subdivision River Bluff Lot # 28

Tax ID # \_\_\_\_\_ Quadrant # \_\_\_\_\_

Number of Bedrooms Proposed: 3 (28x60) Lot Size: 1.34 Ac

Basement with Plumbing:  Garage:  MUST USE FILTER &
Water Supply:  Well  Public  Community Septic Tank marked
Distance From Well: 50 ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system:  Conventional  Other REMOVED 11/8/00

Size of tank: Septic Tank: 1000 gallons Pump Tank: \_\_\_\_\_ gallons 11/8/00


Subsurface Drainage Field No. of 1 exact length 480 width of 3 depth of 18/12/00
ditches 1 of each ditch 480 ft. ditches 3 ft. ditches 18/12/00 in.

French Drain Required: \_\_\_\_\_ Linear feet

Date: 11-23-99

This permit is subject to revocation if site plans or intended use change. lot 27

Signed: [Signature] Environmental Health Specialist

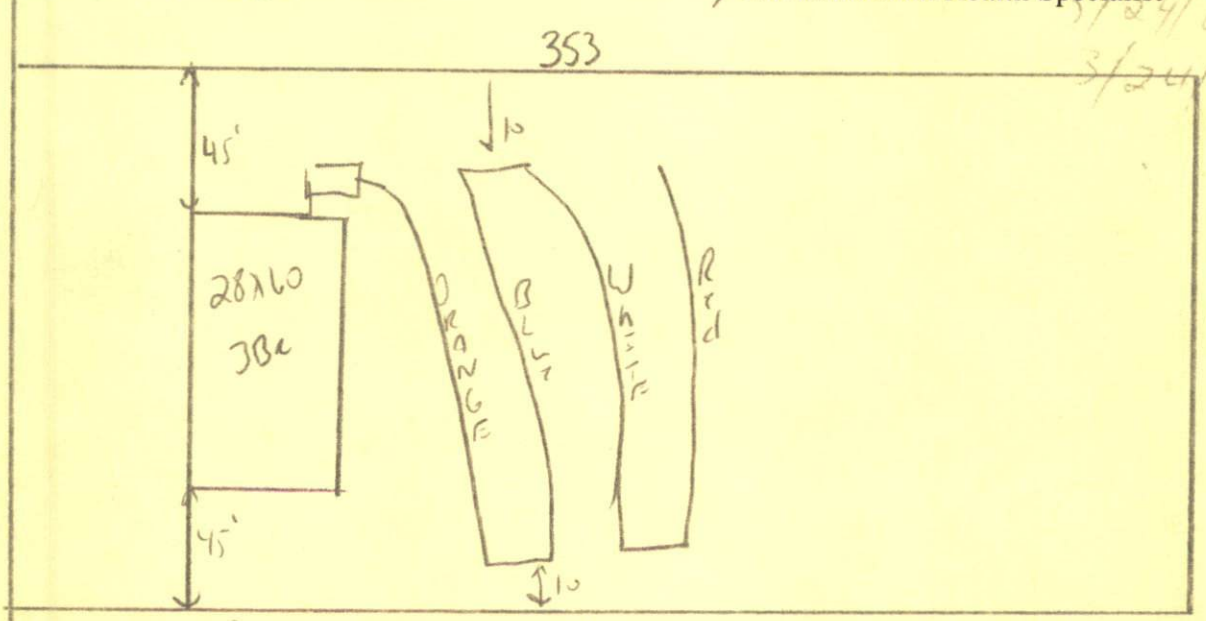

NOTE House must be 55' from front property line as shown
And be min. 45' from lot 27/28 property line MUST meet
on site before installing

HARNETT COUNTY HEALTH DEPARTMENT  
**AUTHORIZATION TO CONSTRUCT**

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Health Department Improvement Permit # 16609. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. This authorization will be invalid if ownership, site plans, or intended use change.

Owner or Authorized Agent Willis B Harvey Prop In

Name: \_\_\_\_\_ Telephone # \_\_\_\_\_

Address: \_\_\_\_\_

Property Location: SR # 1257 Road Name \_\_\_\_\_

New Installation  Repair \_\_\_\_\_ Septic Tank  Nitrification Lines

Subdivision River Bl-AA Lot # 28

Number of Bedrooms Proposed: 3 (28x60) Lot size: 1.34 AC

Basement \_\_\_\_\_ With Plumbing \_\_\_\_\_ Without Plumbing \_\_\_\_\_

Water Supply: Well \_\_\_\_\_ Public  Minimum Well Setback: \_\_\_\_\_ ft.

Type of System: Conventional  Other \_\_\_\_\_

Tank Volume: Septic Tank 1000 gallons Pump Chamber \_\_\_\_\_ gallons

**Nitrification Field Specifications**

Number of fields 1 Number of Lines per Field 1 Length of lines 480

Width of ditches 3 ft. Depth of ditches 18 inches

French Drain: Linear feet required \_\_\_\_\_ Depth of gravel \_\_\_\_\_

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the improvement permit and that a valid operations permit has been issued.

Authorized Agent for Harnett County Health Department

Name: [Signature] Date: 11-27-99