

IMPROVEMENT PERMIT

03-5-7268

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) Pine Grove Dev. Corp

New Installation Septic Tank

Property Location: SR# Nc 24/27

Repairs Nitrification Line

Subdivision Woodbridge Lot # 15

Tax ID # _____ Quadrant # _____

Number of Bedrooms Proposed: 3 (27x56) Lot Size: .50 AC

Basement with Plumbing: Garage: NOTE Changes In

Water Supply: Well Public Community house location

Distance From Well: 55 ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: Conventional Other _____

Size of tank: Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface Drainage Field No. of ditches 1 exact length of each ditch 300 ft. width of ditches 3 ft. depth of ditches 18 in.

French Drain Required: _____ Linear feet


Date: 6-20-03

This permit is subject to revocation if site plans or intended use change.

Signed: [Signature]

Environmental Health Specialist

Please note change in house location
Maintain All set Backs
Do not Drive or Park on septic system
Keep drain lines 15' from top of the Ditch
Keep Lines shallow 18" Ditch Depth

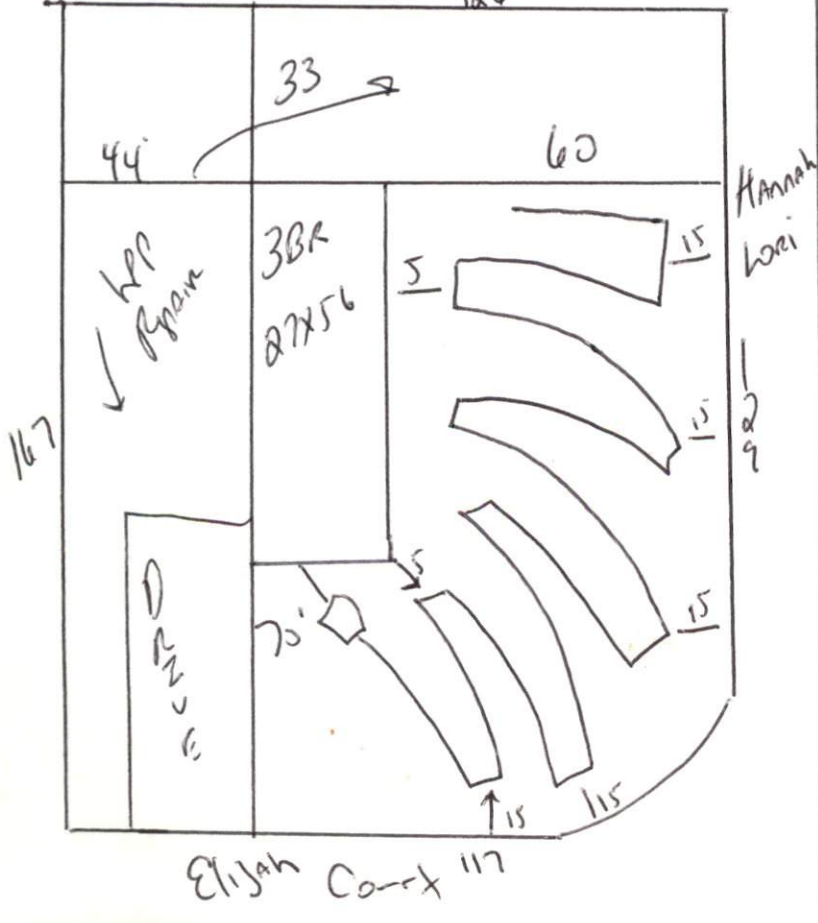

HARNETT COUNTY HEALTH DEPARTMENT
AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Health Department, Improvement Permit # 19436. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. This authorization will be invalid if ownership, site plans, or intended use change.

Pine Grove 498-2204
Name Telephone#

Address

NC 24/27

Property Location SR# Road Name

Woodbridge 15 3 (27x56) 50AC
Subdivision Lot # # Bedrooms Proposed Lot Size

TYPE OF SYSTEM

New Installation Repair Septic Tank Nitrification Lines

Conventional Other _____

Basement With Plumbing Without Plumbing

Water Supply: Well Public Water Supply Minimum Well Setback: _____ Ft.

Septic Tank 1000 gal Pump Chamber _____ gal

NITRIFICATION FIELD SPECIFICATIONS

Number of fields 1 # of lines per field 1 Length of lines 300 Ft.

Width of ditches 3 ft. Depth of ditches 18 inches

French Drain: Linear feet required _____ Depth of gravel _____

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the Improvement Permit and that a valid Operations Permit has been issued.

[Signature] 6-20-03
Signature of Authorized Agent for Harnett County of Harnett Date