

HTE 03-5-7470R

IMPROVEMENT PERMIT

20579

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) Pine Grove New Installation Septic Tank
 Property Location: SR# NC24127 Repairs Nitrification Line

Subdivision Wood Bridge Lot # 27

Tax ID # _____ Quadrant # _____

Number of Bedrooms Proposed: 3(27x76) Lot Size: .50 AC

Basement with Plumbing: Garage:

Water Supply: Well Public Community

Distance From Well: _____ ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: Conventional Other Pump to 2' wide Chamber

Size of tank: Septic Tank: 1000 gallons Pump Tank: 1000 gallons


Subsurface Drainage Field No. of ditches 1 exact length of each ditch 300 ft. width of ditches 02 ft. depth of ditches 18 in.

French Drain Required: _____ Linear feet 92' wide chamber

Date: 5-17-04

This permit is subject to revocation if site plans or intended use change.

Signed: Joe Walker
 Environmental Health Specialist

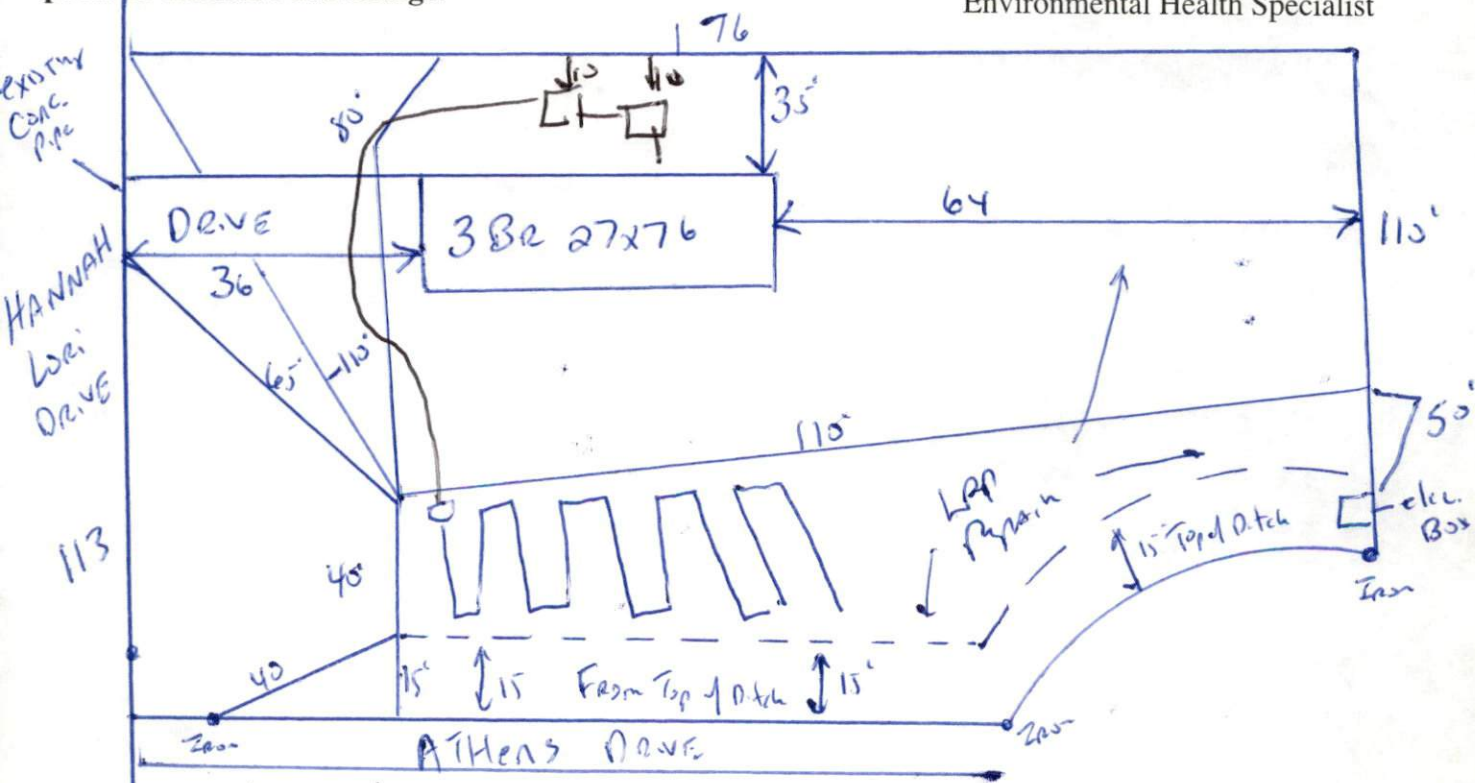

Meet on site
 Place gravel along side to help prevent clogging

HARNETT COUNTY DEPARTMENT OF PUBLIC HEALTH
AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Department of Public Health, Improvement Permit # 20579. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. *This authorization will be invalid if ownership, site plans, or intended use change.*

Pin Groe

Name _____ Telephone # _____

Address _____

Property Location SR# M24/22 Road Name _____

Subdivision Woodbridge Lot # 27 # Bedrooms Proposed 3 Lot Size 27x76

TYPE OF SYSTEM

- New Installation [] Repair [] Septic Tank Nitrification Lines
[] Conventional Other Pipe to 2' wide chamber
[] Basement [] With Plumbing [] Without Plumbing

Water Supply: [] Well Public Water Supply Minimum Well Setback: 50 Ft.

Septic Tank 1000 gal Pump Chamber 1000 gal

NITRIFICATION FIELD SPECIFICATIONS

Number of fields 1 # of lines per field 1 Length of lines 300 Ft.

Width of ditches 3 ft. Depth of ditches 17 inches 2' wide chamber

French Drain: Linear feet required _____ Depth of gravel _____

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the Improvement Permit and that a valid Operations Permit has been issued.

Joe West RS
Signature of Authorized Agent for Harnett County

5-17-04
Date