

**SOIL/SITE EVALUATION
 for ON-SITE WASTEWATER SYSTEM**

Owner:

Applicant:

Address:

Date Evaluated:

Proposed Facility:

Design Flow (.1949):

Property Size:

Location of Site:

Property Recorded:

Water Supply: Public Individual Well

Spring Other

Evaluation Method: Auger Boring ~~SPR~~

Cut

Type of Wastewater: Sewage Industrial Process

Mixed

P R O F I L E #	1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY .1941		OTHER PROFILE FACTORS				Profile Class & LTAR
			.1941 Structure/ Texture	.1941 Consistence Mineralogy	.1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz	
		0-18	SL	GR FR	10YR 8/4				
		18-26	SCL	GR FR	10YR 6/6				
		26-4	ex SC	ABK EFI	10YR 4/6				
	18-0		FILL	—					
		0-30	SL	GR FR	10YR 8/4				
		30-38	SCL	GR FR	10YR 6/6				
		38"	Bottom of pit						
		0-28	SL	GR FR	10YR 8/4				
		28-40	SCL	GR FR	10YR 6/6				
		40-48	SC	SDR VFI	10YR 4/6				
		0-28	SL	GR FR	10YR 8/4				
		28-40	SCL	GR FR	10YR 6/6				
		40-48	SC	SDR VFI	10YR 4/6				
		12-0	FILL						
		0-28	SL SL	GR FR	10YR 8/4				
		28-40	SCL	GR FR	10YR 6/6				
		40-48	SC	SDR VFI	10YR 4/6				

Description	Initial System	Repair System
Available Space (.1945)		
System Type(s)	Gravel	LPP
Site LTAR	.4	.2

Other Factors (.1946): _____
 Site Classification (.1948): _____
 Evaluated By: _____
 Others Present: _____

Change to 2' wide chamber to
 save space

COMMENTS: _____

<u>LANDSCAPE POSITIONS</u>	<u>GROUP</u>	<u>TEXTURES</u>	<u>.1955 LTAR</u>	<u>CONSISTENCE MOIST</u>	<u>WET</u>
R-RIDGE	I	S-SAND	1.2 - 0.8	VFR-VERY FRIABLE	NS-NON-STICKY
S-SHOULDER SLOPE		LS-LOAMY SAND			
L-LINEAR SLOPE	II	SL-SANDY LOAM	0.8 - 0.6	FR-FRIABLE FI-FIRM VFI-VERY FIRM EFI-EXTREMELY FIRM	SS-SLIGHTLY STICKY S-STICKY VS-VERY STICKY NP-NON-PLASTIC SP-SLIGHTLY STICKY P-PLASTIC VP-VERY PLASTIC
FS-FOOT SLOPE		L-LOAM			
N-NOSE SLOPE					
H-HEAD SLOPE					
CC-CONCLAVE SLOPE	III	SI-SILT-	0.6 - 0.3		
CV-CONVEX SLOPE		SIL-SILT LOAM			
T-TERRACE		CL-CLAY LOAM			
FP-FLOOD PLAN		SCL-SANDY CLAY LOAM			
		SICL-SILTY CLAY LOAM			
	IV	SIC-SILTY CLAY	0.4 - 0.1		
		C-CLAY			
		SC-SANDY CLAY			


STRUCTURE

- SG-SINGLE GRAIN
- M-MASSIVE
- CR-CRUMB
- GR-GRANULAR
- SBK-SUBANGULAR BLOCKY
- ABK-ANGULAR BLOCKY
- PL-PLATY
- PR-PRISMATIC

MINERALOGY

- SLIGHTLY EXPANSIVE
- EXPANSIVE

Show profile locations and other site features (dimensions, reference or benchmark, and North).

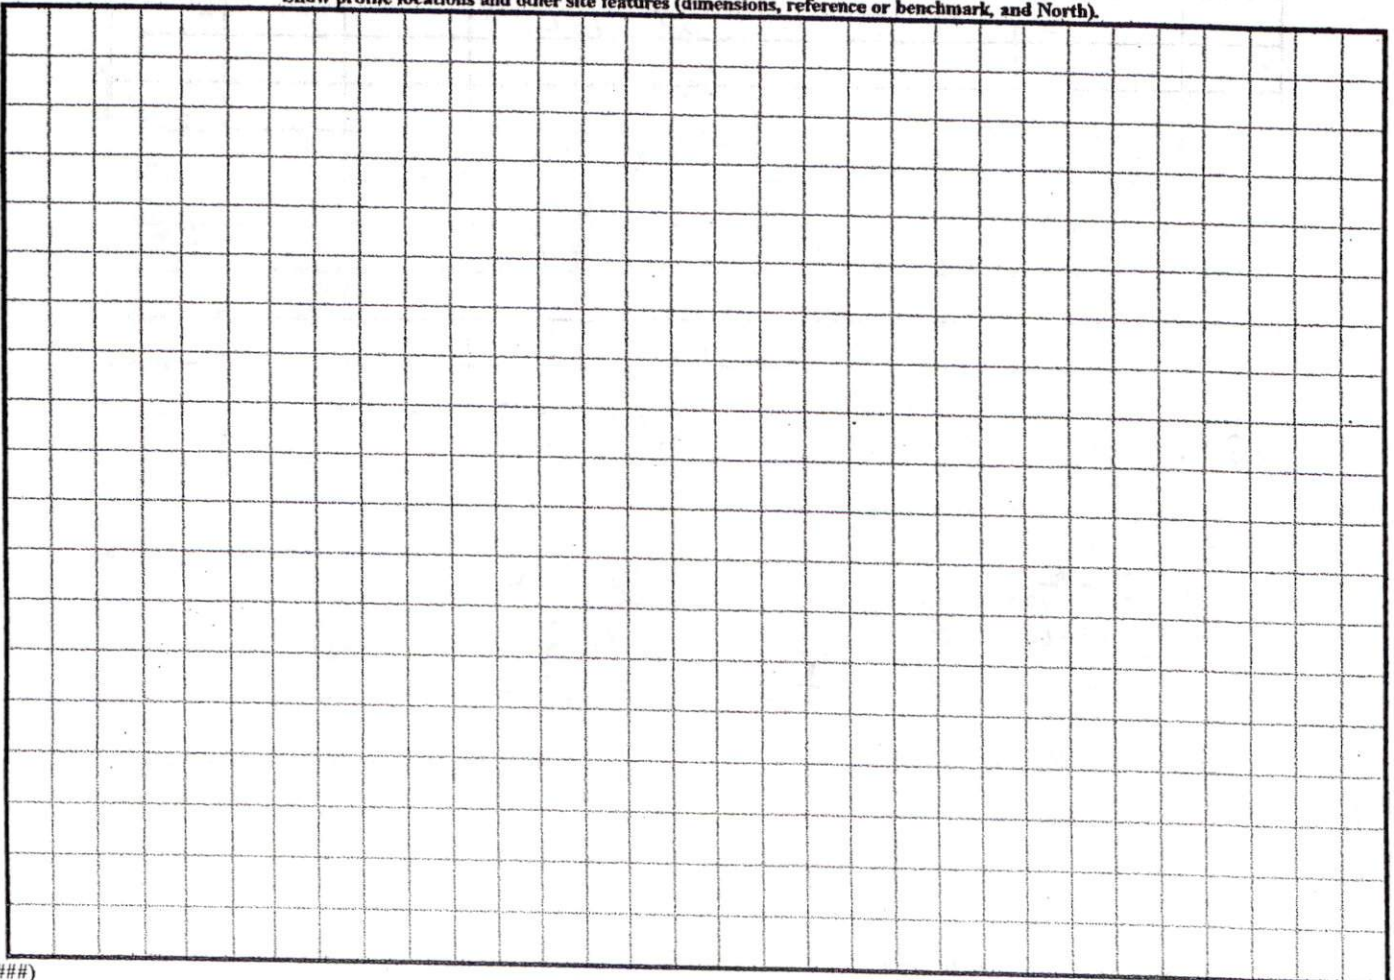

HP: 5369



#SITE PLAN APPROVAL

DISTRICT RAZOR USE DW MH 26

#BEDROOMS 3

11-10-03 D. Hunter
Zoning Administrator

HANNAH LORI DRIVE
50' R/W

N 82°45'07" E 176.99' FIP 330*

*341 FIP 1025.00' R
113.28' CH

N 15°20'57" W
Drive

35'
~SETBACK

27
0.50 ACS. 47'

S 10°34'52" E 110.46' FIP

28

27x76'

42'
Drive

S 61°38'21" W
50.00' R
45.52' CH

FIP *336

FIP S 54°42'53" E
25.00' R
33.80' CH

S 82°45'07" W 81.45' FIP

N 58°39'25" E
25.00' R
20.41' CH *339

*348

50' R/W ATHENS COURT

29

30

OWNER / DEVELOPER
PINE GROVE DEVELOPMENT CORP.
P.O. BOX 806
SOUTHERN PINES, N.C. 28327

NOTE:

BEING ALL OF LOT #27 OF WOODBRIDGE
SUBDIVISION PHASE 2 RECORDED IN
2003/ - HARNETT CO. REG.

LEGEND

FIP FOUND IRON PIPE
SIP SET IRON PIPE
R/W RIGHT OF WAY
PP POWER POLE
* ELEVATIONS

I FURTHER CERTIFY THAT THIS PROPERTY
(DOES NOT)
LIE WITHIN A SPECIAL FLOOD HAZARD AREA
AS DESIGNATED BY FIRM FLOOD INSURANCE

DATE: APRIL 02, 2003

PLOT PLAN

LOT 27

SCALE: 1" = 40'

TOWNSHIP: JOHNSONVILLE

WOODBIDGE
PHASE 2

HARNETT CO. N.C.