HTE # 04-5001 OR

HARNETT COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH SECTION

18099

OPERATIONS PERMIT

Name: (owner) Pine Grove Dev. ☒ New Installation ☒ Septic Tank ☐ Repair

Property Location: SR# 1141 ☒ Nitrification Line ☐ Expansion

Subdivision Cherokee Ridge Lot # 41 Tax ID # _____ Quadrant # _____

Contractor: Ted Brown Registration # _____

Basement with Plumbing: ☐ ~~Garage: ☒~~

Water Supply: ☐ Well ☒ Public ☐ Community

Distance From Well: 50 ft.

Following are the specifications for the sewage disposal system on above captioned property.

Type of system: ☐ Conventional ☒ Other 25% Reduction SYSTEM Infiltrator Quick 4

Size of tank: Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface Drainage Field	No. of ditches 1	exact length of each ditch 160 ft.	width of ditches 3 ft.	depth of ditches 18-24 in.

French Drain Required: _____ Linear feet Date: 12-14-05

PERMIT NO. 20877 Inspected by: [illegible]
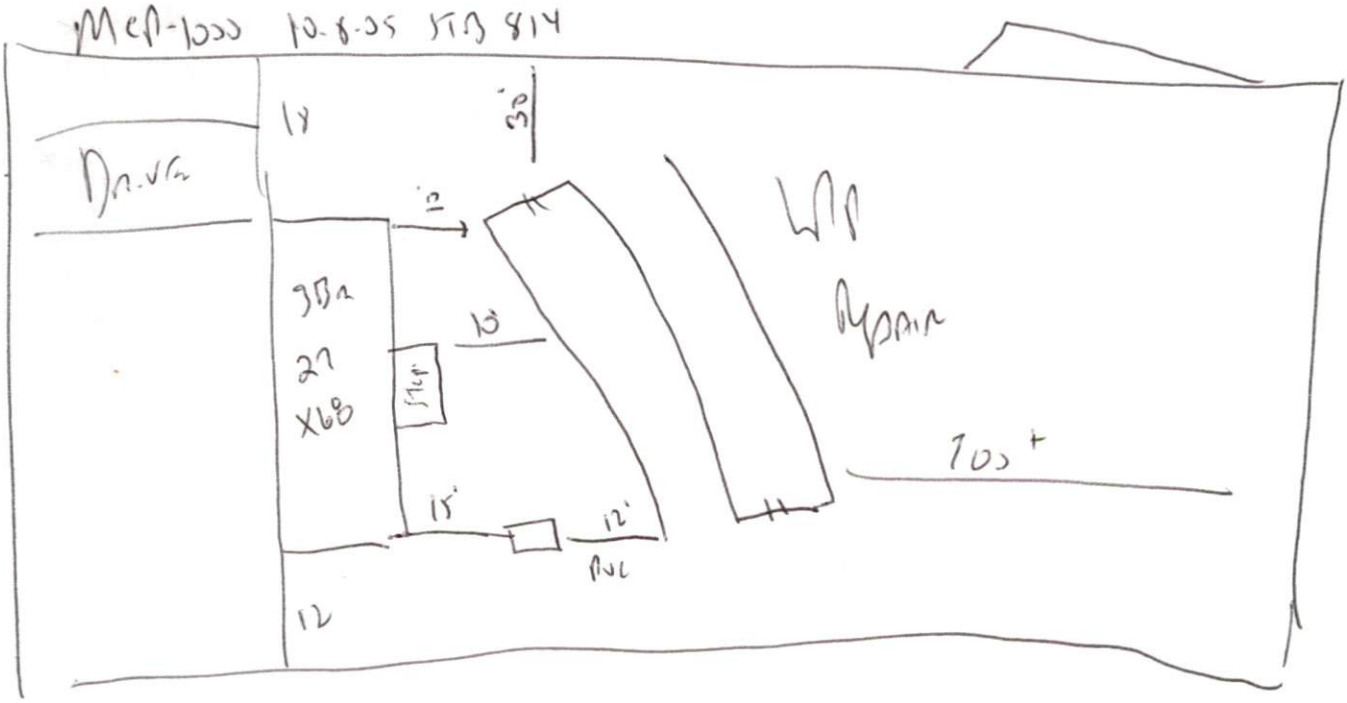
MCP-1000 10-8-05 STB 814