

HTE# 05-50011910R

HARNETT COUNTY HEALTH DEPARTMENT

IMPROVEMENT PERMIT 22687

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) James Mark Curran New Installation Septic Tank Repair

Property Location: SR# NE27 Nitrification Line Expansion

Subdivision Lonestar Est. Lot # 3

Tax ID# _____ Quadrant # _____

Number of Bedrooms Proposed: 2 (14x70) Lot Size: 1.79 AC

Basement with Plumbing: Garage: Limited to 2 BR Home only

Water Supply: Well Public Community

Distance From Well: _____ ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: Conventional Other Pump to Infiltrator Chambers

Size of tank: Septic Tank: 1000 gallons Pump Tank: 1000 gallons


Subsurface No. of Ditches 2 exact length of each ditch 75 ft. width of ditches 3 ft. depth of ditches 18 in.

French Drain Required: _____ Linear feet of Infiltrator Chamber

Date: 6-3-05
PERMIT EXPIRES 5 YEARS FROM ABOVE DATE

This permit is subject to revocation if site plans or intended use change. 54

Signed: [Signature]
Environmental Health Specialist

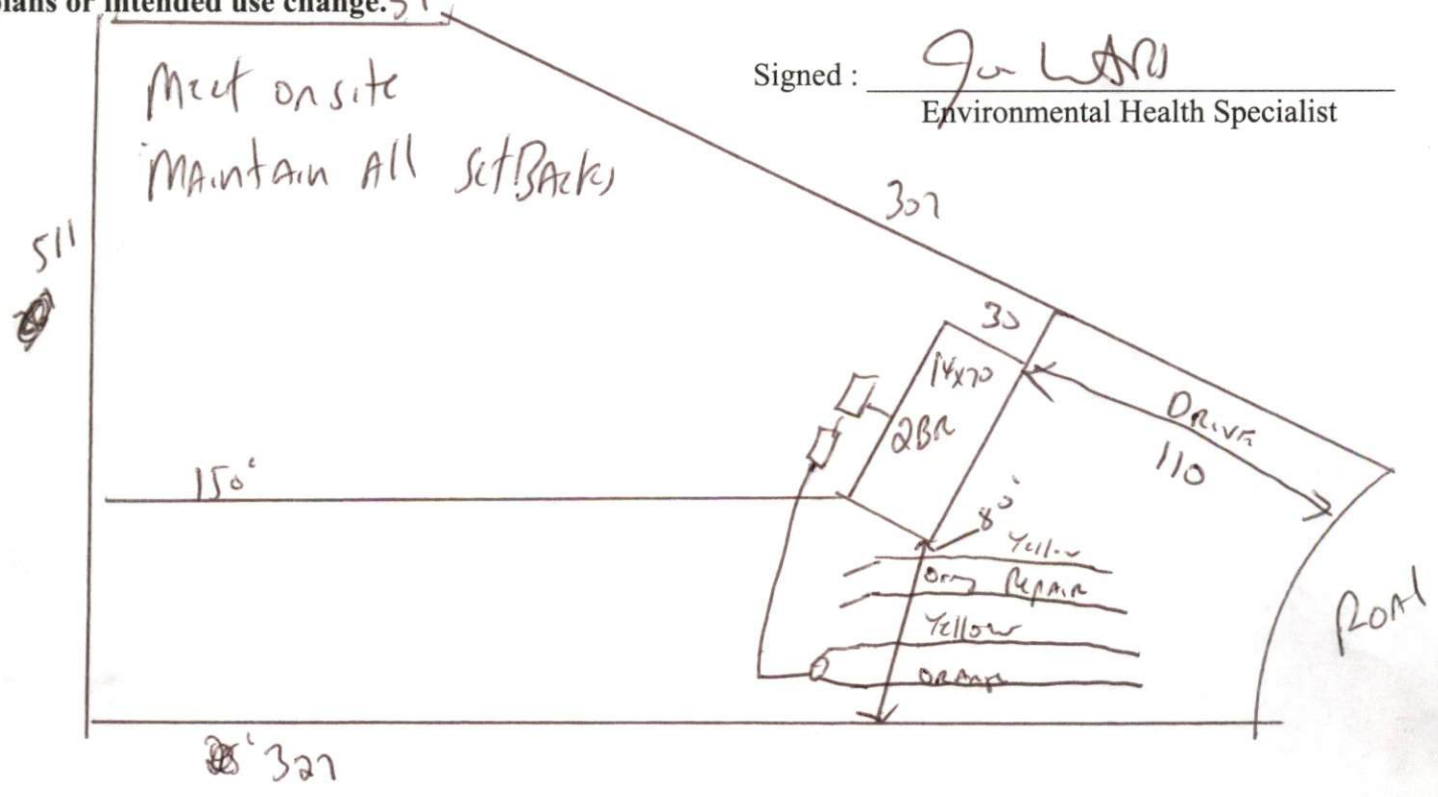

HARNETT COUNTY DEPARTMENT OF PUBLIC HEALTH
AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Department of Public Health, Improvement Permit # 22687. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. *This authorization will be invalid if ownership, site plans, or intended use change.*

Name James Mark Curran Telephone # _____

Address _____

Property Location SR# N627 Road Name _____

Subdivision Longman Ct Lot # 3 # Bedrooms Proposed 2 (14x70) Lot Size 1.75 ac

TYPE OF SYSTEM

New Installation [] Repair Septic Tank Nitrification Lines
[] Conventional Other 25% Reduction SYSTEM Infiltrator Chamber
[] Basement [] With Plumbing [] Without Plumbing

Water Supply: [] Well Public Water Supply Minimum Well Setback: 50 Ft.

Septic Tank 1000 gal Pump Chamber _____ gal

NITRIFICATION FIELD SPECIFICATIONS

Number of fields 1 # of lines per field 2 Length of lines 75 Ft.
Width of ditches 3 ft. Depth of ditches 18 inches OF 25% Reduction SYSTEM
French Drain: Linear feet required _____ Depth of gravel _____

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the Improvement Permit and that a valid Operations Permit has been issued.

Signature of Authorized Agent for Harnett County Joe West RS Date 6-3-05