

SITE/SOIL EVALUATION  
FOR  
ON-SITE WASTE WATER


APPLICANT: Pine Grove PHONE: \_\_\_\_\_ APPLICATION DATE: \_\_\_\_\_  
ADDRESS: \_\_\_\_\_  
COUNTY: Harnett PROPERTY SIZE: \_\_\_\_\_ PROPOSED FACILITY: 3 BR Home  
LOCATION OF SITE: Cherokee Ridge 17  
WATER SUPPLY: On-Site Well \_\_\_\_\_ Community \_\_\_\_\_ Public  Other \_\_\_\_\_ EVALUATION BY: Auger Boring  Pit \_\_\_\_\_ Cut \_\_\_\_\_

FACTORS		PROFILES									
		1	2	3	4	5	6	7	8	9	10
LANDSCAPE POSITION	.1940	LS	LS	LS	LS						
SLOPE (%)	.1940	3%	3%	3%	3%						
HORIZON 1 DEPTH		38-0	36-0	38-0	28-0						
Texture Group	.1941(A)(1)	fill	fill	fill	fill						
Consistence	.1941										
Structure	.1941(A)(2)										
Mineralogy	.1941(A)(3)										
HORIZON 2 DEPTH		0-6	0-6	0-6	0-6						
Texture Group	.1941(A)(1)	Sloam	Sloam	Sloam	Sloam						
Consistence	.1941	Fr	Fr	Fr	Fr						
Structure	.1941(A)(2)	wgr	wgr	wgr	wgr						
Mineralogy	.1941(A)(3)	Nex	Nex	Nex	Nex						
HORIZON 3 DEPTH		6-36r	6-36r	6-36r	6-36r						
Texture Group	.1941(A)(1)	LSand	LSand	LSand	LSand						
Consistence	.1941	VF	VF	VF	VF						
Structure	.1941(A)(2)	m/c	m/c	m/c	m/c						
Mineralogy	.1941(A)(3)	NEX	NEX	NEX	NEX						
HORIZON 4 DEPTH											
Texture Group	.1941(A)(1)										
Consistence	.1941										
Structure	.1941(A)(2)										
Mineralogy	.1941(A)(3)										
SOIL WETNESS	.1942	>30	>30	>30	>30						
RESTRICTIVE HORIZON	.1944	from	original surface								
SAPROLITE	.1943,1956										
CLASSIFICATION	.1948										
LONG TERM ACCEPTANCE RATE	.1955	0.8	0.8	0.8	0.8						

AVAILABLE SPACE (1945): \_\_\_\_\_ SITE LONG TERM ACCEPTANCE RATE: 0.6  
OTHER FACTORS (1946): \_\_\_\_\_ SYSTEM TYPE: \_\_\_\_\_  
SITE CLASSIFICATION (1948): \_\_\_\_\_

EVALUATED BY: M. G. Baker / J. G. W. Smith OTHERS PRESENT: \_\_\_\_\_

COMMENTS: \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

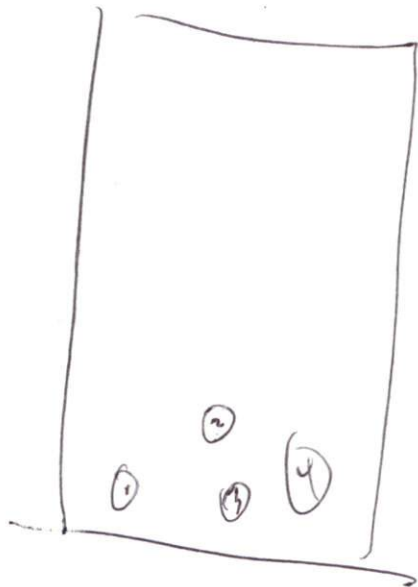

road

