

HTE# 07-500-18614

Harnett County Department of Public Health 19917

PERMIT # 24366

Operation Permit

New Installation Septic Tank Repair Nitrification Line Expansion

PROPERTY LOCATION: 1143

Name: (owner) Chris Chris Homes

SUBDIVISION B9B

LOT # 2

System Installer: Larry Sharpe

Registration # _____

Basement with plumbing: Garage Number of Bedrooms 3


Type of Water Supply: Community Public Well Distance from well 50 feet

System Type: 1, 2, 3, 4, 5 Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

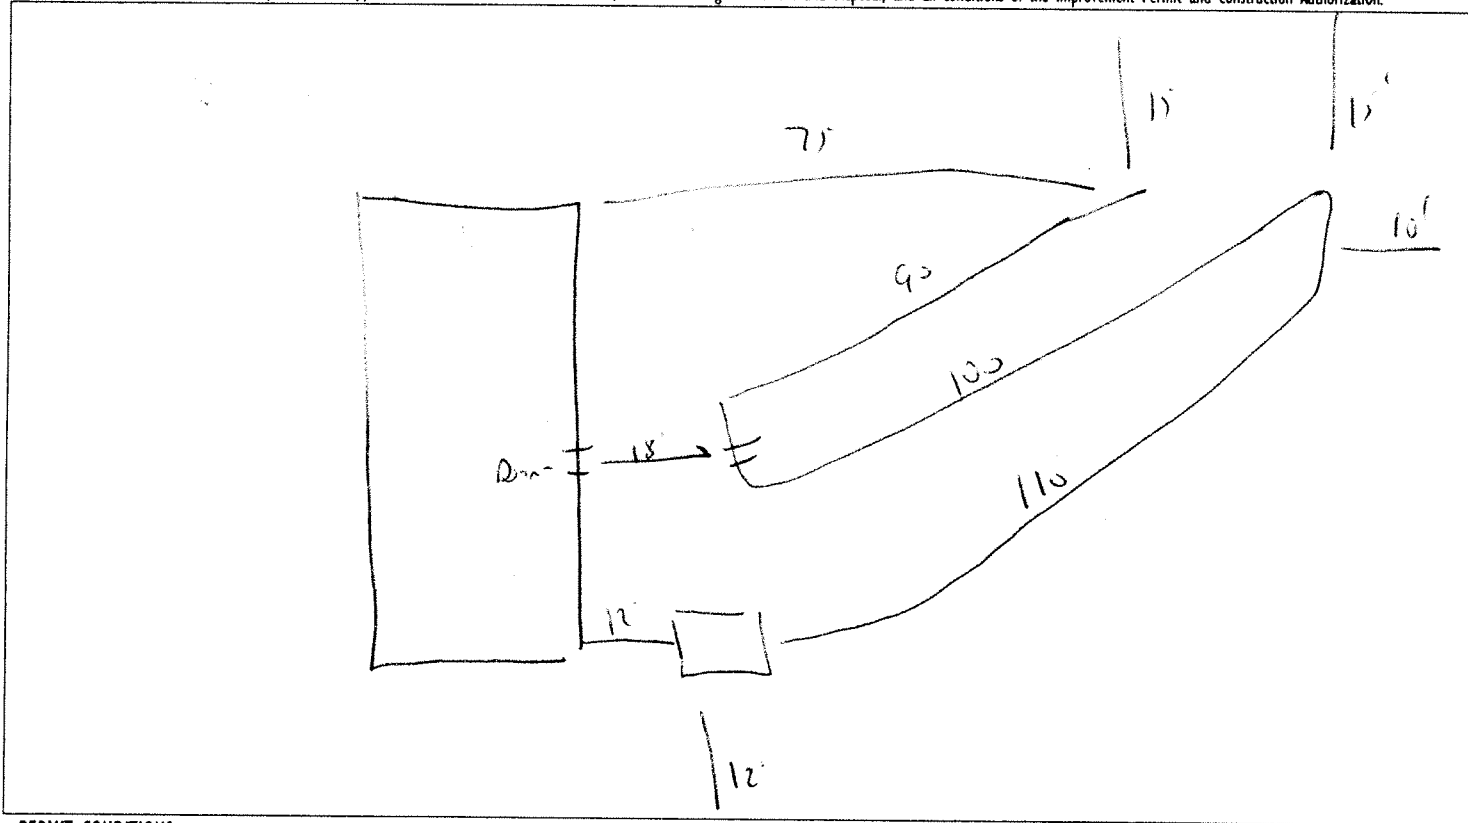

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other _____ Size of tank: Septic Tank: 1000 gallons Pump Tank: _____ gallons
 Subsurface No. of exact length width of depth of
 Drainage Field ditches 1 of each ditch 300 feet ditches 3 feet ditches 18 inches
 French Drain Required: _____ Linear feet

Authorized State Agent [Signature] Date 02-12-08

Central Carolina Holding, LLC
1616 McCoy Town Road
Cameron, NC 28326

Ticket: 40007152
Date: 2/11/2008
Time: 14:17:26 - 14:31:07

A O

Truck: LARRYSHARP
Customer: 400086/LARRY SHARPE SEPT

Gross: 42700 LB M Out Manual Wt
Tare: 21980 LB M In Manual Wt
Net: 20720 LB

Truck Type: Dump Truck

Materials & Services	Quantity	Unit	Rate	Amount
100% of TDF2T/2 inch TDF Ton	18.36	Tons	\$20.00/Ton	\$207.20

Total Amount: \$207.20

Driver: Larry Sharpe

Deputy Weighmaster: Libby Cook
LIBBY COOK

This load of fire chips is from the Fuel Grade location and meets the Nc specification as stated in Innovative Wastewater system approval IWWS-2002-03R for fire chip Substitution for Rock Aggregate in Nitrification Fields.