

Sheet:
 Property ID:
 Lot #:
 File #:
 Code:

**SOIL/SITE EVALUATION
 for ON-SITE WASTEWATER SYSTEM**

Owner: 07-50018614

Applicant:

Address:

Date Evaluated: 10-9-07

Proposed Facility: MH

Design Flow (.1949): 360

Property Size: .55

Location of Site: 1143

Property Recorded:

Water Supply: Public Individual Well Spring Other
 Evaluation Method: Auger Boring Pit Cut
 Type of Wastewater: Sewage Industrial Process Mixed

P R O F I L E #	.1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY .1941		OTHER PROFILE FACTORS				Profile Class & LTAR
			.1941 Structure/ Texture	.1941 Consistence Mineralogy	.1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Saprot Class	.1944 Restr Horiz	
S 3%		0-42	GR SL	VFR SE					6
		0-42	GR SL	VFR SE					6
		0-24	GR SL	VFR SE					
		24-38	SDK SC	FR SE					5
		0-24	GR SL	VFR SE					
		24-36	SDK SC	FR SB					4
		30+	SDK SC	FZ SC					
		0-24	GR SL	VFR SE					
		24-39	SDK SC	FR SB					5


Description	Initial System	Repair System
Available Space (.1945)	—	—
System Type(s)	Gravel	25%
Site LTAR	4	4

Other Factors (.1946):
 Site Classification (.1948): PS
 Evaluated By: GWA
 Others Present:

LOT # 2
 B+B SUBDIVISION
 .55 ACRE

SCALE
 1 = 40

SITE PLAN APPROVAL
 DISTRICT A120R USE DUMH
 #BEDROOMS 3
QAO 10/4/07
 ZONING ADMINISTRATOR

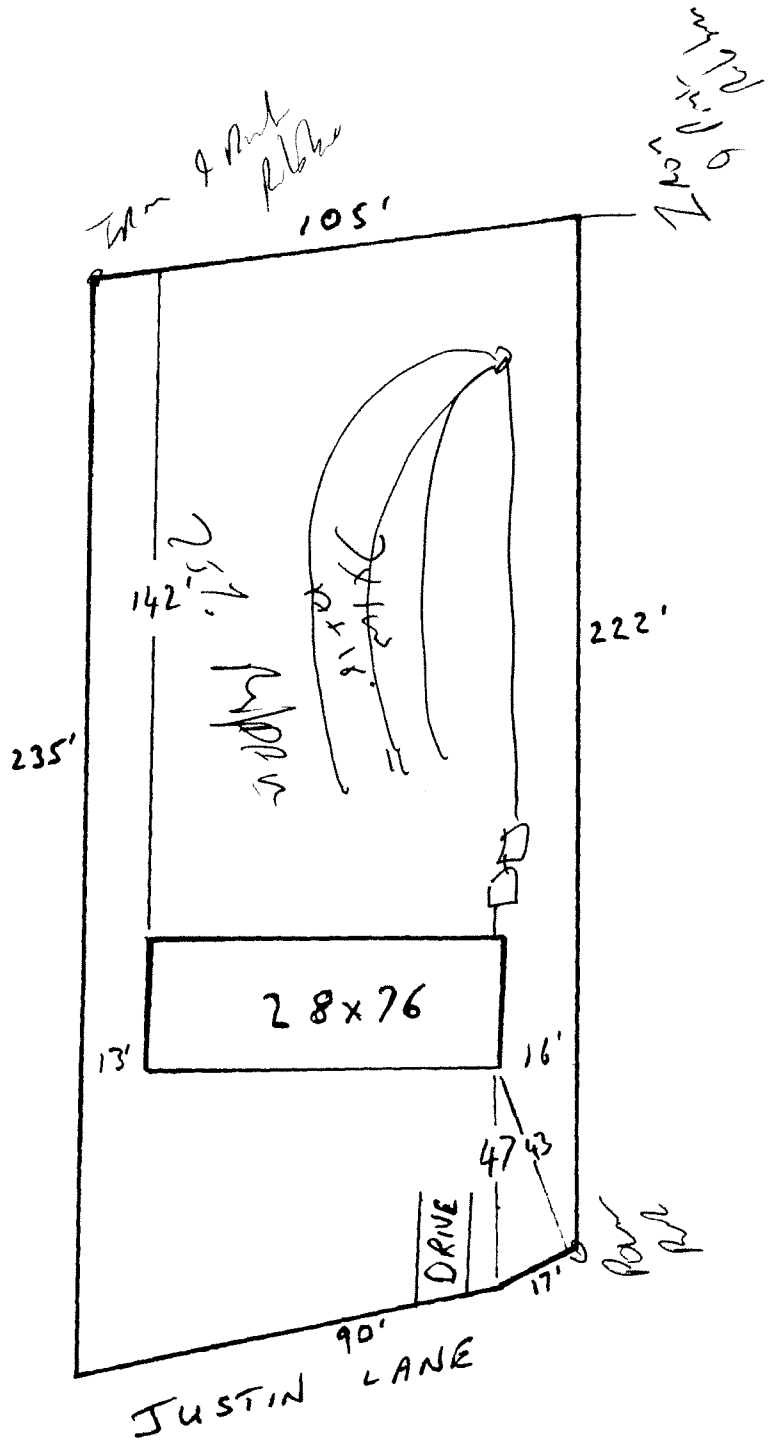

Handwritten notes:

Handwritten notes:
 What shown
 If they may not
 be used
 (could not tell due
 to vegetation