

HTE# 10-5-24070

Harnett County Department of Public Health

20851

PERMIT # 25961

Operation Permit

New Installation Septic Tank Repair Nitrification Line Expansion

PROPERTY LOCATION: PONDEROSA RD

Name: (owner) LEON UNDERWOOD SUBDIVISION BROOKSTONE LOT # 59A

System Installer: LARRY SHARPE Registration # _____

Basement with plumbing: Garage Number of Bedrooms 3


Type of Water Supply: Community Public Well Distance from well 100 feet

System Type: JTG Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

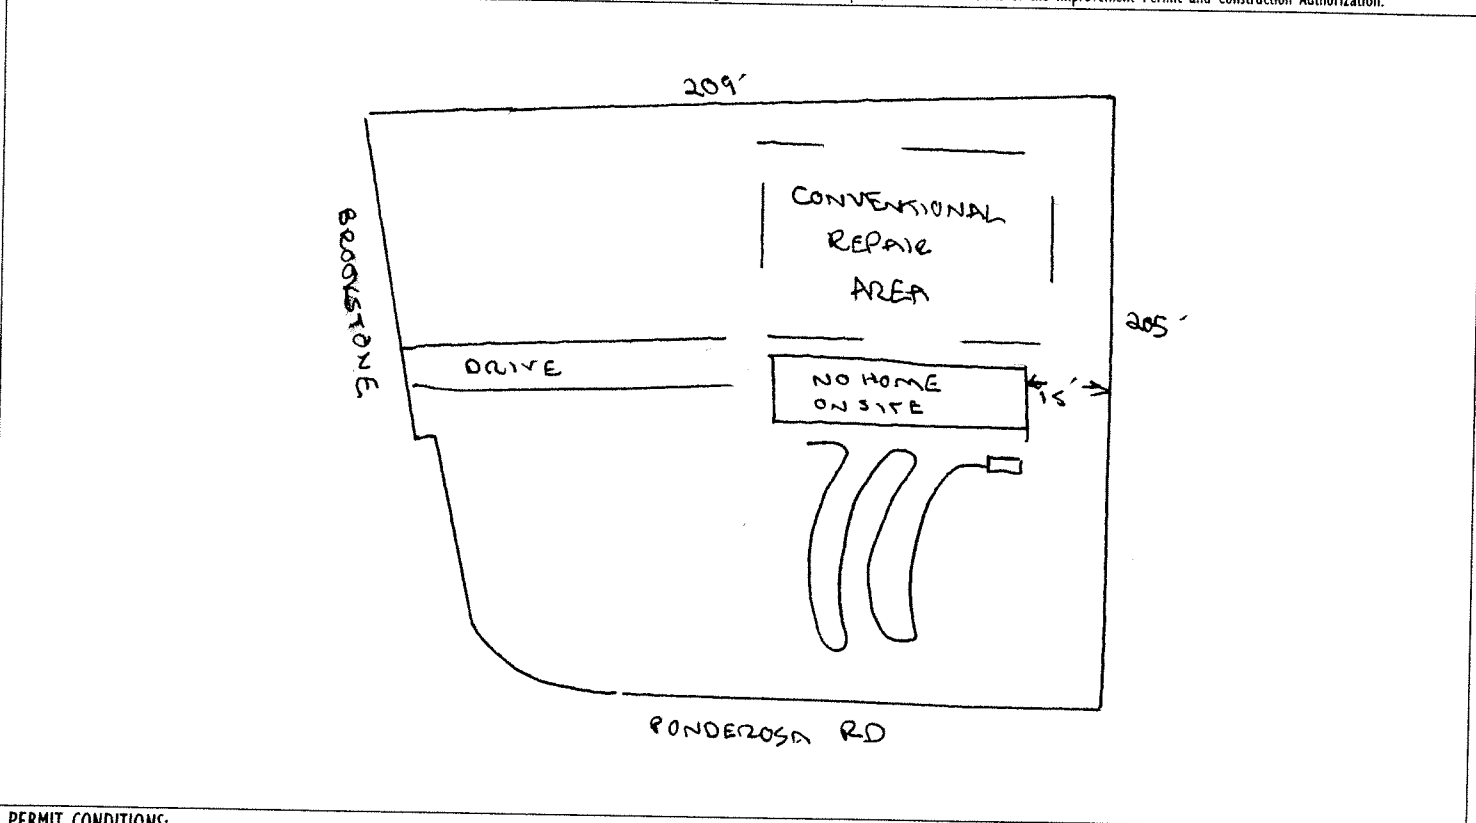

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other TIRE CAPS Septic Tank: 1000 gallons Pump Tank: _____ gallons
 Subsurface No. of exact length width of depth of
 Drainage Field ditches 1 of each ditch 240 feet ditches 3 feet ditches 24-38 inches
 French Drain Required: Linear feet

Authorized State Agent REHS Date 4/2/10

Central Carolina Holding, LLC
1616 McCoy Town Road
Cameron, NC 28326

Ticket: 40016361
Date: 4/5/2010
Time: 12:21:52 - 12:33:59

Customer: 400086 / Larry Sharpes Sep

Scale
Gross: 42120 LB M Out Manual wt
Tare: 22160 LB M In Manual wt
Net: 19960 LB

Generator: NA / Not Applicable
Last: DEST: NA / Not Applicable
Truck: LARRYSHARP

Comment:

| Origin | Wastes & Services | Quantity | Unit | Rate | Amount |
|----------------------|--------------------------------|----------|------|-------------|----------|
| CUT / Outbound Loads | 100% of DENSITY 2 inch BEN Ton | 9.98 | Tons | \$22.00/ton | \$219.56 |

Total Amount: \$219.56

Delivered:

Elizabeth Wipper

Larry Sharpes

This load of the chips is from the Fuel Grade location and meets the NC specification of
standard for Inoperative Wastewater system approval IWW5-2002-03R for the chip
substitution for Rock Aggregate in Wastewater fields.