

HTE# 17-5-41391

Harnett County Department of Public Health

24692

PERMIT # 29532

Operation Permit

 New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: Boyd Bradford Dr. (Barbecue Ch. rd.)

Name: (owner) James & Mary Parrish

SUBDIVISION

LOT # 5

System Installer: Julian Bollard

Registration #


Basement with plumbing: Garage Number of Bedrooms 2Type of Water Supply: Community Public Well Distance from well 180 feet

System Type: 25% reduction system IIIg Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

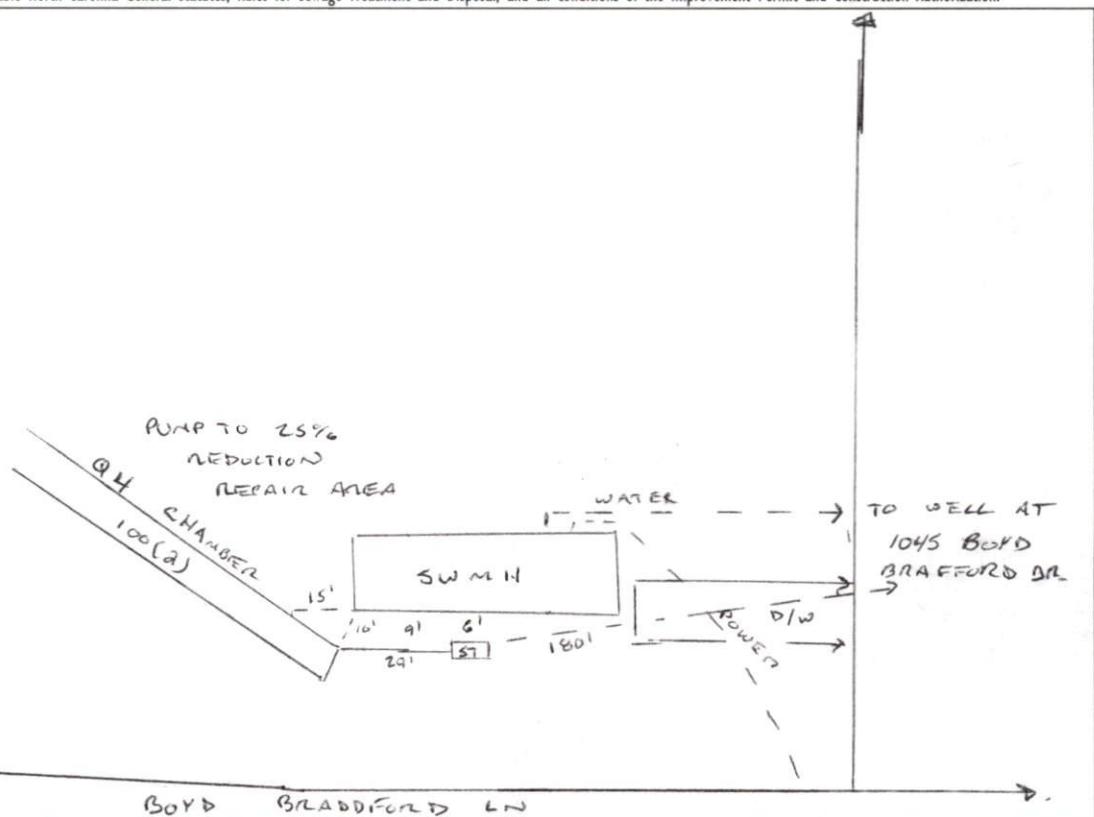

PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961. Other: _____

Subsurface system operator required? Yes No

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: _____

V. Other: _____

 D-Box Pump Alarm H2OLine PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other Q4 Chamber IIIg Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface No. of exact length width of ditches feet depth of ditches feet inches

Drainage Field ditches 2 of each ditch 100 feet 3 feet 20 inches

French Drain Required: _____ Linear feet

Authorized State Agent Tommy Brown, DEHS Date 09/28/2017