

Repair
 HTE# 18-5-4311R
 PERMIT # 29884

18-5-4311R
Harnett County Department of Public Health

24951

Operation Permit

- New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 211 Lake Pointe Dr. (Big Grove Lewis Rd.)

Name: (owner) Fernando Meza SUBDIVISION Lake Pointe LOT # 9
 System Installer: Ricky Holland Registration # _____


Basement with plumbing: Garage Number of Bedrooms 3
 Type of Water Supply: Community Public Well Distance from well NA feet

System Type: Existing gravel system Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

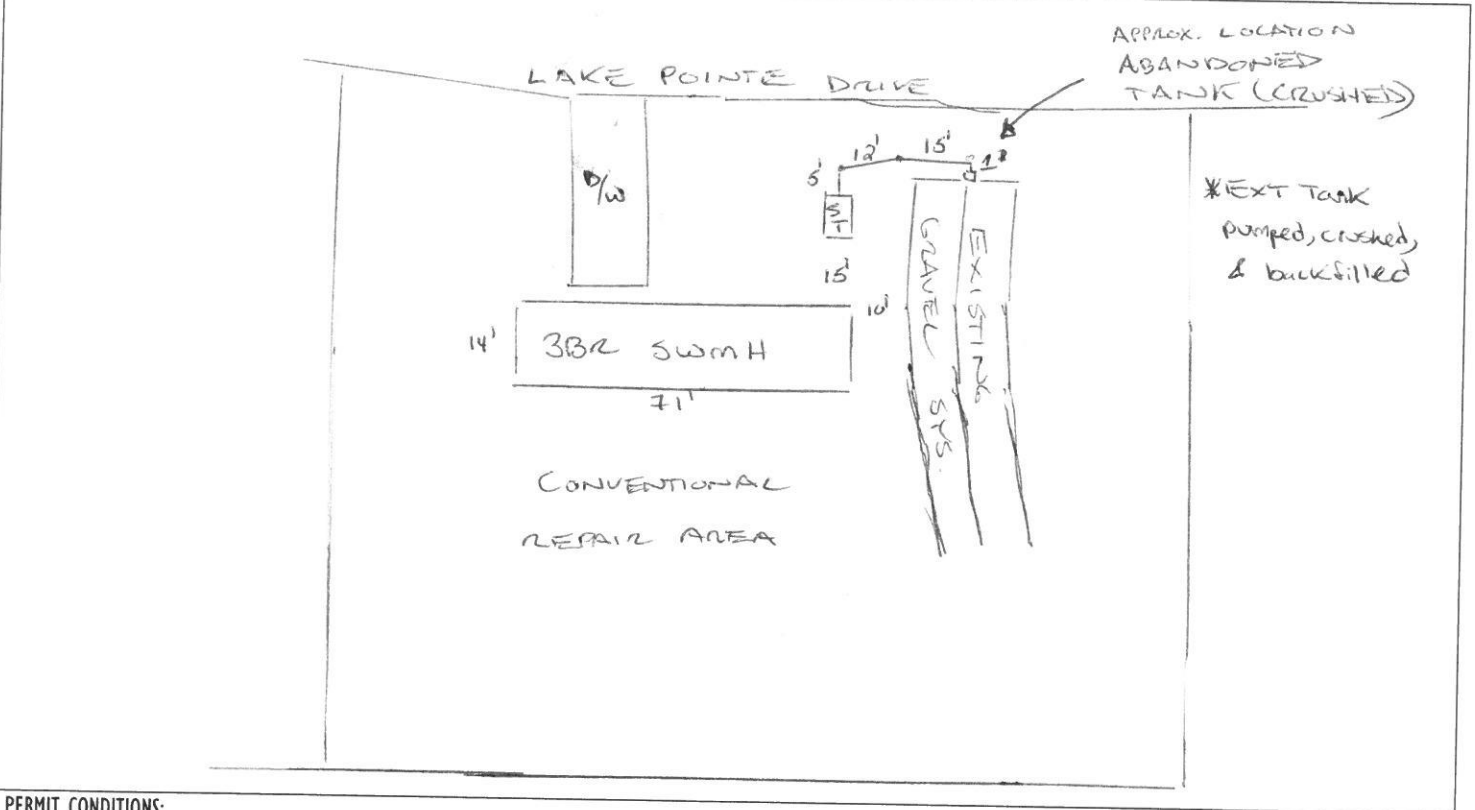

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
 Subsurface system operator required? Yes No
 If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.







Type of system: Conventional Other _____
 Subsurface Drainage Field: No. of ditches 3 exact length of each ditch APPROX 75 FT feet
 French Drain Required: _____ Linear feet
 Septic Tank: 1000 gallons Pump Tank: _____ gallons
 width of ditches 3 feet depth of ditches EXT inches

Authorized State Agent [Signature] Date 04/18/2018

All Lake Pointe Dr.

Repair

Fernando Mezer

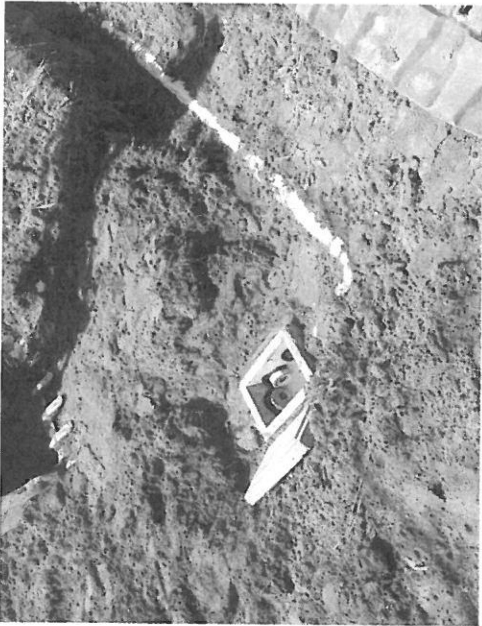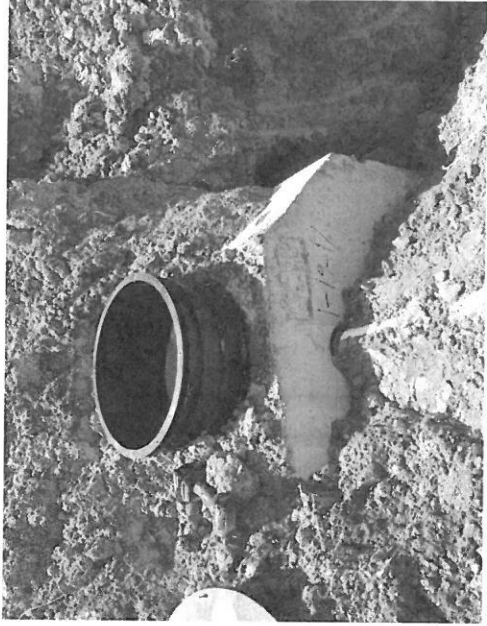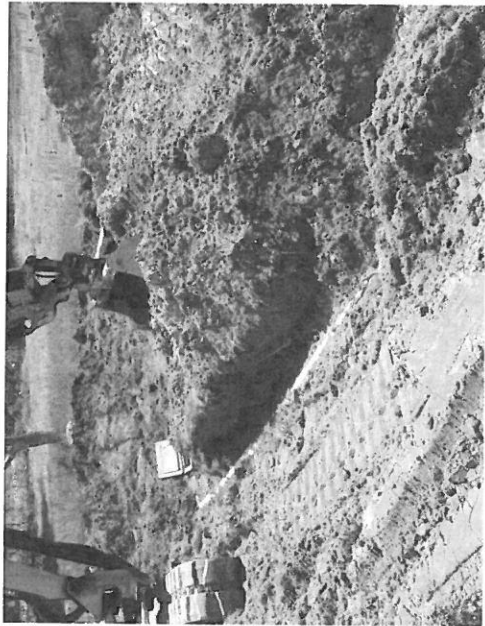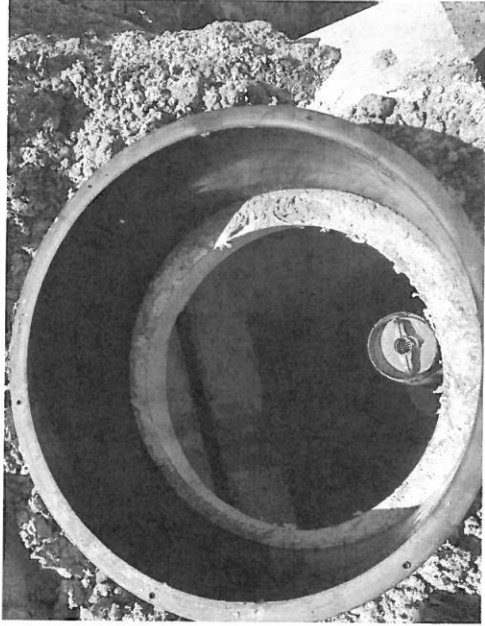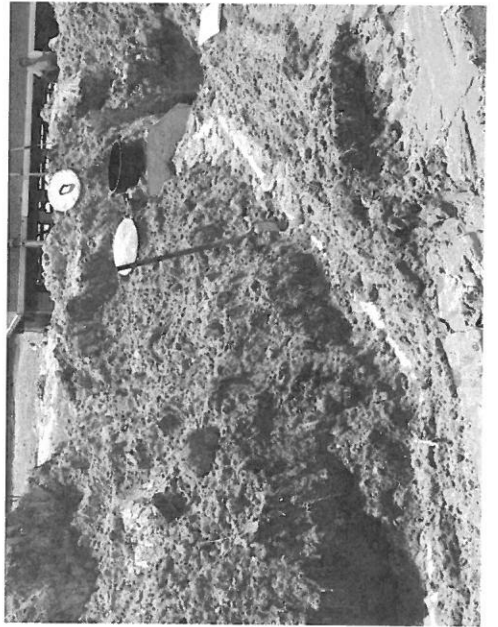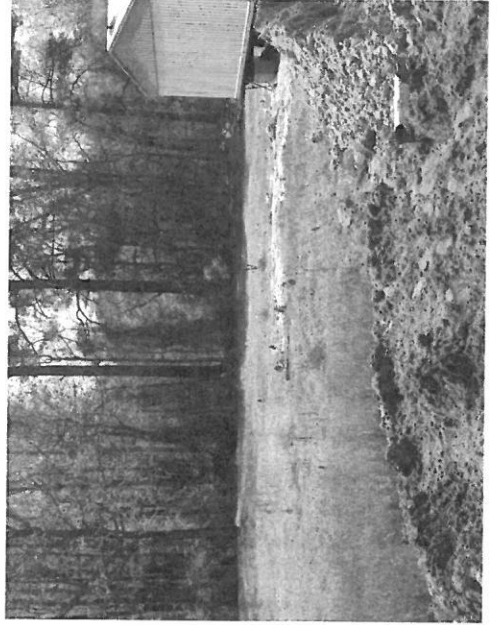

18-5-4311R