


SITE/SOIL EVALUATION FOR ON-SITE WASTEWATER

APPLICANT NAME _____

DATE _____

FACTORS		PROFILES													
		1	2	3	4	5	6	7	8	9	10				
LANDSCAPE POSITION	.1940														
SLOPE (%)	.1940														
HORIZON 1 DEPTH		0-4	0-18	0-18	0-24	0-24									
Texture Group	.1941(A)(1)	SL	SL	SL	SL	SL									
Consistence	.1941	VFR	VFR	VFR	VFR	VFR									
Structure	.1941(A)(2)	G	G	G	G	G									
Mineralogy	.1941(A)(3)	NS/NP	NS/NP	NS/NP	NS/NP	NS/NP									
HORIZON 2 DEPTH		14-16	18"	18"	24"	24"									
Texture Group	.1941(A)(1)	SCL	SCL	SCL	SCL	SCL									
Consistence	.1941	FR	FR	FR	FR	FR									
Structure	.1941(A)(2)	SBK	SBK	SBK	SBK	SBK									
Mineralogy	.1941(A)(3)	SS/SP	SS/SP	SS/SP	SS/SP	SS/SP									
HORIZON 3 DEPTH															
Texture Group	.1941(A)(1)														
Consistence	.1941														
Structure	.1941(A)(2)														
Mineralogy	.1941(A)(3)														
HORIZON 4 DEPTH															
Texture Group	.1941(A)(1)														
Consistence	.1941														
Structure	.1941(A)(2)														
Mineralogy	.1941(A)(3)														
SOIL WETNESS	.1942	34"	36"	38"	34"	34"									
RESTRICTIVE HORIZON	.1944														
SAPROLITE	.1943/.1956														
CLASSIFICATION	.1948	PS	PS	PS	PS	PS									
LONG TERM ACCEPTANCE RATE	.1955	.5	.5	.5	.5	.5									

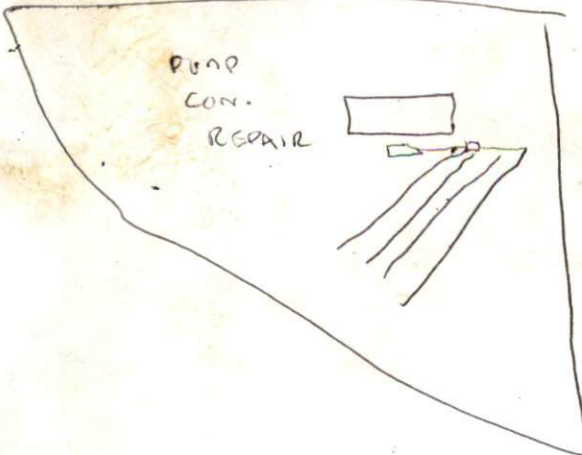

4 30' LINES
ON CONTOUR
18-20" DEEP

SITE PLAN APPROVAL

DISTRICT RA30 USE DwM#

#BEDROOMS 4

Date 6-1-21

Theresa Jones
Zoning Administrator

Required Property Line Setbacks

	Minimum	Actual
Front	<u>35</u>	<u>50</u>
Side	<u>10</u>	<u>10</u>
Corner	<u>20</u>	<u>10</u>
Rear	<u>25</u>	<u>50</u>
Nearest Building	<u>10</u>	<u>10</u>

