

HTE# 06-50014167 HARNETT COUNTY HEALTH DEPARTMENT

IMPROVEMENT PERMIT 22539

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) Clyde Patterson New Installation ☒ Septic Tank ☒ Repair ☐

Property Location: SR# 1274 Carter Morrison Rd Nitrification Line ☒ Expansion ☐

Subdivision Frank Stewart Lot # 8

Tax ID# _____ Quadrant # _____

Number of Bedrooms Proposed: 3 (24x64) 360 sq ft Lot Size: 1.07 ac

Basement with Plumbing: ☐ Garage: ☐

Water Supply: ☐ Well ☒ Public ☐ Community

Distance From Well: 50 ft.

Following is the minimum specifications for sewage disposal system on above captioned property.
Subject to final approval.

Type of system: ☒ Conventional ☐ Other _____

Size of tank: Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface Drainage Field No. of ditches 1 ft. exact length of each ditch 400 ft. width of ditches 3 ft. depth of ditches 18 in.

French Drain Required: _____ Linear feet


Date: 03-06-06

PERMIT EXPIRES 5 YEARS FROM ABOVE DATE

This permit is subject to revocation if site plans or intended use change.

met on site
Maintain All Set Backs

Signed: [Signature]
Environmental Health Specialist

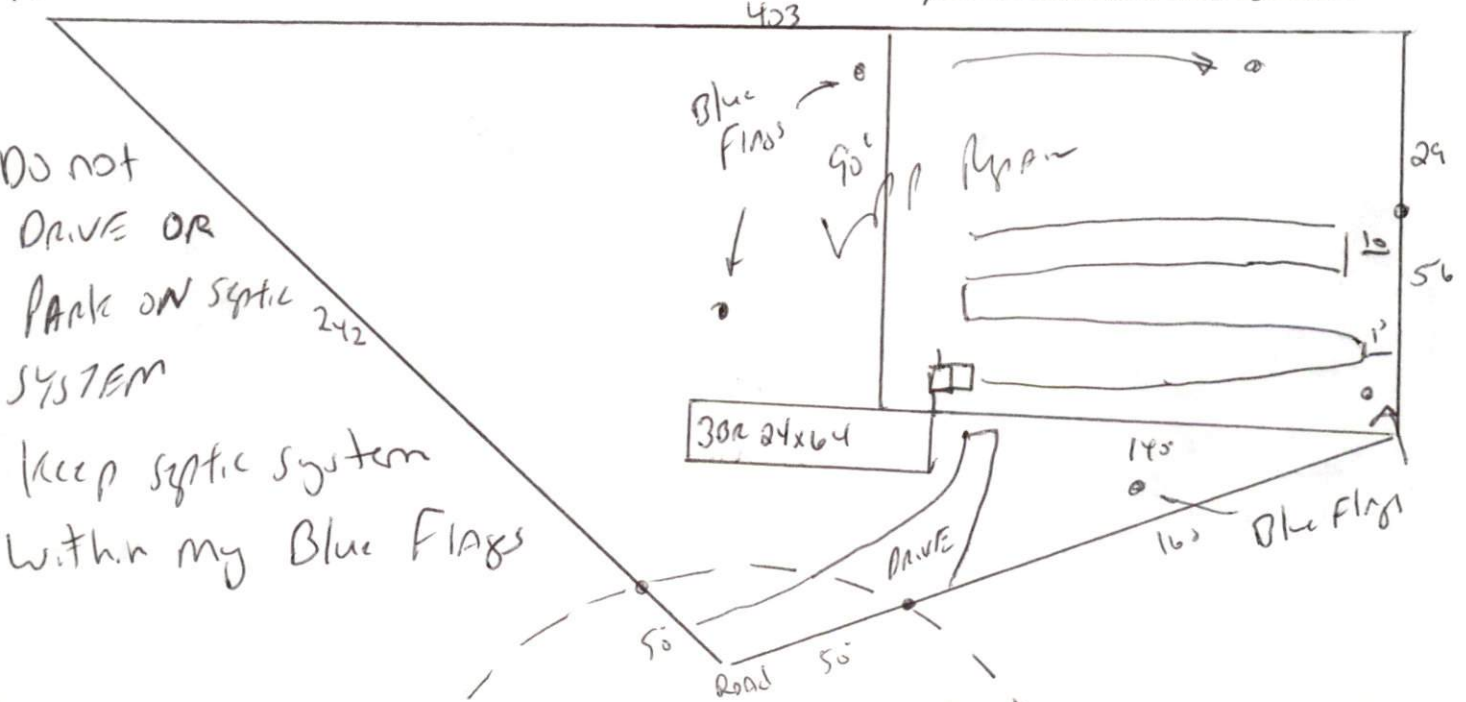

HARNETT COUNTY DEPARTMENT OF PUBLIC HEALTH
AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Department of Public Health, Improvement Permit # 22539. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. *This authorization will be invalid if ownership, site plans, or intended use change.*

Clyde Patterson

Name

Telephone #

Address

1274

Property Location SR#

Road Name

Frank Stewart

8

3(24x64)

360 ft

1.07 ac

Subdivision

Lot #

Bedrooms Proposed

Lot Size

TYPE OF SYSTEM

☒ New Installation [] Repair ☒ Septic Tank ☒ Nitrification Lines

☒ Conventional [] Other _____

[] Basement [] With Plumbing [] Without Plumbing

Water Supply: [] Well ☒ Public Water Supply Minimum Well Setback: 50 Ft.

Septic Tank 1000 gal Pump Chamber _____ gal

NITRIFICATION FIELD SPECIFICATIONS

Number of fields 1 # of lines per field 1 Length of lines 400 Ft.

Width of ditches 3 ft. Depth of ditches 18 inches

French Drain: Linear feet required _____ Depth of gravel _____

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the Improvement Permit and that a valid Operations Permit has been issued.

Jon West RS

Signature of Authorized Agent for Harnett County

07-06-06

Date