

HTE# 08-500-20340

Harnett County Department of Public Health

20155

PERMIT # 24977

Operation Permit

New Installation  Septic Tank  Repair  Nitrification Line  Expansion

Name: (owner) Wayne Mangum PROPERTY LOCATION: Thomas Farm M  
SUBDIVISION LBC LOT # 5

System Installer: Mike Ray Registration #


Basement with plumbing:  Garage  Number of Bedrooms 7

Type of Water Supply:  Community  Public  Well Distance from well 50 feet

System Type: Gravel Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

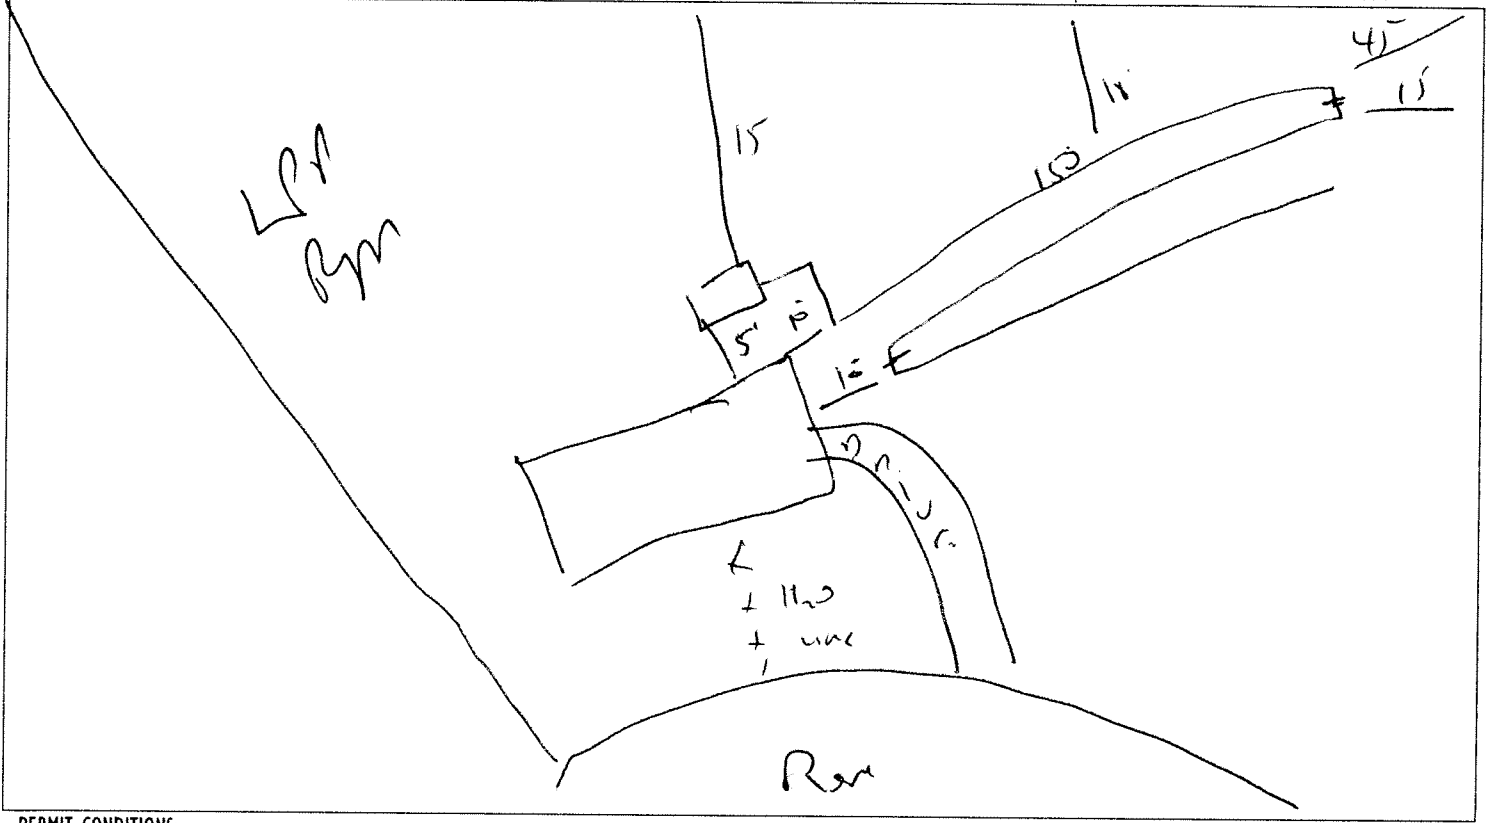

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
II. Monitoring: As required by Rule .1961.
III. Maintenance: As required by Rule .1961. Other: Subsurface system operator required? Yes [ ] No [x]
IV. Operation:
V. Other:

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: [x] Conventional [ ] Other Gravel Septic Tank: 1000 gallons Pump Tank: gallons
Subsurface No. of exact length width of depth of
Drainage Field ditches 1 of each ditch 400 feet ditches 3 feet ditches 18 inches
French Drain Required: Linear feet

Authorized State Agent [Signature] Date 07-02-08