

HTE# 14-5-33611

Harnett County Department of Public Health

23235

PERMIT # 27937

Operation Permit

- New Installation
 Septic Tank
 Nitrification Line
 Repair
 Expansion

PROPERTY LOCATION: Royal Pines Dr.

Name: (owner) Max McCaully

SUBDIVISION Royal Pines

LOT # 9-B

System Installer: Ralph Brown

Registration # _____

Basement with plumbing: Garage Number of Bedrooms 2


Type of Water Supply: Community Public Well Distance from well 100 feet

System Type: III g Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

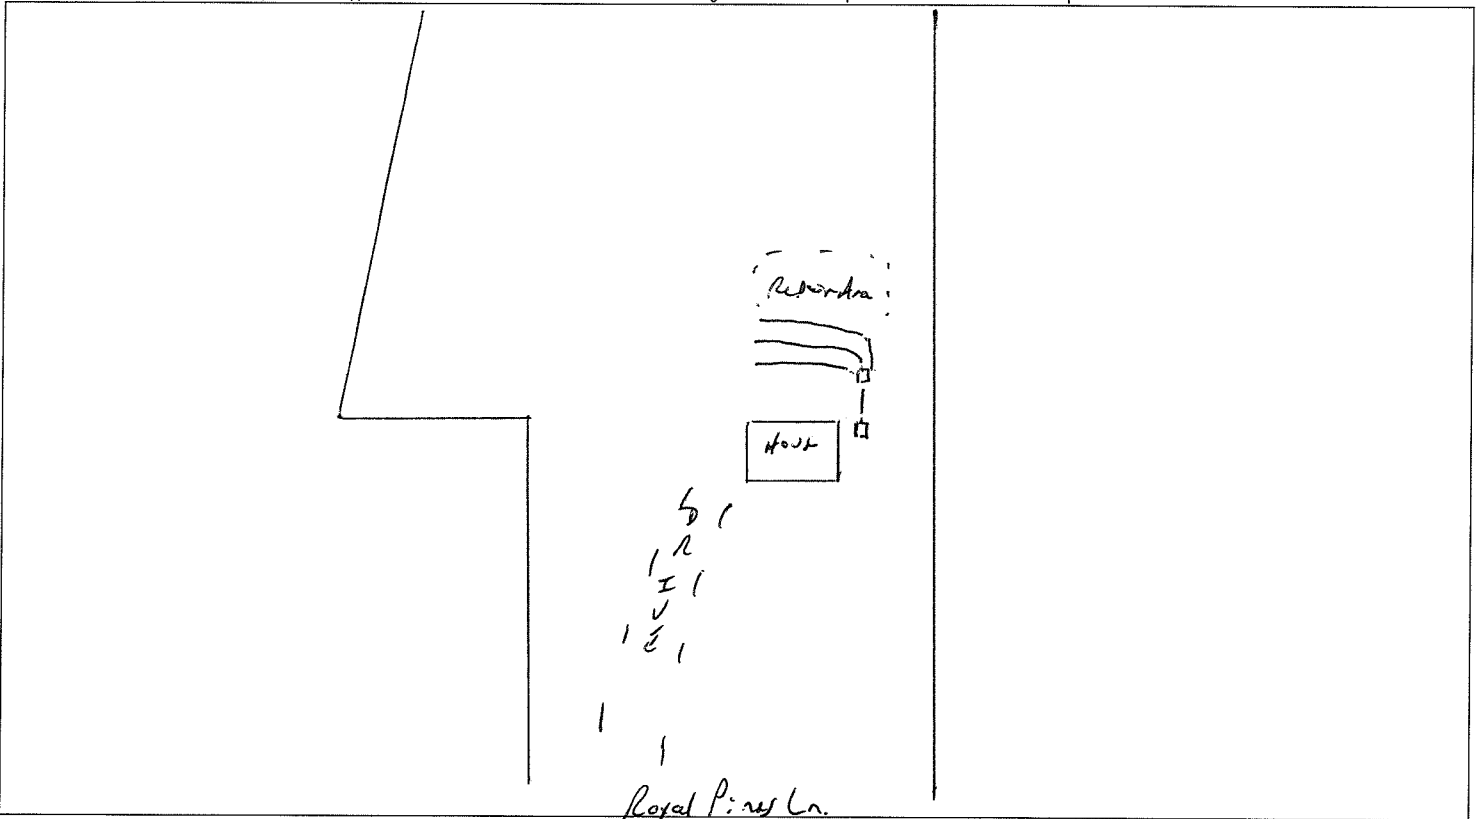

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
 Subsurface system operator required? Yes No
 If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

D-Box
 Pump
 Alarm
 H2O Line
 PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other ERFlow Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface Drainage Field: No. of ditches 3 exact length of each ditch 60 feet width of ditches 3 feet depth of ditches 18 inches

French Drain Required: _____ Linear feet

Authorized State Agent [Signature] Date 6/17/2014