

HTE# 18-5-43384

Harnett County Department of Public Health

24988

PERMIT # 29905


Operation Permit

☒ New Installation ☒ Septic Tank ☒ Nitrification Line ☐ Repair ☐ ExpansionPROPERTY LOCATION: 1523 Red Hill Church Road (SR 1703)Name: (owner) River Shawn Lucas SUBDIVISION _____ LOT # 3System Installer: Clinton Road Septic Registration # _____Basement with plumbing: ☐ Garage ☐ Number of Bedrooms 3Type of Water Supply: ☐ Community ☒ Public ☐ Well Distance from well NA feetSystem Type: 25% reduction sys. IIIg Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

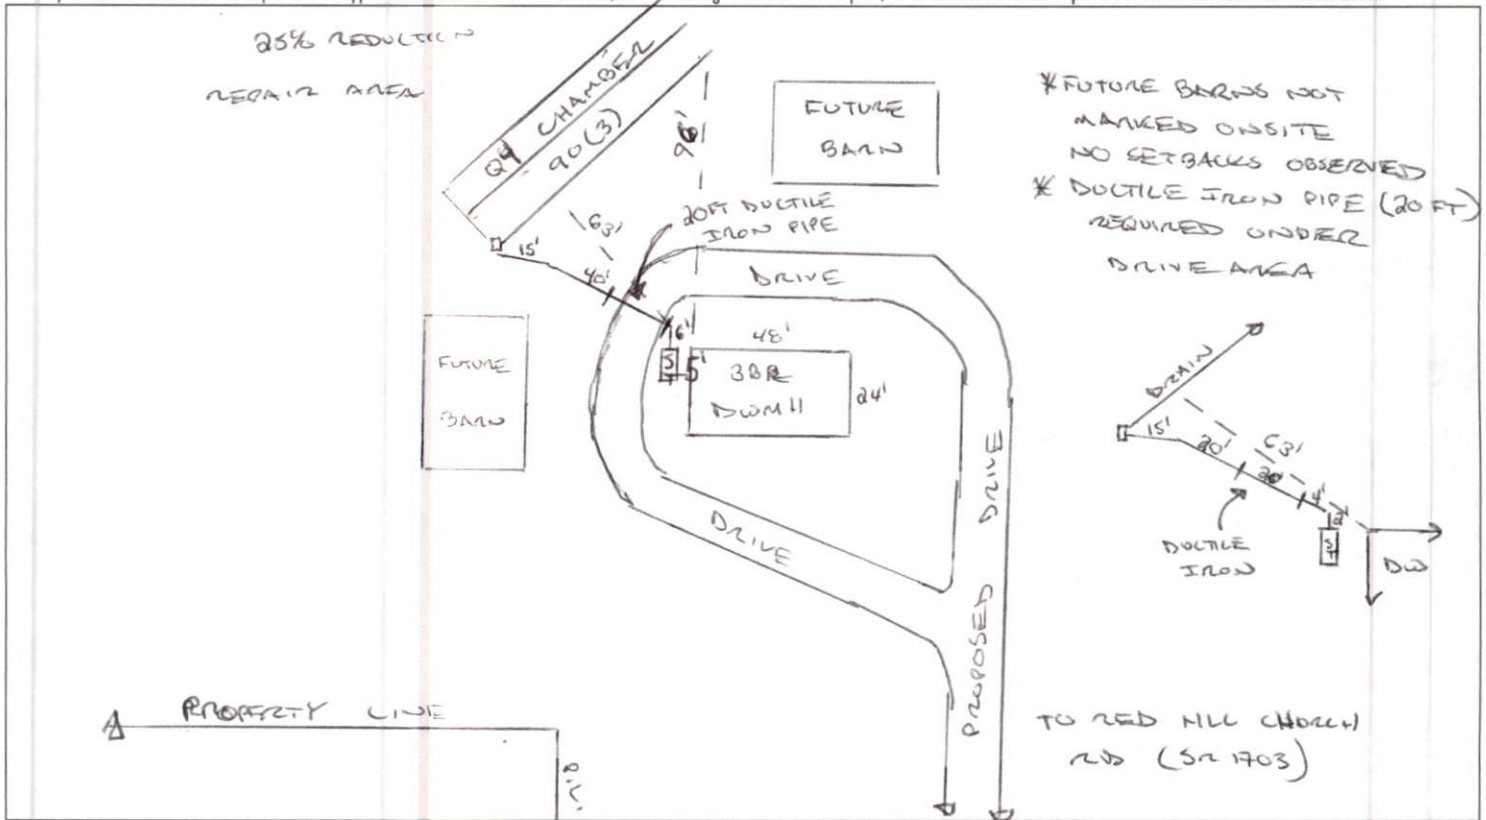

PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961. Other: _____

Subsurface system operator required? Yes ☐ No ☒

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: _____

V. Other: _____

☐ D-Box ☐ Pump ☐ Alarm ☐ H2O Line ☐ PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: ☐ Conventional ☒ Other G4 Chamber IIIg Septic Tank: 10000 gallons Pump Tank: _____ gallonsSubsurface No. of exact length width of depth of
Drainage Field ditches 3 of each ditch 90 feet ditches 3 feet ditches 22 inches

French Drain Required: _____ Linear feet

Authorized State Agent [Signature]Date 06/27/2018