

HTE# 5501807-0030

Harnett County Department of Public Health

25336

PERMIT # 30185

Operation Permit

New Installation Septic Tank Nitrification Line Repair Expansion

SR 1703

PROPERTY LOCATION: 215 Planters Ln. (Red Hill Ch. rd.)

Name: (owner) Adams Homes, LLC SUBDIVISION Cane Mill Ests LOT # 7

System Installer: Thorntons Plumbing Registration # _____


Basement with plumbing: Garage Number of Bedrooms 4

Type of Water Supply: Community Public Well Distance from well ~ feet

System Type: 25% reduction sys. IIIb Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

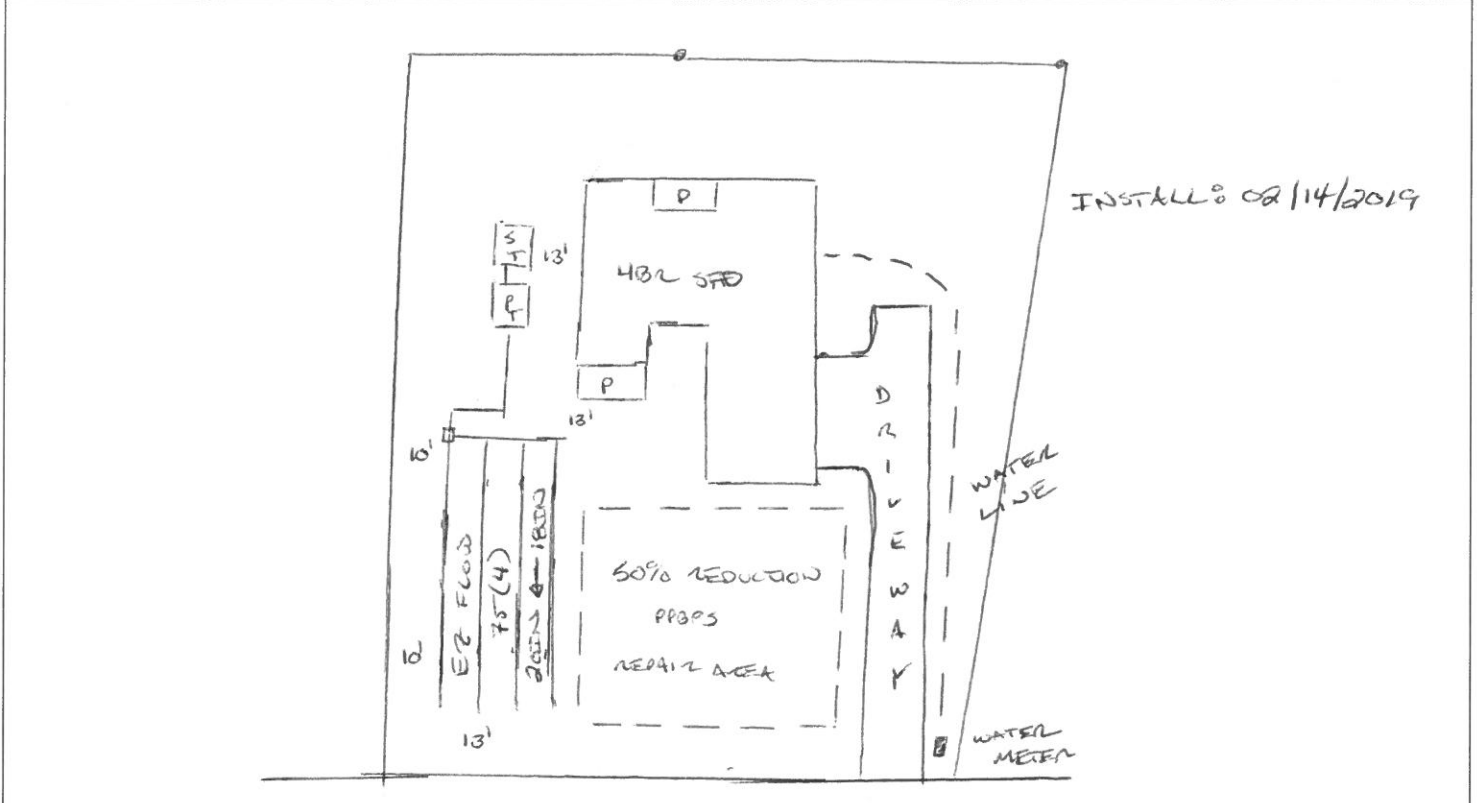

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other EZ Flow IIIb Septic Tank: 1250 gallons Pump Tank: 1250 gallons

Subsurface Drainage Field No. of ditches 4 exact length of each ditch 75 feet width of ditches 3 feet depth of ditches 18-20 inches

French Drain Required: _____ Linear feet

Authorized State Agent [Signature] Date 02/21/2019