

Improvement Permit

A building permit cannot be issued with only an Improvement Permit

ISSUED TO: WELCH, ERIC & DEANNA PROPERTY LOCATION: 295 SECRETARIATE
 SUBDIVISION _____ LOT # _____
 NEW REPAIR EXPANSION
 Type of Structure: SFO (55'x55') Site Improvements required prior to Construction Authorization Issuance: _____
 Proposed Wastewater System Type: 25% REDUCTION SYSTEM
 Projected Daily Flow: 480 GPD
 Number of bedrooms: 4 Number of Occupants: 8 max
 Basement Yes No
 Pump Required: Yes No May be required based on final location and elevations of facilities
 Type of Water Supply: Community Public Well Distance from well 100 feet Permit valid for: Five years
 No expiration
 Permit conditions: _____

Authorized State Agent: [Signature] Date: 8/28/18 SEE ATTACHED SITE SKETCH
 The issuance of this permit by the Health Department in no way guarantees the issuance of other permits. The permit holder is responsible for checking with appropriate governing bodies in meeting their requirements. This site is subject to revocation if the site plan, plat, or the intended use changes. The Improvement Permit shall not be affected by a change in ownership of the site. This permit is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to conditions of this permit.

Construction Authorization

(Required for Building Permit)

The construction and installation requirements of Rules .1950, .1952, .1954, .1955, .1956, .1957, .1958, and .1959 are incorporated by references into this permit and shall be met. Systems shall be installed in accordance with the attached system layout.

ISSUED TO: WELCH, ERIC & DEANNA PROPERTY LOCATION: 295 SECRETARIATE
 SUBDIVISION _____ LOT # _____
 Facility Type: SFO (55'x55') New Expansion Repair
 Basement? Yes No Basement Fixtures? Yes No
 Type of Wastewater System** 25% REDUCTION SYSTEM (Initial) Wastewater Flow: 480 GPD
 (See note below, if applicable 25% Red. Sys (Repair))

Installation Requirements/Conditions
 Septic Tank Size 1000 gallons
 Pump Tank Size _____ gallons
 Number of trenches 1
 Exact length of each trench 400 feet
 Trench Spacing: 9 Feet on Center
 Trenches shall be installed on contour at a
 Maximum Trench Depth of: 18 inches
 (Maximum soil cover shall not exceed 36" above the trench bottom)
 (Trench bottoms shall be level to +/- 1/4" in all directions)
 Pump Requirements: _____ ft. TDH vs. _____ GPM
 Aggregate Depth: _____ inches below pipe
 _____ inches above pipe
 _____ inches total
 Conditions: _____

**WATER LINES (INCLUDING IRRIGATION) MUST BE 10FT. FROM ANY PART OF SEPTIC SYSTEM OR REPAIR AREA.
NO UTILITIES ALLOWED IN INITIAL OR REPAIR DRAIN FIELD AREA.**

**If applicable: I understand the system type specified is different from the type specified on the application. I accept the specifications of this permit.

Owner/Legal Representative Signature: _____ Date: _____

This Construction Authorization is subject to revocation if the site plan, plat, or the intended use changes. The Construction Authorization shall not be transferred when there is a change in ownership of the site. This Construction Authorization is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to the conditions of this permit. SEE ATTACHED SITE SKETCH

Authorized State Agent: [Signature] Date: 8/28/18
 Construction Authorization Expiration Date: 8/28/23

HTE# 5FD1808-0011


Permit # 30211

Harnett County Department of Public Health Site Sketch

ISSUED TO: WELCH, ERIC DEANNA PROPERTY LOCATOR: 295 SECRETARIATE
SUBDIVISION _____ LOT # _____

Authorized State Agent: ~~_____~~ REHS (OLIVER TOLKSDOTT) Date: 8/28/18

➔ FINAL DRAIN FIELD LAYOUT TO BE DETERMINED WITH HOMEOWNER AFTER CLEARING IS FINISHED

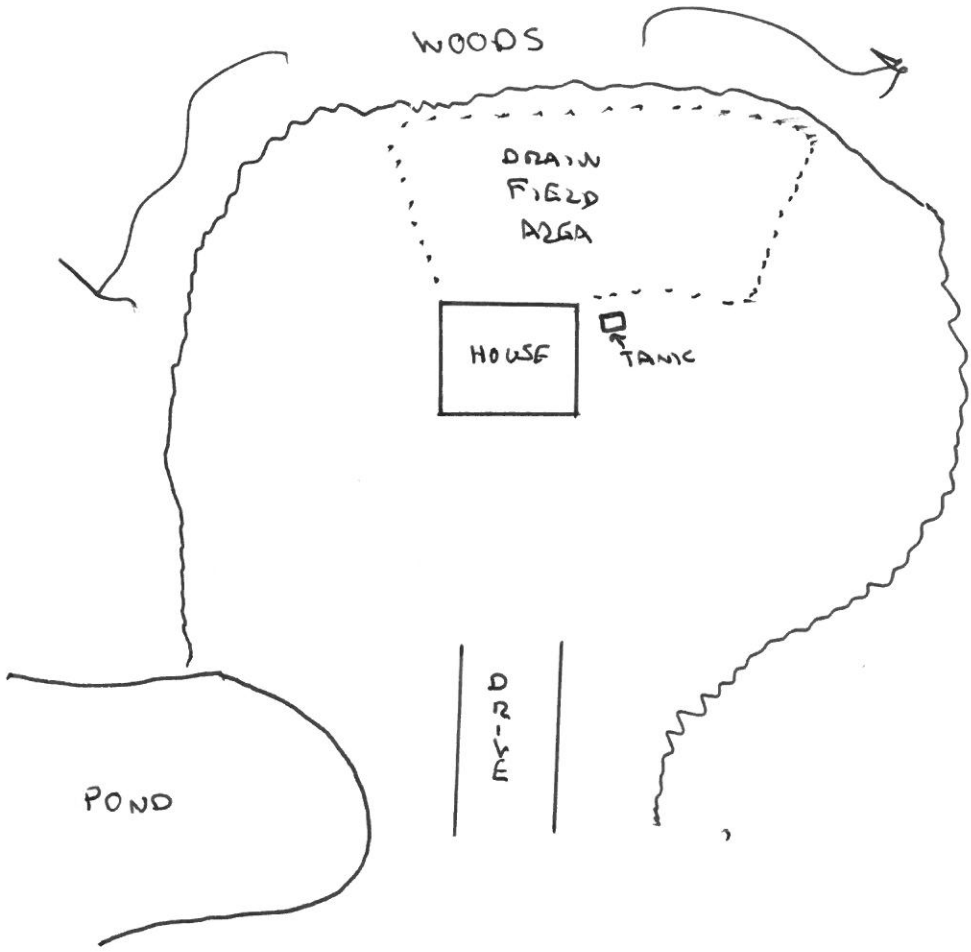

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

Owner: _____ Applicant: SECRETARIAT
 Address: 215 SECRETARIAT Date Evaluated: 2/20/18
 Proposed Facility: LABOR Design Flow (.1949): 480 gpd Property Size: _____
 Location of Site: _____ Property Recorded: _____
 Water Supply: Public Individual Well Spring Other
 Evaluation Method: Auger Boring Pit Cut
 Type of Wastewater: Sewage Industrial Process Mixed

P R O F I L E #	.1940 Landscape Position/ Slope %	Horizon Depth (In.)	SOIL MORPHOLOGY .1941		OTHER PROFILE FACTORS				Profile Class & LTAR
			.1941 Structure/ Texture	.1941 Consistence Mineralogy	.1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz	
1	<u>LS CV 5-7</u>	<u>0-20</u>	<u>GS</u>	<u>VFN NS/MP</u>					
		<u>20-26</u>	<u>SBX C</u>	<u>F1 S/P</u>	<u>10YR 7/2 @ 23"</u>				<u>US</u>
2	<u>LS CV</u>	<u>0-21</u>	<u>GS</u>	<u>VFN NS/MP</u>					
		<u>21-31</u>	<u>SBX SCL</u>	<u>F2 SS/SP</u>					
		<u>31-36</u>	<u>SBX C</u>	<u>F2 S/P</u>					<u>PS .3</u>
3		<u>0-21</u>	<u>GS</u>	<u>VFN NS/MP</u>					
		<u>21-34</u>	<u>SBX SCL</u>	<u>F2 SS/SP</u>					
		<u>34-42</u>	<u>SBX C</u>	<u>F2 S/P</u>					<u>PS .3</u>
4		<u>0-36</u>	<u>GS</u>	<u>VFN NS/MP</u>					
		<u>31-36</u>	<u>SBX SCL</u>	<u>F2 SS/SP</u>					
		<u>36-42</u>	<u>SBX C</u>	<u>F2 S/P</u>	<u>10YR 7/5 @ 38"</u>				<u>PS .3</u>
5		<u>0-18</u>	<u>GS</u>	<u>VFN NS/MP</u>					
		<u>18-30</u>	<u>SBX SCL</u>	<u>F2 SS/SP</u>					
		<u>30</u>	<u>SBX SCL/SP</u>	<u>F2 SS/SP</u>					<u>PS.4</u>

6.17.18	0-21	GS	21-36	SBX SCL	PS.4	8. 0-31	GS	31-42	SBX SCL	PS.4	9. 0-37	GS
Description	Initial System	Repair System	Other Factors (.1946): Site Classification (.1948): <u>PS</u> Evaluated By: <u>DT</u> Others Present: <u>-</u>									
Available Space (.1945)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>										
System Type(s)	<u>2.5%</u>	<u>(2SD)</u>										
Site LTAR	<u>3</u>	<u>3</u>										

WEST
 LS
 CV/CA