

HTE# SFD1810-0003

Harnett County Department of Public Health

25412

PERMIT # 30252

Operation Permit

SR 1513

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 106 Fisher Rd. (Weills Creek Rd.)

Name: (owner) Signature Home Bldg Inc SUBDIVISION South Creek LOT # 7

System Installer: Gene's Backhoe Service Registration # _____


Basement with plumbing: Garage Number of Bedrooms 4

Type of Water Supply: Community Public Well Distance from well NA feet

System Type: 25% reduction sys. TTB Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

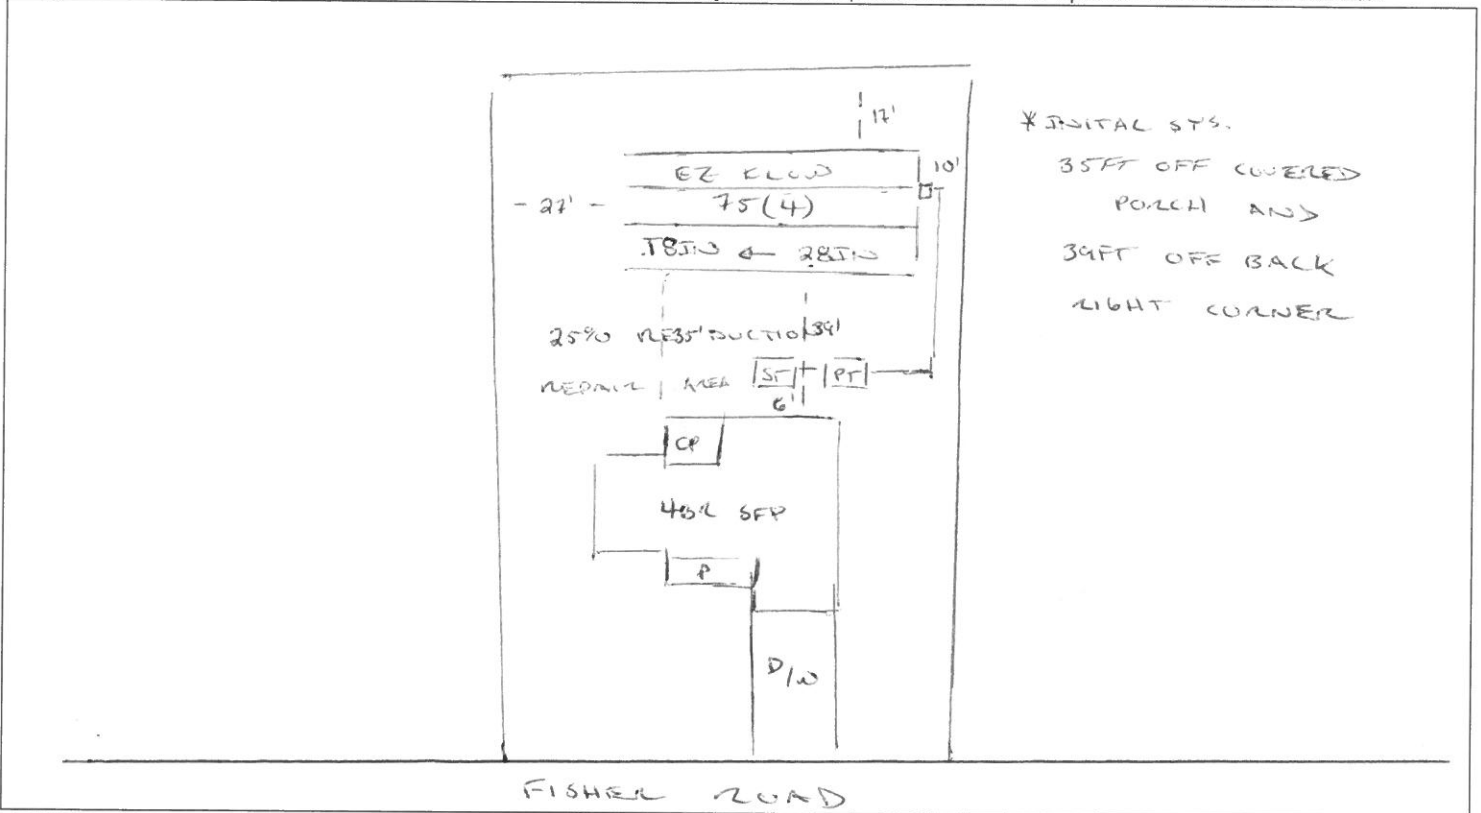

*INITIAL SYS.
 35FT OFF COVERED
 PORCH AND
 39FT OFF BACK
 RIGHT CORNER

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
 Subsurface system operator required? Yes No
 If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other EZ FLOW TTB Septic Tank: 1000 gallons Pump Tank: 1000 gallons
 Subsurface No. of exact length width of depth of
 Drainage Field ditches 4 of each ditch 75 feet ditches 3 feet ditches 28-18 inches
 French Drain Required: _____ Linear feet

Authorized State Agent [Signature]

Date 08/05/2019