

HTE# SFD1811-0004

# Harnett County Department of Public Health

25638

PERMIT # 30318

## Operation Permit

New Installation  Septic Tank  Nitrification Line  Repair  Expansion

PROPERTY LOCATION: 1155 Oak Grove Ch. Rd. (S21532)

Name: (owner) Southern Touch Homes SUBDIVISION \_\_\_\_\_ LOT # 2

System Installer: Clint Adams Registration # \_\_\_\_\_


Basement with plumbing:  Garage  Number of Bedrooms 3

Type of Water Supply:  Community  Public  Well Distance from well NA feet

System Type: Conventional sys. IIa Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

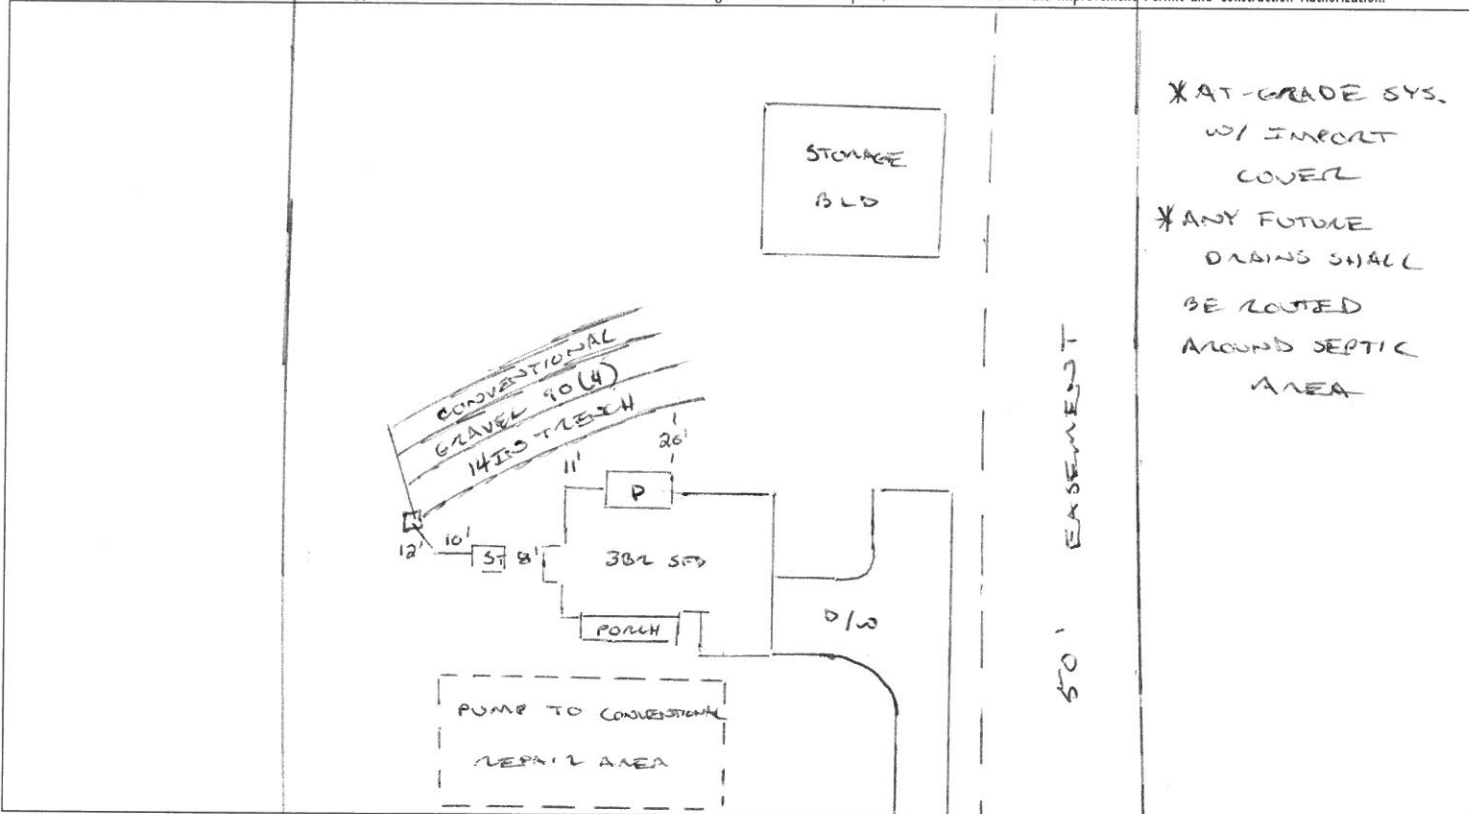

\* AT-GRADE SYS. W/ IMPROV COVER  
 \* ANY FUTURE DRAINS SHALL BE ROUTED AROUND SEPTIC AREA

50' EASEMENT

### PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961. OAK GROVE CH. RD (S21532)
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
 Subsurface system operator required? Yes  No   
 If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: \_\_\_\_\_
- V. Other: \_\_\_\_\_

D-Box  Pump  Alarm  H2O Line  PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional  Other \_\_\_\_\_ Septic Tank: 1000 gallons Pump Tank: \_\_\_\_\_ gallons  
 Subsurface Drainage Field No. of ditches 4 exact length of each ditch 90 feet width of ditches 3 feet depth of ditches 14 inches  
 French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent [Signature] Date 06/26/2019