
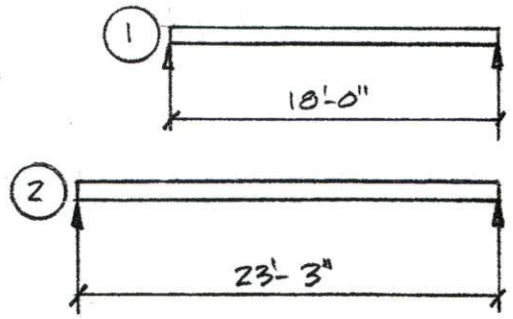
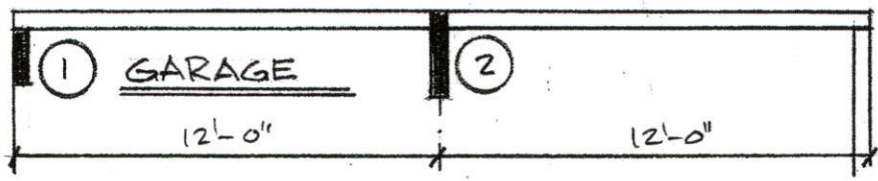


MADISON # 2
 FOR: SARAH ROYAL
 PERMIT:
 DATE: 12-04-18
 REVISED:

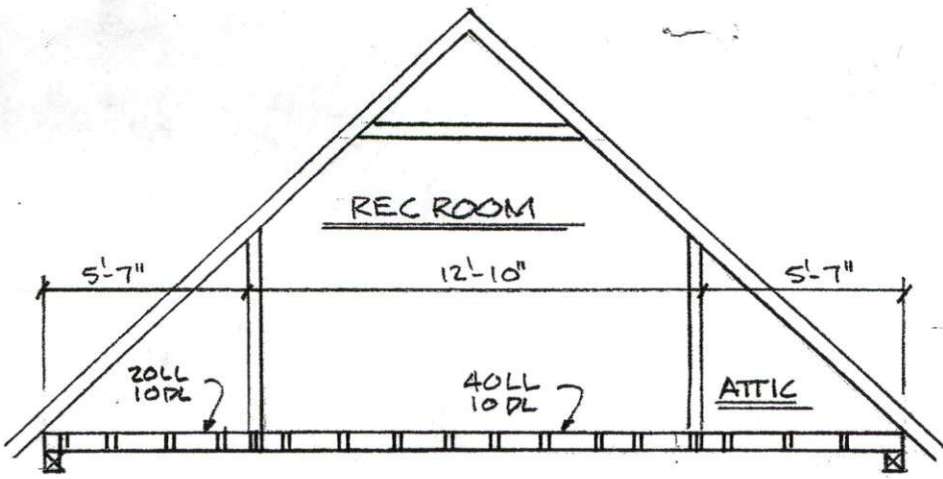

① $w = (6'-0'')(50 \text{ PSF})$
 $w = 300 \text{ PLF}$
 Choose (2) 1 3/4" x 14" LVL (see attached)

② $w = (12'-0'')(50 \text{ PSF})$
 $w = 600 \text{ PLF}$
 Choose (3) 1 3/4" x 18" LVL (see attached)

AP 9
 HARNETT COUNTY CENTRAL PERMITTING
 APPLICATION # SPD1901-0022
 JOB NAME Serenity Homes
 DATE PLANS RECEIVED 2-27-19
 SITE PLANS APPROVED _____
 APPROVED BY _____

GANG LAM LVL BY LOUISIANA PACIFIC 2950 Fb - 2.0 E

GANG-LAM LVL 2950 Fb 2.0E DESIGN SPECIFICATIONS

GANG-LAM PS & W 2950 Fb 2.0E ALLOWABLE STRESSES (PSI) FOR BEAMS

| GRADE | BENDING Fb | MOE (X 10 ⁶) | TENSION Ft | COMPRESSION PARALLEL TO GRAIN Fc | COMPRESSION PERPENDICULAR TO GRAIN Fcp | SHEAR Fv |
|---------------|------------|--------------------------|------------|----------------------------------|--|----------|
| 2950 Fb -2.0E | 2950* | 2.0 | 2300 | 3180 | 1020 | 290 |

* Value is for 12" depth For other depths adjust values by (12/depth)^{1/2}. For depths less than 5.5", use the value for 5.5".

GANG-LAM LVL PS & W 2950 Fb 2.0E SECTION PROPERTIES

| DEPTH (Inches) | MAXIMUM MOMENT (Ft - Lbs) | | | MAXIMUM SHEAR (Lbs) | | | MOMENT OF INERTIA (In ⁴) | | | WEIGHT * (Lbs / Ft) | | |
|----------------|---------------------------|----------------|----------------|---------------------|----------------|----------------|--------------------------------------|----------------|----------------|---------------------|----------------|----------------|
| | 1-1/4 | 2-1/4 1-3/2 | 3-1/4 1-5/4 | 1-1/4 | 2-1/4 1-3/2 | 3-1/4 1-5/4 | 1-1/4 | 2-1/4 1-3/2 | 3-1/4 1-5/4 | 1-1/4 | 2-1/4 1-3/2 | 3-1/4 1-5/4 |
| 7/4 | 4050 | 8100 | 12150 | 2452 | 4905 | 7358 | 55 | 111 | 166 | 3.63 | 7.26 | 10.89 |
| 9/4 | 6367 | 12734 | 19102 | 3129 | 6259 | 9388 | 115 | 230 | 346 | 4.63 | 9.26 | 13.89 |
| 9 1/2 | 6690 | 13381 | 20072 | 3214 | 6428 | 9642 | 125 | 250 | 375 | 4.76 | 9.51 | 14.27 |
| 11 1/4 | 9158 | 18317 | 27476 | 3806 | 7612 | 11418 | 207 | 415 | 622 | 5.63 | 11.27 | 16.90 |
| 11 3/8 | 10126 | 20252 | 30378 | 4017 | 8035 | 12053 | 244 | 488 | 732 | 5.95 | 11.90 | 17.84 |
| 14 | 13747 | 27494 | 41242 | 4736 | 9473 | 14210 | 400 | 800 | 1200 | 7.01 | 14.02 | 21.03 |
| 16 | 17616 | 35233 | 52849 | 5413 | 10826 | 16240 | 597 | 1194 | 1792 | 8.01 | 16.02 | 24.03 |
| 18 | 21923 | 43847 | 65771 | 6090 | 12180 | 18270 | 850 | 1701 | 2551 | 9.01 | 18.02 | 27.04 |

Modification Factors:
 Allowable stresses listed above for bending (Fb), tension (Ft), compression parallel to grain (Fc), shear (Fv), also maximum moment and maximum shear values are for normal load duration. These may be increased where allowed by code for shorter load durations.

Fastener Values:
 Allowable withdrawal loads for nails installed perpendicular and parallel to glue lines of the LVL are as provided in the code for sawn lumber having minimum specific gravities of 0.50 and 0.47, respectively. Allowable lateral loads for nails installed perpendicular and parallel to glue lines of the LVL are as provided in the code for solid-sawn lumber having minimum specific gravities of 0.46 and 0.39, respectively. Nails installed perpendicular to the wide face of veneers may be installed in accordance with the code. Nails installed parallel to the wide face of veneers must be spaced at least 3 inches on center for 8d common nails and 4 inches on center for 10d common nails.

Allowable loads for bolts installed perpendicular to the wide face of veneers with the loads applied parallel and perpendicular to the grain of the veneers are as provided in the code for solid-sawn lumber having a specific gravity of 0.47.

GANG-LAM PS & W 2950 Fb 2.0E BEARING CHARTS

| 1 Ply 1 3/4" | | | | | | | | | | | |
|---------------------|-------|-------|-------|-------|-------|-------|-------|--------|-------|--------|-------|
| Bearing Length (In) | 1 1/2 | 2 | 2 1/2 | 3 | 3 1/2 | 4 | 4 1/2 | 5 | 5 1/2 | 6 | 6 1/2 |
| Maximum Reaction | 2677 | 3570 | 4462 | 5355 | 6247 | 7140 | 8032 | 8925 | 9817 | 10710 | 11602 |
| Bearing Length (In) | 7 | 7 1/2 | 8 | 8 1/2 | 9 | 9 1/2 | 10 | 10 1/2 | 11 | 11 1/2 | 12 |
| Maximum Reaction | 12495 | 13387 | 14280 | 15172 | 16065 | 16957 | 17850 | 18742 | 19635 | 20527 | 21420 |

| 2 Ply 1 3/4" or 1 Ply 3 1/2" | | | | | | | | | | | |
|------------------------------|-------|-------|-------|-------|-------|-------|-------|--------|-------|--------|-------|
| Bearing Length (In) | 1 1/2 | 2 | 2 1/2 | 3 | 3 1/2 | 4 | 4 1/2 | 5 | 5 1/2 | 6 | 6 1/2 |
| Maximum Reaction | 5355 | 7140 | 8925 | 10710 | 12495 | 14280 | 16065 | 17850 | 19635 | 21420 | 23205 |
| Bearing Length (In) | 7 | 7 1/2 | 8 | 8 1/2 | 9 | 9 1/2 | 10 | 10 1/2 | 11 | 11 1/2 | 12 |
| Maximum Reaction | 24990 | 26775 | 28560 | 30345 | 32130 | 33915 | 35700 | 37485 | 39270 | 41055 | 42840 |


| 3 Ply 1 3/4" | | | | | | | | | | | |
|---------------------|-------|-------|-------|-------|-------|-------|-------|--------|-------|--------|-------|
| Bearing Length (In) | 1 1/2 | 2 | 2 1/2 | 3 | 3 1/2 | 4 | 4 1/2 | 5 | 5 1/2 | 6 | 6 1/2 |
| Maximum Reaction | 8032 | 10710 | 13387 | 16065 | 18742 | 21420 | 24097 | 26775 | 29452 | 32130 | 34807 |
| Bearing Length (In) | 7 | 7 1/2 | 8 | 8 1/2 | 9 | 9 1/2 | 10 | 10 1/2 | 11 | 11 1/2 | 12 |
| Maximum Reaction | 37485 | 40162 | 42840 | 45517 | 48195 | 50872 | 53550 | 56227 | 58905 | 61582 | 64260 |

- How to use bearing charts:**
- Determine the thickness required for the Gang-Lam LVL beam and calculate the maximum reaction.
 - Select the appropriate table for 1, 2 or 3 plies.
 - Select a bearing length with a maximum reaction that meets or exceeds your calculated value.
 - Make sure the support is structurally adequate to carry the reaction.

Example: 3 1/2" Gang-Lam LVL with a reaction of 9200 lb.
Solution: Select a 3" bearing length with a maximum reaction of 10710 Lbs.

- Notes:**
- Tabulated values are based on a support with minimum allowable bearing strength of 1020 psi. This is suitable for beams bearing on steel or the end grain of studs.
 - Make sure the support is structurally adequate to carry the reaction. Compressive strength parallel-to-grain of studs may require more studs than the bearing length above indicates.
 - For beams bearing on wood plates, the required bearing length will increase based on the bearing strength (compression perpendicular-to-grain) of the species and grade used for the plate material.
 - Verify local code requirements concerning minimum bearing.

ATTIC STORAGE

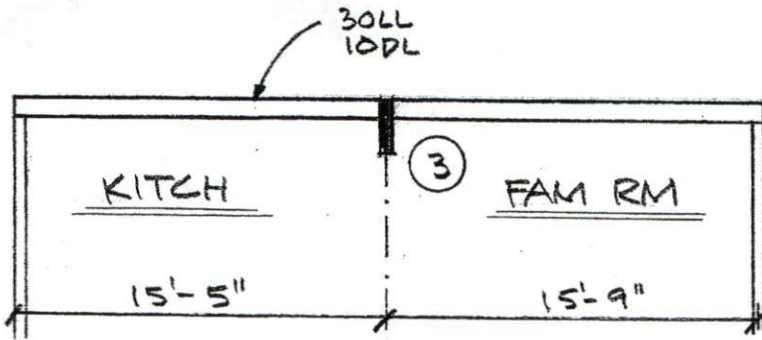

MADISON # 2

FOR: SARAH ROYAL

PERMIT:


DATE: 12-04-18

REVISED:

③ $w = (15'-7\" (40 \text{ PSF})$

$w = 623 \text{ PLF}$

Choose (3) $1 \frac{3}{4}'' \times 16'' \text{ LVL (see attached)}$

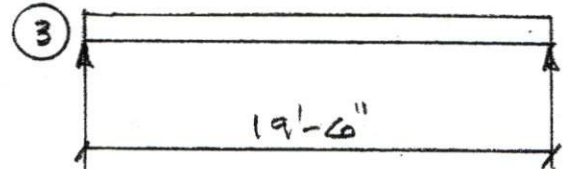

GANG LAM LVL BY LOUISIANA PACIFIC 2950 F_b - 2.0E

GANG-LAM LVL 2950 Fb 2.0E MAXIMUM UNIFORM LOAD (PLF)

ALLOWABLE FLOOR LOADS (PLF) 100%

| Beam Span (Ft) | 1 Ply 1 1/4 x 7 1/4 | | | 1 Ply 1 1/4 x 9 1/4 | | | 1 Ply 1 1/4 x 9 1/2 | | | 1 Ply 1 1/4 x 11 1/4 | | | 1 Ply 1 1/4 x 11 1/8 | | | 1 Ply 1 1/4 x 14 | | | 1 Ply 1 1/4 x 16 * Refer To Note 4 | | | 1 Ply 1 1/4 x 18 * Refer To Note 4 | | |
|----------------|----------------------|-------|------------|----------------------|-------|------------|----------------------|-------|------------|----------------------|-------|------------|----------------------|-------|------------|----------------------|-------|------------|---------------------------------------|-------|------------|---------------------------------------|-------|------------|
| | Live Load Deflection | | Total Load | Live Load Deflection | | Total Load | Live Load Deflection | | Total Load | Live Load Deflection | | Total Load | Live Load Deflection | | Total Load | Live Load Deflection | | Total Load | Live Load Deflection | | Total Load | Live Load Deflection | | Total Load |
| | L/360 | L/480 | L/240 | L/360 | L/480 | L/240 | L/360 | L/480 | L/240 | L/360 | L/480 | L/240 | L/360 | L/480 | L/240 | L/360 | L/480 | L/240 | L/360 | L/480 | L/240 | L/360 | L/480 | L/240 |
| 6 | 681 | 522 | 777 | 1046 | 1016 | 1046 | 1082 | 1082 | 1082 | 1348 | 1348 | 1348 | 1450 | 1450 | 1450 | 1827 | 1827 | 1827 | 2233 | 2233 | 2233 | 2698 | 2698 | 2698 |
| 7 | 443 | 337 | 639 | 864 | 669 | 864 | 893 | 720 | 893 | 1102 | 1102 | 1102 | 1181 | 1181 | 1181 | 1470 | 1470 | 1470 | 1772 | 1772 | 1772 | 2110 | 2110 | 2110 |
| 8 | 303 | 229 | 441 | 603 | 461 | 736 | 649 | 497 | 760 | 932 | 794 | 932 | 996 | 918 | 996 | 1229 | 1229 | 1229 | 1469 | 1469 | 1469 | 1732 | 1732 | 1732 |
| 9 | 215 | 163 | 315 | 434 | 330 | 607 | 467 | 356 | 637 | 748 | 574 | 807 | 861 | 667 | 861 | 1056 | 1041 | 1056 | 1254 | 1254 | 1254 | 1468 | 1468 | 1468 |
| 10 | 158 | 120 | 231 | 321 | 244 | 467 | 347 | 263 | 504 | 559 | 427 | 704 | 649 | 497 | 758 | 925 | 784 | 925 | 1094 | 1094 | 1094 | 1274 | 1274 | 1274 |
| 11 | 120 | 90 | 174 | 244 | 185 | 355 | 263 | 199 | 384 | 428 | 325 | 584 | 498 | 380 | 644 | 785 | 603 | 823 | 969 | 870 | 969 | 1125 | 1125 | 1125 |
| 12 | 93 | 70 | 134 | 189 | 143 | 276 | 205 | 155 | 298 | 334 | 253 | 484 | 389 | 296 | 543 | 618 | 473 | 732 | 870 | 686 | 870 | 1007 | 945 | 1007 |
| 13 | 73 | 55 | 105 | 150 | 113 | 218 | 162 | 122 | 235 | 265 | 201 | 385 | 310 | 235 | 449 | 495 | 377 | 625 | 717 | 550 | 790 | 911 | 761 | 911 |
| 14 | 59 | 44 | 84 | 121 | 91 | 175 | 130 | 96 | 189 | 214 | 162 | 310 | 250 | 189 | 363 | 401 | 305 | 541 | 584 | 446 | 689 | 807 | 621 | 832 |
| 15 | 48 | 36 | 68 | 98 | 74 | 142 | 106 | 80 | 154 | 175 | 132 | 253 | 205 | 155 | 297 | 329 | 250 | 472 | 481 | 367 | 601 | 668 | 512 | 744 |
| 16 | 40 | - | 55 | 81 | 61 | 117 | 88 | 66 | 126 | 145 | 109 | 209 | 170 | 128 | 245 | 274 | 207 | 396 | 401 | 305 | 529 | 559 | 427 | 656 |
| 17 | 33 | - | 46 | 68 | 51 | 97 | 74 | 55 | 105 | 121 | 91 | 174 | 142 | 107 | 205 | 230 | 174 | 332 | 337 | 256 | 469 | 472 | 359 | 582 |
| 18 | - | - | 38 | 58 | 43 | 81 | 62 | 47 | 88 | 102 | 77 | 147 | 120 | 91 | 172 | 194 | 147 | 281 | 286 | 217 | 413 | 401 | 305 | 520 |
| 19 | - | - | 32 | 49 | 37 | 68 | 53 | 40 | 74 | 87 | 66 | 124 | 102 | 77 | 146 | 166 | 125 | 239 | 245 | 185 | 353 | 344 | 261 | 467 |
| 20 | - | - | - | 42 | 32 | 58 | 46 | 34 | 63 | 75 | 57 | 106 | 88 | 66 | 125 | 143 | 108 | 205 | 211 | 160 | 304 | 297 | 225 | 421 |
| 21 | - | - | - | 37 | - | 50 | 39 | - | 54 | 65 | 49 | 91 | 76 | 57 | 108 | 124 | 93 | 177 | 183 | 138 | 263 | 258 | 195 | 371 |
| 22 | - | - | - | 32 | - | 43 | 34 | - | 47 | 57 | 43 | 79 | 66 | 50 | 93 | 108 | 81 | 154 | 160 | 121 | 229 | 225 | 170 | 324 |
| 23 | - | - | - | - | - | 37 | - | - | 40 | 50 | 37 | 68 | 58 | 44 | 81 | 95 | 71 | 134 | 140 | 106 | 200 | 198 | 150 | 284 |
| 24 | - | - | - | - | - | 32 | - | - | - | 44 | 33 | 60 | 51 | 39 | 71 | 84 | 63 | 117 | 124 | 93 | 176 | 175 | 132 | 250 |
| 25 | - | - | - | - | - | - | - | - | - | 39 | - | 52 | 46 | 34 | 62 | 74 | 56 | 103 | 110 | 83 | 155 | 155 | 117 | 221 |
| 26 | - | - | - | - | - | - | - | - | - | 35 | - | 46 | 41 | 31 | 55 | 66 | 50 | 91 | 98 | 74 | 138 | 138 | 104 | 196 |
| 27 | - | - | - | - | - | - | - | - | - | 31 | - | 41 | 36 | - | 48 | 59 | 45 | 81 | 88 | 66 | 122 | 124 | 93 | 175 |
| 28 | - | - | - | - | - | - | - | - | - | - | - | 36 | 33 | - | 43 | 53 | 40 | 72 | 79 | 59 | 109 | 111 | 84 | 156 |
| 29 | - | - | - | - | - | - | - | - | - | - | - | 32 | - | - | 38 | 48 | 36 | 64 | 71 | 53 | 98 | 100 | 76 | 140 |
| 30 | - | - | - | - | - | - | - | - | - | - | - | - | - | - | 34 | 43 | 33 | 57 | 64 | 48 | 88 | 91 | 68 | 126 |

How to use maximum uniform load tables:

1. Select the correct table for the beam application you need.
2. Choose the required beam span in the left column.
3. Select a beam depth from the tables that satisfies BOTH the live and total load PLF on the beam.
4. Check the bearing requirements as shown on page 8.

Example: Floor live load 480 PLF, L/360 deflection limit.
 Floor total load 660 PLF, L/240 deflection limit.
 Beam span 14' - 0"

Solution: Try 2 plies 1 1/4" x 11 1/8", which can carry:

- Live load 2 x 250 = 500 > 480 PLF ✓OK
- Total load 2 x 363 = 726 > 660 PLF ✓OK


Notes (for page 6 and 7)

1. Beam spans are defined as follows: Simple span dimensions are measured from inside face of supports. Multiple span dimensions are measured from inside face of exterior supports to center line of interior supports.
2. These tables are for simple spans (with a support at each end) or for continuous (multiple span) beams if spans are equal.
3. PLF values are for a single ply of 1 1/4" Gang-Lam LVL.
 - Double the values for two plies or 3/2" thickness.
 - Triple the values for three plies or 5/4" thickness.
- * 4. For 1 1/4" x 16" beams and deeper, two plies (minimum) are required.
5. More than three plies may require special design. Contact your L-P engineered products distributor.

CONNECTION OF MULTIPLE PLY BEAMS


10A TOP LOADED (3 PLYS MAXIMUM)

Framing is applied on top of the beam so that each ply carries an equal load.

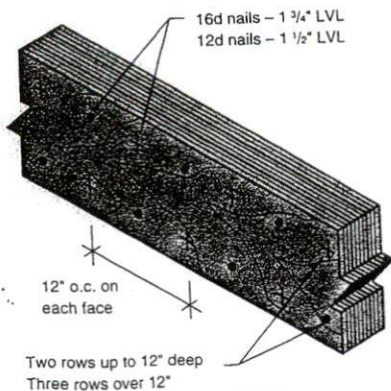

10B TOP LOADED 4 PLYS

Framing is applied on top of the beam so that each ply carries an equal load.

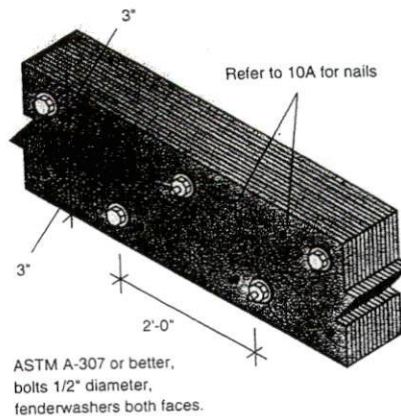

10C SIDE LOADED

The same framing is used on each side of the beam so the same load is carried on each face.

