

HTE# SFD1903-0052

# Harnett County Department of Public Health

25711

PERMIT # 30494

## Operation Permit

New Installation  Septic Tank  Nitrification Line  Repair  Expansion

PROPERTY LOCATION: 88 Sunnybrook Ln. (Box 2152116)

Name: (owner) H&H Const. of Fayetteville SUBDIVISION Government LOT # 314

System Installer: Yellow Dog Grading Registration # \_\_\_\_\_

Basement with plumbing:  Garage  Number of Bedrooms 4


Type of Water Supply:  Community  Public  Well Distance from well N/A feet

System Type: 25% reduction Sys IIIg Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

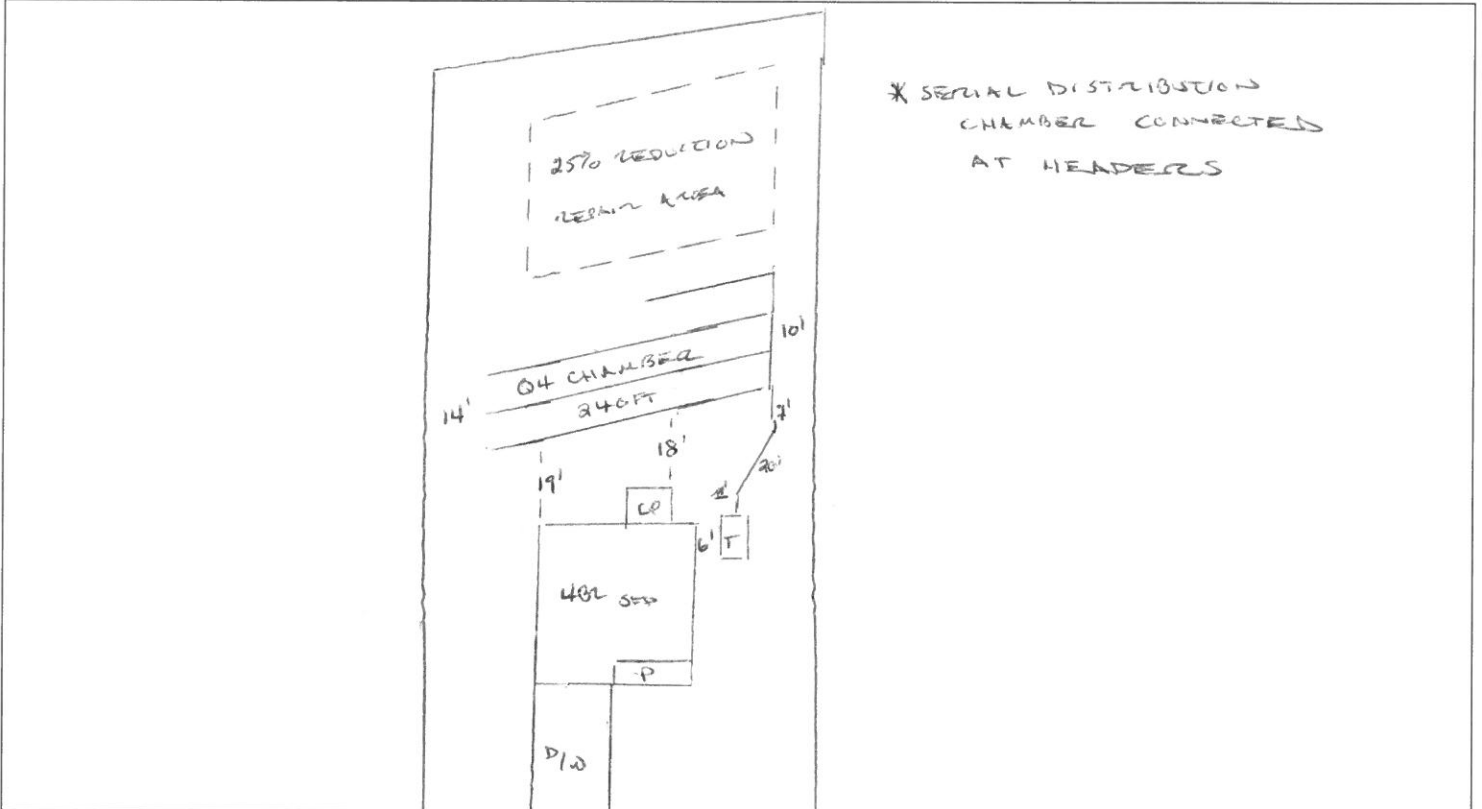

\* SERIAL DISTRIBUTION  
CHAMBER CONNECTED  
AT HEADERS

### PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
Subsurface system operator required? Yes  No   
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: \_\_\_\_\_
- V. Other: \_\_\_\_\_

D-Box  Pump  Alarm  H2O Line  PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional  Other 6'4 Chamber IIIg Septic Tank: 1000 gallons Pump Tank: \_\_\_\_\_ gallons  
 Subsurface No. of exact length width of depth of  
 Drainage Field ditches 1 of each ditch 240 feet ditches 3 feet ditches 22 inches  
 French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent [Signature] Date 08/30/2019